


- NOTES:
1. OUTLET STRUCTURE SHALL BE CLASS "3" CONCRETE WHICH SHALL ATTAIN A 28-DAY COMPRESSIVE STRENGTH OF 4000 PSI IN ACCORDANCE WITH ASTM C39/C39M-99.
 2. FLOOR OF STRUCTURE SHALL BE GIVEN A STEEL TROWEL FINISH.
 3. TOP OF BOX TO HAVE SIDEWALK FINISH.
 4. ANCHORS SHALL BE SYMMETRICALLY SPACED AND NOT TO EXCEED 4' BETWEEN CENTERS, AND BE PLACED 4 1/2" FROM EACH END OF THE STEEL ANGLE, A MINIMUM OF 3 ANCHORS IS REQUIRED.
 5. ALL METAL FORM STAKES MUST HAVE PROTECTIVE DEVICES SUCH AS "MUSHROOMS" INSTALL AT ALL TIMES DURING USE, TO ADEQUATELY INSURE THE PUBLIC SAFETY.

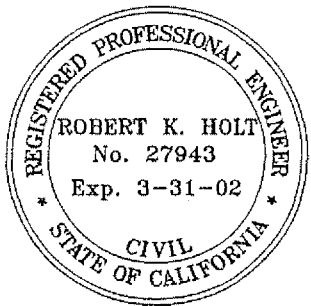

APPROVED: PUBLIC WORKS DIRECTOR
James W. Rodkey, Jr. DATE *2/7/00*
 JAMES W. RODKEY, JR.
 APPROVED: CITY ENGINEER
Robert K. Holt DATE *8/31/00*
 ROBERT K. HOLT, P.E.

CITY OF
BLYTHE

OUTLET STRUCTURE

REVISION	BY	DATE

STANDARD DRAWING NO. S-218