

**STANDARD PLANS
FOR
PUBLIC WORKS
CONSTRUCTION
2009 Edition**

Written And Promulgated By
Public Works Standards, Inc.

Published By

BNi ***Building News***

Division of BNi Publications, Inc.

990 Park Center Drive, Suite E, Vista, CA 92081

1-760-734-1113

BNi® ***Building News***

BNi PUBLICATIONS, INC.
990 Park Center Drive, Suite E
Vista, CA 92081

LOS ANGELES
10801 National Blvd., Ste. 100
Los Angeles, CA 90064

NEW ENGLAND
PO Box 14527
East Providence, RI 02914

ANAHEIM
1612 S. Clementine St.
Anaheim, CA 92802

VISTA
990 Park Center Dr., Suite E
Vista, Ca 92081

Copyright © 2009 by BNi Publications, Inc. All rights reserved. Printed in the United States of America. Except as permitted under the United States Copyright Act of 1976, no part of this publication may be reproduced or distributed in any form or by any means, or stored in a data base or retrieval system, without the prior written permission of the publisher.

While diligent effort is made to provide reliable, accurate and up-to-date information, neither BNi Publications Inc., nor its authors or editors, can place a guarantee on the correctness of the data or information contained in this book. BNi Publications Inc., and its authors and editors, do hereby disclaim any responsibility or liability in connection with the use of this book or of any data or other information contained therein.

ISBN 978-1-55701-545-7

BY WAY OF EXPLANATION

This edition of *Standard Plans for Public Works Construction* is the fruition of over twenty eight years of intensive work by a multi-governmental agency subcommittee of the Public Works Standards, Inc., American Public Works Association, and the Southern California Districts, Associated General Contractors of California.

These plans, representing the professional thinking of the leading public works officials and private members of the construction industry, were prepared to answer a need for uniform design governing public works construction performed for the many cities, counties, and public agencies. This need dates back to the very founding of these governmental jurisdictions.

Uniform plans, embracing the most modern design and construction techniques, will greatly benefit both the general public and the private contracting industry. Such plans will eliminate conflicts and confusion, lower construction costs, and encourage more competitive bidding by private contractors.

The prime sponsors of this effort have been the City and County of Los Angeles, County of Ventura, City and County of San Diego, City of Long Beach, City of Burbank, and County of Orange. In the case of Los Angeles County, this includes the Road Department, Flood Control District, County Engineer/Facilities Department, and the Sanitation Districts. In addition to these major organizations, numerous municipal agencies, large and small, served a key role on the various task forces.

The Standard Plans are to be used in conjunction with the *Standard Specifications for Public Works Construction* as a companion document. This latter document has been in existence since 1967 and is commonly referred to as the "*Greenbook*." The Standard Plans, being engineering plans, are subject to the provisions of Chapter 7, Division 3, Business and Professions Code, State of California when used in that state. As such, they must be approved by a registered professional engineer to indicate his or her responsibility for them. In addition, they do not have the legal effect of a contract document or construction plan until officially adopted by the particular user agency.

The plans are numbered with a three digit prefix and a single digit suffix. The first number denotes the section in which the plan is located. The suffix is used to denote changes. All plans when originally approved will bear the suffix "0." As they are amended, the suffix will be numbered to denote the change number.

The *Standard Plans for Public Works Construction* will be revised periodically and reprinted to reflect advanced thinking and the changing technology of the construction industry. Subsequent editions will be published as additional material is prepared. To this end, the Public Works Standards, Inc. will continue to study and recommend changes to both the *Standard Plans* and *Standard Specifications*. Interested parties who wish to suggest additions or amendments may communicate with the Public Works Standards, Inc., c/o Associated General Contractors of California, 1906 W. Garvey Avenue South, Suite 100, West Covina, CA 91790.

This document is copyrighted by BNI Publications, Inc. on behalf of the Public Works Standards, Inc., and reproduction is expressly prohibited, except for User Public Agencies, which may reproduce individual elements of these Standard Plans for their own Agency use. No other reproduction is authorized except by express written permission of the publisher.

TABLE OF CONTENTS

SECTION 1

Street Improvements

GENERAL

- 100-1 TOPOGRAPHY SYMBOLS
- 101-2 ABOVE-GROUND UTILITIES LOCATION IN PARKWAY

SIDEWALKS, DRIVEWAYS, AND RAMPS

- 110-2 DRIVEWAY APPROACHES
- 111-4 CURB RAMP
- 112-2 CURB AND SIDEWALK JOINTS
- 113-2 SIDEWALK AND DRIVEWAY REPLACEMENT

CURB AND GUTTER

- 120-2 CURB AND GUTTER BARRIER
- 121-2 CURB AND GUTTER-MOUNTABLE
- 112-2 CROSS AND LOGITUNDINAL GUTTERS
- 123-2 CROSS GUTTER AT T INTERSECTIONS

PAVEMENT

- 130-2 ALLEY INTERSECTION
- 131-2 CONCRETE BUS PAD
- 132-3 CONCRETE PAVEMENT REPLACEMENT
- 133-3 ASPHALT CONCRETE PAVEMENT REPLACEMENT
- 134-2 CONCRETE PAVEMENT JOINT DETAILS

MEDIAN

- 140-3 MEDIAN TAPER
- 141-2 MEDIAN FLARE
- 150-3 CURB DRAIN
- 151-2 PARKWAY DRAIN
- 152-2 RECTANGULAR FRAME AND COVER

SECTION 2

Sewers and Sanitation

MANHOLES AND STRUCTURES

- 200-3 PRECAST CONCRETE SEWER MANHOLE
- 201-2 PRECAST CONCRETE SHALLOW MANHOLE
- 202-2 DROP SEWER MANHOLE
- 203-2 BRICK SEWER MANHOLE
- 204-2 TERMINAL CLEANOUT STRUCTURE
- 205-2 SEWER MANHOLE ADJUSTMENT
- 206-2 MANHOLE RAISING RINGS
- 207-2 PRECAST REINFORCED CONCRETE MANHOLE BASE
- 208-2 BREAKING INTO EXISTING MANHOLES
- 210-3 24" (610mm) MANHOLE FRAME AND COVER – LOCKING TYPE
- 211-2 MANHOLE FRAME AND COVER – PRESSURE TYPE
- 212-2 ANCHOR SYSTEM FOR PRESSURE COVER
FOR OTHER MANHOLES, SEE SECTION 6 – GENERAL FACILITIES

PIPE APPURTENANCES

- 220-3 CHIMNEYS
- 221-2 PIPE ANCHORS AND BACKFILL STABILIZIERS
- 222-2 HOUSE CONNECTION SEWER
- 223-2 HOUSE CONNECTION REMODELING
- 224-2 SUPPORTS FOR CONDUITS ACROSS TRENCHES
- 225-2 BLANKET PROTECTION FOR PIPES

SECTION 3

Flood Control And Storm Drain Facilities

GENERAL

- 300-3 CURB OPENING CATCH BASIN
- 301-3 CURB OPENING CATCH BASIN WITH GRATING(S) AND DEBRIS SKIMMER
- 302-3 CURB OPENING CATCH BASIN WITH GRATING(S)
- 303-3 CURBSIDE GRATING CATCH BASIN
- 304-3 GRATING CATCH BASIN – ALLEY (LONGITUDINAL)
- 305-3 GRATING CATCH BASIN – ALLEY (TRANSVERSE)
- 306-3 CURB OPENING CATCH BASIN AT DRIVEWAY
- 307-3 CURB OPENING AT CATCH BASIN WITH MANHOLE IN STREET
- 308-2 MONOLITHIC CATCH BASIN CONNECTION
- 309-2 CATCH BASIN REINFORCEMENT
- 310-3 CATCH BASIN FACE PLATE ASSEMBLY AND PROTECTION BAR
- 311-3 FRAME AND GRATING FOR CATCH BASINS
- 312-3 CATCH BASIN MANHOLE FRAME AND COVER
- 313-3 LOCAL DEPRESSIONS AT CATCH BASINS
- 314-3 MODIFICATIONS FOR SIDE OPENING CATCH BASINS

MANHOLES AND JUNCTION STRUCTURES

- 320-2 MANHOLE - PIPE TO PIPE [MAIN LINE ID = 36" (900 mm) OR LARGER]
- 321-2 MANHOLE - PIPE TO PIPE [ONE OR BOTH MAINLINE IDS 33" (825mm) OR SMALLER]
- 322-2 MANHOLE - PIPE TO PIPE (LARGE SIDE INLET)
- 323-2 MANHOLE - CONCRETE BOX STORM DRAIN
- 324-2 MANHOLE SHAFT - WITH ECCENTRIC REDUCER
- 326-2 MANHOLE SHAFT – 36" (900 mm) WITHOUT REDUCER
- 327-2 MANHOLE FOR EXISTING RCB
- 328-2 PRESSURE MANHOLE SHAFT - WITH ECCENTRIC REDUCER
- 329-2 PRESSURE MANHOLE SHAFT AND PRESSURE PLATE DETAILS 36" (914 mm) WITHOUT REDUCER
- 330-2 MANHOLE SHAFT SAFETY LEDGE
- 331-3 JUNCTION STRUCTURE - PIPE TO PIPE [INLET ID ≥ 24" (600 mm) OR OD > ½ MAIN LINE ID]
- 332-2 JUNCTION STRUCTURE - PIPE TO PIPE [ID ≤ 24" (600 mm)]
- 333-2 JUNCTION STRUCTURE - PIPE TO RCB
- 334-2 JUNCTION STRUCTURE - PIPE TO PIPE [INLET ID < 30" (750 mm)]
- 335-2 PIPE CONNECTIONS TO EXISTING STORM DRAINS

TRANSITION STRUCTURES

- 340-2 TRANSITION STRUCTURE PIPE TO PIPE
- 341-2 TRANSITION STRUCTURE SINGLE RCP TO SINGLE RCB
- 342-2 TRANSITION STRUCTURE RCB TO PIPE
- 343-2 TRANSITION STRUCTURE SINGLE RCB TO DOUBLE RCB
- 344-2 TRANSITION STRUCTURE DOUBLE RCB TO DOUBLE RCB
- 345-2 TRANSITION STRUCTURE DOUBLE RCB TO TRIPLE RCB
- 346-2 TRANSITION STRUCTURE TRIPLE RCB TO TRIPLE RCB INLETS
- 350-2 YARD INLET
- 351-2 CSP FLARED INLET
- 360-2 SLOPED PROTECTION BARRIER
- 361-2 TRASH RACK (INCLINED)
- 380-4 CONCRETE COLLAR FOR RCP 12" (300 mm) THROUGH 72" (1800 mm)
- 381-2 ABANDONMENT SEALS FOR MANHOLES AND INLETS
- 382-2 WINDOW DETAILS FOR MULTIPLE RCB STRUCTURES
- 383-2 VELOCITY CONTROL RING PRECAST RCP SECTION
- 384-3 ENERGY DISSIPATOR - IMPACT BASIN WITH VERTICAL BAFFLE WALL
- 390-0 PRECAST REINFORCED CONCRETE BOX

TABLE OF CONTENTS – (Continued)

SECTION 4

Street Lighting and Traffic Signals

SERVICE

- 401-1 ELECTRICAL SERVICE
- 403-1 SERVICE CABINET
- 405-1 PULL BOXES
- 408-1 WIRING SERVICE DETAILS

CONTROLLER CABINETS

- 429-1 STEEL LIGHTING STANDARD TYPE 10
- 430-1 CONCRETE LIGHTING STANDARD TYPE C-1
- 431-1 CONCRETE LIGHTING STANDARD TYPE C-2
- 432-1 CONCRETE LIGHTING STANDARD TYPE C-4
- 433-1 CONCRETE LIGHTING STANDARD TYPE C-6
- 434-1 STREET LIGHTING DETAILS
- 452-1 CONTROLLER CABINET TYPE 170
- 453-1 SIGNAL STANDARDS
- 454-1 SIGNAL HEADS AND FIXTURES
- 455-1 SIGNAL FITTINGS
- 456-1 PEDESTRIAN PUSH BUTTON STAND
- 457-1 LOOP DETECTORS
- 458-1 TEMPORARY SIGNALS

SECTION 5

Landscaping and Irrigation Systems

- 500-2 LANDSCAPE IRRIGATION SYMBOLS
- 501-3 ELECTRICAL SERVICE
- 502-3 ANGLE VALVE
- 503-3 GATE VALVE
- 504-3 QUICK COUPLER VALVE
- 505-3 HOSE BIBB VALVE
- 506-3 REMOTE CONTROL VALVE
- 507-3 REMOTE CONTROL VALVE WITH QUICK COUPLER
- 508-3 THRUST BLOCKS FOR PLASTIC PIPE
- 509-3 IRRIGATION SPRINKLER HEAD
- 510-3 VACUUM BREAKER ASSEMBLY
- 511-3 BACKFLOW PREVENTER ASSEMBLY DOUBLE CHECK TYPE
- 512-3 BACKFLOW PREVENTER ASSEMBLY REDUCED PRESSURE TYPE
- 513-3 ELECTRICAL PULL BOX
- 514-3 IRRIGATION CONTROLLER ENCLOSURE
- 515-3 PIPE PINNING
- 517-3 SWING JOINT ASSEMBLY
- 518-3 TREE STAKING
- 519-3 TREE WELLS
- 520-4 TREE PLANTING
- 521-3 PRESSURE REGULATOR INSTALLATION
- 523-2 ROOT PRUNING
- 524-2 TEMPORARY TREE WELL COVER

SECTION 6

General Facilities

PROTECTIVE FACILITIES

- 600-3 CHAIN LINK FENCE AND GATES
- 601-3 REINFORCED CONCRETE BLOCK WALL
- 602-3 STANDARD PIPE GATE FOR ACCESS ROADS
- 606-3 METAL HAND RAILINGS

RETAINING STRUCTURES

- 610-3 REINFORCED CONCRETE RETAINING WALL TYPE 1
- 611-3 REINFORCED CONCRETE RETAINING WALL TYPE 2
- 612-3 REINFORCED CONCRETE RETAINING WALL TYPE 3
- 613-3 REINFORCED CONCRETE RETAINING WALL TYPE 4
- 614-3 REINFORCED CONCRETE RETAINING WALL TYPE 5
- 615-4 REINFORCED CONCRETE RETAINING WALL TYPE 6
- 616-3 REINFORCED CONCRETE RETAINING WALL TYPE 7
- 617-3 REINFORCED CONCRETE RETAINING WALL DETAILS
- 618-3 MASONRY RETAINING WALL
- 619-2 REINFORCED CONCRETE CRIB WALL
- 620-2 STEEL CRIB WALL
- 621-2 REINFORCED CONCRETE BLOCK WALL AND CHAIN LINK FENCE COMBINATION
- 622-3 CONCRETE BLOCK SLOUGH WALL

SUBSURFACE ACCESS

- 630-3 24" (600 mm) MANHOLE FRAME AND COVER
- 631-3 27" (686 mm) MANHOLE FRAME AND COVER
- 632-3 30" (762 mm) MANHOLE FRAME AND COVER
- 633-3 36" (914 mm) MANHOLE FRAME AND COVER
- 635-3 STEEL STEP
- 636-2 POLYPROPYLENE - PLASTIC STEP
- 640-3 REINFORCED CONCRETE STAIRWAY

SECTION 1

Street Improvements

CONVENTIONAL SYMBOLS FOR EXISTING TOPOGRAPHY

	EXISTING	PROPOSED
CURB	-----	=====
CURB AND GUTTER	{-----}	{=====}
GUTTER	{-----}	{=====}
PAVEMENT		
PCC	{-----}	{=====}
AC	/// --- ///	=====
ACCESS RAMP		
BENCH MARK		
BUILDING		
DEAD MAN	€	
DRIVEWAY		
FENCE & GATE	x---x^x---x	
FIRE HYDRANT	+O+	
GUARDRAIL		
GUY POLE	⊖	
MANHOLE		
PIPE	====	=====
PROPERTY LINE	_____	
RAILROAD		
RETAINING WALL	—^—^—^—	
RETAINING WALL WITH FENCE ON TOP	x^x^x^x	
RR XING PROTECTION	⊗ <u>TYPE OF PROTECTION</u>	
SHRUB		
SIDEWALK		
SIGN (1 POST)	—	
SIGN (2 POST)	—	

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1993

TOPOGRAPHY SYMBOLS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

100-1

SHEET 1 OF 2

EXISTING

PROPOSED

SIGNAL CONTROL BOX



SIGNAL
FLASHING
TRAFFIC
LOOP



SMALL STREAM
OR DITCH



SPRINKLER HEAD



STREET LIGHT



TREE
PALM
OAK
OTHER



UTILITY POLE




VALVE



VAULT




WALL
BRICK (BLOCK)
CONCRETE
STONE



WELL



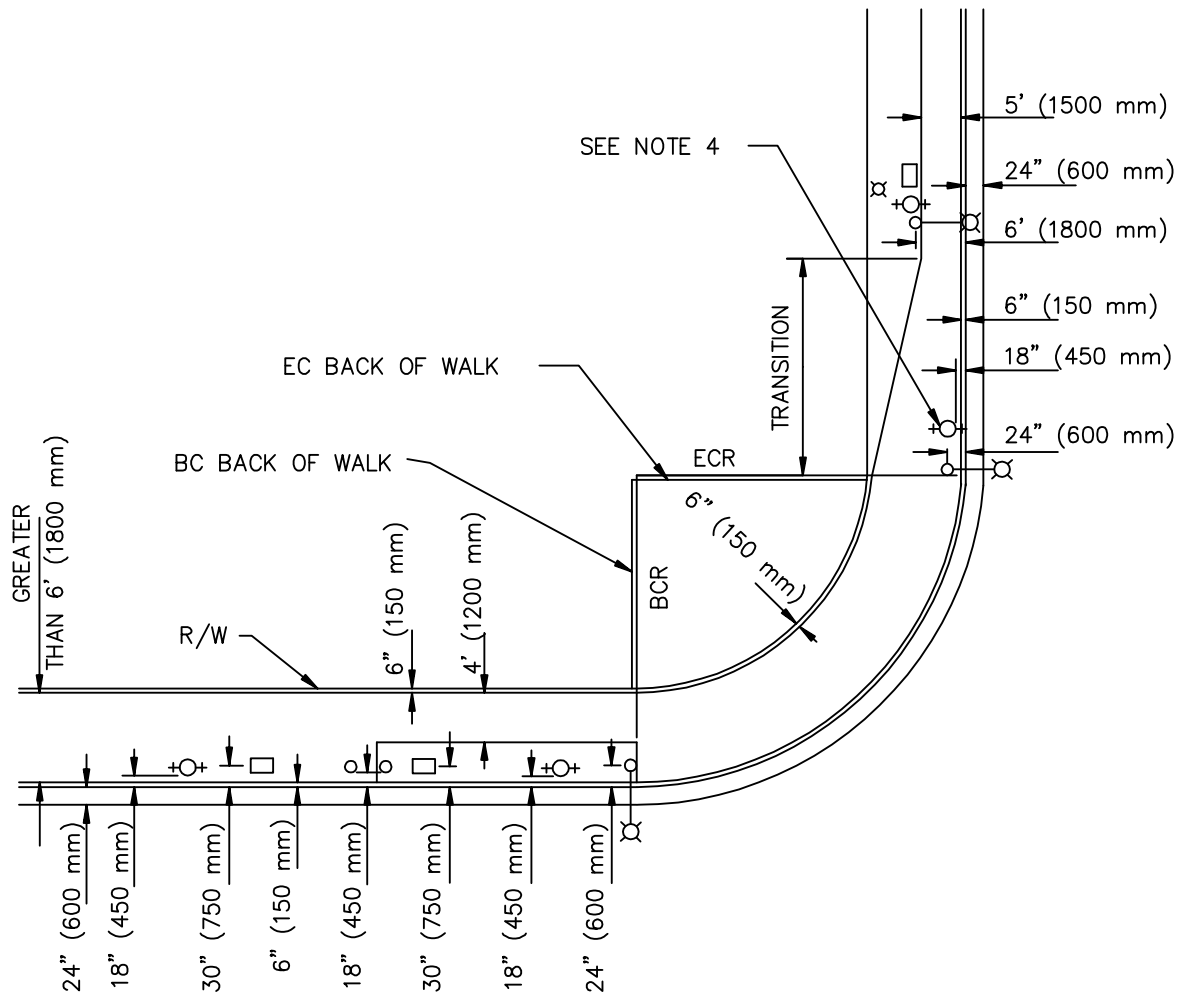

LEGEND

- +⊕ FIRE HYDRANT (SEE NOTE 4)
- VENTS AND POLES
- ⊗ STREET LIGHTS
- PEDESTAL

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2009

**ABOVE-GROUND UTILITIES
LOCATION IN PARKWAY**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

101-2

SHEET 1 OF 2

NOTES:

1. NO ABOVE-GROUND UTILITIES ARE ALLOWED IN CONCRETE SIDEWALKS LESS THAN 6' (1800 mm) WIDE.
2. WHEN SIDEWALK IS 6' (1800 mm) WIDE OR MORE, ABOVE-GROUND UTILITIES ARE ALLOWED AT LOCATIONS NOTED ON PLAN.
3. IN THE RETURN AND SIDEWALK TRANSITION AREAS, ONLY UTILITIES CONSISTING OF STREET LIGHTS, TRAFFIC SIGNALS AND FIRE HYDRANTS ARE ALLOWED.
4. FIRE HYDRANTS SHALL NOT BE PLACED AT THE SAME CURB RETURN OCCUPIED BY A STREET LIGHT.
5. PEDESTALS SHALL BE PLACED AT INCONSPICUOUS LOCATIONS.
6. IN THE ABSENCE OF CURBS, THE FACE OF ALL ABOVE-GROUND STRUCTURES SHALL BE LOCATED A MINIMUM OF 10' (3000 mm) AWAY FROM THE TRAVELED WAY ON ALL RURAL HIGHWAYS AND 6' (1800 mm) ON RESIDENTIAL STREETS.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

**ABOVE-GROUND UTILITIES
LOCATION IN PARKWAY**


STANDARD PLAN

101-2

SHEET 2 OF 2

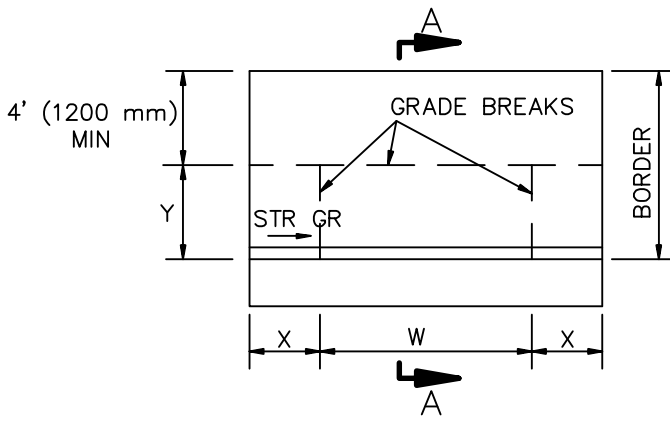


TYPE A

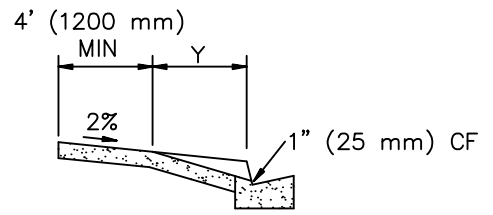


SECTION A-A

CURB FACE, inches (mm)	X, inches (mm)	Y, inches (mm)
6" (150) or less	3'-0" (900)	4'-0" (1200)
7" (175)	3'-6" (1050)	4'-9" (1425)
8" (200)	4'-0" (1200)	5'-8" (1700)
9" (225)	4'-6" (1350)	6'-6" (1950)
10" (250)	5'-0" (1500)	7'-3" (2175)
11" (275)	5'-6" (1650)	8'-0" (2400)
12" (300) or more	6'-0" (1800)	8'-9" (2625)

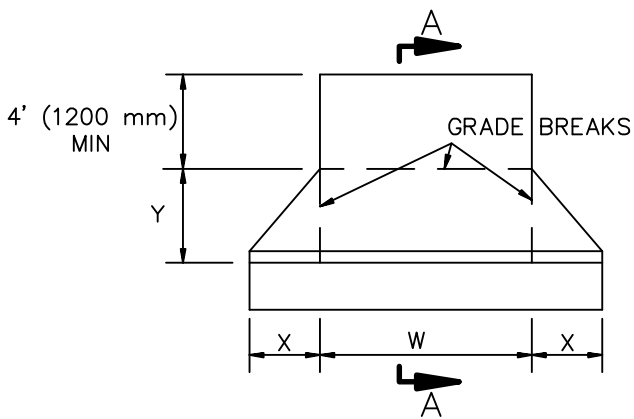

TYPE B

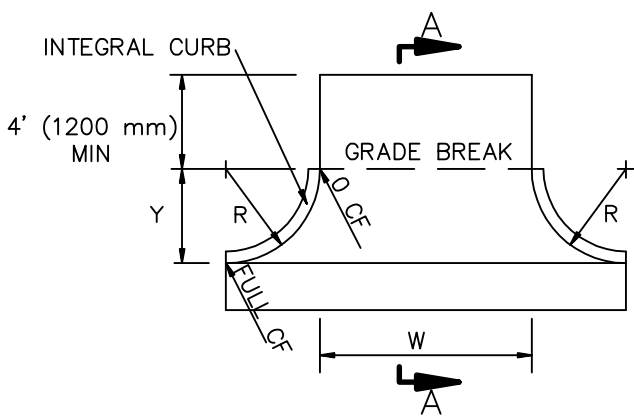

TYPE C

NOTES:

1. RESIDENTIAL DRIVEWAYS SHALL BE 4" (100 mm) THICK PCC.
2. COMMERCIAL DRIVEWAYS SHALL BE 6" (150 mm) THICK PCC.
3. WEAKENED PLANE JOINTS SHALL BE INSTALLED AT BOTH SIDES OF A DRIVEWAY AND AT 10' (3.0 m) INTERVALS.
4. CURB FOR TYPE C DRIVEWAY SHALL BE INTEGRAL AND MATCH ADJACENT CONSTRUCTION.
5. REFER TO LOCAL DEVELOPMENT REGULATIONS FOR AMERICANS WITH DISABILITIES ACCESS REQUIREMENTS AND MAXIMUM PERMITTED DRIVEWAY WIDTHS.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009


DRIVEWAY APPROACHES

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

110-2

SHEET 1 OF 1

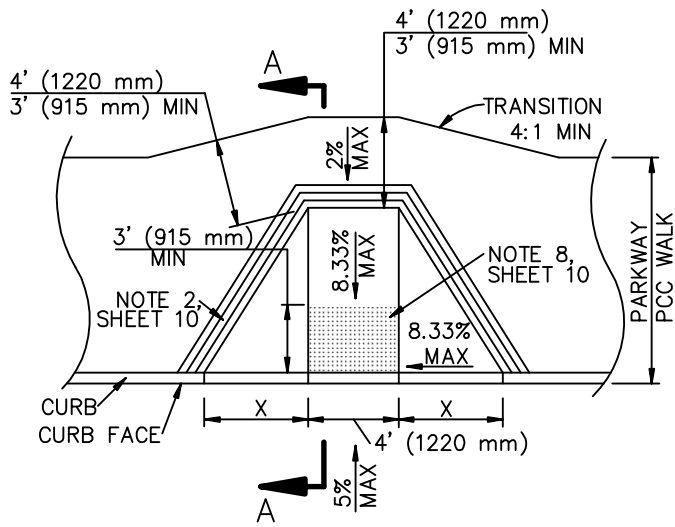

TYPE 1

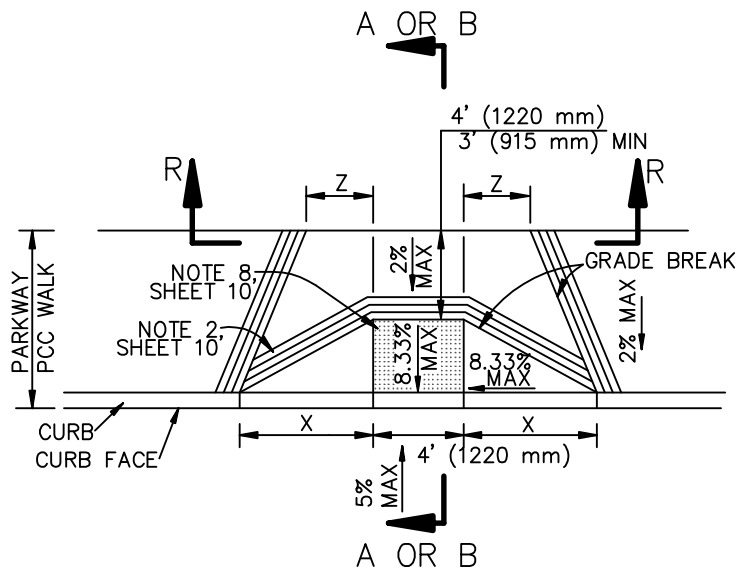

SEE SHEET 7, THIS SECTION

TYPE 2

CASE A

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1996, 2000, 2005, 2009


CURB RAMP

STANDARD PLAN

111-4


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 10

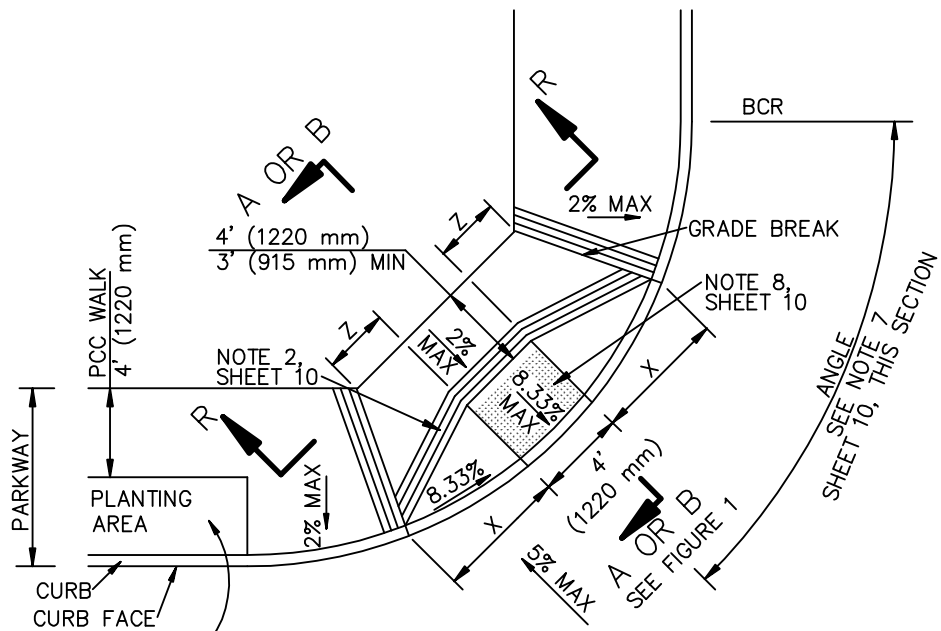


WHERE PLANTING AREA IS ADJACENT TO THE CURB RAMP, USE CASE A, TYPE 6

TYPE 3

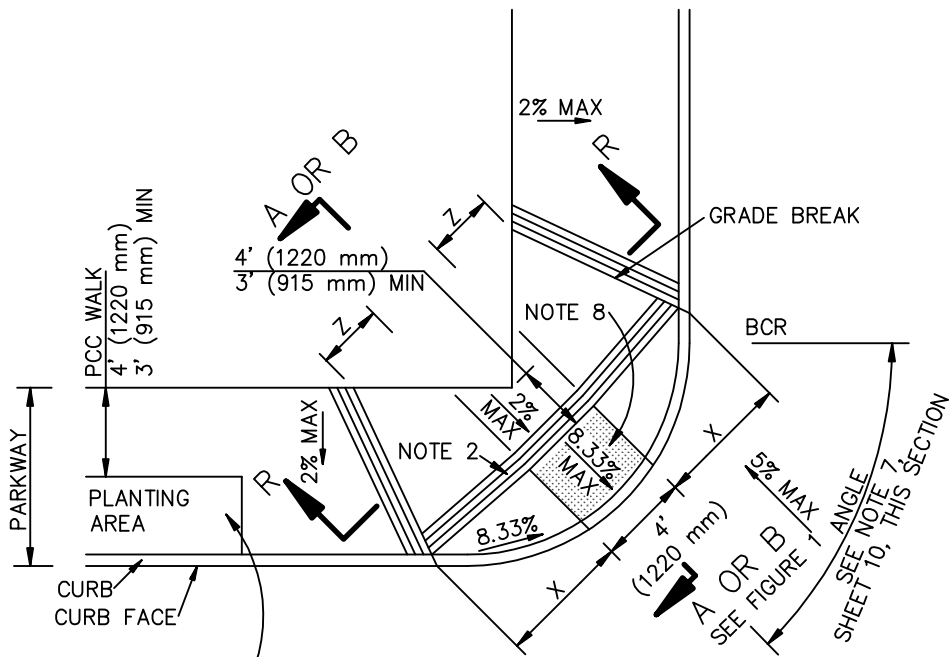


WHERE PLANTING AREA IS ADJACENT TO THE CURB RAMP, USE CASE A, TYPE 6

TYPE 4
CASE A

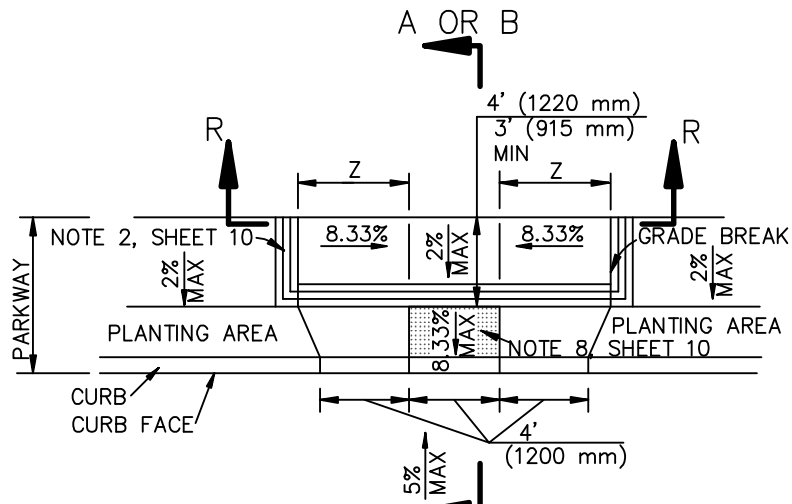


A OR B
SEE FIGURE 1, SHEET 8, THIS SECTION


TYPE 5

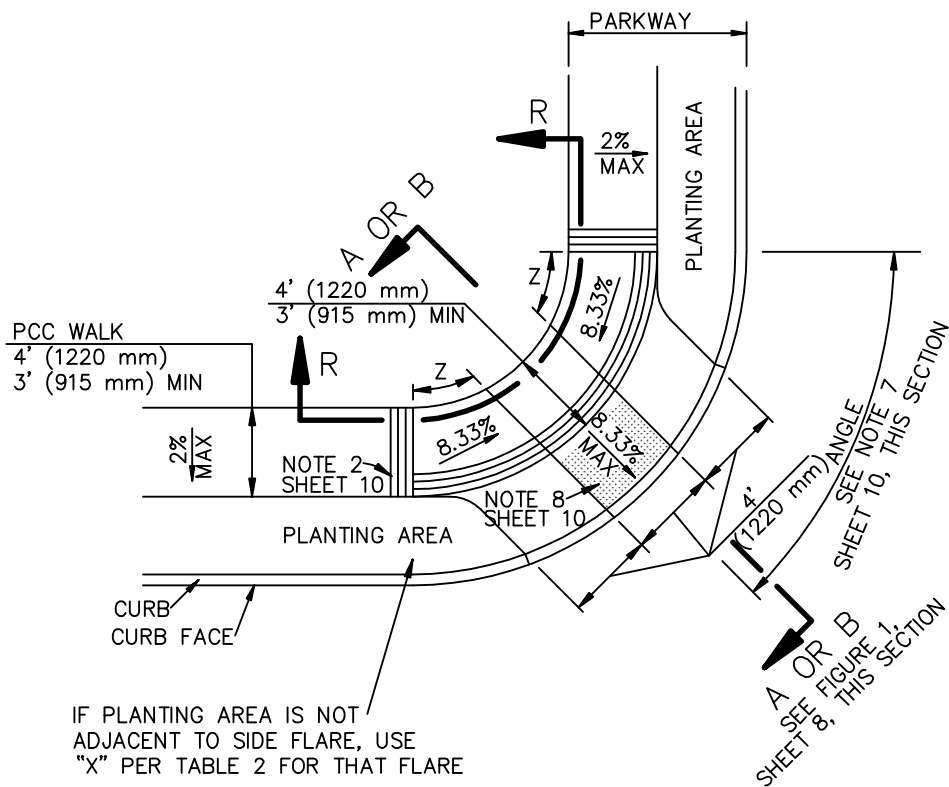

TYPE 6
CASE A

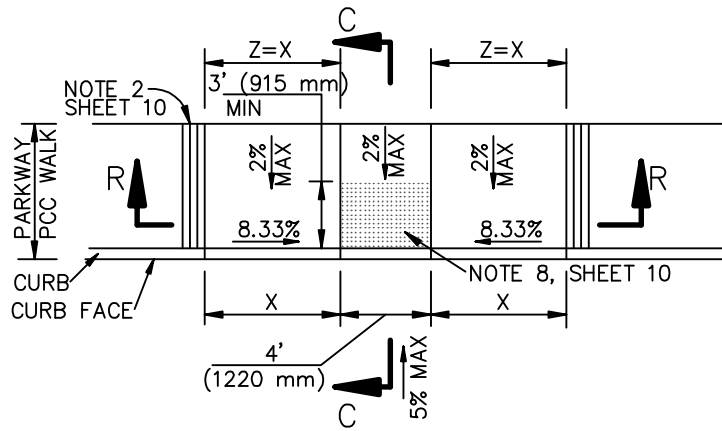


TYPE 1

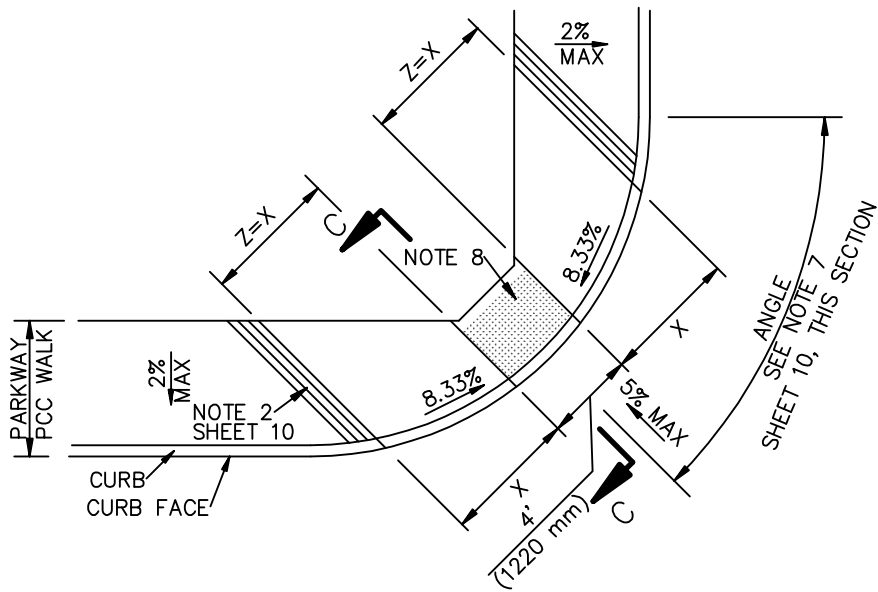


TYPE 2
CASE B


SKEW ANGLE $\alpha=45^\circ$
 OFFSET $b=0$
 UNLESS OTHERWISE
 NOTED ON PLANS

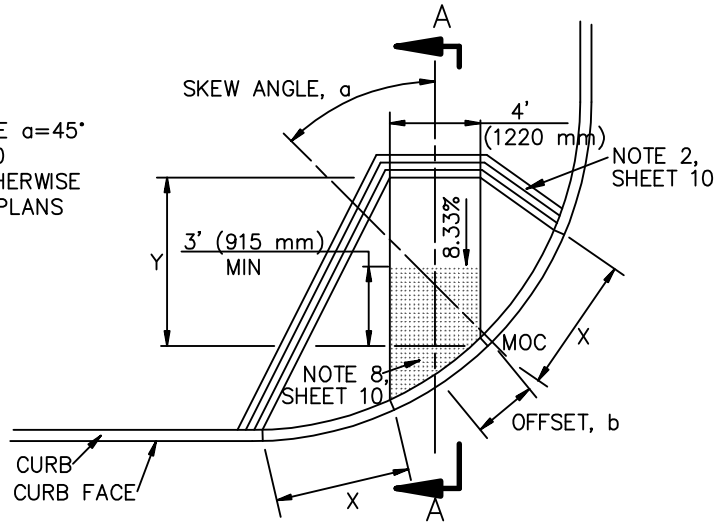


CASE C

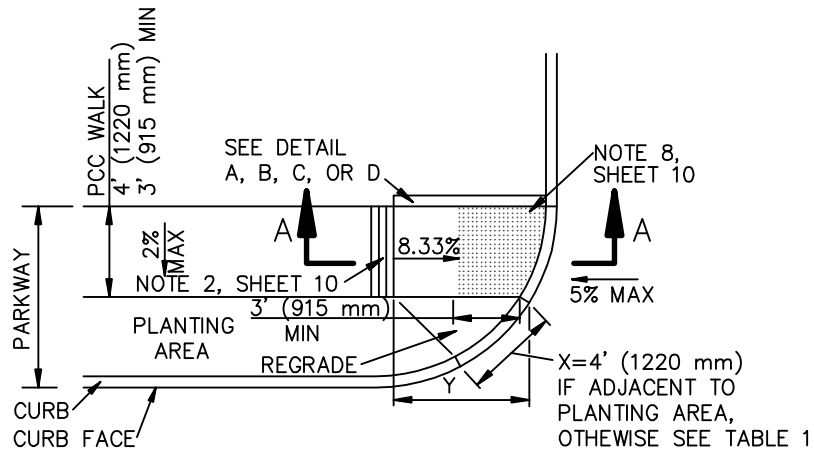


TYPE 1

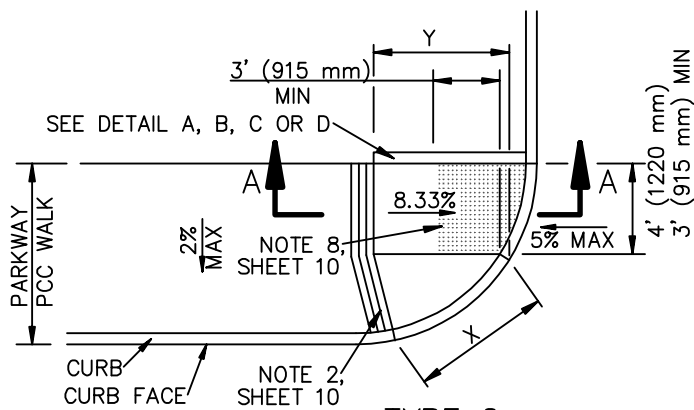


TYPE 2
CASE D

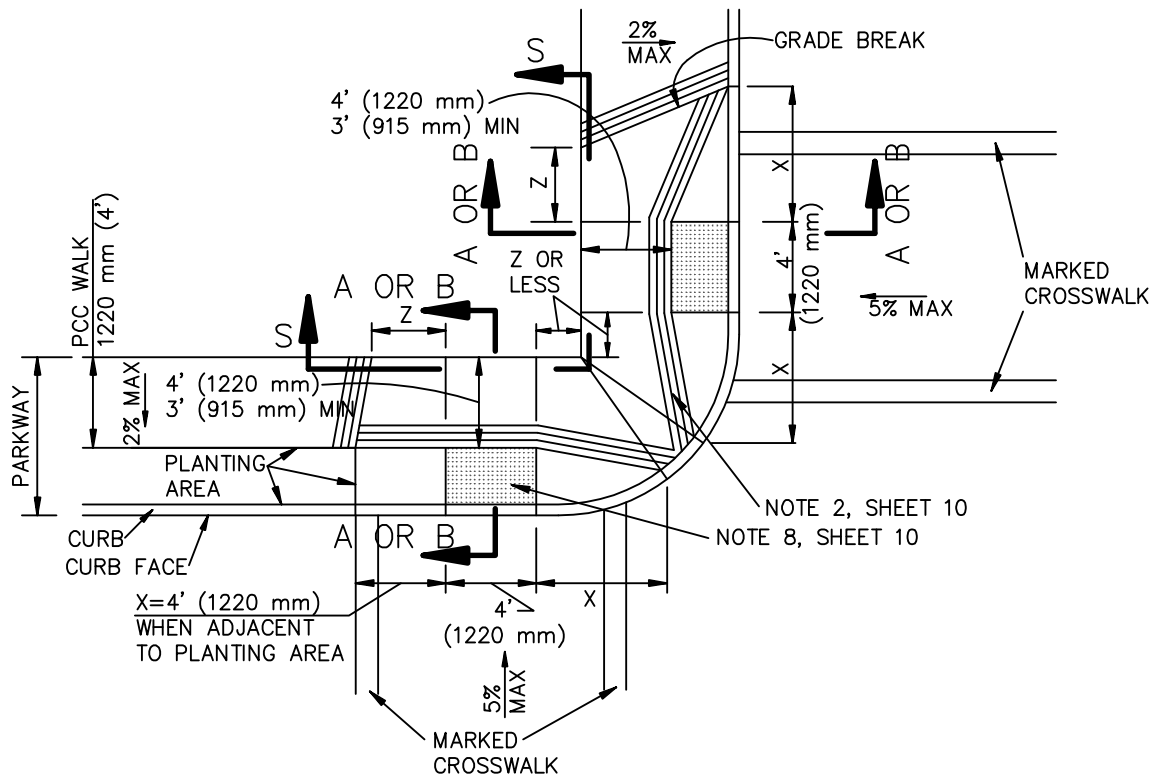

TYPE 1

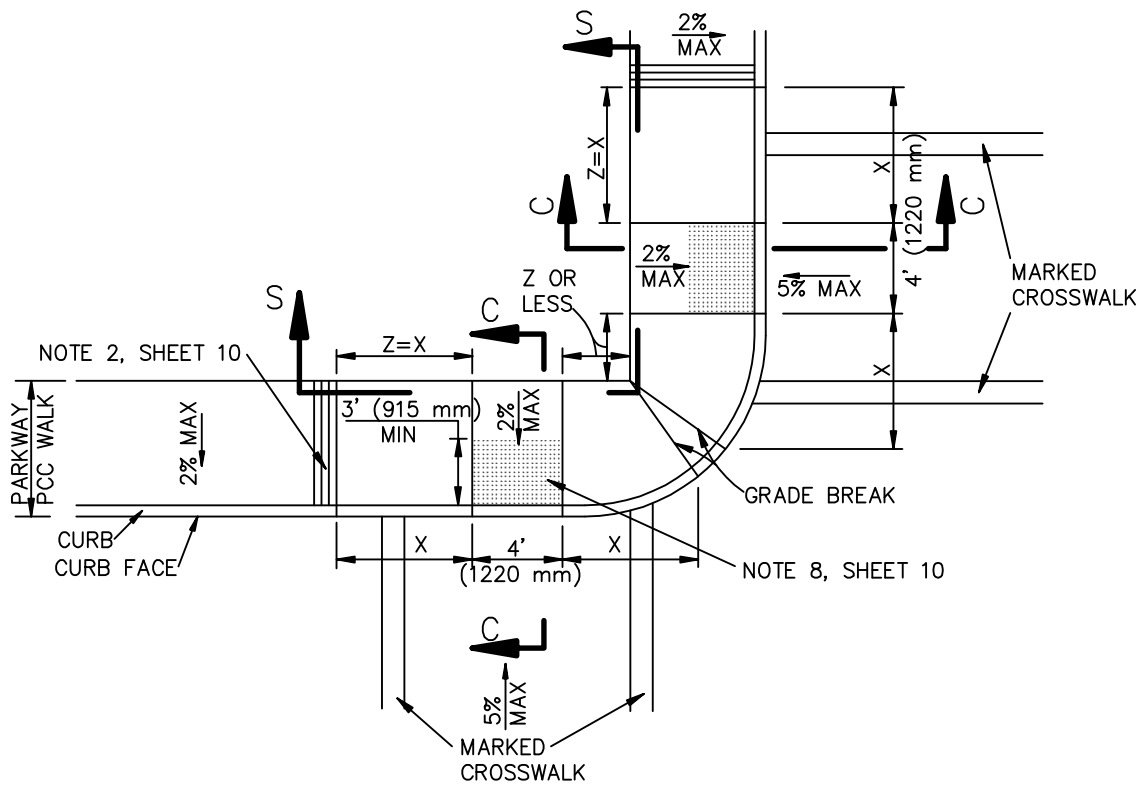


TYPE 2
CASE E

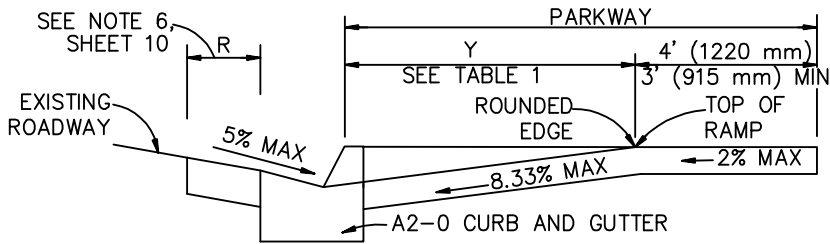


SECTION A-A

USE FIGURE 1 TO DETERMINE WHICH OF SECTIONS A-A, B-B OR C-C IS APPROPRIATE.

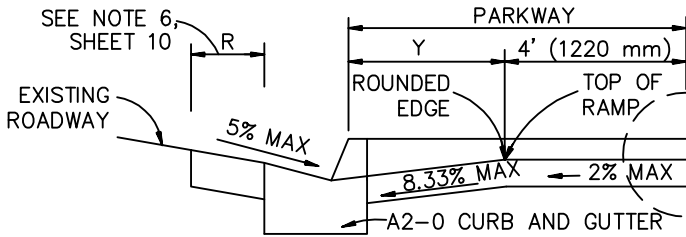


SECTION B-B

DEPRESS BACK OF WALK SEE DETAIL A, B, C OR D, SHEET 10.

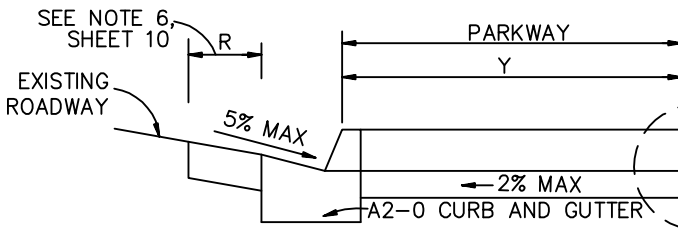


SECTION C-C

DEPRESS BACK OF WALK SEE DETAIL A, B, C OR D, SHEET 10.

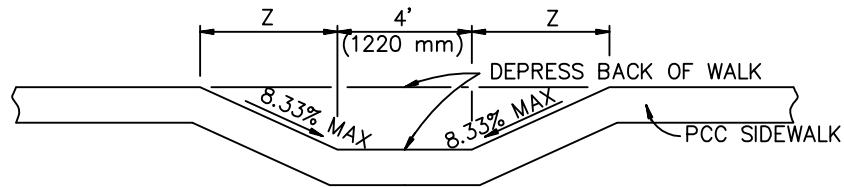

SECTION R-R

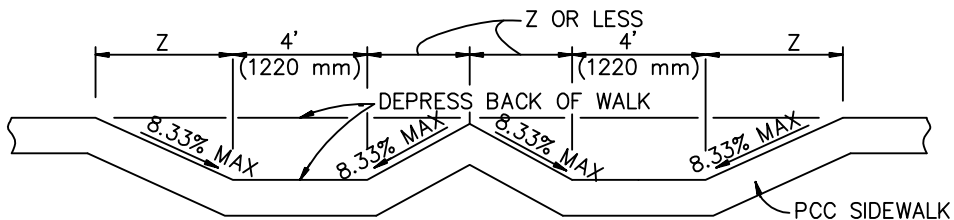

SECTION S-S

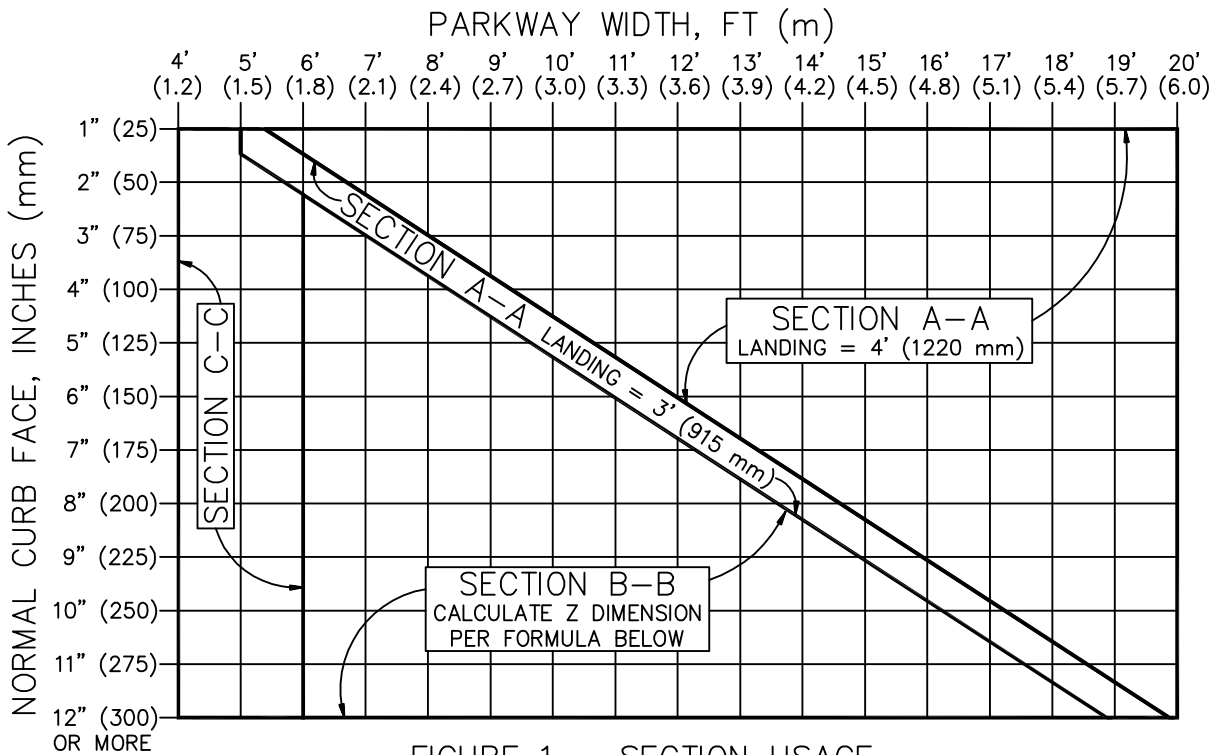


FIGURE 1 – SECTION USAGE

NORMAL CURB FACE, INCHES (mm)	X, FT (mm)	SECTION Y-Y Y, FT (mm)
2" (50)	4.00' (1200) MIN	2.63' (790)
3" (75)	4.00' (1200) MIN	3.95' (1185)
4" (100)	4.00' (1200)	5.26' (1580)
5" (125)	5.00' (1500)	6.58' (1975)
6" (150)	6.00' (1800)	7.90' (2370)
7" (175)	7.00' (2100)	9.21' (2765)
8" (200)	8.00' (2400)	10.53' (3160)
9" (225)	9.00' (2700)	11.84' (3555)
10" (250)	10.00' (3000)	13.16' (3950)
11" (275)	11.00' (3300)	14.47' (4340)
12" (300)	12.00' (3600)	15.79' (4735)

WHERE FIGURE 1 SHOWS USE OF SECTION B-B, FIGURE Z DIMENSION AS FOLLOWS:

W = PARKWAY WIDTH
L = LANDING WIDTH, 4' (1220 mm) TYP, 3' (915 mm) MIN

$$Z = [(Y+L)-W] \times 0.760$$

IF (Y+L) < W, THEN Z = 0

TABLE 1 SHOWS X FOR A FLARE SLOPE OF 8.33% AT THE CURB FACE. IF L IS 4' (1220 mm) OR MORE, X MAY BE MULTIPLIED BY 0.833 FOR A MAXIMUM FLARE SLOPE OF 10% AT THE CURB FACE.

SEE SHEET 9 FOR STREET SLOPE ADJUSTMENT FACTORS, ALL STREETS

TABLE 1 – X AND Y VALUES

TABLE 1 REFERENCE FORMULAS:

$$X = CF / 8.333\%$$

$$Y = CF / (8.333\% - 2\% \text{ WALK CROSS SLOPE})$$


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


CURB RAMP

111-4

SHEET 8 OF 10

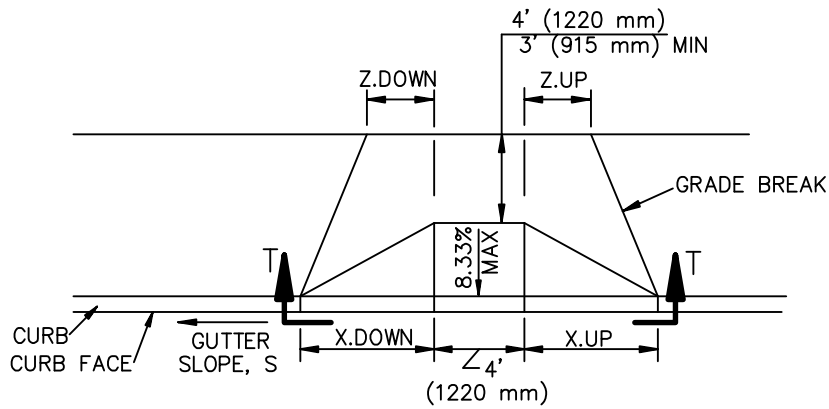

TYPICAL CURB RAMP

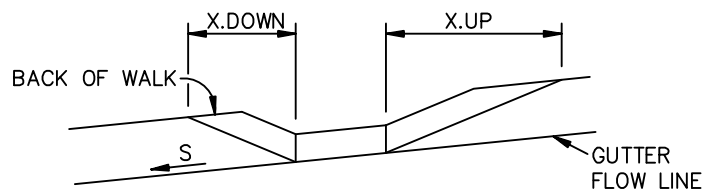

SECTION T-T
SLOPED STREET

FOR SLOPED STREETS, MULTIPLY THE DIMENSIONS PARALLEL TO THE STREET, X AND Z, UPSTREAM AND DOWNSTREAM OF THE RAMP, BY THE FACTORS IN THE FOLLOWING TABLE.


FOR EXAMPLE, $X.DOWN = X \times K.DOWN$

S	K.DOWN	K.UP
0%	1.000	1.000
0.2%	0.977	1.025
0.5%	0.943	1.064
1%	0.893	1.136
2%	0.806	1.316
3%	0.735	1.563
4%	0.676	1.923
5%	0.625	2.500


TABLE 2 - SLOPE ADJUSTMENTS

TABLE 2 REFERENCE FORMULAS:
 $K.DOWN = 8.333\% / (8.333\% + S)$
 $K.UP = 8.333\% / (8.333\% - S)$


STREET SLOPE ADJUSTMENTS

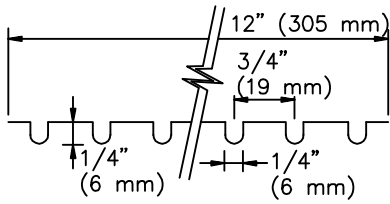


GROOVING DETAIL

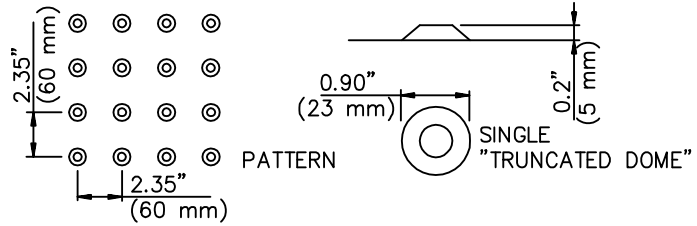


DETECTABLE WARNING DETAIL

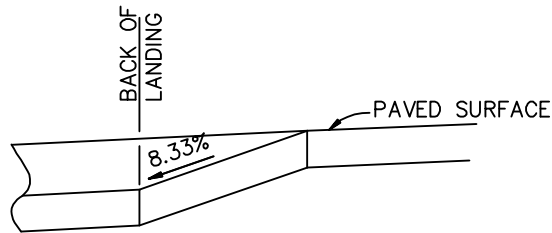


DETAIL A

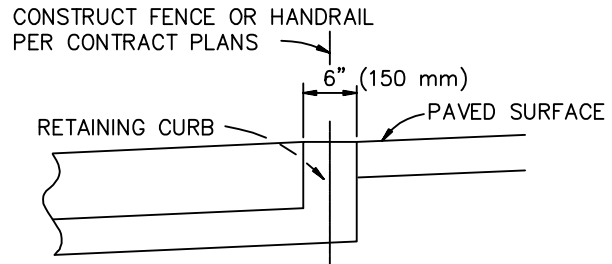

DETAIL B

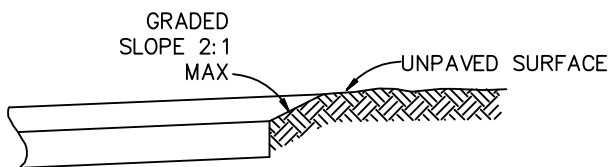


DETAIL C

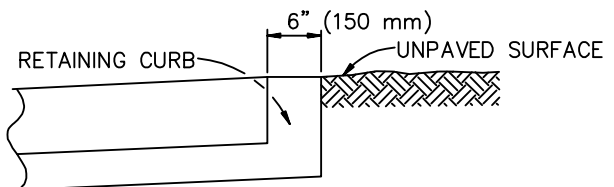

DETAIL D

GENERAL NOTES:

1. CONCRETE SHALL BE CLASS 520-C-2500 (310-C-17) CONFORMING TO SSPWC 201-1.1.2 AND SHALL BE 4" (100 mm) THICK.
2. THE RAMP SHALL HAVE A 12" (305 mm) WIDE BORDER WITH 1/4" (6 mm) GROOVES APPROXIMATELY 3/4" (19 mm) OC. SEE GROOVING DETAIL.
3. THE RAMP SURFACE SHALL HAVE A TRANSVERSE BROOMED SURFACE TEXTURE CONFORMING TO SSPWC 303-1.9.
4. USE DETAIL "A" OR "B" IF EXISTING SURFACE BEHIND LANDING IS PAVED.
5. USE DETAIL "C" OR "D" IF EXISTING SURFACE BEHIND LANDING IS UNPAVED.
6. R = 3' (900 mm) UNLESS OTHERWISE SHOWN ON PLAN.
7. ANGLE = $\Delta/2$ UNLESS OTHERWISE SHOWN ON PLAN.
8. CONSTRUCT DETECTABLE WARNING SURFACE PER DETAIL THIS SHEET. MATERIALS SHALL BE PER CONTRACT DOCUMENTS.

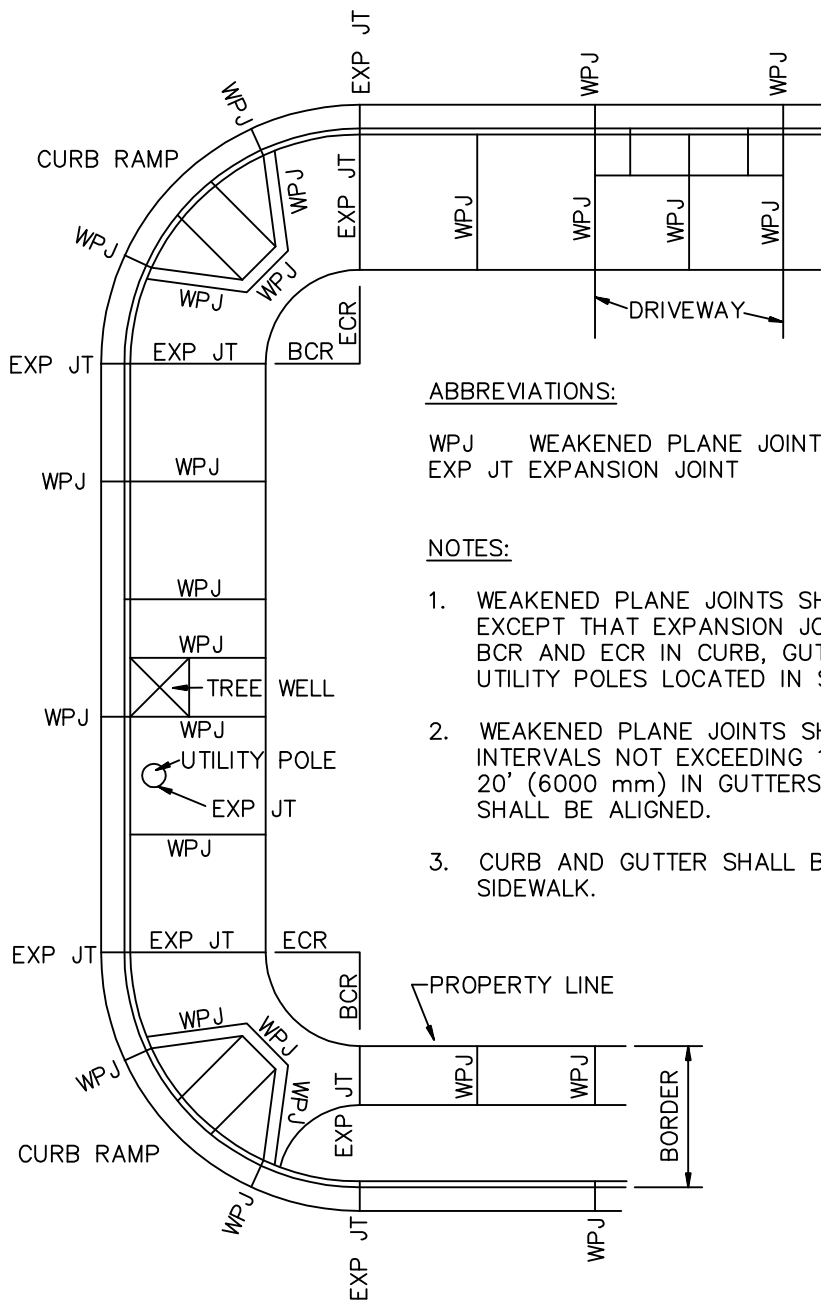

ABBREVIATIONS:

WPJ WEAKENED PLANE JOINT BCR BEGINNING OF CURB RETURN
 EXP JT EXPANSION JOINT ECR END OF CURB RETURN

NOTES:

1. WEAKENED PLANE JOINTS SHALL BE USED FOR ALL JOINTS, EXCEPT THAT EXPANSION JOINTS SHALL BE PLACED AT THE BCR AND ECR IN CURB, GUTTER AND SIDEWALK, AND AROUND UTILITY POLES LOCATED IN SIDEWALK AREAS.
2. WEAKENED PLANE JOINTS SHALL BE CONSTRUCTED AT REGULAR INTERVALS NOT EXCEEDING 10' (3000 mm) IN WALKS AND 20' (6000 mm) IN GUTTERS. JOINTS IN CURB AND WALK SHALL BE ALIGNED.
3. CURB AND GUTTER SHALL BE CONSTRUCTED SEPARATELY FROM SIDEWALK.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2009

CURB AND SIDEWALK JOINTS

STANDARD PLAN

112-2


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 1


WALK OR FILL-IN REPLACEMENT FOR EXCAVATIONS MADE PARALLEL TO CURB OR PROPERTY LINE

WALK ADJACENT TO PROPERTY LINE

WALK LESS THAN 5' (1500 mm) WIDE

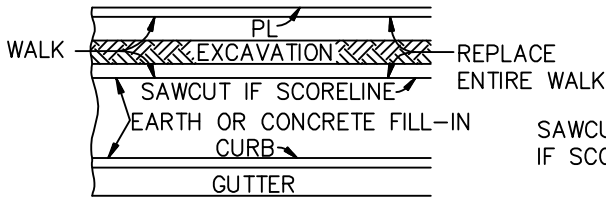


WALK 5' (1500 mm) WIDE OR MORE

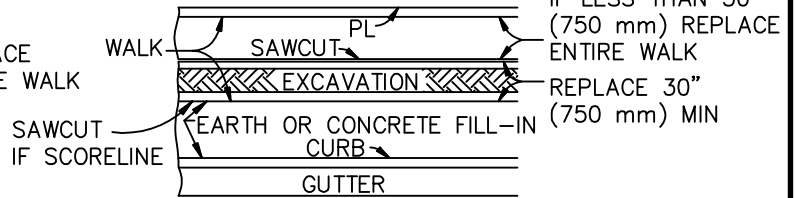


WALK ADJACENT TO CURB

WALK LESS THAN 5' (1500 mm) WIDE




WALK 5' (1500 mm) WIDE OR MORE

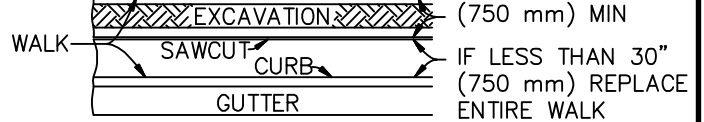


FILL-IN REPLACEMENT


FILL-IN LESS THAN 5' (1500 mm) WIDE

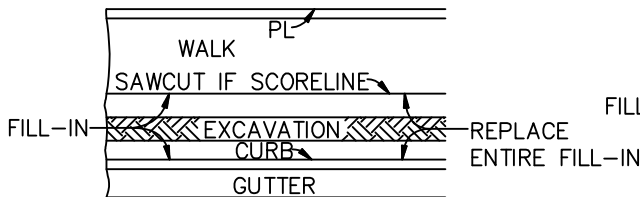

FILL-IN 5' (1500 mm) WIDE OR MORE

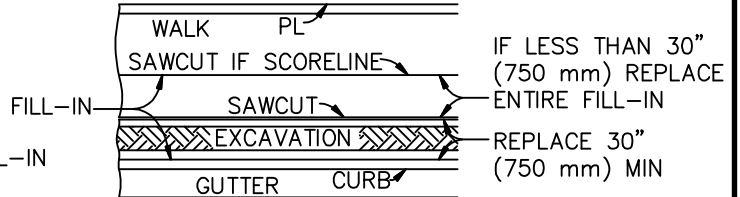

WALK OR FILL-IN REPLACEMENT FOR EXCAVATIONS MADE NORMAL TO CURB OR PROPERTY LINE

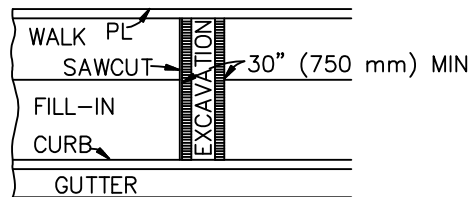

THESE REQUIREMENTS ALSO APPLY TO ENDS OF PARALLEL EXCAVATIONS.

IF AN EXCAVATION FALLS WITHIN 30" (750 mm) OF AN EXPANSION JOINT, CONSTRUCTION JOINT, WEAKENED PLANE JOINT, OR EDGE, THE CONCRETE SHALL BE REMOVED AND REPLACED TO THE JOINT OR EDGE.

IF AN EXCAVATION FALLS WITHIN 12" (300 mm) OF A SCORELINE, THE CONCRETE SHALL BE REMOVED AND REPLACED TO THE SCORELINE. THE SCORELINE SHALL BE SAWCUT BEFORE CONCRETE REMOVAL.

THE MINIMUM LENGTH OF REPLACEMENT IN BOTH CASES SHALL BE 30" (750 mm).

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2009

SIDEWALK & DRIVEWAY REPLACEMENT

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

113-2

SHEET 1 OF 2

NOTES

1. CONCRETE WALK, FILL-IN AND DRIVEWAYS REMOVED IN CONNECTION WITH CONSTRUCTION SHALL BE REPLACED TO NEATLY SAWED EDGES. ALL CUTS SHALL BE PARALLEL TO OR PERPENDICULAR TO THE CURB; ON CURVES, THE CUT SHALL BE RADIAL TO THE CURB.
2. DRIVEWAY APRONS IN WHICH THE "W" DISTANCE IS LESS THAN 11' (3300 mm) SHALL BE REPLACED IN THEIR ENTIRETY IF CUT IN ANY AREA.
3. DRIVEWAY APRONS IN WHICH THE "W" DISTANCE IS 11' (3300 mm) OR MORE MAY BE CUT WITHIN THE "W" SECTION. THE MINIMUM REPLACEMENT SHALL BE 30" (750 mm) IN LENGTH. THE MINIMUM DISTANCE ALLOWED BETWEEN SUCH CUTS SHALL BE 14' (4200 mm).
4. DRIVEWAY APRONS IN WHICH THE "W" DISTANCE IS 11' (3300 mm) OR MORE MAY BE CUT IN THE "X" OR "R" SECTION. REPLACEMENT SHALL BE THE ENTIRE "X" OR "R" SECTION.
5. DRIVEWAY APRONS SHALL BE REPLACED FROM THE BACK OF THE CURB TO THE FRONT EDGE OF THE WALK, EXCEPT, WHERE WALK IS ADJACENT TO CURB, REPLACEMENT SHALL BE FROM BACK OF CURB TO BACK OF WALK.
6. WALK PORTIONS OF DRIVEWAYS SHALL BE REPLACED AS SHOWN ABOVE FOR EXCAVATIONS MADE PARALLEL OR NORMAL TO CURB.
7. REPLACEMENT OF THE "X" OR "R" SECTION SHALL MATCH EXISTING CONSTRUCTION.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


SIDEWALK & DRIVEWAY REPLACEMENT

113-2


SHEET 2 OF 2

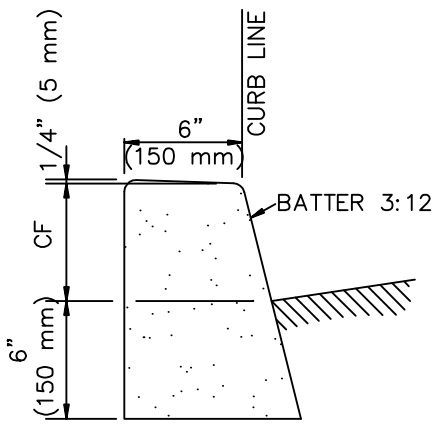


A1-6(150) AND
A1-8(200)

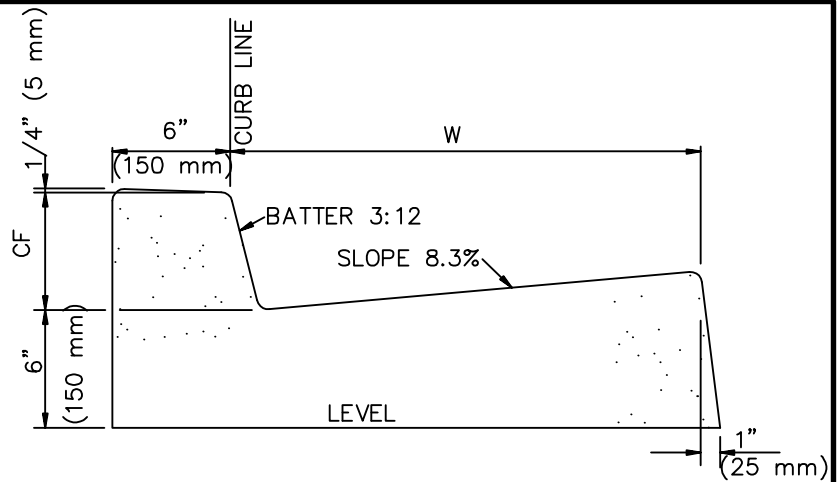

A2-6(150) AND A2-8(200)

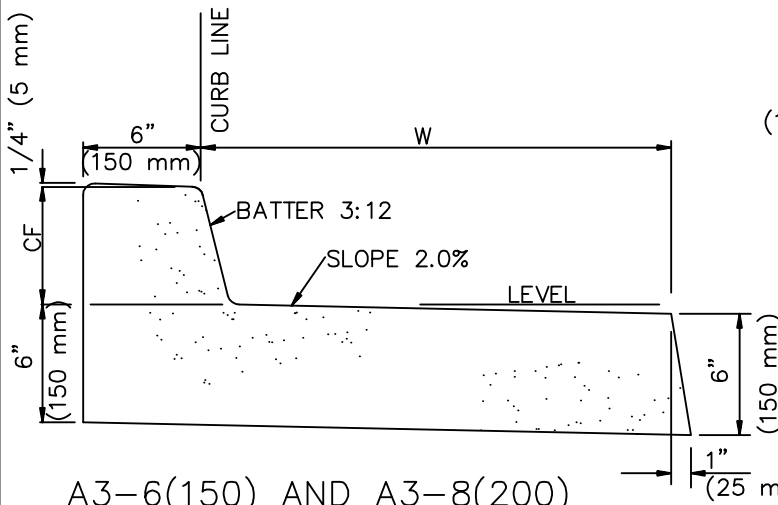


A3-6(150) AND A3-8(200)

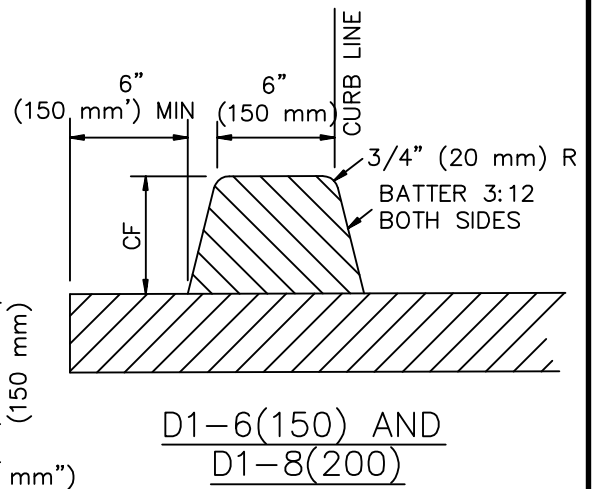

D1-6(150) AND
D1-8(200)

NOTES:

1. THE LAST NUMBER IN THE DESIGNATION IS THE CURB FACE (CF) HEIGHT, INCHES (MM).
2. GUTTER WIDTH, W, IS 24" (600 MM) UNLESS OTHERWISE SPECIFIED.
3. TYPES A1, A2, A3 AND C1 SHALL BE CONSTRUCTED FROM PCC.
4. TYPE D1 CURB SHALL BE CONSTRUCTED FROM ASPHALT CONCRETE.
5. TYPE C1 CURB SHALL BE ANCHORED WITH STEEL DOWELS AS SHOWN OR WITH AN EPOXY APPROVED BY THE ENGINEER.
6. ALL EXPOSED CORNERS ON PCC CURBS AND GUTTERS SHALL BE ROUNDED WITH A 1/2" (15 MM) RADIUS.

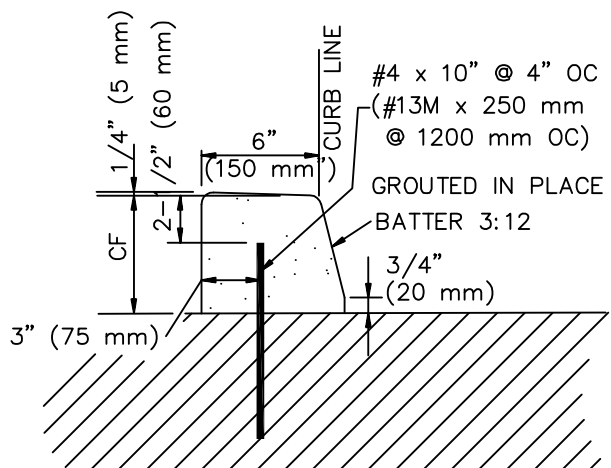

C1-6(150) AND C1-8(200)

STANDARD PLAN FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009


CURB AND GUTTER - BARRIER

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

120-2


SHEET 1 OF 1

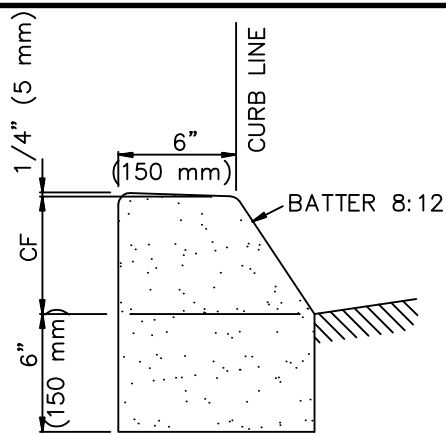


B1-6(150)

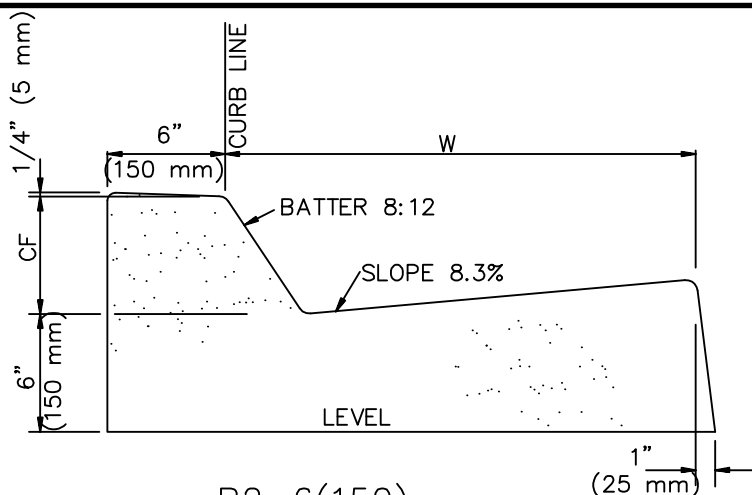

B2-6(150)

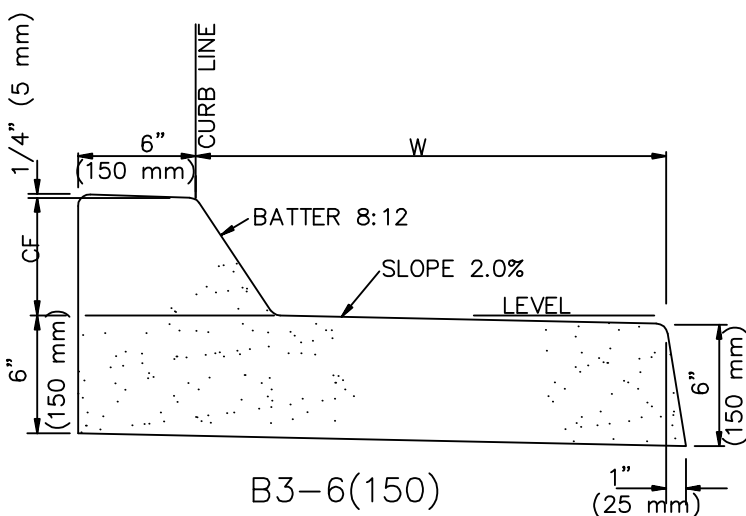


B3-6(150)

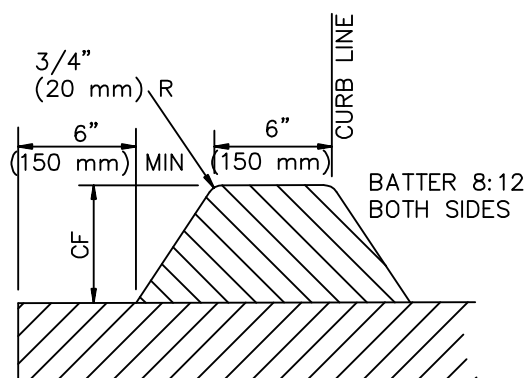

D2-6(150)

NOTES:

1. THE LAST NUMBER IN THE DESIGNATION IS THE CURB FACE (CF) HEIGHT, INCHES (mm).
2. GUTTER WIDTH, W, IS 24" (600 mm) UNLESS OTHERWISE SPECIFIED.
3. TYPES B1, B2, B3 AND C2 SHALL BE CONSTRUCTED FROM PCC.
4. TYPE D2 CURB SHALL BE CONSTRUCTED FROM ASPHALT CONCRETE.
5. TYPE C2 CURB SHALL BE ANCHORED WITH STEEL DOWELS AS SHOWN OR WITH AN EPOXY APPROVED BY THE ENGINEER.
6. ALL EXPOSED CORNERS ON PCC CURBS AND GUTTERS SHALL BE ROUNDED WITH A 1/2" (15 mm) RADIUS.

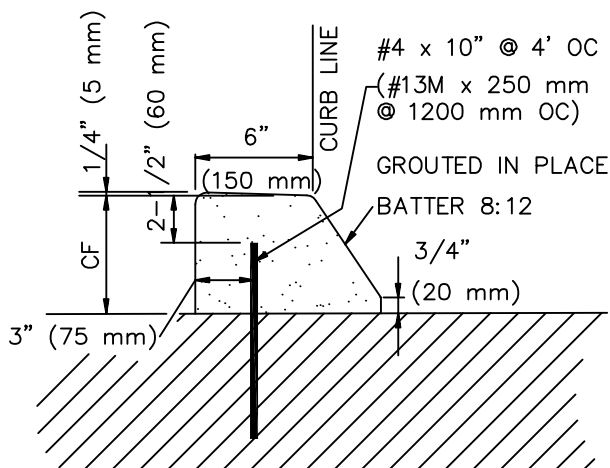

C2-6(150)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009


CURB AND GUTTER-MOUNTABLE

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


121-2

SHEET 1 OF 1

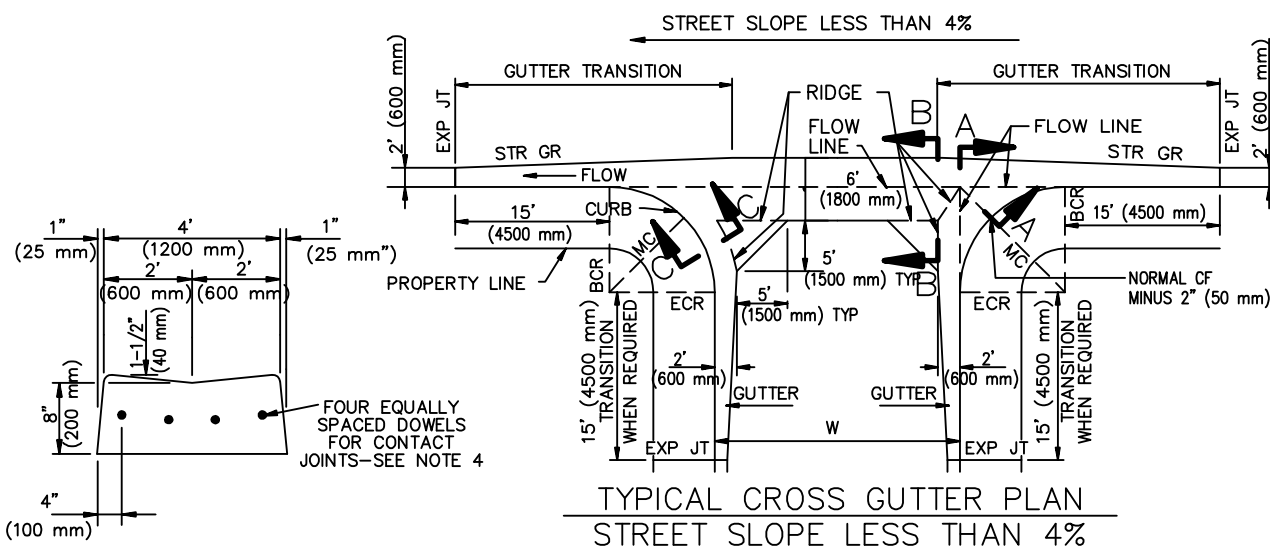


TYPICAL CROSS GUTTER PLAN
STREET SLOPE LESS THAN 4%

LONGITUDINAL
GUTTER

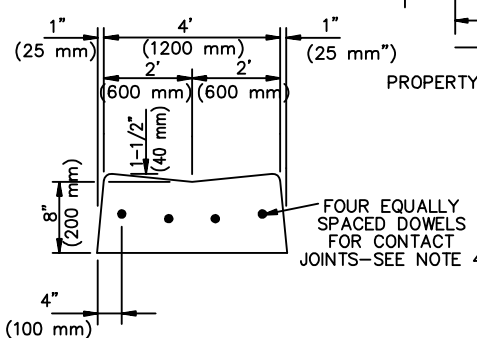


(100 mm)


STREET SLOPE 4% OR GREATER

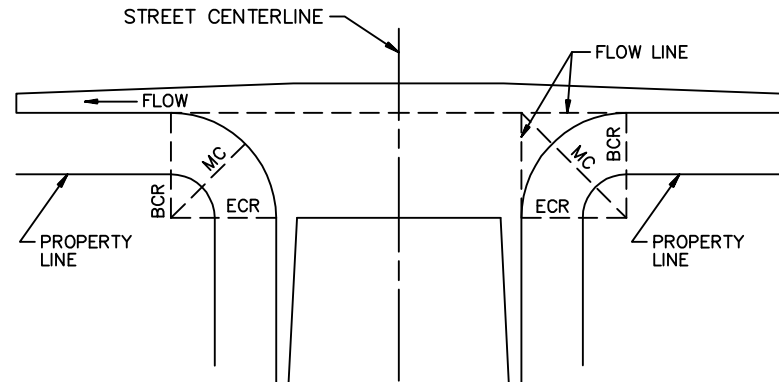


TYPICAL CROSS GUTTER PLAN
STREET SLOPE MORE THAN 4%

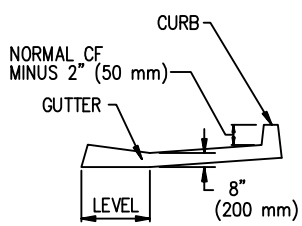


SECTION A-A

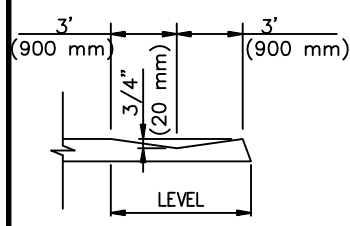

SECTION B-B



SECTION C-C

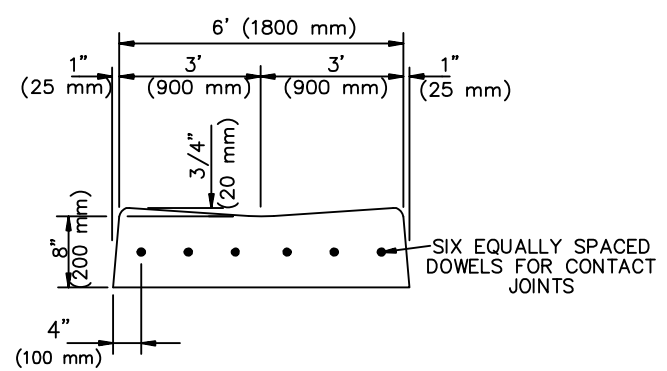

SECTION D-D


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

CROSS AND LONGITUDINAL GUTTERS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
122-2
SHEET 1 OF 2

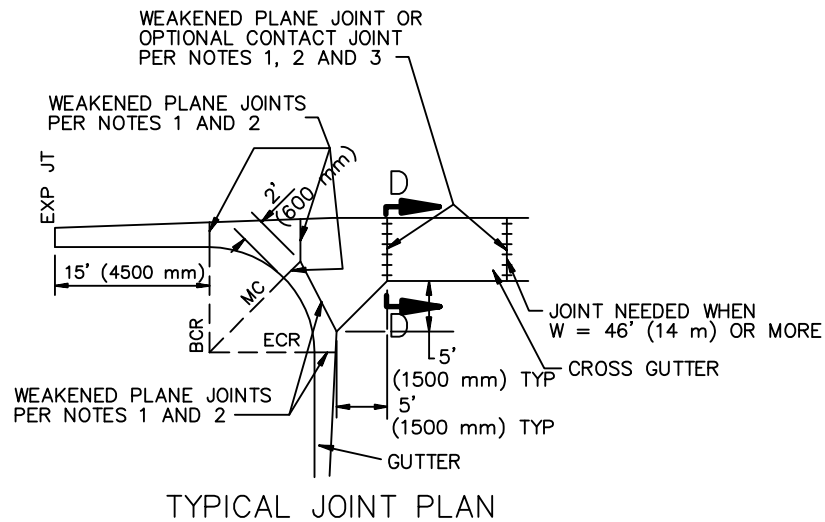

NOTES:

1. WEAKENED PLANE AND/OR CONTACT JOINTS SHALL BE PLACED IN CURB AND GUTTER AT LOCATIONS SHOWN ON THE TYPICAL JOINT PLAN HEREON.
2. WEAKENED PLANE JOINTS SHALL BE PLASTIC CONTROL JOINTS OR 1-1/2" (40 mm) DEEP SAW CUTS. CONCRETE SAWING SHALL TAKE PLACE WITHIN 24 HOURS AFTER CONCRETE IS PLACED.
3. DOWELS FOR CONTACT JOINTS SHALL BE #4 BARS 18" LONG (#13M BARS 450 mm LONG).
4. PLACE A WEAKENED PLANE OR CONTACT JOINT WHERE LONGITUDINAL ALLEY GUTTER JOINS CONCRETE ALLEY INTERSECTION.
5. ALL EXPOSED CORNERS ON PCC GUTTERS SHALL BE ROUNDED WITH 1/2" (15 mm) RADIUS.
6. CONCRETE SHALL BE INTEGRAL WITH CURB UNLESS OTHERWISE SPECIFIED.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

CROSS AND LONGITUDINAL GUTTERS

122-2

SHEET 2 OF 2

NOTES:

1. WEAKENED PLANE JOINTS SHALL BE PLASTIC CONTROL JOINTS OR 1-1/2" (35 mm) DEEP SAW CUTS. CONCRETE SAWING SHALL TAKE PLACE WITHIN 24 HOURS AFTER CONCRETE IS PLACED.
2. DOWELS FOR CONTACT JOINTS SHALL BE #4 BARS 18" LONG (#13M BARS 450 mm LONG).
3. ALL EXPOSED CORNERS SHALL BE ROUNDED WITH 1/2" (15 mm) RADIUS.
4. CONCRETE SHALL BE INTEGRAL WITH CURB UNLESS OTHERWISE SPECIFIED.




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**CROSS GUTTER AT
T INTERSECTIONS**

123-2

SHEET 2 OF 2

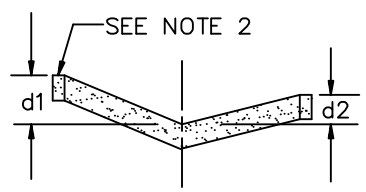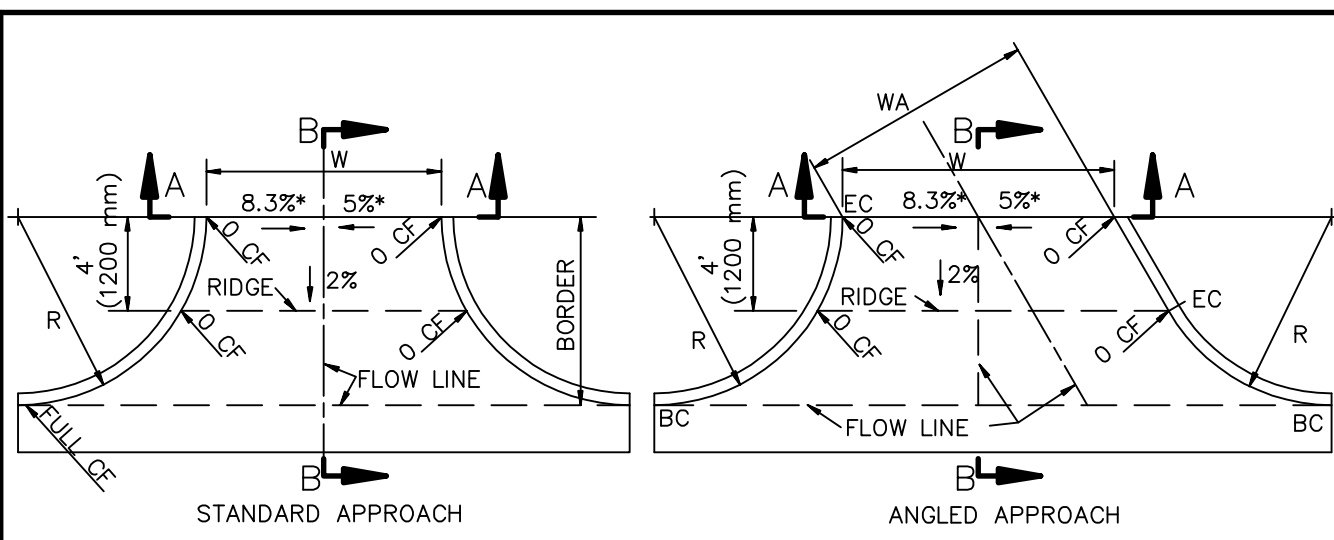


W, ft	8'	10'	15'	20'	25'	30'
W, mm	(2400mm)	(3000mm)	(4500mm)	(6000mm)	(7500mm)	(9000mm)
d1, ft	0.33'	0.42'	0.63'	0.83'	1.04'	1.25'
MAX	(100 mm)	(125 mm)	(188 mm)	(250 mm)	(313 mm)	(375 mm)
d2, ft	0.17'	0.25'	0.25'	0.25'	0.25'	0.25'
MIN	(50 mm)	(75 mm)	(75 mm)	(75 mm)	(75 mm)	(75 mm)


NOTES:

1. FOR CASE A, THE RADIUS OF THE CURB RETURN, R, IS EQUAL TO THE PARKWAY WIDTH.
2. ALLEY INTERSECTION SHALL BE PCC, CLASS 520-C-2500 (310-C-17), 6" (150 mm) THICK. CURB SHALL BE INTEGRAL TYPE "A".
3. ASTERISKS,* , SHOW MAXIMUM GRADES.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION		
PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1984 REV. 1996, 2009	<h2 style="margin: 0;">ALLEY INTERSECTION</h2>	STANDARD PLAN <h1 style="margin: 0;">130-2</h1>
USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION		SHEET 1 OF 1

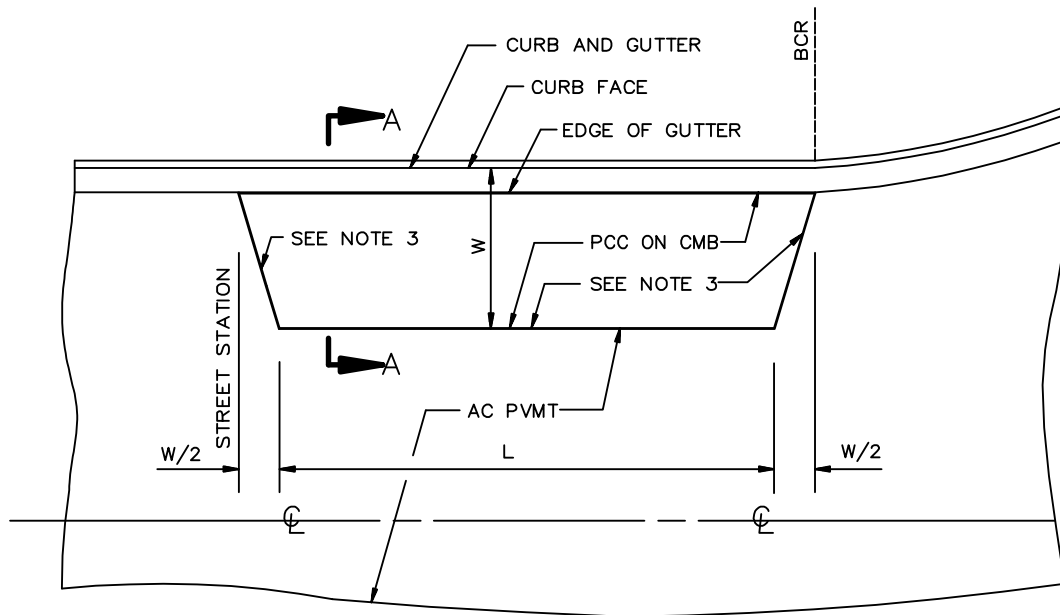

TYPICAL BUS PAD

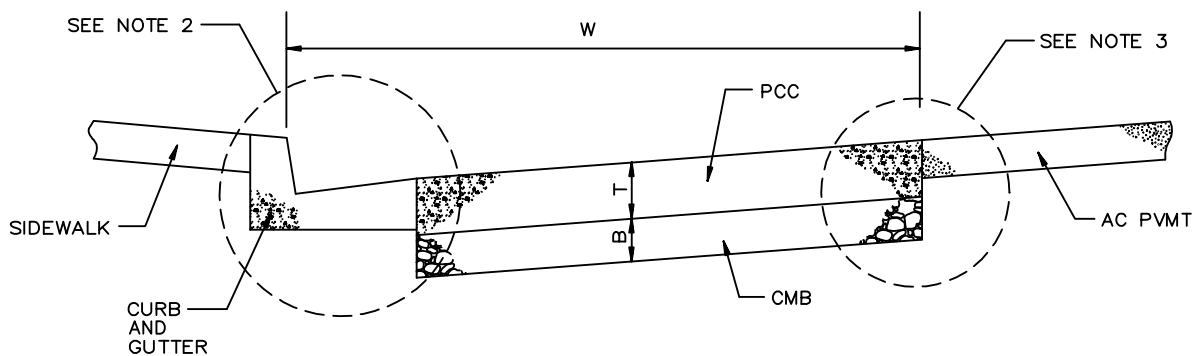

SECTION A-A

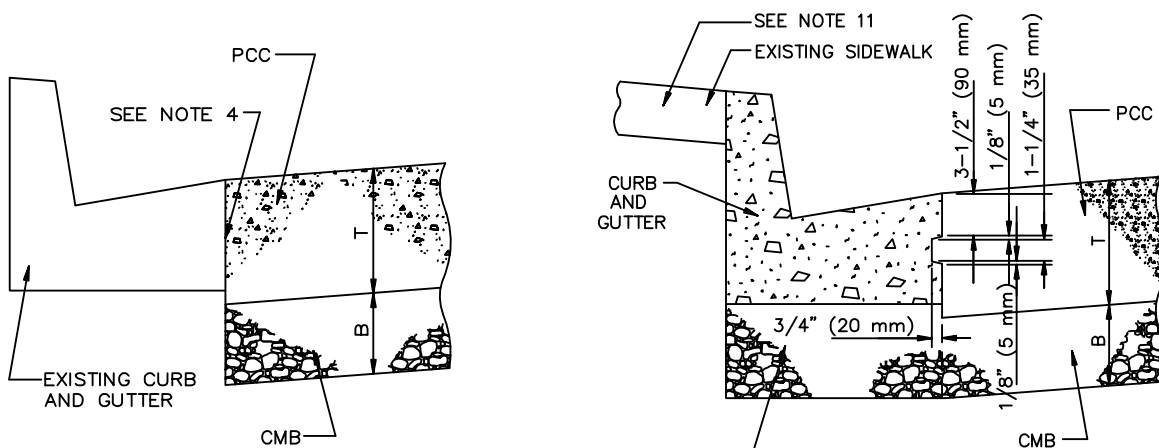

SECTION B-B

SECTION C-C

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2009




CONCRETE BUS PAD

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

131-2

SHEET 1 OF 2

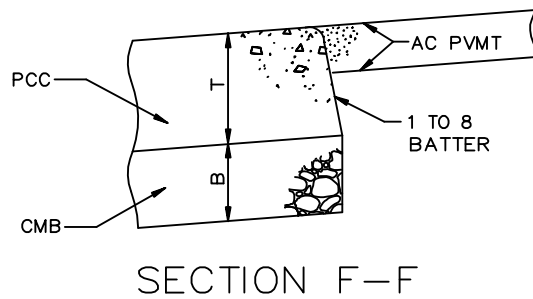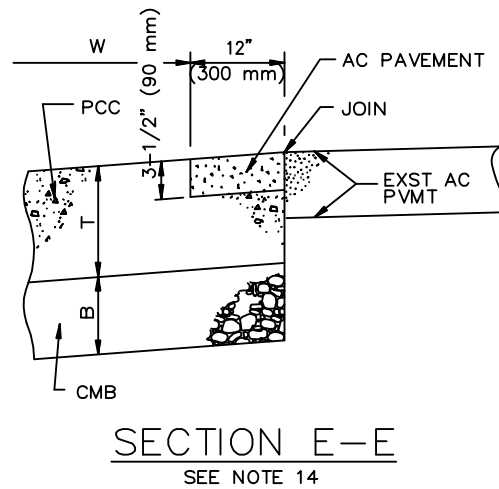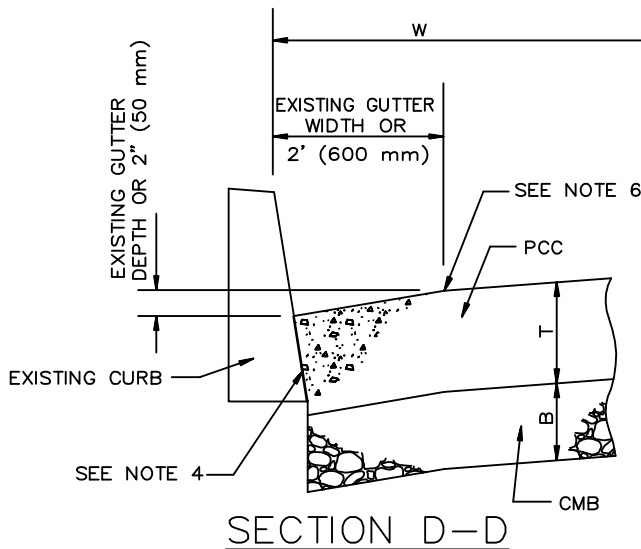

NOTES:

1. DIMENSIONS: (UNLESS OTHERWISE SHOWN)
 $L = 85'$ (26 m) $T = 8''$ (200 mm)
 $W = 10'$ (3 m) $B = 6''$ (150 mm)
2. USE SECTION B-B FOR EXISTING CURB AND GUTTER THAT IS TO REMAIN.
 USE SECTION C-C FOR NEW CURB AND GUTTER.
 USE SECTION D-D FOR EXISTING CURB THAT IS TO REMAIN.
3. USE SECTION E-E FOR EXISTING AC PAVEMENT.
 USE SECTION F-F FOR NEW AC PAVEMENT.
4. AT LOCATIONS WHERE PCC PAVEMENT WILL ABUT EXISTING CONCRETE, AN EPOXY APPROVED BY THE ENGINEER SHALL BE APPLIED TO THE EXISTING CONCRETE SURFACES PRIOR TO CONCRETE PLACEMENT.
5. IF $B + T \geq 300$ mm (12"), CMB SHALL EXTEND UNDER NEW CURB AND GUTTER.
6. CONSTRUCT LONGITUDINAL WEAKENED-PLANE JOINT TO MATCH ADJOINING EXISTING GUTTER WIDTH, OR 2' (600 mm) IF NO ADJOINING GUTTER EXISTS.
7. USE 2"x4" (50x100) HEADER TO FORM 3-1/2" (90 mm) STEP. TOP OF HEADER SHALL BE SET TO LINE AND GRADE.
8. ALL EXPOSED PCC CORNERS SHALL BE ROUNDED WITH A 1/2" (15 mm) RADIUS.
9. SURFACE OF CONCRETE SHALL HAVE A ROUGH TRANSVERSE BROOM FINISH.
10. WHERE DESIGNATED BY THE ENGINEER, UNDESIRABLE SUBGRADE MATERIAL SHALL BE REMOVED AND REPLACED WITH CMB.
11. WHERE NEW CURB AND GUTTER IS CONSTRUCTED ADJACENT TO EXISTING SIDEWALK, SIDEWALK SHALL BE REMOVED AND REPLACED TO NEAREST SCORELINE.
12. CONSTRUCT TRANSVERSE WEAKENED PLANE JOINTS IN BUS PAD PAVEMENT AT APPROX. 10' (3 m) INTERVALS.
13. CONSTRUCT TRANSVERSE WEAKENED PLANE JOINTS IN BUS PAD PAVEMENT AT ALL EXISTING CURB/CURB & GUTTER CONSTRUCTION JOINTS AND WEAKENED-PLANE JOINTS.
14. AT THE OPTION OF THE ENGINEER, THE EXISTING PAVEMENT MAY BE NEATLY SAWCUT AROUND THE DIMENSIONS OF THE BUS PAD, AND CONCRETE POURED DIRECTLY USING THE EXISTING PAVEMENT AS A FORM. THE CONCRETE EDGES SHALL BE ROUNDED WITH A 1/2" (15 mm) RADIUS.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

CONCRETE BUS PAD

131-2

SHEET 2 OF 2

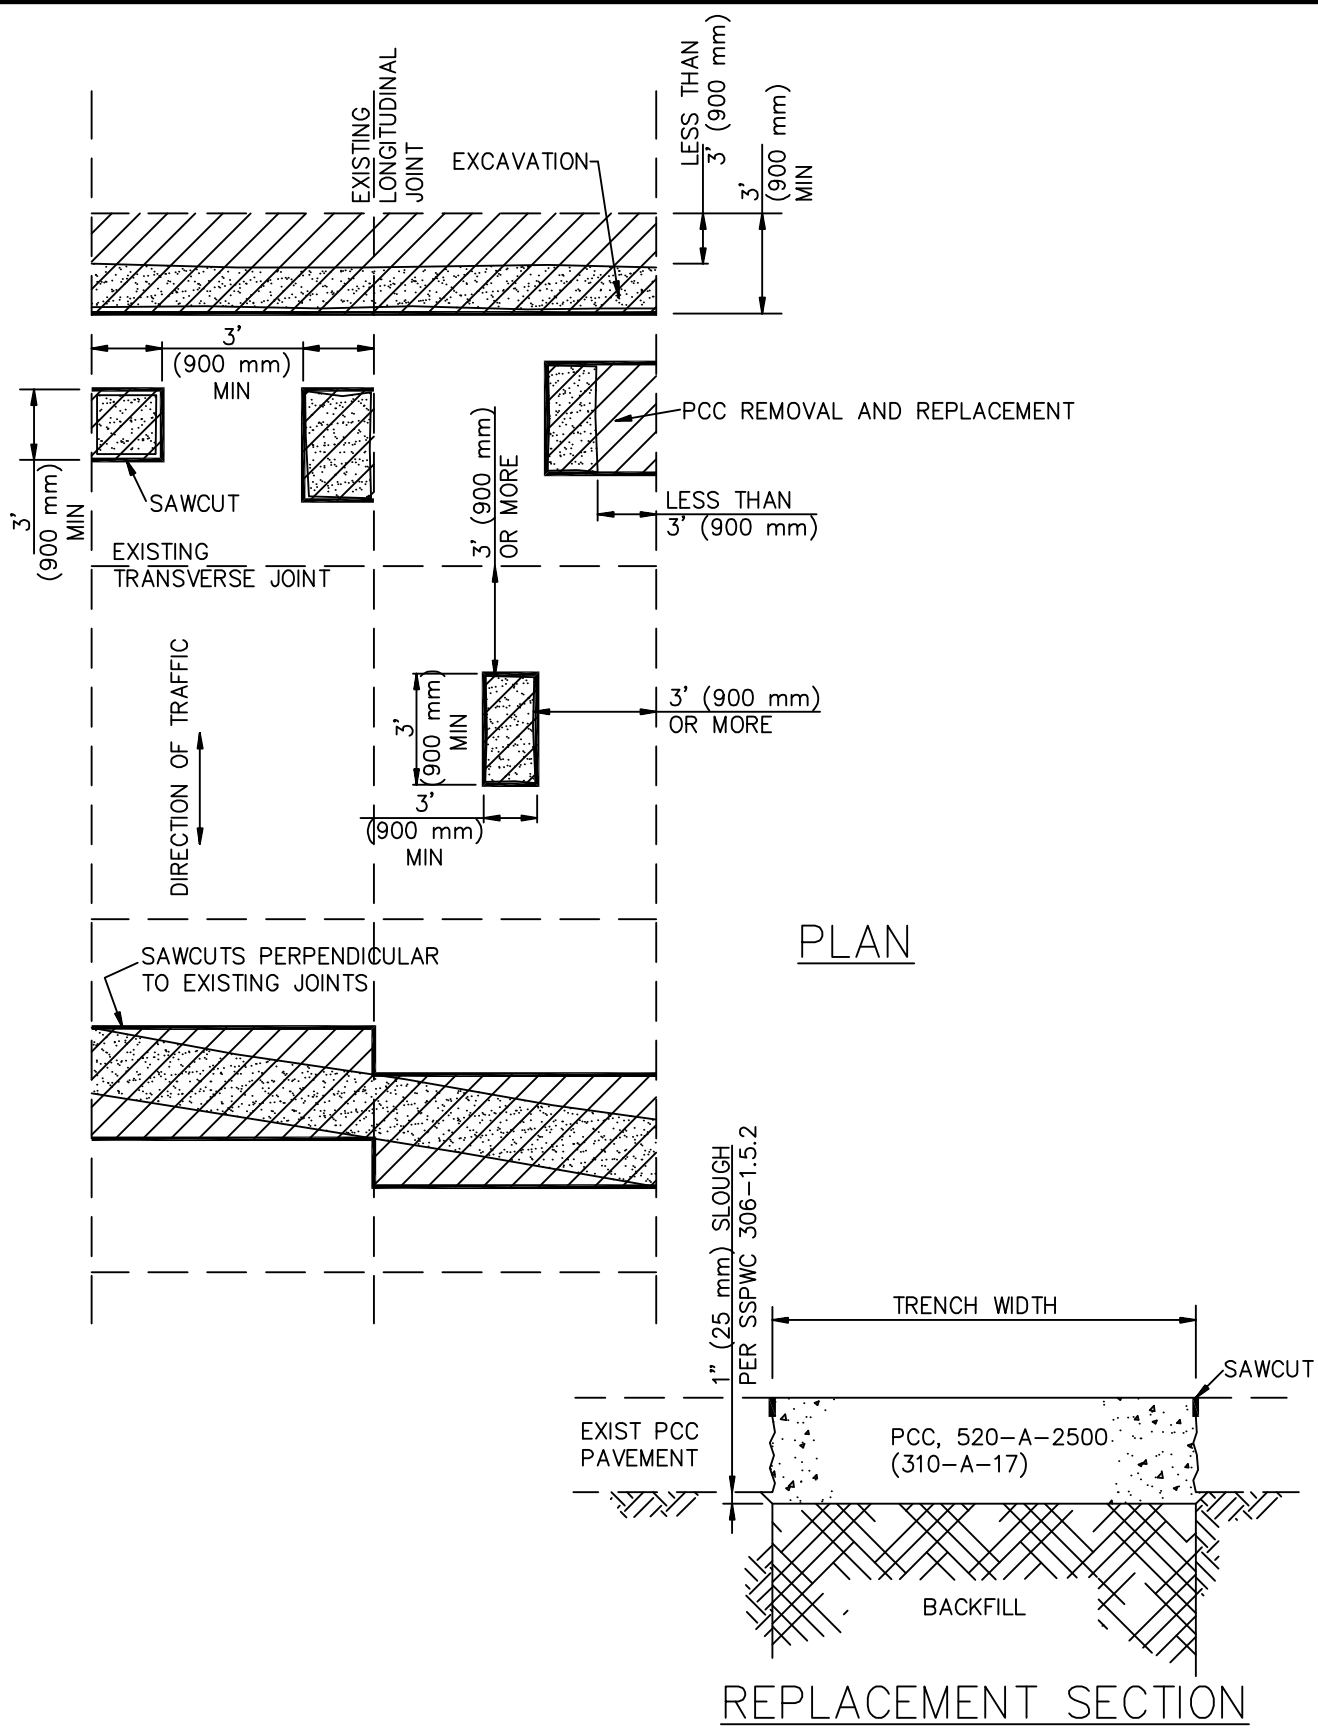

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 2005, 2009

CONCRETE PAVEMENT REPLACEMENT
USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
132-3
SHEET 1 OF 2

NOTES:

1. THE EXTENT OF REPAIRS FOR CONCRETE CUTS NOT SHOWN ON THIS STANDARD OR CUTS MADE WITHIN 3' (900 mm) OF EXISTING PATCHES, CRACKS, OR DETERIORATED SLABS SHALL BE DETERMINED BY THE ENGINEER.
2. CONCRETE PAVEMENT SHALL BE REMOVED PER SSPWC 300-1.3.
3. BACKFILL AND DENSIFICATION SHALL CONFORM TO SSPWC 306-1.3.
4. TEMPORARY RESURFACING SHALL BE PLACED PER SSPWC 306-1.5.1.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

CONCRETE PAVEMENT REPLACEMENT


STANDARD PLAN

132-3


SHEET 2 OF 2

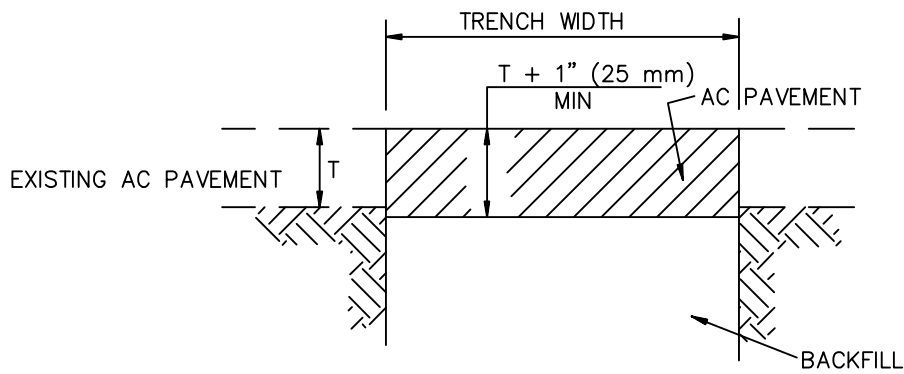

CASE I – WITHOUT BASE

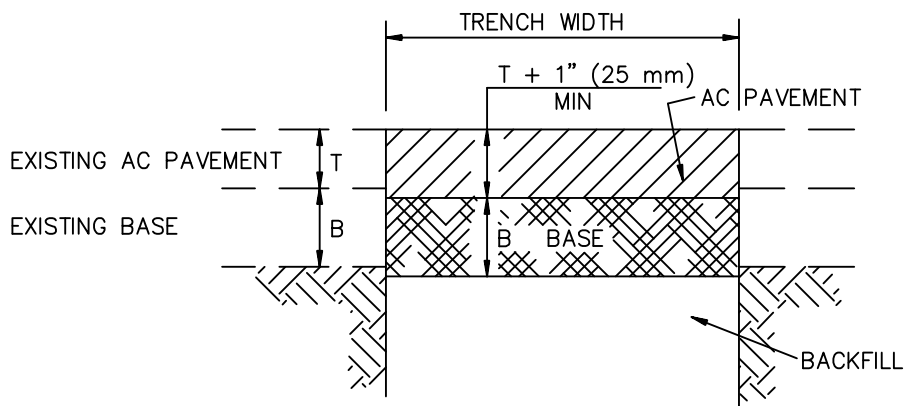

CASE II – WITH BASE

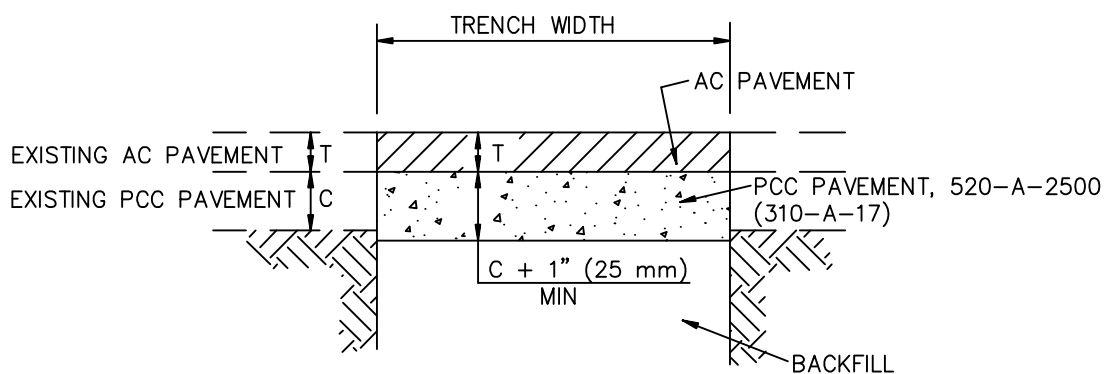

CASE III – AC PVMT ON PCC PVMT

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 2005, 2009

**ASPHALT CONCRETE PAVEMENT
REPLACEMENT**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

133-3

SHEET 1 OF 2

NOTES:

1. BACKFILL AND DENSIFICATION SHALL CONFORM TO SSPWC 306-1.3.
3. TEMPORARY RESURFACING SHALL BE PLACED PER SSPWC 306-1.5.1.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

**ASPHALT CONCRETE PAVEMENT
REPLACEMENT**


STANDARD PLAN

133-3

SHEET 2 OF 2

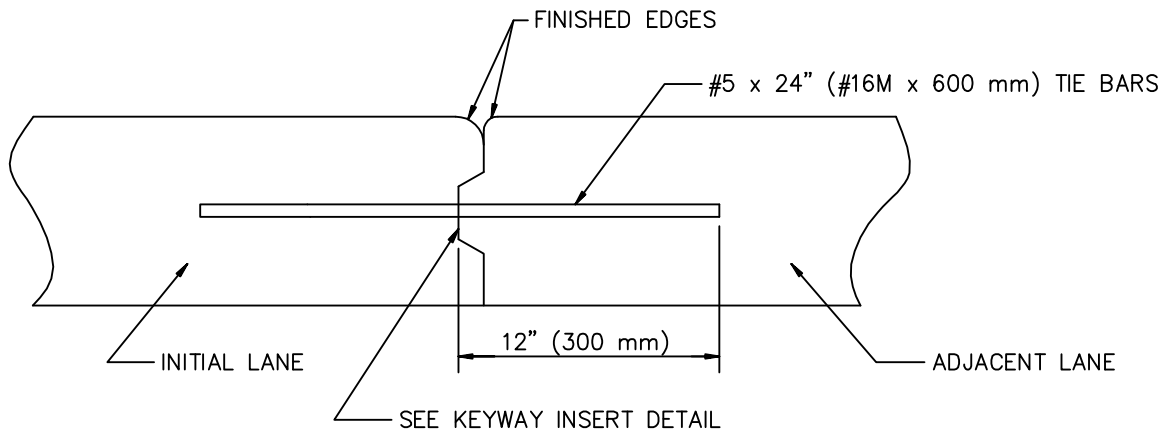

CONTACT JOINT WITH KEYWAY AND TIE BAR

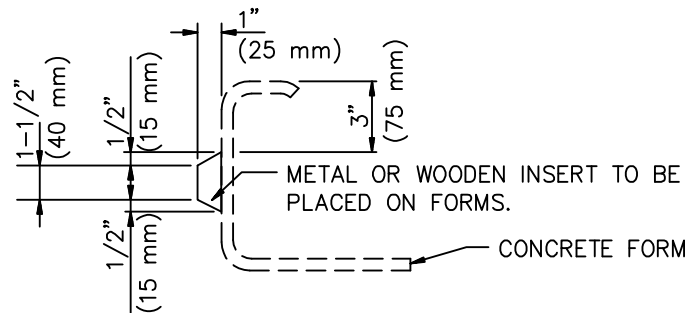

KEYWAY INSERT DETAIL

NOTES:

1. LONGITUDINAL JOINTS SHALL BE LOCATED AS SHOWN ON PLAN. CONTACT OR WEAKENED PLANE JOINTS MAY BE USED AT THE CONTRACTOR'S OPTION.
2. TRANSVERSE WEAKENED PLANE JOINTS SHALL BE CONSTRUCTED AT INTERVALS OF 15' (4500 mm) AND SHALL BE AT LEAST 5' (1500 mm) FROM ANY TRANSVERSE CONTACT JOINT. (SEE NOTE 5.)
3. TRANSVERSE CONTACT JOINTS SHALL BE CONSTRUCTED AS SHOWN HEREON AT ALL CONSTRUCTION JOINTS AND AS DIRECTED BY THE ENGINEER.
4. SPACE TIE BARS AT 36" (900 mm) ON-CENTER FOR TRANSVERSE JOINTS AND 45" (1200 mm) FOR LONGITUDINAL JOINTS. PLACE IN MIDDLE THIRD OF SLAB.
5. SEE SSPWC 302-6.5 FOR DETAILS ON CONCRETE PAVEMENT JOINTS.
6. CONSTRUCT CONTACT JOINTS IN THE APPROACH SLABS AT THE FIRST THREE TRANSVERSE JOINTS OF CONCRETE INTERSECTIONS.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2009


CONCRETE PAVEMENT JOINT DETAILS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

134-2

SHEET 1 OF 1

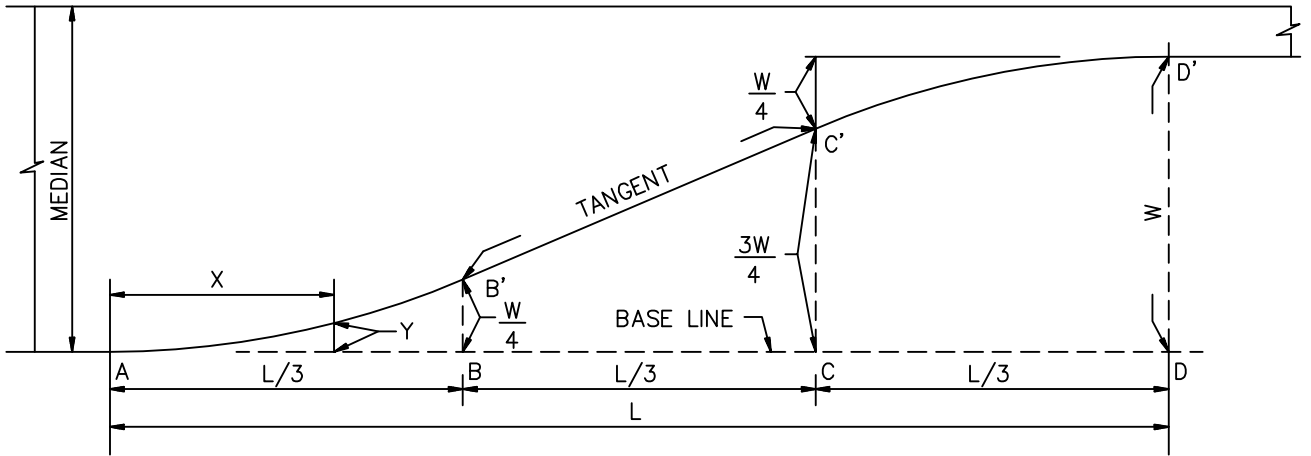

$$Y = 2.25W \left(\frac{X}{L} \right)^2$$

L=LENGTH OF TAPER
 W=MAXIMUM OFFSET DISTANCE
 X=DISTANCE ALONG BASE LINE
 Y=OFFSET FROM BASE LINE

L, ft (m)	DISTANCE X, L/12 INCREMENTS, ft (m)											
60' (18.00)	5' (1.50)	10' (3.00)	15' (4.50)	20' (6.00)	25' (7.50)	30' (9.00)	35' (10.50)	40' (12.00)	45' (13.50)	50' (15.00)	55' (16.50)	60' (18.00)
72' (21.60)	6' (1.80)	12' (3.60)	18' (5.40)	24' (7.20)	30' (9.00)	36' (10.80)	42' (12.60)	48' (14.40)	54' (16.20)	60' (18.00)	66' (19.80)	72' (21.60)
90' (27.00)	7.5' (2.25)	15' (4.50)	22.5' (6.75)	30' (9.00)	37.5' (11.25)	45' (13.50)	52.5' (15.75)	60' (18.00)	67.5' (20.25)	75' (22.50)	82.5' (24.75)	90' (27.00)
120' (36.00)	10' (3.00)	20' (6.00)	30' (9.00)	40' (12.00)	50' (15.00)	60' (18.00)	70' (21.00)	80' (24.00)	90' (27.00)	100' (30.00)	110' (33.00)	120' (36.00)
150' (45.00)	12.5' (3.75)	25' (7.50)	37.5' (11.25)	50' (15.00)	62.5' (18.75)	75' (22.50)	87.5' (26.25)	100' (30.00)	112.5' (33.75)	125' (37.50)	137.5' (41.25)	150' (45.00)
W, ft(mm)	OFFSET Y, ft (mm)											
10' (3000)	0.16' (47)	0.62' (188)	1.41' (422)	2.50' (750)	3.75' (1125)	5.00' (1500)	6.25' (1875)	7.50' (2250)	8.59' (2578)	9.38' (2812)	9.84' (2953)	10.00' (3000)
11' (3300)	0.17' (51)	0.69' (206)	1.55' (464)	2.75' (825)	4.13' (1238)	5.50' (1650)	6.88' (2063)	8.25' (2475)	9.45' (2836)	10.31' (3094)	10.83' (3249)	11.00' (3300)
12' (3600)	0.19' (56)	0.75' (225)	1.69' (506)	3.00' (900)	4.50' (1350)	6.00' (1800)	7.50' (2250)	9.00' (2700)	10.31' (3094)	11.25' (3375)	11.81' (3544)	12.00' (3600)
19' (5700)	0.30' (89)	1.19' (356)	2.67' (802)	4.75' (1425)	7.13' (2138)	9.50' (2850)	11.88' (3562)	14.25' (4275)	16.33' (4898)	17.81' (5344)	18.70' (5611)	19.00' (5700)
20' (6000)	0.31' (94)	1.25' (375)	2.81' (844)	5.00' (1500)	7.50' (2250)	10.00' (3000)	12.50' (3750)	15.00' (4500)	17.19' (5156)	18.75' (5625)	19.69' (5906)	20.00' (6000)
21' (6300)	0.33' (98)	1.31' (394)	2.95' (886)	5.25' (1575)	7.88' (2363)	10.50' (3150)	13.13' (3937)	15.75' (4725)	18.05' (5414)	19.69' (5906)	20.67' (6202)	21.00' (6300)
22' (6600)	0.34' (103)	1.38' (412)	3.09' (928)	5.50' (1650)	8.25' (2475)	11.00' (3300)	13.75' (4125)	16.50' (4950)	18.91' (5672)	20.62' (6188)	21.66' (6497)	22.00' (6600)

NOTE:

TO DETERMINE OFFSET DISTANCE FOR ANY LENGTH OF TAPER USE THE FORMULA $Y = 2.25W \left(\frac{X}{L} \right)^2$ FOR THE PORTIONS AB' AND C'D' WHICH ARE PARABOLIC CURVES. THE PORTION B'C' IS A TANGENT. WHEN THE BASE LINE IS CURVED, THE OFFSETS ARE APPLIED TO THE CURVED BASE LINE, AND B'C' IS NO LONGER A TANGENT.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1992, 1996, 2009


MEDIAN TAPER

STANDARD PLAN

140-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 1

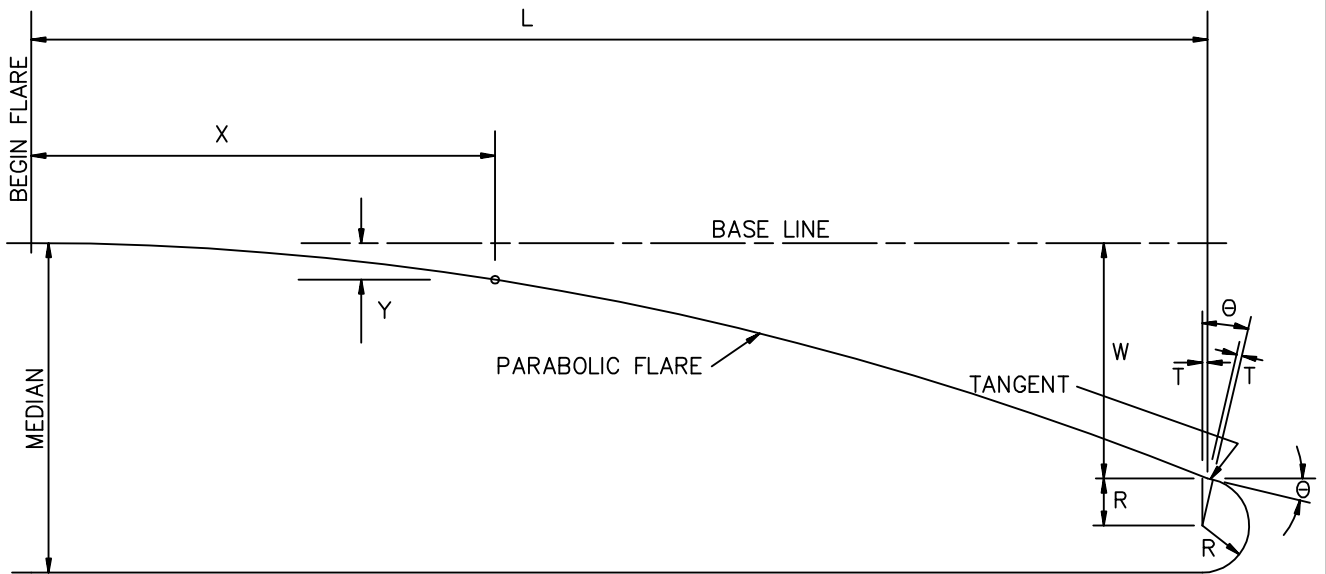

- L = LENGTH OF FLARE
- W = MAXIMUM OFFSET DISTANCE
- X = DISTANCE ALONG BASE LINE
- Y = OFFSET FROM BASE LINE
- T = TANGENT LENGTH
- R = RADIUS OF NOSE
- θ = MAXIMUM FLARE DEFLECTION ANGLE

$$Y = W \left(\frac{X}{L} \right)^2$$

$$\tan \theta = \frac{2W}{L}$$

$$T = R \tan \frac{\theta}{2}$$

IF STATION OF RADIUS POINT IS NOT GIVEN ON PLAN, TANGENT DISTANCE T MAY BE IGNORED

OFFSET Y, ft (mm)

L, ft (m)	W, ft (mm)	X, ft (m)													
		10' (3.0)	15' (4.5)	20' (6.0)	25' (7.5)	30' (9.0)	40' (12.0)	45' (13.5)	50' (15.0)	60' (18.0)	70' (21.0)	75' (22.5)	80' (24.0)	90' (27.0)	100' (30.0)
W/L = 1:5															
25' (7.5)	5' (1500)	0.80' (240)	1.80' (540)	3.20' (960)	5.00' (1500)										
50' (15.0)	10' (3000)	0.40' (120)	0.90' (270)	1.60' (480)	2.50' (750)	3.60' (1080)	6.40' (1920)	8.10' (2430)	10.00' (3000)						
W/L = 1:10															
50' (15.0)	5' (1500)	0.20' (60)	0.45' (135)	0.80' (240)	1.25' (375)	1.80' (540)	3.20' (960)	4.05' (1215)	5.00' (1500)						
100' (30.0)	10' (3000)	0.10' (30)	0.23' (68)	0.40' (120)	0.63' (188)	0.90' (270)	1.60' (480)	2.03' (608)	2.50' (750)	3.60' (1080)	4.90' (1470)	5.63' (1688)	6.40' (1920)	8.10' (2430)	10.00' (3000)
W/L = 1:15															
45' (13.5)	3' (900)	0.15' (44)	0.33' (100)	0.59' (178)	0.93' (278)	1.33' (400)	2.37' (711)	3.00' (900)							
75' (22.5)	5' (1500)	0.09' (27)	0.20' (60)	0.36' (107)	0.56' (167)	0.80' (240)	1.42' (427)	1.80' (540)	2.22' (667)	3.20' (960)	4.36' (1307)	5.00' (1500)			
90' (27.0)	6' (1800)	0.07' (22)	0.17' (50)	0.30' (89)	0.46' (139)	0.67' (200)	1.19' (356)	1.50' (450)	1.85' (555)	2.67' (800)	3.63' (1089)	4.17' (1250)	4.74' (1422)	6.00' (1800)	

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009



MEDIAN FLARE

STANDARD PLAN


141-2

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


SHEET 1 OF 1

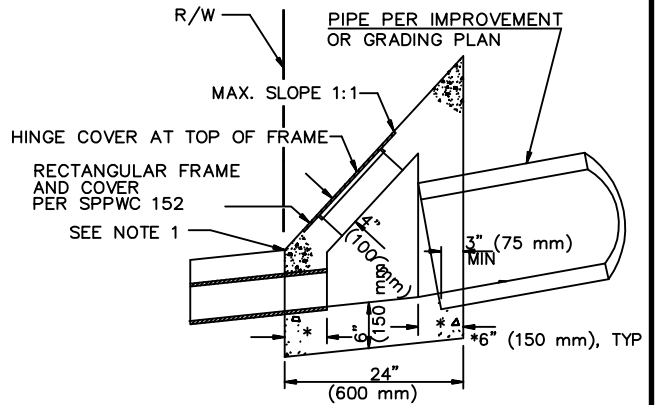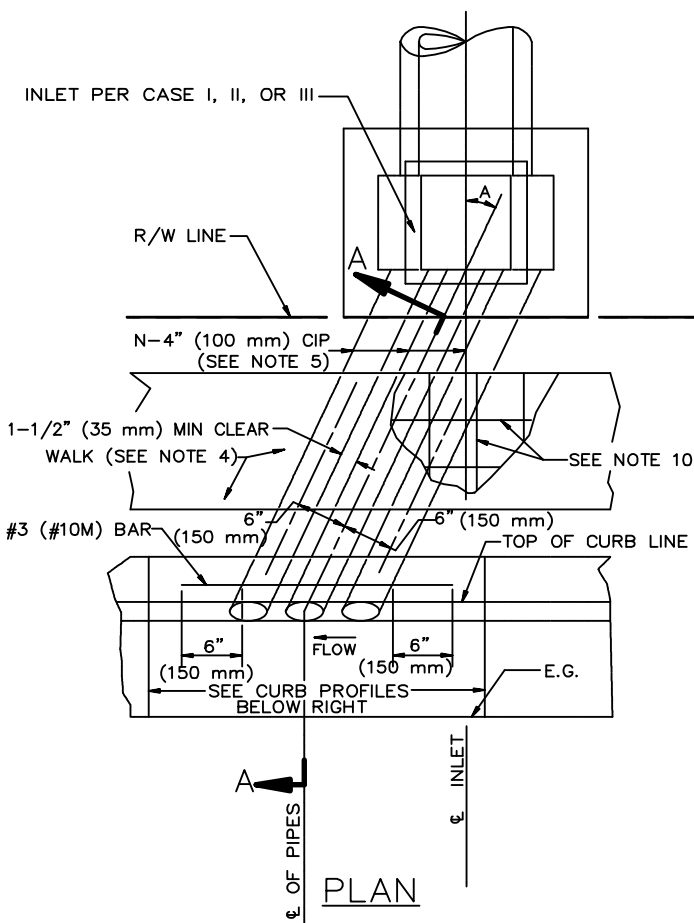



CASE I INLET
TRANSITION STRUCTURE SECTION

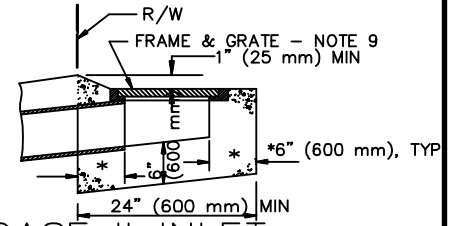


CASE II INLET
DROP INLET CATCH BASIN SECTION

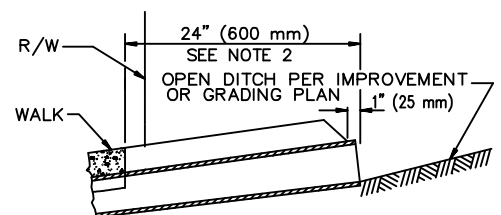

CASE III INLET
GRADED DITCH SECTION

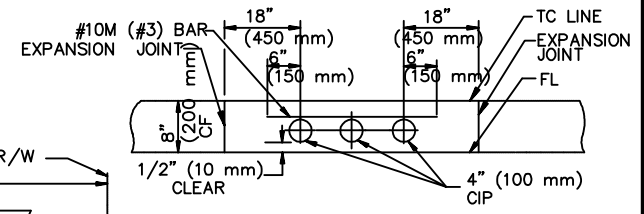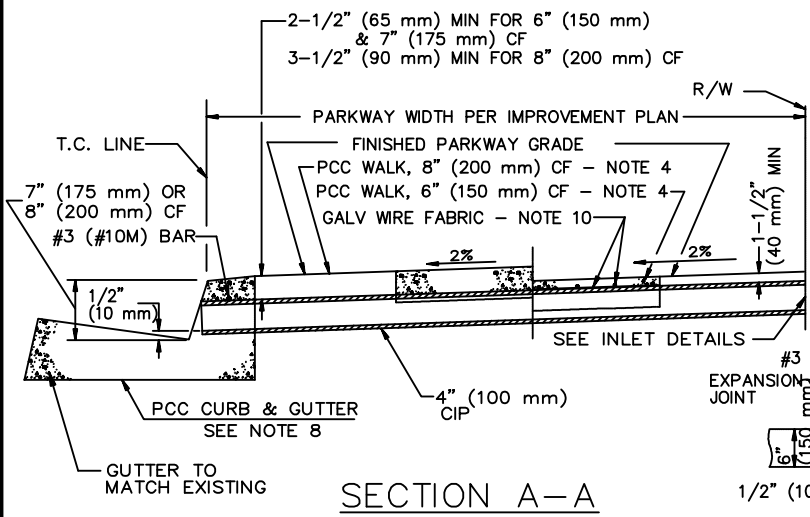

CURB PROFILE
8" (200 mm) CURB FACE

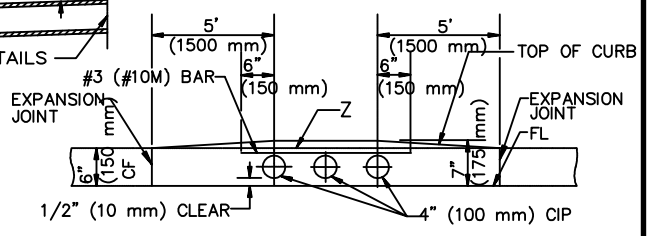

CURB PROFILE
6" (150 mm) CURB FACE

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1992, 1996, 2009


CURB DRAIN

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
150-3
SHEET 1 OF 2

NOTES

1. IF THE TOP OF SLOPE IS ALLOWED WITHIN THE R/W, INLET CASE I BEGINS AT THE TOP RATHER THAN THE R/W LINE.
2. FOR OPEN DITCH (CASE INLET III), THE 24" (600 mm) EXTENSION BEYOND THE R/W LINE IS NOT REQUIRED WHEN BACK OF WALK IS 24" (600 mm) OR MORE FROM THE R/W LINE; HOWEVER, PIPE SHALL EXTEND TO R/W LINE.
3. TOP OF INLET STRUCTURE (CASE I AND II) TO BE FLUSH WITH ADJACENT SURFACE WHERE PRACTICAL.
4. CONSTRUCT PCC WALK WHEN SPECIFIED ON PLANS. THE CONTRACT PRICE PAID FOR PCC WALK ITEM SHALL INCLUDE WALK CONSTRUCTED IN CONJUNCTION WITH PARKWAY CULVERT.
5. "N" EQUALS NUMBER OF PIPES (MAXIMUM OF THREE) AS SPECIFIED ON PLANS.
6. INLET CASE TO BE SPECIFIED ON PLANS.
7. ANGLE A EQUALS 0°, UNLESS OTHERWISE SPECIFIED.
8. TYPE, DIMENSIONS AND ELEVATIONS OF P.C.C. CURB AND GUTTER PER PLANS.
9. UNLESS OTHERWISE SPECIFIED, FRAME AND GRATE FOR CASE II INLET SHALL BE GALVANIZED CAST IRON. WEIGHT OF FRAME AND GRATE SHALL BE 80 LBS (36 kg).
10. AT LOCATIONS WITH LESS THAN 8" (200 mm) CURB FACE, USE 6x6-10/10 (152x152-MW9.1xMW9.1) GALVANIZED WIRE FABRIC. WIRE FABRIC SHALL EXTEND 8" (200 mm) BEYOND THE EDGE OF CAST IRON PIPES.

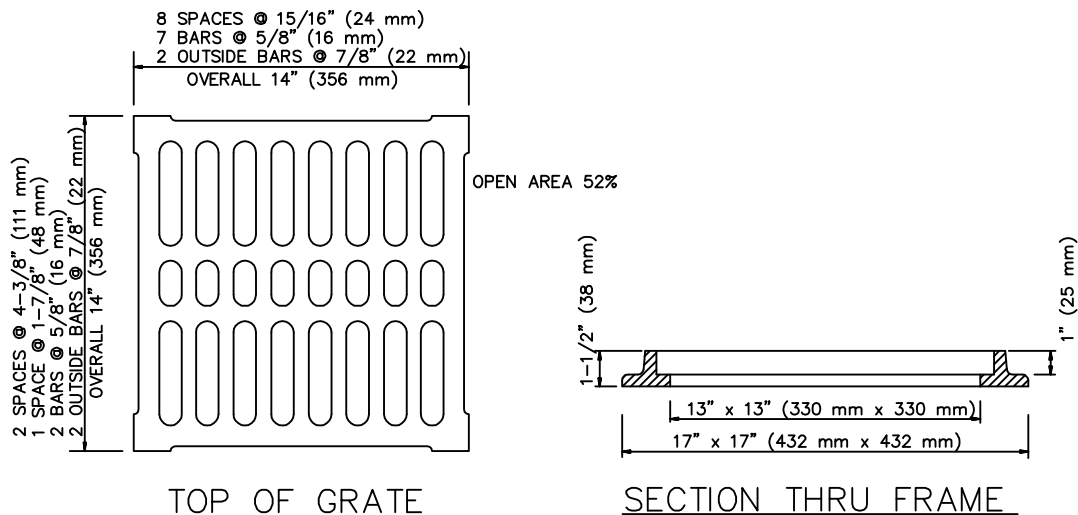

GRATE FOR CASE II INLET

NOTES

1. FLOOR OF BOX SHALL BE TROWELED SMOOTH.
2. IF THE TOE OF SLOPE IS ALLOWED WITHIN THE R/W, INLET TYPE 1 BEGINS AT THE TOE RATHER THAN AT THE R/W LINE.
3. FOR OPEN DITCH (TYPE 2), THE 24" (600 mm) EXTENSION BEYOND THE R/W LINE IS NOT REQUIRED WHEN BACK OF WALK IS 24" (600 mm) OR MORE FROM THE R/W LINE; HOWEVER, THE PIPE SHALL EXTEND TO THE R/W LINE IN ANY EVENT.
4. TOP OF INLET STRUCTURE (TYPE 1 & 2) SHALL BE FLUSH WITH ADJACENT SURFACE WHERE PRACTICAL.
5. A HEADED STEEL STUD 5/8" x 6-3/8" WITH A 1" HEAD (16 x 160 mm, 25 mm HEAD) ATTACHED BY A FULL PENETRATION BUTT WELD MAY BE USED AS AN ALTERNATE ANCHOR.
6. NORMAL CURB FACE AT POINT M AND Q. CURB FACE IS B + 5" (125 mm) AT POINT N AND P.
7. THE 3" (75 mm) LEG OF THE 5/8" (16 mm) DIA ANCHORS SHALL BE PARALLEL TO THE TOP OF SIDEWALK.
8. SLOPE = 2.0%.








STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PARKWAY DRAIN

151-2

SHEET 2 OF 2

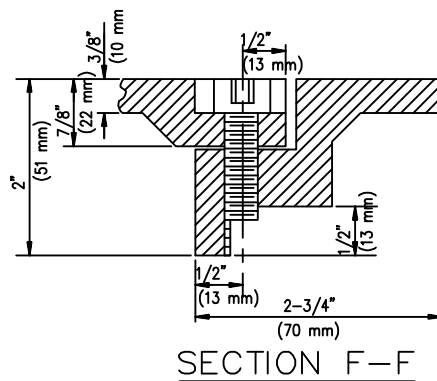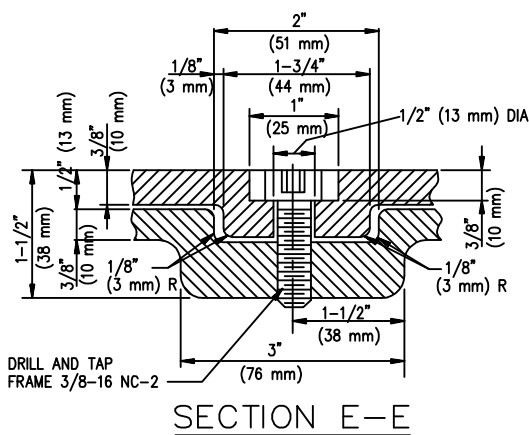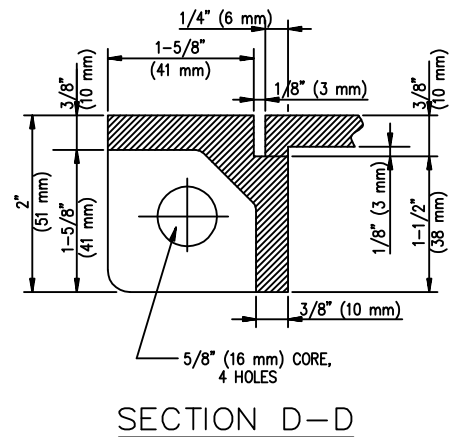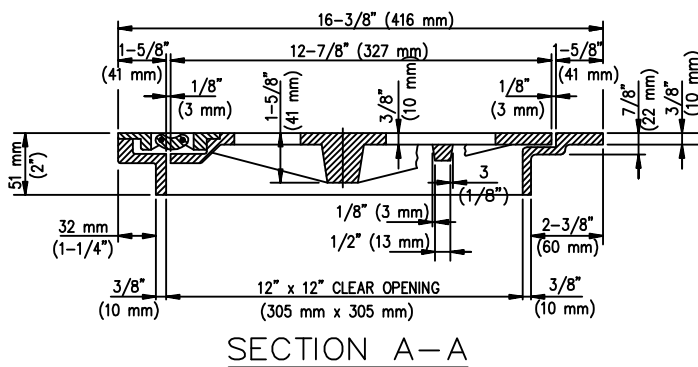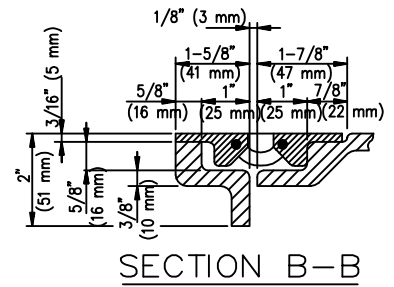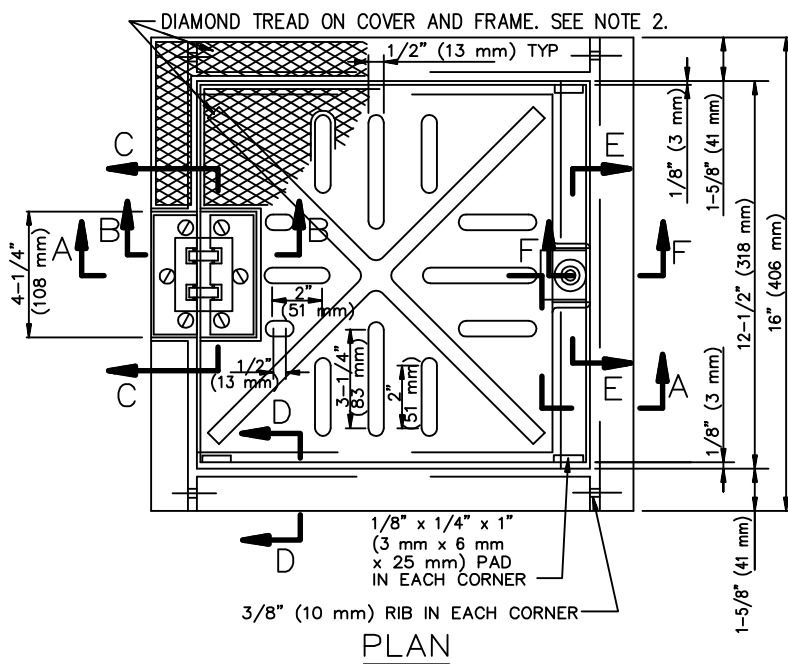

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2009

RECTANGULAR FRAME AND COVER

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

152-2

SHEET 1 OF 2

NOTES

1. FRAME AND COVER SHALL BE CAST IRON.
2. A PLAIN 1/4" (6 mm) BORDER SHALL BE TYPICAL FOR ALL BORDERS ON FRAME AND COVER.
3. ALL CASTING RADII SHALL BE 1/4" (6 mm) UNLESS OTHERWISE SHOWN.
4. WEIGHT OF FRAME AND COVER SHALL BE 43 LBS (19.5 kg).
5. USE ONE 3/8"-16x1" STAINLESS STEEL SOCKET CAP SCREW. APPLY HIGH ADHESIVE, OPEN GEAR GREASE TO THREADED PORTION PRIOR TO INSERTION.
6. USE 4" x 4" (102 mm x 102 mm) CAST ALUMINUM LINK HINGE WITH SST PIN FOR 180° OPENING.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

RECTANGULAR FRAME AND COVER


STANDARD PLAN

152-2


SHEET 2 OF 2

SECTION 2


Sewers and Sanitation

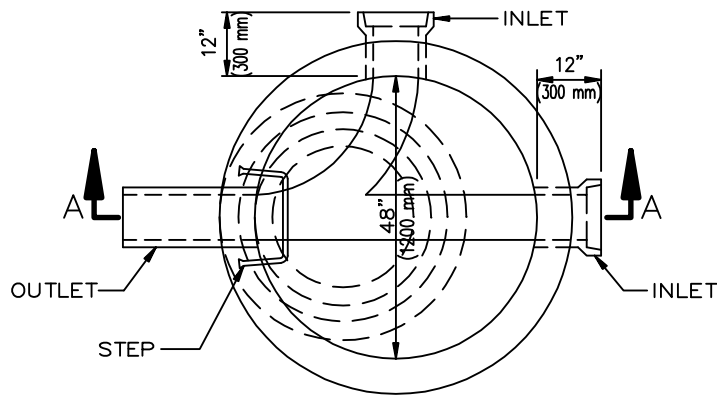


PLAN
SHOWING BASE

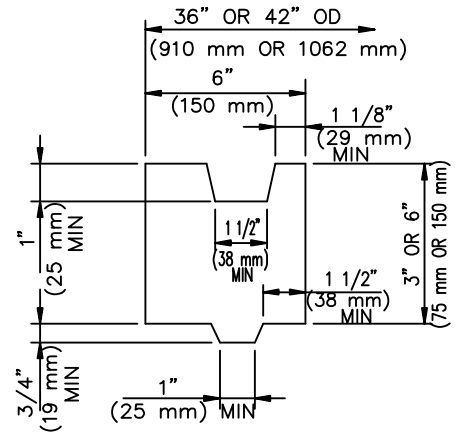


ADJUSTING RING DETAIL

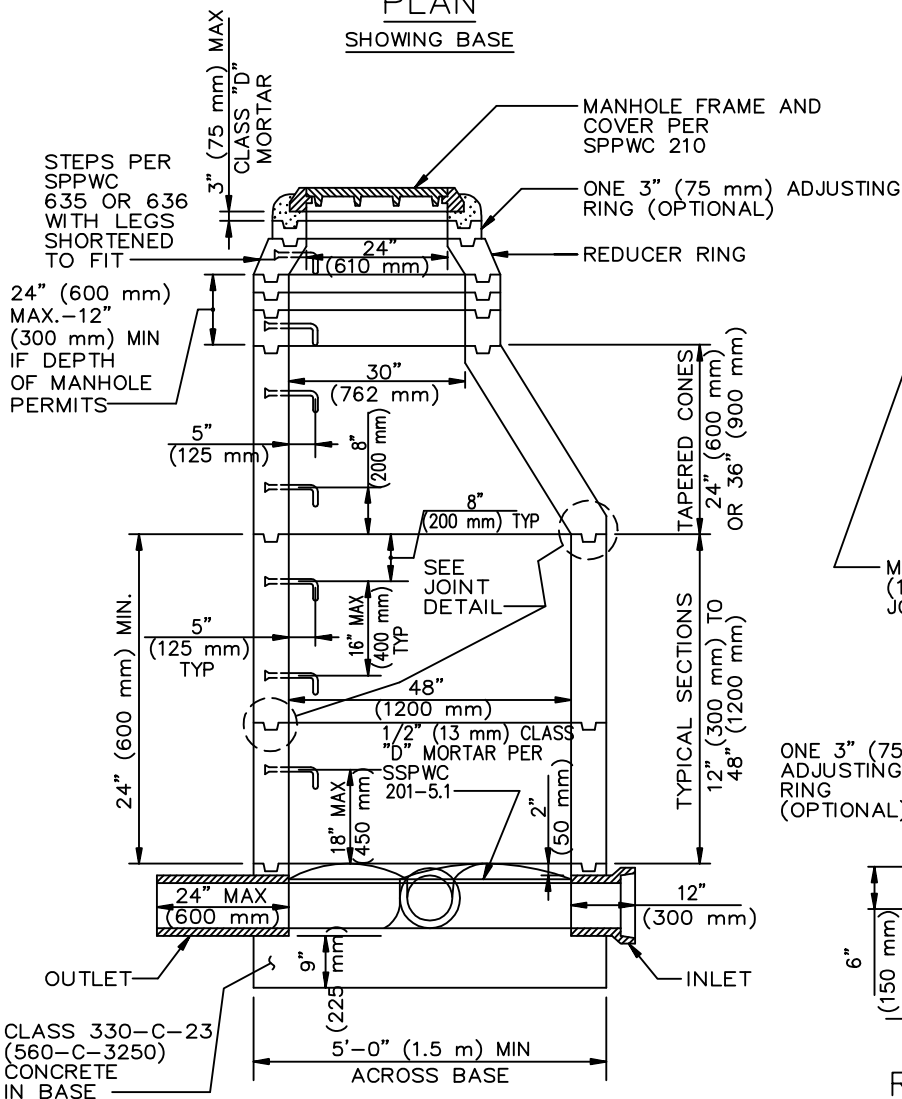

SECTION A-A

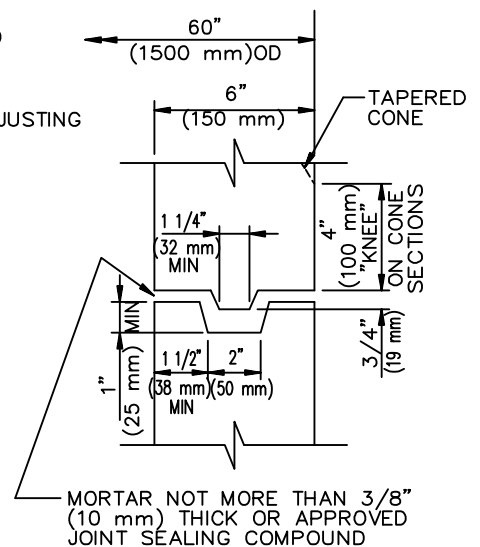

JOINT DETAIL
NON-REINFORCED

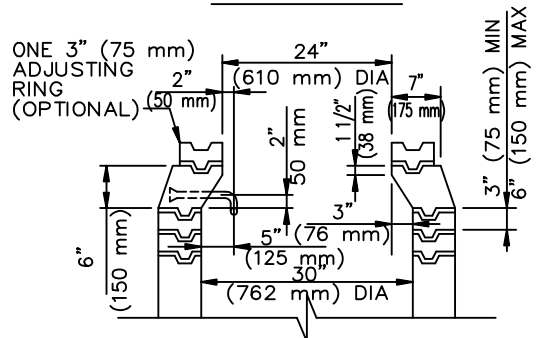

REDUCER RING AND ADJUSTING RINGS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1993, 1995, 2009

**PRECAST CONCRETE
SEWER MANHOLE**

STANDARD PLAN

200-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 2

NOTES:

1. EXCEPT AS NOTED HEREON, THE PRECAST UNITS SHALL BE MANUFACTURED AND TESTED IN ACCORDANCE WITH ASTM C 478. AS AN ALTERNATE CURING METHOD, THE UNITS MAY BE CURED USING SATURATED STEAM FOR A MINIMUM OF 12 HOURS FOLLOWED BY 6 DAYS OF WATER CURING OR MEMBRANE CURING. IF THE UNITS ARE CURED BY THE ALTERNATE METHOD, THEY SHALL NOT BE SHIPPED PRIOR TO 8 DAYS AFTER CASTING NOR UNTIL THE CONCRETE HAS ATTAINED A STRENGTH OF 3500 PSI (25 MPa).
2. MANHOLE STEPS SHALL CONFORM TO SPPWC 635 TYPE 1 OR 3 OR SPPWC 636. THE MANHOLE STEPS SHALL BE UNIFORMLY SPACED AT A MAXIMUM OF 16" (400 mm). THE LOWEST STEP SHALL BE PLACED NOT LESS THAN 8" (200 mm) NOR MORE THAN 18" (450 mm) ABOVE THE SHELF. THE STEPS SHALL PROJECT 5" (125 mm) INSIDE THE MANHOLE.
3. RISER SECTIONS MAY BE REINFORCED OR UNREINFORCED. REINFORCED SECTIONS SHALL BE REINFORCED IN ACCORDANCE WITH ASTM C 478 AND SHALL HAVE A MINIMUM WALL THICKNESS OF 5" (125 mm). UNREINFORCED RISER SECTIONS SHALL HAVE A MINIMUM WALL THICKNESS OF 6" (150 mm).
4. THE 24"x48" (600 mm x 1200 mm) ECCENTRIC CONES MAY BE REINFORCED OR UNREINFORCED. IF REINFORCED, THE WALL THICKNESS SHALL BE NOT LESS THAN 5" (125 mm). IF UNREINFORCED, THE WALL THICKNESS SHALL NOT BE LESS THAN 6" (150 mm).
5. JOINTS SHALL BE TONGUE AND GROOVE. JOINTS FOR REINFORCED STRUCTURES SHALL CONFORM WITH ASTM C 478 SECTION 14.
6. PRECAST UNITS SHALL BE ASSEMBLED USING CLASS "B" MORTAR.
7. IF 30" (762 mm) DIAMETER MANHOLE FRAME AND COVER IS REQUIRED, IT SHALL BE INSTALLED WHERE THE REDUCER RING IS SHOWN IN THE SECTION.
8. FOR REINFORCED PRECAST STRUCTURES, ALL REINFORCEMENT SHALL HAVE A MINIMUM OF 2" (50 mm) OF COVER OVER THE STEEL ON THE INSIDE FACE.
9. THE TOP OPENING OF THE MANHOLE AND THE STEPS SHALL BE PLACED DIRECTLY OVER THE OUTLET OF THE STRUCTURE EXCEPT AS OTHERWISE NOTED ON PLANS.
10. CONCRETE BASE AND STUB WALLS SHALL BE POURED IN ONE OPERATION TO A POINT 2" (50 mm) ABOVE THE INLET AND OUTLET PIPES. ALL PIPES SHALL BE RIGIDLY SUPPORTED BY TEMPORARY PIERS OR OTHER METHODS DURING THE OPERATION. CONCRETE SHALL SET FOR 24 HOURS BEFORE PLACING PRECAST UNITS.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION


**PRECAST CONCRETE
SEWER MANHOLE**

STANDARD PLAN

200-3


SHEET 2 OF 2

FRAME & COVER PER SPPWC 632

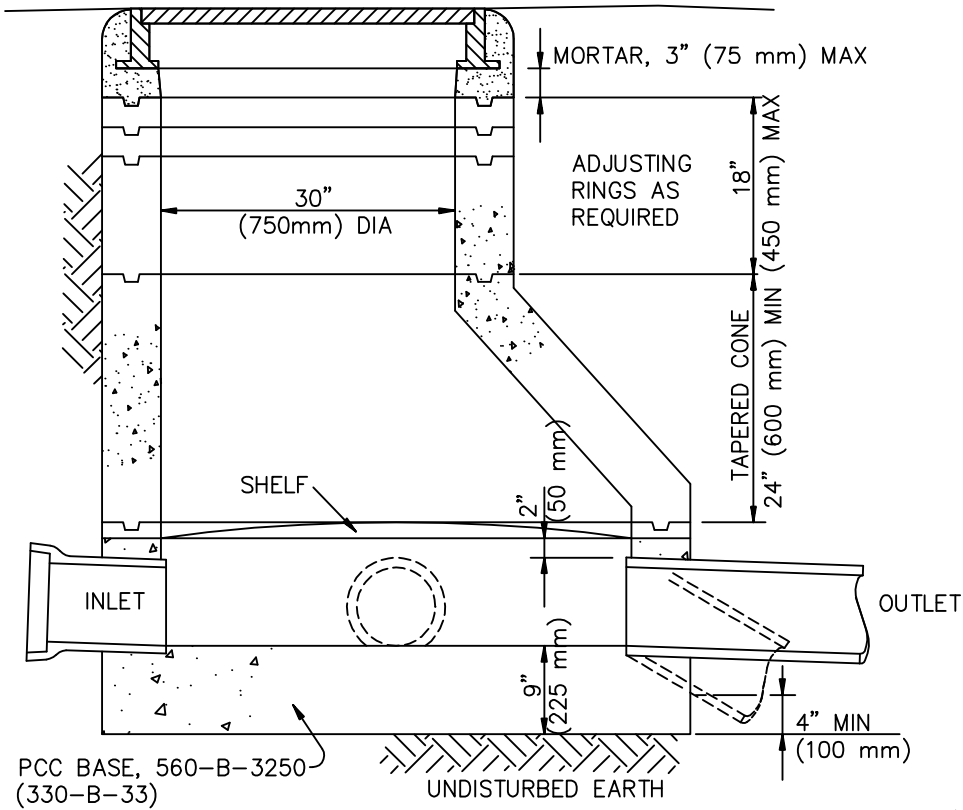


SECTION A-A

BASE MAY BE SQUARE OR ROUND

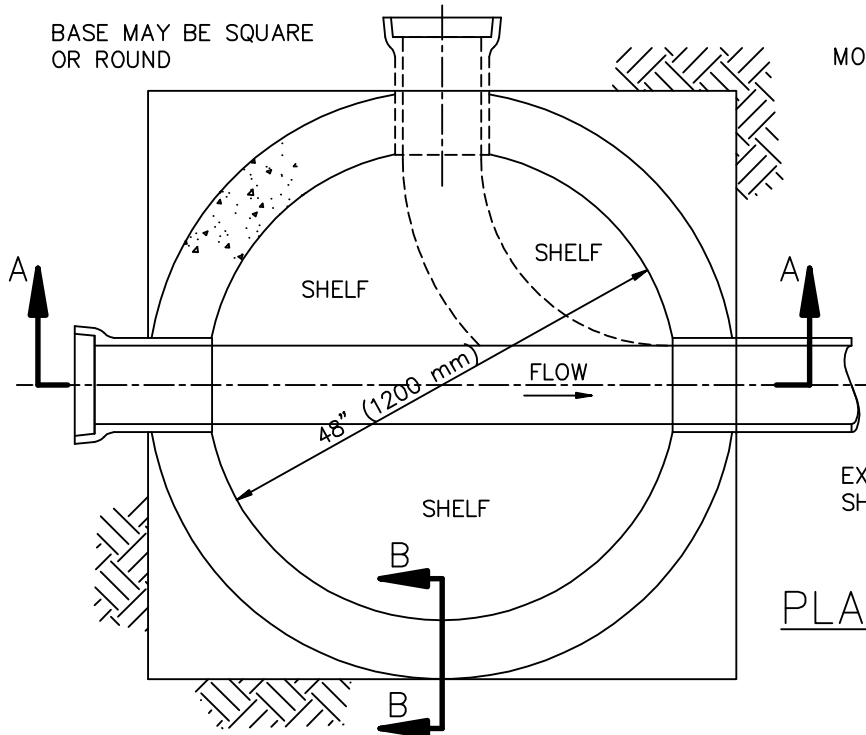

PLAN

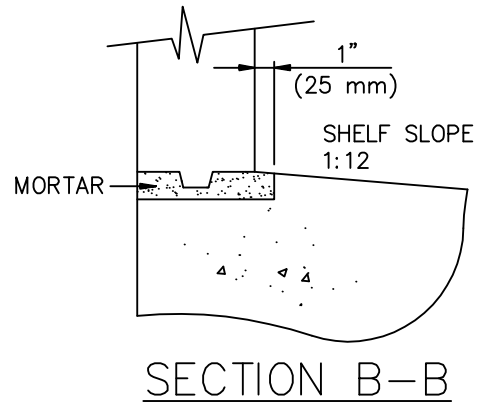

SECTION B-B

EXCEPT AS SHOWN HEREON, MANHOLES SHALL CONFORM TO SPPWC 200.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1994
REV. 2005, 2009


PRECAST CONCRETE SHALLOW MANHOLE

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

201-2

SHEET 1 OF 1

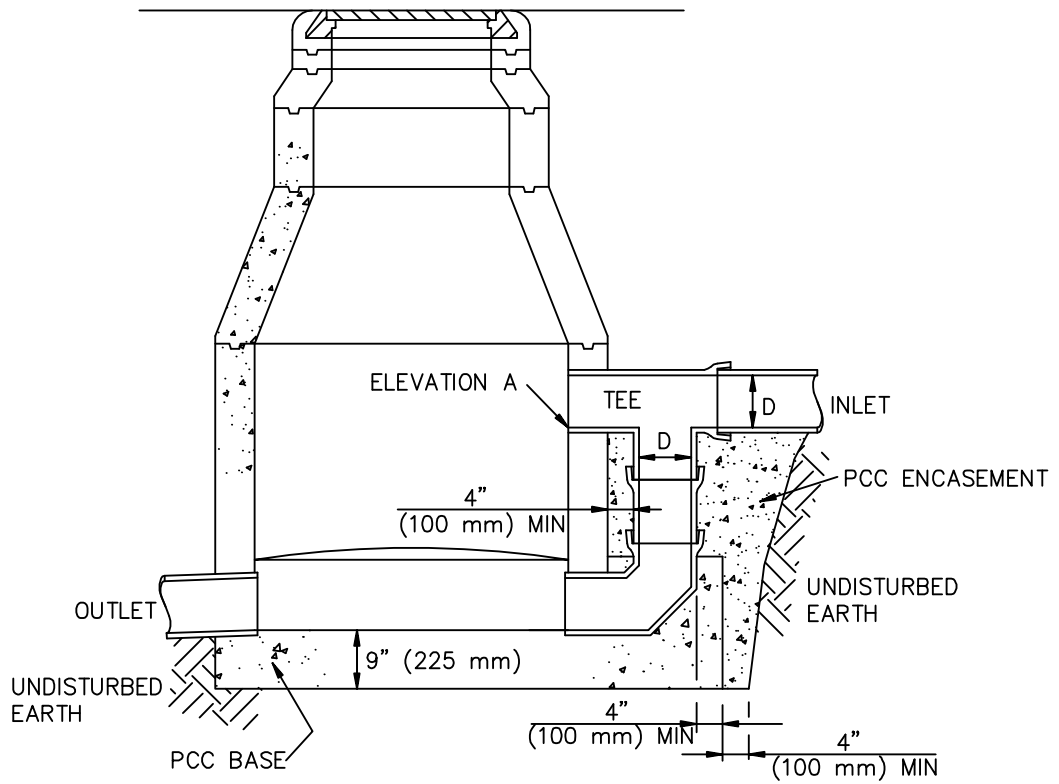

SECTION A-A

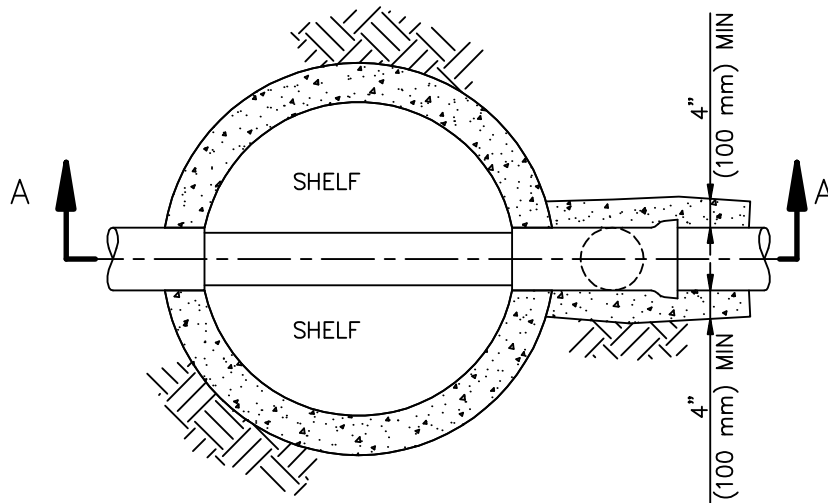

PLAN

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 2005, 2009

DROP SEWER MANHOLE

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

202-2

SHEET 1 OF 2

NOTES:

1. EXCEPT AS SHOWN ON THIS PLAN, MANHOLES SHALL CONFORM TO SPPWC 200 OR 203.
2. PIPE FOR THE DROP INLET SHALL BE THE SAME MATERIAL AS THE SEWER UNLESS APPROVED ADAPTERS ARE USED. IF SO, THE PIPE MAY BE VCP, ABS SOLID WALL, ABS COMPOSITE, PVC PLASTIC, OR POLYETHELYNE.
3. FOR BRICK MANHOLES, A BRICK ARCH IS ALSO REQUIRED OVER THE UPPER INLET PIPE.
4. IF TWO OR MORE DROP INLETS ARE REQUIRED IN A SINGLE MANHOLE, EACH SHALL BE CONSTRUCTED SEPARATELY.




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

DROP SEWER MANHOLE

STANDARD PLAN

202-2

SHEET 2 OF 2

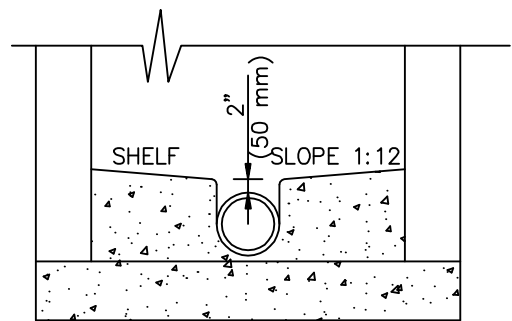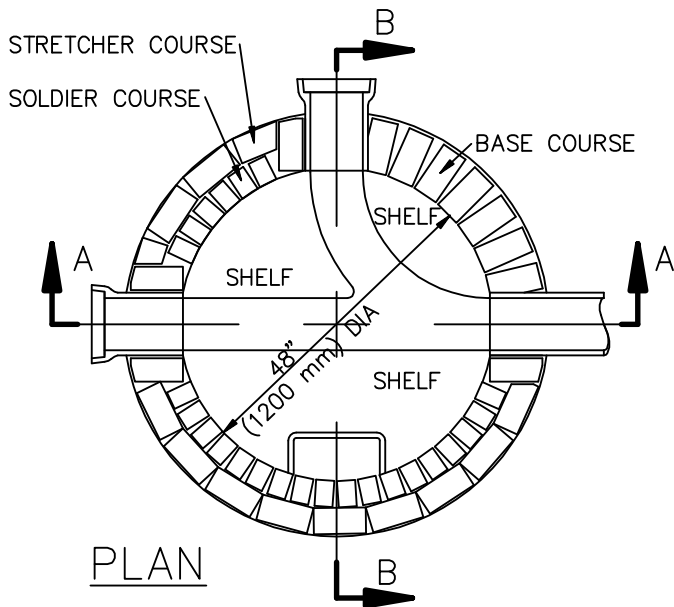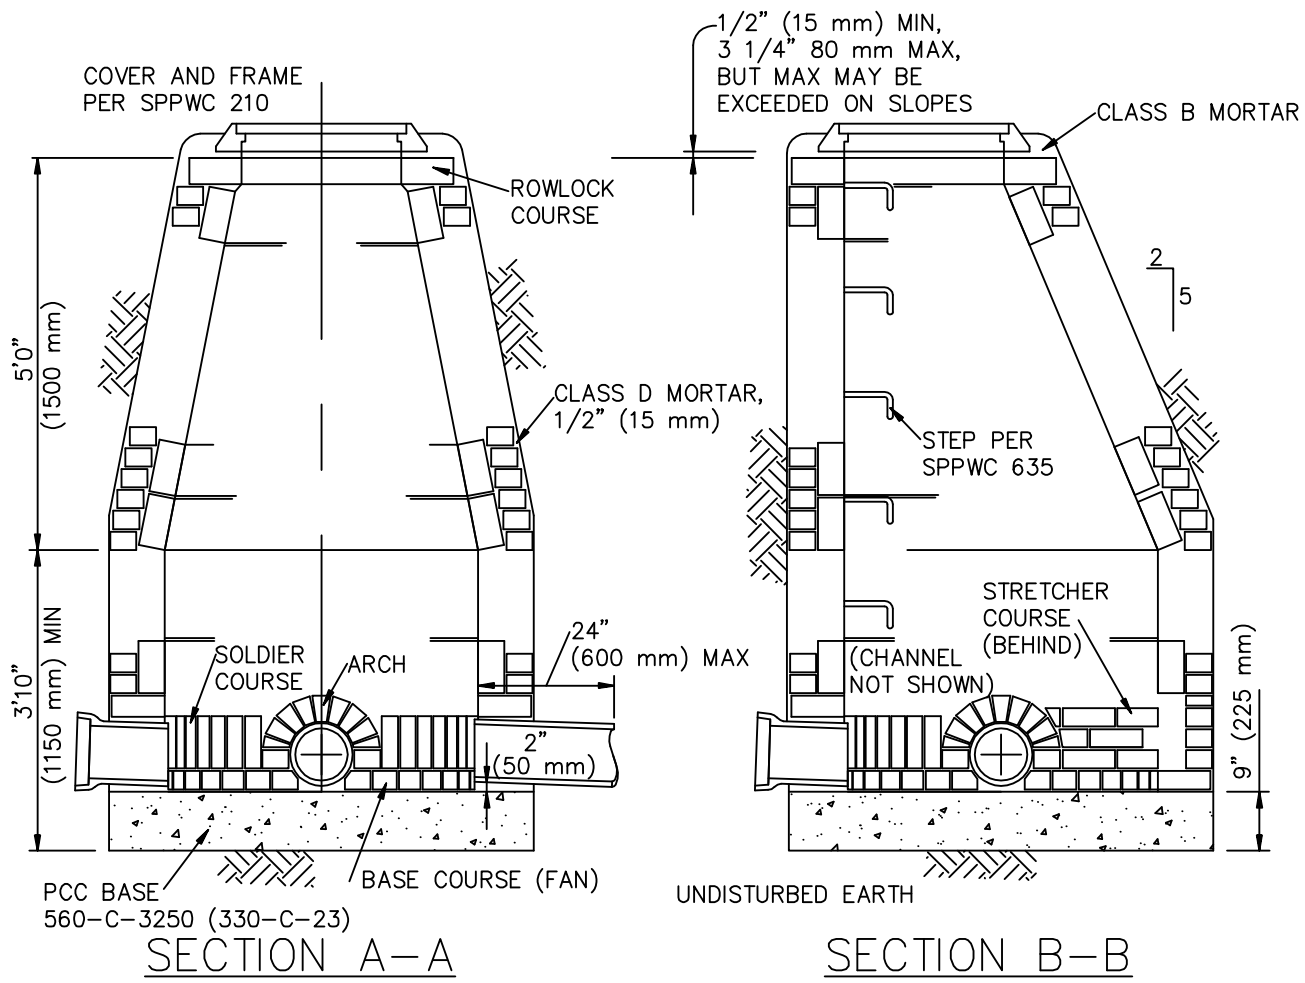

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 2005, 2009

BRICK SEWER MANHOLE

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

203-2


SHEET 1 OF 2

NOTES:


1. CONCRETE BASE: DURING CONSTRUCTION, ALL PIPES SHALL BE RIGIDLY SUPPORTED BY BRICK PIERS 12" (300 mm) DEEP, LOCATED JUST OUTSIDE THE STRUCTURE. CONSTRUCT TOP OF CONCRETE BASE 2" (50 mm) BELOW INVERT OF LOWEST PIPE. FILL SPACE BENEATH PIPE WITH MORTAR AND SHOVE FROM BOTH SIDES WITH BASE COURSE BRICK TO FORM A WATER-TIGHT JOINT.
2. BASE OF FAN COURSE: LAY BRICK FLAT ON RADIAL LINES WITH TOPS TO SAME LEVEL.
3. ARCHES: LAY SPALLED BRICK ON EDGE TO FORM A TRUE RADIAL ARCH WITH FULL MORTAR JOINT AROUND ALL PIPE OPENINGS. TURN ARCH OF TWO SUCH COURSES OVER PIPES 15" (375 mm) OR MORE IN DIAMETER.
4. SOLDIER COURSES: LAY INSIDE BRICK ON RADIAL LINES WITH FIRST FOUR COURSES VERTICAL. LAY SUCCEEDING COURSES WITH A UNIFORM BATTER TO OBTAIN AN INSIDE DIAMETER OF 24" (600 mm) AT TOP OF LAST OR FRACTIONAL SOLDIER COURSE. USE SPLIT BRICK TO CLOSE SOLDIER COURSE.
5. STRETCHER COURSES: LAY OUTSIDE BRICK FLAT IN A DEEP BED OF MORTAR. SHOVE BRICK TOGETHER AGAINST ADJACENT SOLDIER COURSE.
6. ROWLOCK COURSE: LAY LAST COURSE OF BRICK ON EDGE ACROSS SOLDIER AND STRETCHER COURSES ON RADIAL LINES, WITH TOPS PARALLEL AND 4 1/2" (120 mm) BELOW FINISHED GRADE.
7. JOINTS: INSIDE JOINTS SHALL BE NEATLY STRUCK AND SHALL NOT EXCEED 3/8" (10 mm) IN THICKNESS.
8. STEPS: MANHOLE STEPS SHALL CONFORM WITH SPPWC 635 TYPE 3. THE TOP STEP SHALL BE PLACED JUST UNDER THE MANHOLE FRAME. THE LOWEST STEP SHALL BE PLACED BETWEEN 8" (200 mm) AND 24" (600 mm) ABOVE THE SHELF.
9. WALL THICKNESS: BRICKWORK SHALL BE 8" (200 mm) THICK TO A DEPTH OF 22' (6.5 m). BRICKWORK BELOW 22' (6.5 m) DEEP SHALL BE 12" (300 mm) THICK.
10. A FLEXIBLE JOINT SHALL BE INSTALLED AT THE FIRST JOINT FROM MANHOLE FOR ALL CONNECTIONS EXCEPT THOSE WITH REINFORCED CONCRETE PIPE.

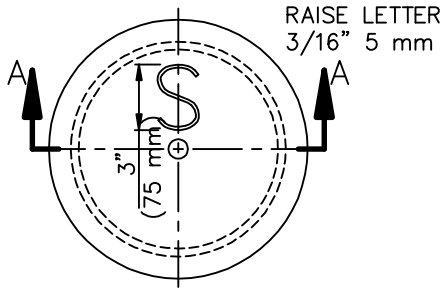


ACCESS COVER

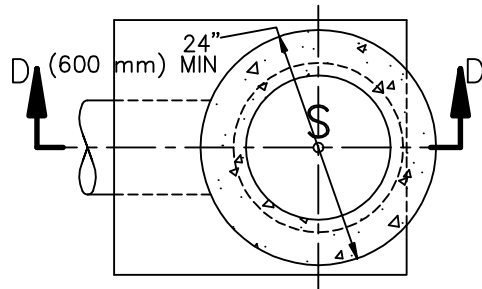


PLAN

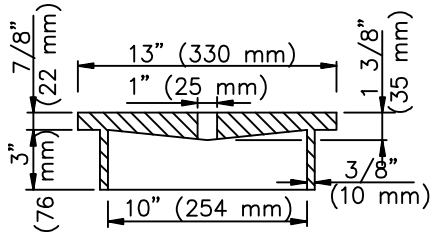



SECTION A-A

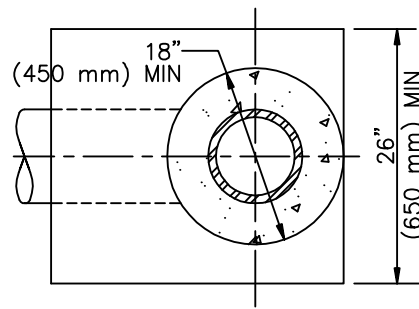


SECTION C-C

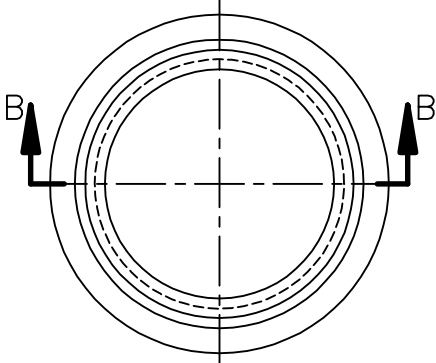

ACCESS FRAME

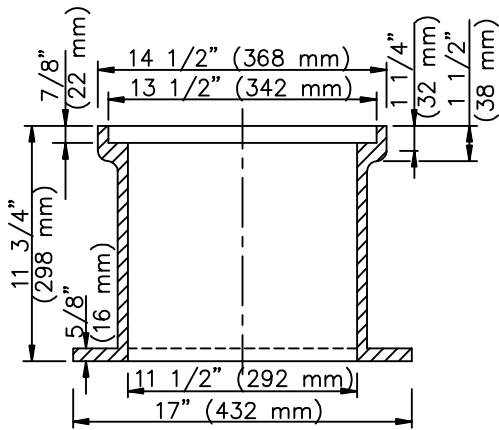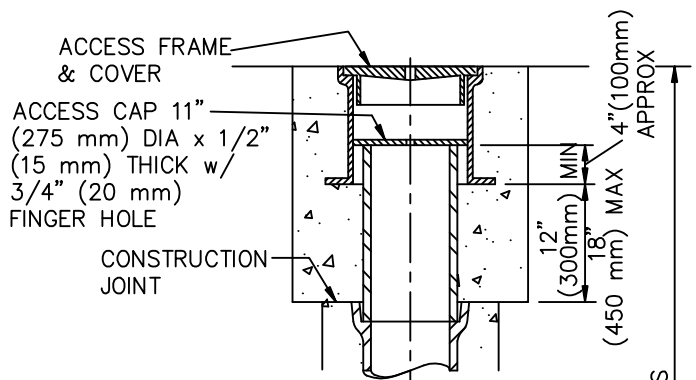

SECTION B-B

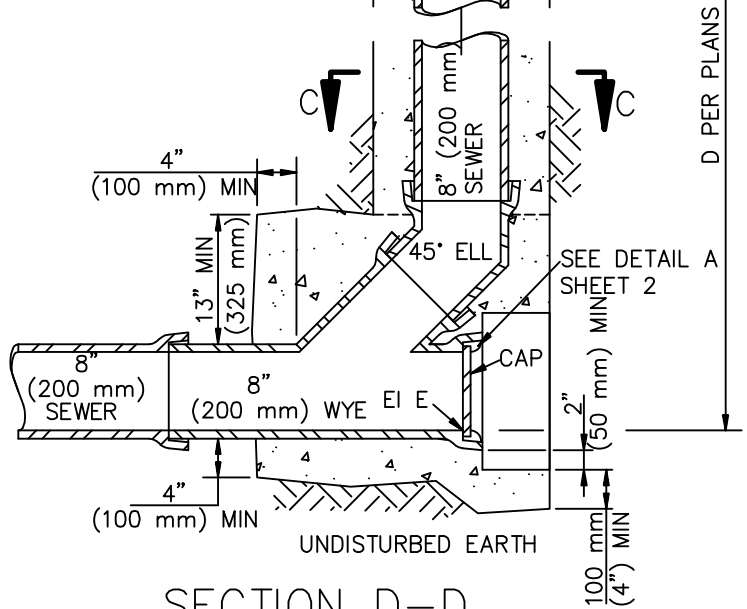

SECTION D-D

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 2005, 2009


TERMINAL CLEANOUT STRUCTURE

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

204-2

SHEET 1 OF 2

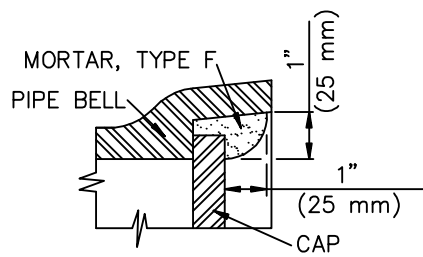

DETAIL A

NOTES:

1. SEE PLANS FOR VALUES OF DIMENSION D AND ELEVATION E.
2. PIPE AND FITTINGS, UNLESS OTHERWISE NOTED, SHALL BE OF THE SAME MATERIALS AS THE SEWER, UNLESS APPROVED ADAPTORS ARE USED, AND MAY BE ANY OF THE FOLLOWING:
 - A. VC PIPE
 - B. PE PIPE
 - C. ABS SOLID WALL PIPE
 - D. ABS COMPOSITE PIPE
 - E. PVC PLASTIC PIPE
3. PIPE AND FITTINGS SHALL BE BEDDED AND ENCASED IN PCC AS SHOWN. PCC SHALL BE CLASS 450-C-2000(265-C-14). JOIN AND ALIGN PIPE AND FITTINGS BEFORE PLACING CONCRETE. MAINTAIN ALIGNMENT WHILE PLACING AND ALLOWING PCC TO SET.
4. THE ACCESS FRAME, COVER AND CAP SHALL BE CAST IRON. THE FINGER HOLES MAY BE DRILLED OR BLOCKED OUT PRIOR TO CASTING. THEY SHALL NOT BE PUNCHED OUT.
5. THE CONTRACTOR MAY PLACE EITHER CIRCULAR OR SQUARE CONCRETE PIPE WALL SUPPORTS.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

TERMINAL CLEANOUT STRUCTURE


STANDARD PLAN

204-2


SHEET 2 OF 2

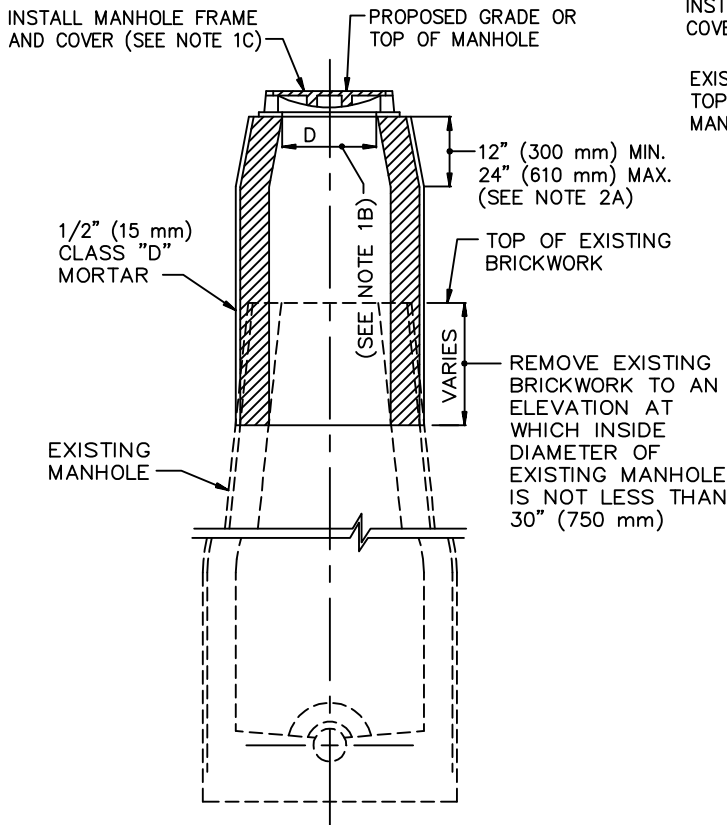


RAISING EXISTING BRICK MANHOLES

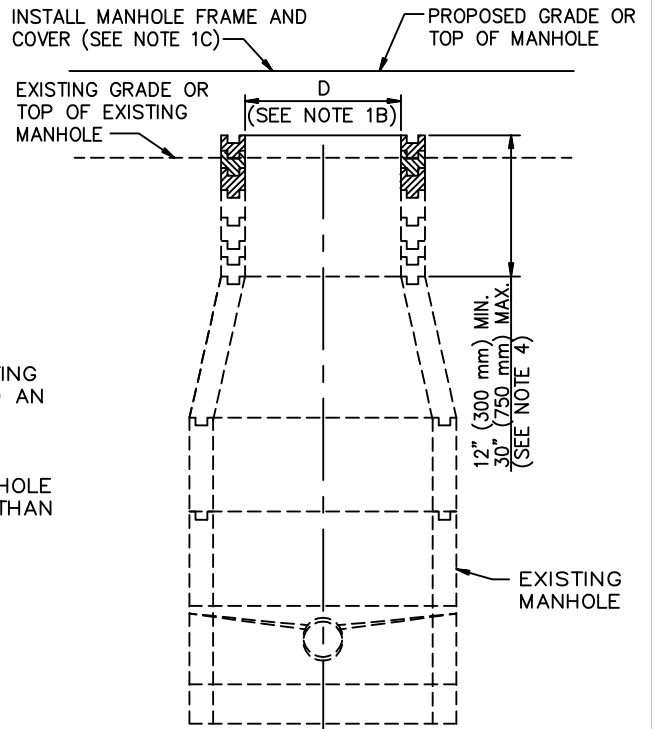

RAISING EXISTING PRECAST CONCRETE SEWER MANHOLES

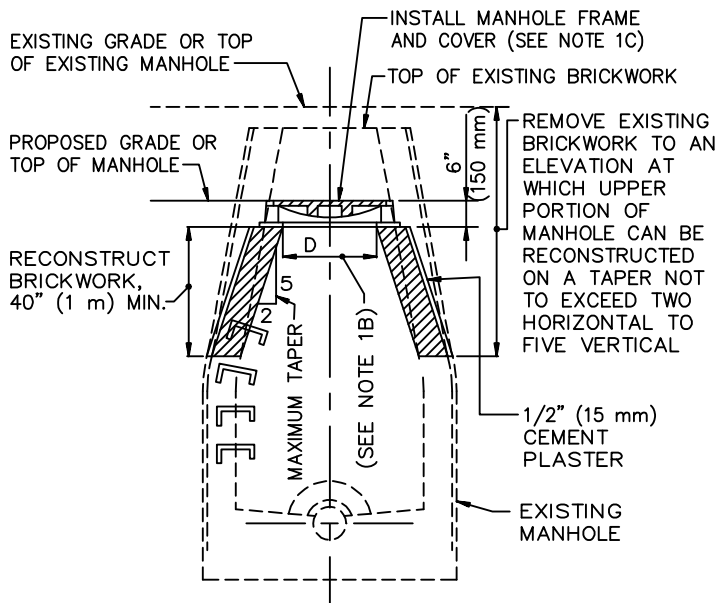

LOWERING EXISTING BRICK MANHOLES

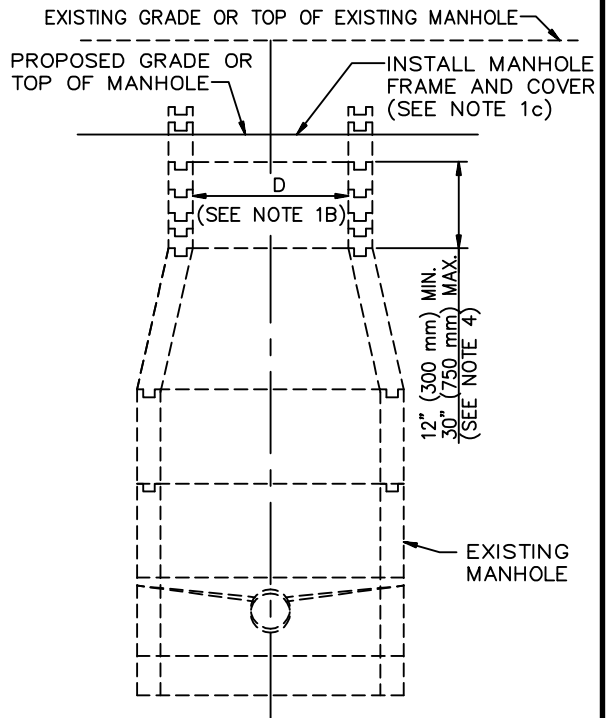

LOWERING EXISTING PRECAST CONCRETE SEWER MANHOLES

BRICK MANHOLES

PRECAST CONCRETE SEWER MANHOLES

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARD, INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

SEWER MANHOLE ADJUSTMENT

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

205-2

SHEET 1 OF 3

NOTES:

1. GENERAL

- A. EXCEPT AS INDICATED HEREON OR ON THE PLANS, MANHOLES SHALL CONFORM TO: SPPWC 200, PRECAST CONCRETE SEWER MANHOLE AND SPPWC 203, BRICK SEWER MANHOLE.
- B. DIMENSION "D" SHALL BE THE SAME AS THE SIZE OF MANHOLE FRAME AND COVER TO BE USED.
- C. THE CONTRACTOR MAY REUSE THE EXISTING MANHOLE FRAME AND COVER, UNLESS DAMAGED DURING THE WORK OR WHEN OTHERWISE SHOWN IN THE CONTRACT DOCUMENTS. ITEMS DAMAGED BY THE CONTRACTOR SHALL BE REPLACED WITH IDENTICAL NEW ITEMS AT NO EXPENSE TO THE AGENCY.
- D. EXISTING STEPS LOCATED WITHIN REMOVAL LIMITS SHALL BE REPLACED. WHEN REMOVAL OF EXISTING STEPS BEYOND THE MANHOLE REMOVAL LIMITS IS SHOWN ON THE PLANS, THE STEPS SHALL BE REMOVED TO A DEPTH OF 2" (50 mm) BEYOND THE INSIDE FACE OF THE BRICK MANHOLE AND THE HOLES SHALL BE FILLED WITH CLASS "D" MORTAR.

2. RAISING EXISTING BRICK MANHOLES

- A. BRICK MANHOLES TO BE RAISED LESS THAN 1' (300 mm) MAY BE EXTEND VERTICALLY, PROVIDED THAT AT A DEPTH OF 2 1/2' (750 mm) BELOW THE TOP OF THE MANHOLE AT ITS NEW ELEVATION, THE INSIDE DIAMETER OF THE MANHOLE IS 30" (750 mm) OR GREATER.
- B. BRICK MANHOLES TO BE RAISED LESS THAN 3 1/2" (90 mm) MAY BE RAISED BY APPLYING CLASS "D" MORTAR TO THE TOP OF THE EXISTING BRICKWORK. IF THE BRICK MANHOLE IS TO BE RAISED 3 1/2" (90 mm) OR MORE, A NEW COURSE OR COURSES OF BRICKWORK SHALL BE PLACED ON TOP OF THE EXISTING BRICKWORK.

3. LOWERING EXISTING BRICK MANHOLES

- A. WHERE A BRICK MANHOLE IS TO BE LOWERED LESS THAN 1' (300 mm), THE FRAME MAY BE RESET ON THE EXISTING BRICKWORK AND THE 40" (1 m) MINIMUM BRICKWORK RECONSTRUCTION OMITTED, PROVIDED THAT THE BASE OF THE FRAME DOES NOT OVERHANG THE BRICKWORK ON THE INSIDE SURFACE OF THE MANHOLE MORE THAN AN AVERAGE OF 1 1/2" (35 mm) IN ANY QUADRANT NOR MORE THAN 2" (50 mm) AT ANY POINT.

4. RAISING EXISTING PRECAST CONCRETE SEWER MANHOLES

- A. PRECAST CONCRETE MANHOLES TO BE RAISED LESS THAN 3" (75 mm) MAY BE RAISED BY APPLYING CLASS "D" MORTAR TO THE TOP OF THE EXISTING MANHOLE, PROVIDED THE TOTAL HEIGHT OF MORTAR, EXISTING AND NEWLY APPLIED, DOES NOT EXCEED 3" (75 mm).
- B. WHERE THE PRECAST CONCRETE MANHOLE IS TO BE RAISED 3" (75 mm) OR MORE, OR WHERE THE TOTAL HEIGHT OF MORTAR, EXISTING AND NEWLY APPLIED, WOULD EXCEED 3" (75 mm), GRADE RINGS SHALL BE UTILIZED. CLASS "D" MORTAR MAY BE USED FOR FINAL ADJUSTMENT, BUT NOT MORE THAN 3" (75 mm) IN HEIGHT. WHERE RAISING THE MANHOLE WOULD RESULT IN THE UPPER SEGMENT OF THE SHAFT BEING MORE THAN 30" (750 mm) IN HEIGHT, REMOVE THE REDUCER AND THE UPPER SEGMENT OF THE SHAFT, INSTALL ADDITIONAL RINGS OR PIPE TO THE LOWER SEGMENT OF THE SHAFT, AND REINSTALL THE REDUCER AND GRADE RINGS AS REQUIRED.


5. LOWERING EXISTING PRECAST CONCRETE SEWER MANHOLES

- A. REMOVE SUFFICIENT GRADE RINGS TO LOWER THE MANHOLES AS REQUIRED, APPLY CLASS "D" MORTAR TO A HEIGHT NOT EXCEEDING 3" (75 mm) FOR ADJUSTMENT TO FINAL GRADE.
- B. WHERE REMOVAL OF GRADE RINGS WOULD RESULT IN THE UPPER SEGMENT OF THE SHAFT BEING LESS THAN 12" (300 mm) IN HEIGHT, REMOVE THE REDUCER AND SUFFICIENT SECTIONS OF THE LOWER SEGMENT OF THE SHAFT AND REINSTALL ANY NECESSARY SEGMENT OF THE LOWER SHAFT, THE REDUCER, AND THE GRADE RINGS TO CONFORM TO THE REQUIREMENTS OF THIS PLAN.
- C. EXISTING GRADE RINGS NEED NOT BE REMOVED IF EXISTING MORTAR IS REMOVED, AND AT LEAST 1 1/2" (35 mm) OF MORTAR MAY BE PLACED ON TOP OF THE EXISTING GRADE RINGS TO RESEAT THE FRAME.

6. REPLACEMENT OF BRICK REDUCER WITH PRECAST CONCRETE REDUCER AND SHAFT UNLESS OTHERWISE INDICATED ON THE PLANS, THE CONTRACTOR MAY INSTALL A PRECAST CONCENTRIC CONCRETE REDUCER, CONCRETE GRADE RINGS, AND CONCRETE PIPE IN LIEU OF RECONSTRUCTING A BRICK REDUCER, PROVIDED:


- A. THE MAXIMUM ID OF SEWER PIPE CONNECTED TO THE MANHOLE DOES NOT EXCEED 8" (200 mm).
- B. THE CONTRACTOR SECURES PRIOR APPROVAL FROM THE ENGINEER TO INSTALL THE CONCENTRIC REDUCER ONTO THE MANHOLE SHAFT. THE ENGINEER MAY, AS PART OF THE INSTALLATION REQUIREMENTS, REQUIRE THE CONTRACTOR TO COAT THE INSIDE OF THE REDUCER, RINGS, AND PIPE WITH AN APPROVED COATING.
- C. THE CONCRETE GRADE RINGS, THE CONCRETE REDUCER, AND ANY CONCRETE PIPE SHALL BE JOINED TOGETHER AND BEDDED ONTO THE EXISTING BRICK MANHOLE WITH CLASS "D" MORTAR. THE DEPTH, WIDTH, AND THICKNESS OF THE MORTAR SHALL BE OF SUFFICIENT DIMENSIONS TO PROPERLY AND ADEQUATELY JOIN AND BED THE COMPONENT PARTS.

RAISING RINGS TO BE MADE OF STEEL, ASTM DESIGNATION AT MERCHANT QUALITY

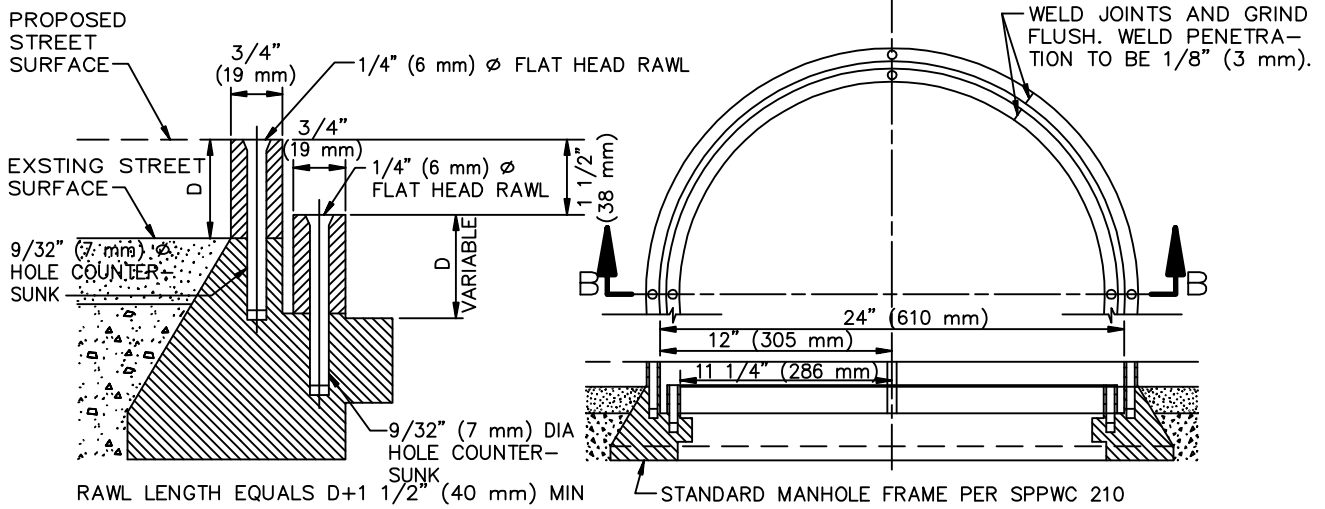

SECTION B-B

STEEL RAISING RINGS

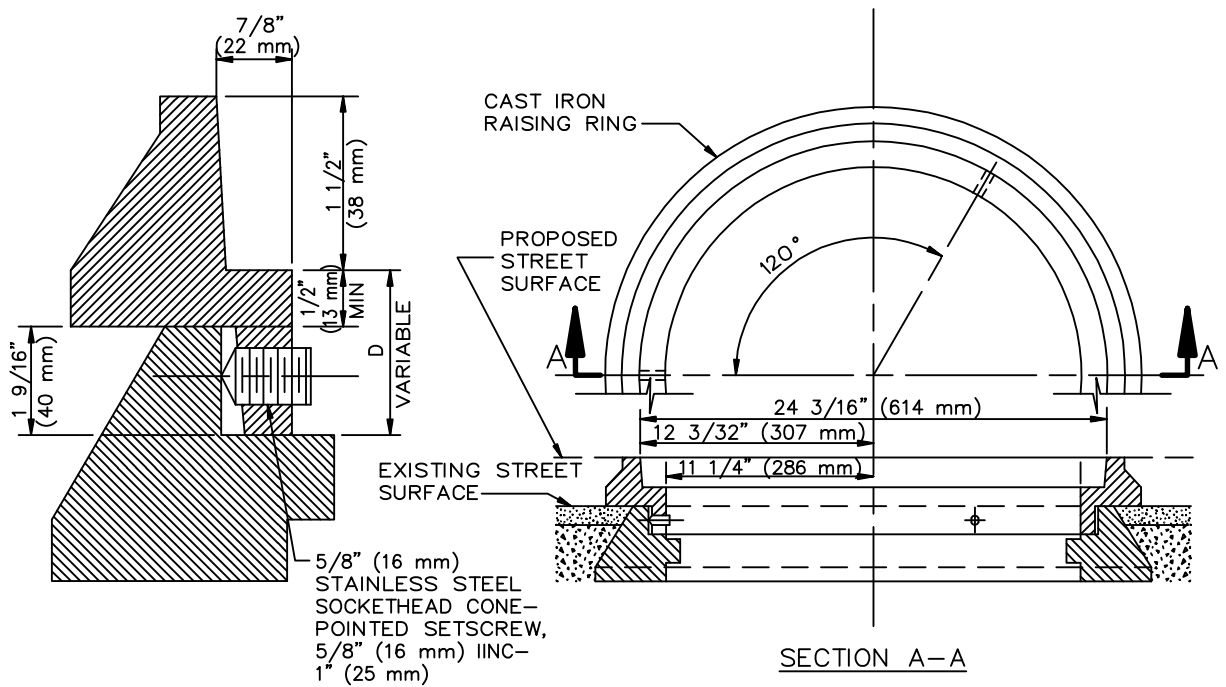

SECTION A-A

CAST IRON RAISING RINGS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

MANHOLE RAISING RINGS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

206-2

SHEET 1 OF 2

NOTES:

1. MACHINE SEATS FROM CAST IRON RINGS.
2. THE CAST IRON USED SHALL CONFORM TO SSPWC 206-3.
3. THE METAL RAISING RINGS MAY BE USED IN LIEU OF THE REGULAR METHOD OF ADJUSTMENT UTILIZING MORTAR OR BRICK AND MORTAR UNDER THE FOLLOWING CONDITIONS.
 - A. ONLY ONE ADJUSTMENT WITH RAISING RINGS WILL BE ALLOWED ON ANY MANHOLE.
 - B. MAXIMUM "D" SHALL BE 3" (75 mm).



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

MANHOLE RAISING RINGS

STANDARD PLAN

206-2

SHEET 2 OF 2

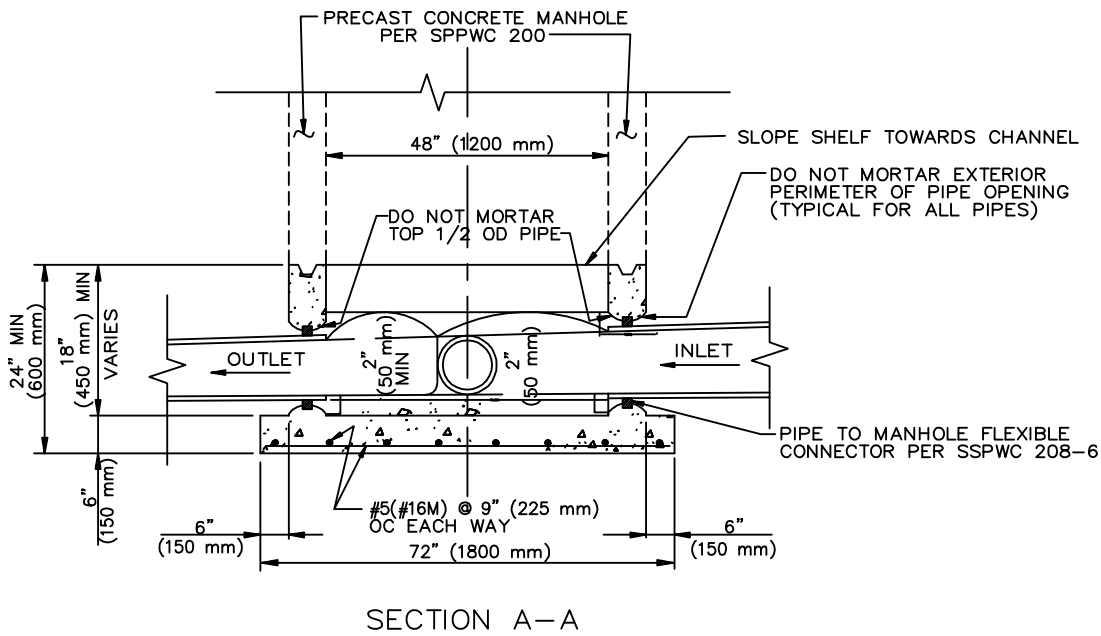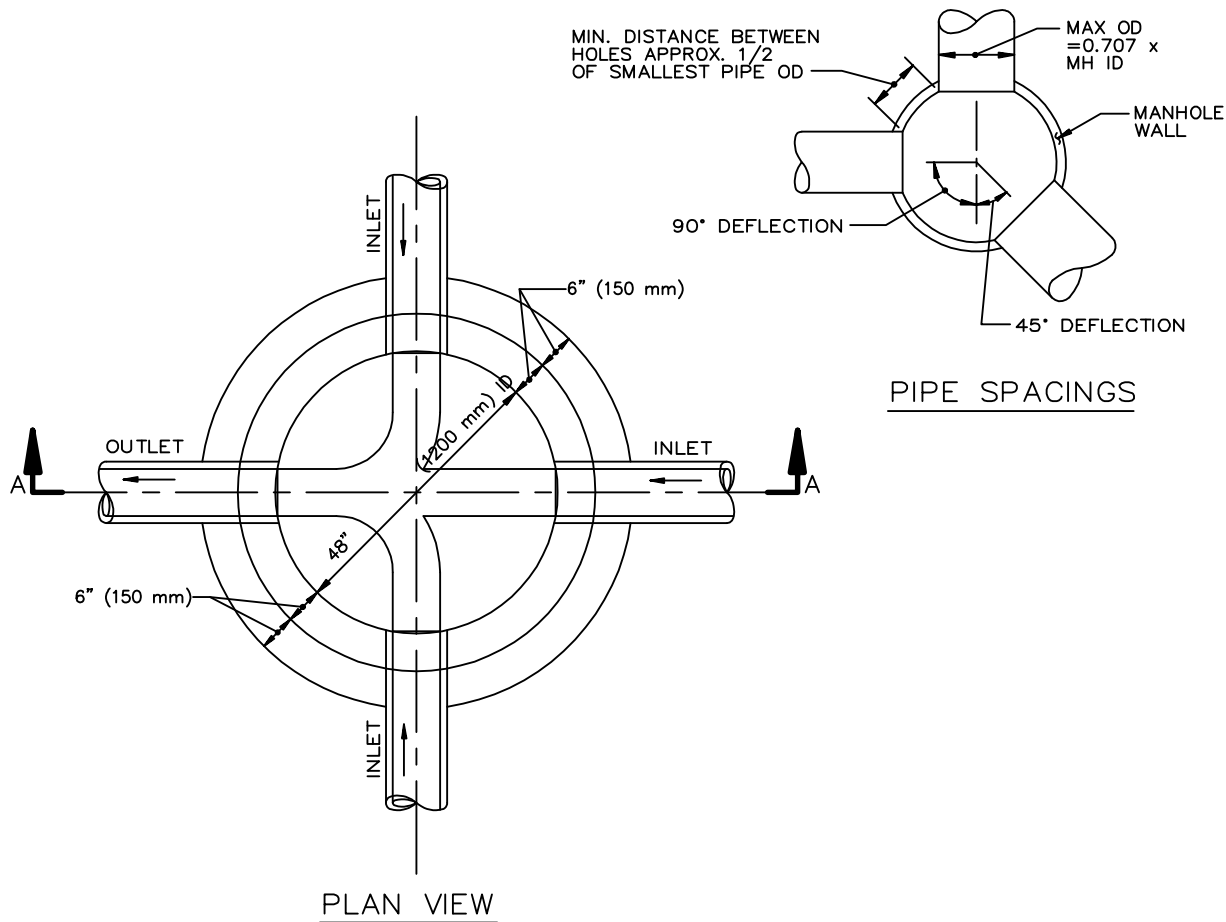

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

**PRECAST REINFORCED CONCRETE
MANHOLE BASE**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

207-2

SHEET 1 OF 2


NOTES

1. CONCRETE BASE AND STUB WALLS SHALL BE POURED IN ONE OPERATION.
2. CONCRETE FOR ALL PRECAST UNITS SHALL BE COMPACTLY VIBRATED IN THE FORMS. IT SHALL BE CURED ACCORDING TO APPROVED PRACTICE EITHER BY STEAM, SPRINKLING, MEMBRANE SOLUTION, OR A COMBINATION OF THESE. IT SHALL DEVELOP 3500 PSI (25 MPa) OR GREATER STRENGTH IN 28 DAYS.
3. THE DEPTH OF CHANNEL SHALL EQUAL THE PIPE DIAMETER FOR ALL SIZES OF PIPE. FOR SPECIAL CHANNELS IN TRAP OR GAUGING MANHOLES, SEE SPECIAL PLANS.
4. CEMENT MORTAR INSIDE JOINTS SHALL BE NEATLY STRUCK AND POINTED AND SHALL NOT EXCEED 3/8" (10 mm) IN THICKNESS.
5. STUB WALLS AND BASE SHALL CONFORM TO ASTM C 478 AND SHALL HAVE A MINIMUM OF 2" (50 mm) COVER THE STEEL ON THE INSIDE FACE.
6. INVERT CHANNELS AND SHELF MAY BE POURED AT THE FACTORY OR IN THE FIELD AT THE OPTION OF THE CONTRACTOR.
7. BEDDING FOR PRECAST BASE SHALL BE EQUAL TO BEDDING FOR PIPE. IF PIPE IS PLACED ON NATIVE MATERIAL USE 6" (150 mm) MINIMUM CRUSHED ROCK UNDER BASE.

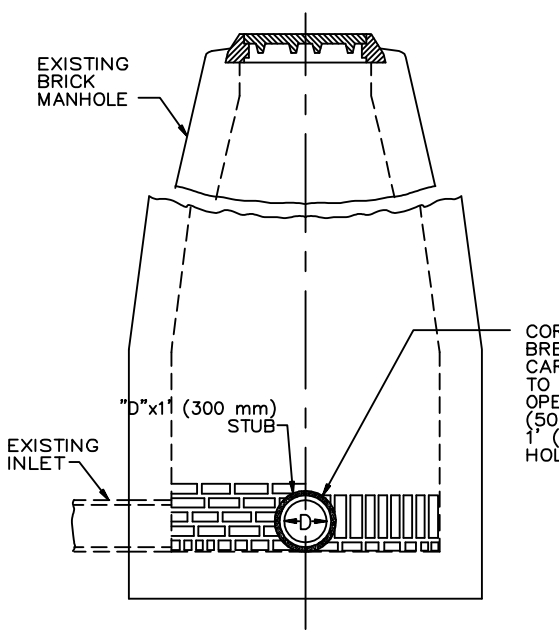


SECTIONAL ELEVATION A-A

CORE CUT HOLE OR
BREAK OUT BRICKS
CAREFULLY AND NEATLY
TO FORM MINIMUM
OPENING OF OD + 2"
(50 mm). SECURELY FASTEN "D"x
1' (300 mm) STUB INTO
HOLE WITH CEMENT MORTAR

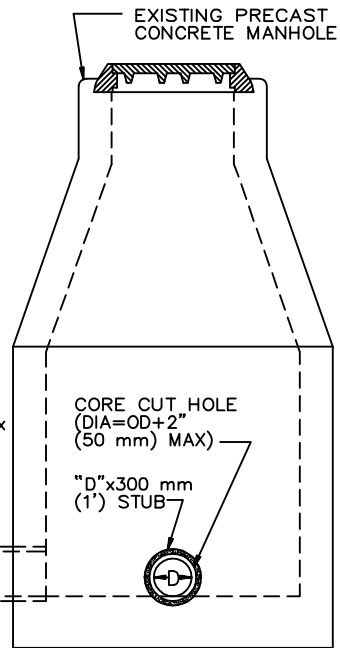


SECTIONAL ELEVATION C-C

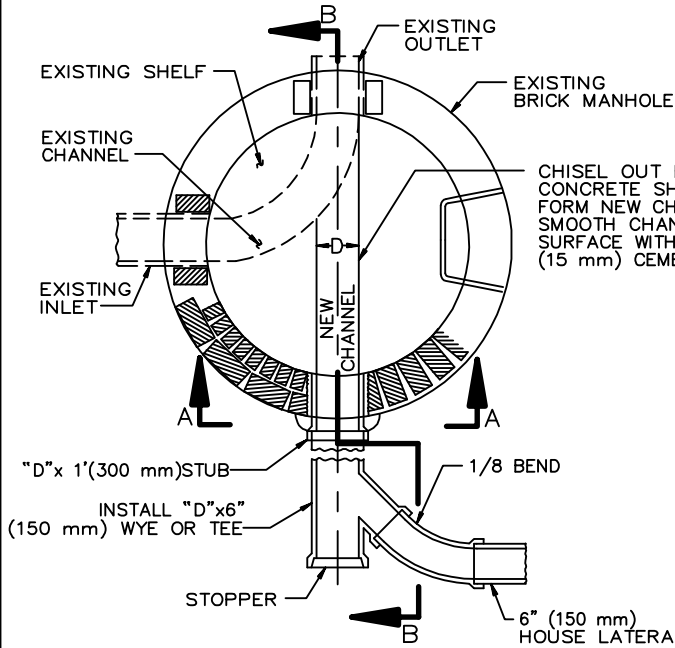


SECTIONAL PLAN OF BASE

CHISEL OUT EXISTING
CONCRETE SHELF TO
FORM NEW CHANNEL.
SMOOTH CHANNEL
SURFACE WITH 1/2"
(15 mm) CEMENT MORTAR

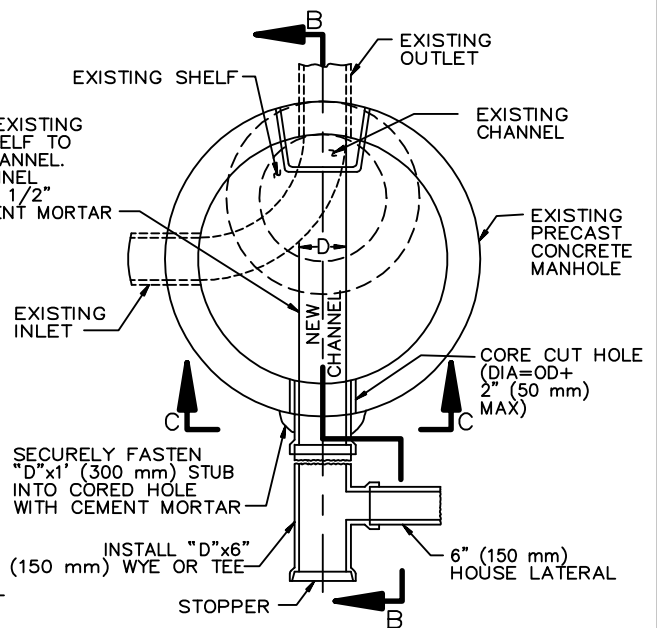

SECTIONAL PLAN OF BASE

SECURELY FASTEN
"D"x1' (300 mm) STUB
INTO CORED HOLE
WITH CEMENT MORTAR

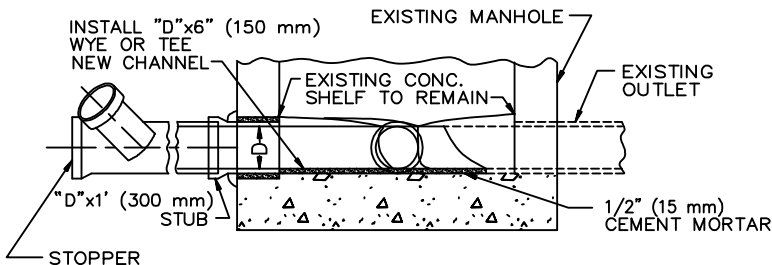

SECTIONAL ELEVATION B-B
CHANNEL BASE

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS, INC.,
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

BREAKING INTO EXISTING MANHOLES

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

208-2

SHEET 1 OF 2

NOTES:

1. INVERT ELEVATION OF "D" x 1' (300 mm) STUB AT THE INSIDE FACE OF MANHOLE TO BE 0.10' (30 mm) HIGHER THAN EXISTING OUTLET INVERT ELEVATION.
2. THE CORE CUT HOLE SHALL BE MADE WITH EQUIPMENT SPECIALLY DESIGNED TO CUT A SMOOTH HOLE WITHOUT SPALLING OR DAMAGE TO THE REINFORCING STEEL OR STRUCTURE.
3. "D" TO BE 8" (200 mm) MINIMUM.
4. ALL WORK SHALL BE UNCOVERED AND CONVENIENT FOR THE INSPECTION.
5. ALL CEMENT MORTAR SHALL BE CLASS "D" PER SSPWC 201-5.1.

HOUSE LATERAL NOTES:

1. WYE SHALL BE LAID WITH 1/8' (3 mm) RISE PER 1" (300 mm) AND 6" (150 mm) SPUR AT 45° FROM HORIZONTAL UNLESS OTHERWISE NOTED ON PLANS.
2. "D" X 4" (100 mm) WYE OR TEE AND 4" (100 mm) HOUSE LATERAL MAY BE SUBSTITUTED FOR "D" x 6" (150 mm) WYE OR TEE AND 6" (150 mm) HOUSE LATERAL.
3. USE TYPE "D" OR "G" JOINTS PER SSPWC 208-2.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

BREAKING INTO EXISTING MANHOLES

STANDARD PLAN

208-2

SHEET 2 OF 2

NOTES:

1. THE CAST IRON USED SHALL CONFORM TO ASTM A-48 CLASS 35B.
2. THE FRAME AND COVER SHALL BE COATED WITH ASPHALTUM OR BITUMINOUS PAINT AFTER TESTING AND INSPECTION.
3. COVERS SHALL BE CAST WITH THE LETTER "D" FOR STORM DRAINS AND "S" FOR SEWERS AND THE AGENCY IDENTIFICATION IN ACCORDANCE WITH INSTRUCTIONS FURNISHED BY THE AGENCY. THE LETTER "D" OR "S" SHALL BE APPROXIMATELY 2 1/2" (65 mm) HIGH WITH 1/2" (13 mm) LINE WIDTH AND PLACED IN THE CENTER OF THE COVER. ALL LETTERS SHALL BE FLUSH WITH THE FINISHED SURFACE OF THE COVER.
4. FOUNDRY IDENTIFYING MARK, HEAT AND DATE SHALL BE CAST ON THE BOTTOM OF THE COVER AND ON THE INSIDE OF THE FRAME.
5. IMPORTED COVERS AND FRAMES SHALL HAVE THE COUNTRY OF ORIGIN MARKING IN COMPLIANCE WITH FEDERAL REGULATIONS.
6. WEIGHT OF FRAME SHALL BE 160 POUNDS (73 kg). WEIGHT OF COVER SHALL BE 200 POUNDS (91 kg). ACTUAL WEIGHTS SHALL BE WITHIN A RANGE OF 95% TO 110%.
7. THE MANHOLE FRAME AND COVER SHALL BE INSPECTED BY THE ENGINEER PRIOR TO SHIPMENT TO THE JOBSITE. ACCEPTANCE WILL BE INDICATED BY THE AGENCY'S MARK.
8. THE PROOF-LOAD FOR TEST METHOD B OF SSPWC 206-3.2 IS 55,300 POUNDS (228 kN).
9. COVERS FOR MANHOLES LOCATED IN EASEMENTS, ALLEYS, PARKWAYS AND ALL OTHER PLACES EXCEPT PAVED STREETS SHALL BE PROVIDED WITH SOCKET SET SCREW LOCKING DEVICES. DRILL AND TAP TWO HOLES TO A DEPTH OF 1" (25 mm) AT 90° TO PICK HOLE AND INSTALL 3/4" x 3/4" (19 mm x 19 mm) STAINLESS STEEL SOCKET SET SCREWS WITH 3/8" (10 mm) RECESSED HEX HEAD. ALL THREADS SHALL BE N.C.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**24" (610 mm) MANHOLE FRAME
AND COVER LOCKING TYPE**

210-3

SHEET 2 OF 2

NOTES:

1. EXCEPT AS OTHERWISE INDICATED, THE MANHOLE FRAME AND COVER SHALL CONFORM TO SPPWC 632, 30" (762 mm) MANHOLE FRAME AND COVER.
2. THE PRESSURE PLATE SHALL BE STEEL CONFORMING TO ASTM A36 (A 36M), AND SHALL BE GALVANIZED AFTER FABRICATION, BUT BEFORE INSTALLATION OF SCREWS AND BOLTS.
3. CAP SCREWS AND EYEBOLTS, INCLUDING WASHERS AND NUTS ATTACHED THERETO, SHALL BE FABRICATED FROM ANY SERIES 300 STAINLESS STEEL.
4. ALL HOLES IN CAST IRON SHALL BE DRILLED AFTER CASTING, OR PLUGGED PRIOR TO CASTING. THEY SHALL NOT BE PUNCHED.
5. ALL IRON CASTING SHALL RECEIVE AN ASPHALTIC COATING AFTER FABRICATION.
6. GASKET MATERIAL SHALL BE 1/16" (2 mm) THICK NEOPRENE RUBBER. PRESSURE PLATE GASKET SHALL BE 2'-7 1/4" (794 mm) O.D.
7. ALL NUTS AND BOLTS SHALL BE TIGHTENED TO A MINIMUM TORQUE OF 25 FOOT-POUNDS (34 Nm).
8. FRAME SHALL BE SET ON 1/2" (13 mm) THICK MINIMUM WET MORTAR BASE, CLASS "B" MORTAR.
9. MANHOLE FRAME AND COVER AND PRESSURE PLATE ASSEMBLY SHALL BE TESTED FOR ACCURATE FIT PRIOR TO DELIVERY TO JOBSITE AND MARKED IN SETS.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**MANHOLE FRAME AND COVER
PRESSURE TYPE**


211-2

SHEET 2 OF 2

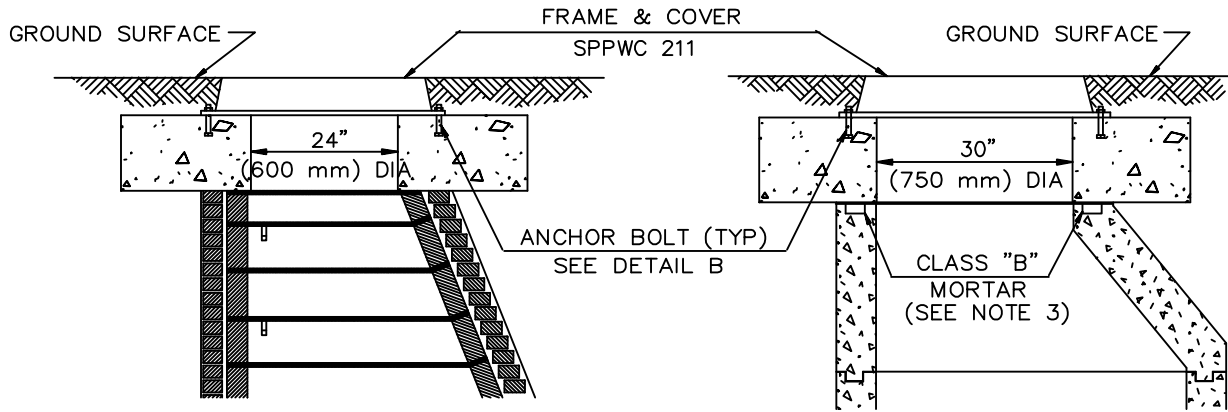


BRICK MANHOLE SHAFT


PRECAST CONCRETE CONE

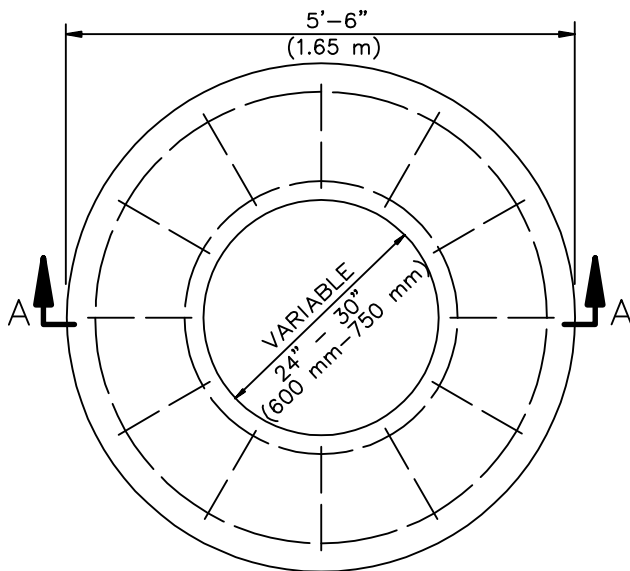

PLAN

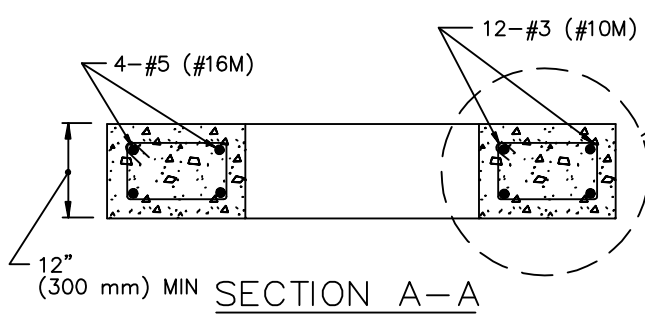

SECTION A-A

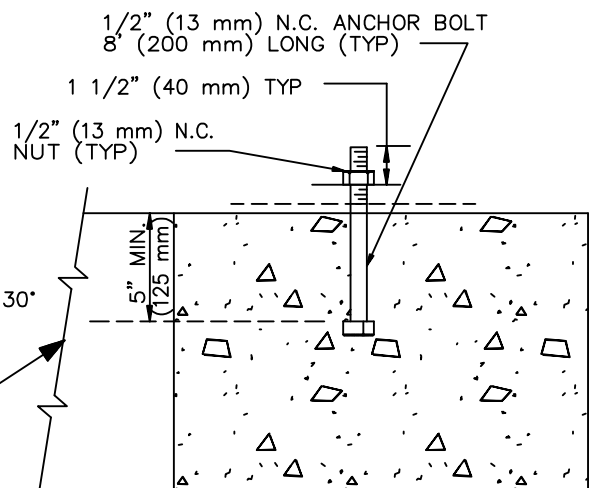

DETAIL B

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS, INC.,
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

**ANCHOR SYSTEM FOR
PRESSURE COVER**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

212-2

SHEET 1 OF 2

NOTES:

1. ANCHOR SYSTEM DESIGNED FOR LESS THAN 10' (3 m) OF HEAD.
2. MINIMUM EMBEDMENT OF 1/2" (13 mm) ϕ ANCHOR BOLT WITH HEAD SHALL BE 5" (130 mm).
3. SET CONCRETE ANCHOR ON WET, CLASS "B" MORTAR ON TOP OF BRICK MANHOLE SHAFT OR PRECAST CONCRETE CONE.
4. UNLESS OTHERWISE NOTED, 1/2" (13 mm) ϕ ANCHOR BOLTS AND NUTS ARE REQUIRED AND SHALL BE FABRICATED FROM ANY SERIES 300 STAINLESS STEEL.
5. NUTS ON ANCHOR BOLTS SHALL BE TIGHTENED TO A MINIMUM TORQUE OF 25 FOOT-POUNDS (34 Nm).

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

**ANCHOR SYSTEM FOR
PRESSURE COVER**


212-2

SHEET 2 OF 2


BARS ARE TO BE LEFT VERTICAL AND BENT IN PLACE WHEN BEAM IS FORMED

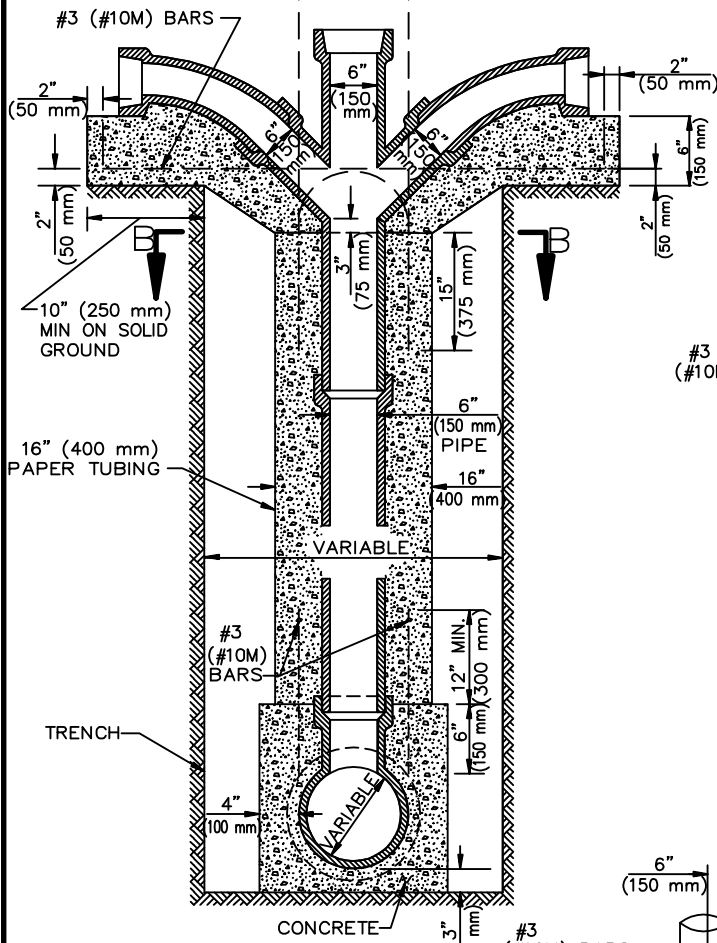


SECTION A-A

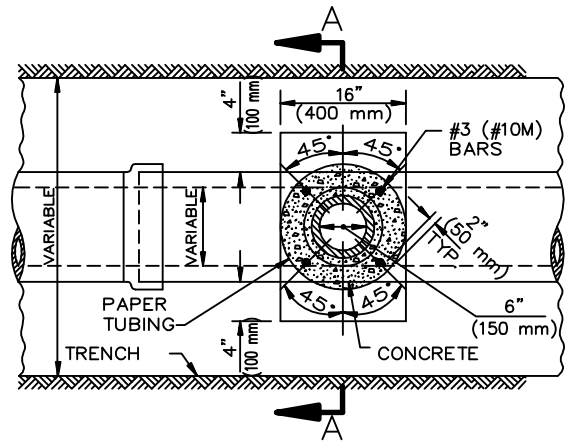


SECTION B-B

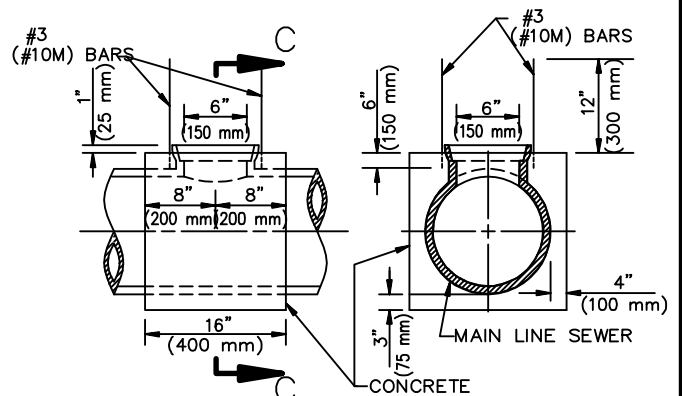


ELEVATION SECTION C-C
CHIMNEY BASE
CASE I

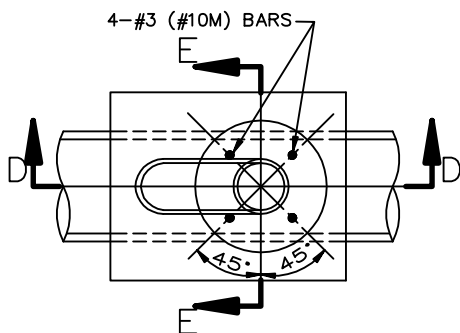

SECTION B-B

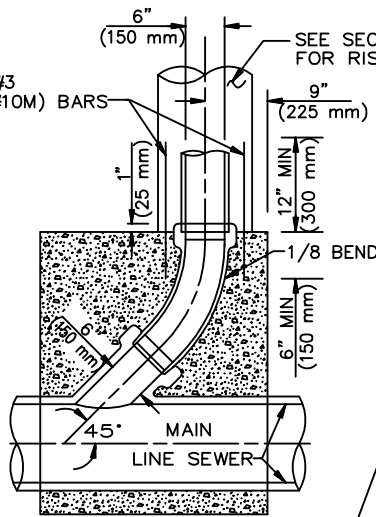

SECTION D-D

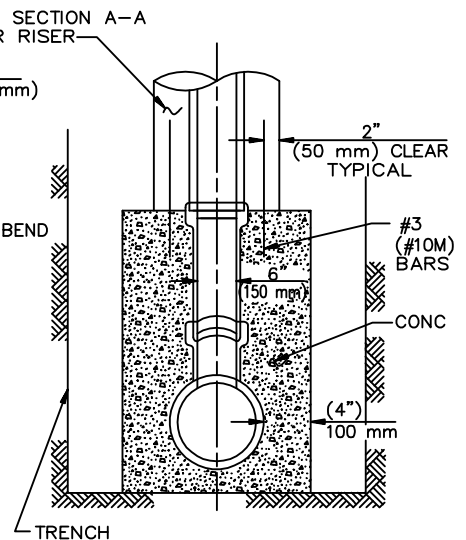

SECTION E-E

CHIMNEY BASE
CASE II

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1993, 1996, 2009

CHIMNEYS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

220-3

SHEET 1 OF 2

NOTES

1. THE UPPER END OF THE CHIMNEY PIPE SHALL BE AT LEAST 8' (2.5 m) BELOW THE GRADE OF THE LOWER CURB.
2. NO CONNECTION SHALL BE MADE DIRECTLY TO TOP OF CHIMNEY PIPE.
3. WHERE ONE HOUSE LATERAL IS TO BE JOINED TO THE CHIMNEY PIPE, USE A SINGLE WYE AND FACE WYE TOWARDS PROPERTY TO BE SERVED.
4. WHERE TWO OR MORE HOUSE LATERALS ARE TO BE JOINED TO THE CHIMNEY PIPE, INSTALL WYE BRANCHES AS FOLLOWS:
 - A. FOR TWO HOUSE LATERALS, ONE SERVING EACH SIDE OF STREET, USE A DOUBLE WYE BRANCH.
 - B. FOR TWO HOUSE LATERALS SERVING THE SAME SIDE OF THE STREET, USE TWO SINGLE WYES STACKED WITH BRANCHES FACING THE PROPERTIES SERVED.
 - C. FOR THREE OR FOUR HOUSE LATERALS, USE TWO DOUBLE WYE BRANCHES OR ONE DOUBLE AND ONE SINGLE WYE BRANCH STACKED.
5. EACH DOUBLE OR SINGLE WYE BRANCH AND EIGHTH BEND SHALL BE SUPPORTED BY A CONCRETE BEAM AS SHOWN.
6. FOR CHIMNEY BASE, 6" (150 mm) TEE BRANCH OR WYE SHALL BE INSTALLED VERTICALLY ON TOP OF THE MAIN LINE SEWER AS SHOWN. THE CHIMNEY BASE MUST BE POURED AND SET WITH DOWELS AS SHOWN 24 HOURS BEFORE THE CHIMNEY CONCRETE IS POURED.
7. ALL CONCRETE SHOWN SHALL BE CLASS 520-C-2500 (310-C-17).
8. CASE I SHALL BE FOR VITRIFIED CLAY PIPE ONLY.
9. CASE II SHALL BE FOR ALL ALLOWABLE PIPE MATERIALS.
10. FOR ABS PIPE USE SOLVENT WELDED JOINTS ONLY.
11. A CAP SHALL BE INSTALLED AT THE OPENING OF THE PIPE RISER AND AT EACH UNCONNECTED BRANCH, SEALED AROUND ITS CIRCUMFERENCE WITH 1" (25 mm) THICK TYPE "F" MORTAR.

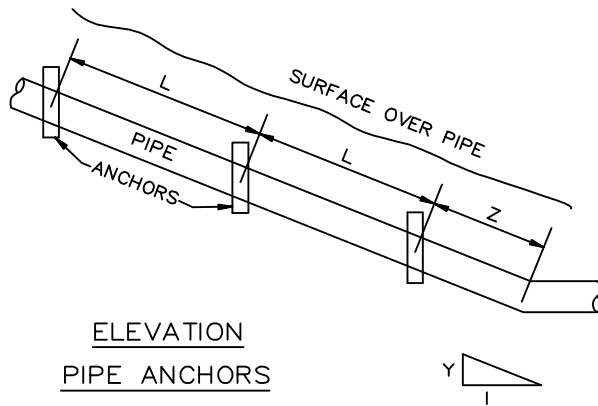
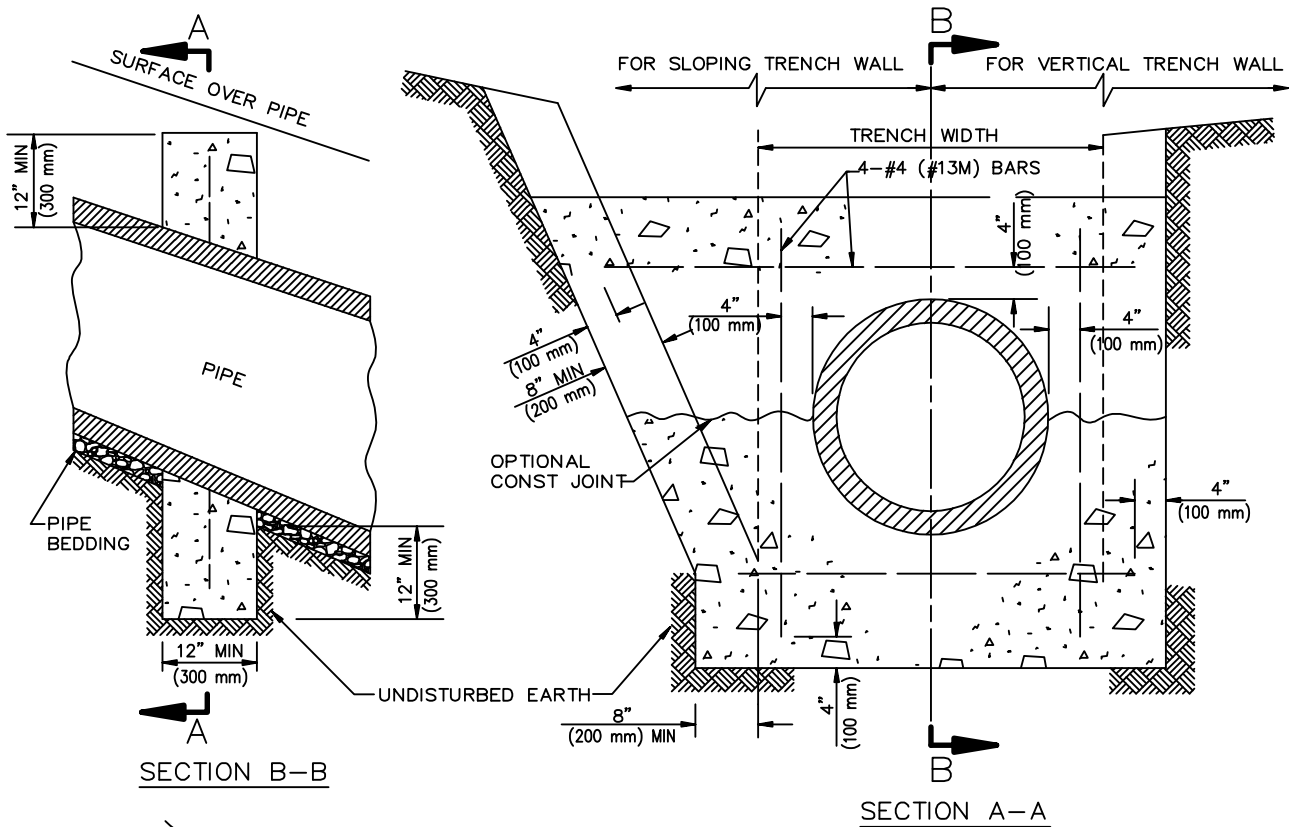


TABLE A

PIPE SLOPE(%) Y:1(100)	L DISTANCE (MAX)	Z DISTANCE (MAX)
100	12' (3.65 m)	4' (1.20 m)
67	14' (4.25 m)	8' (2.40 m)
50	16' (4.90 m)	12' (3.65 m)
40	18' (5.50 m)	18' (5.50 m)
33	20' (6.00 m)	20' (6.00 m)

ANCHORS

NOTES:

1. ANCHORS SHALL BE CLASS 450-C-2000 (265-C-14) CONCRETE.
2. FOR CLAY PIPE, ANCHORS SHALL NOT BE PLACED WITHIN 6" (150 mm) OF THE PIPE JOINT.
3. TRENCH SHALL BE BACKFILL PER NOTE 4 ON SHEET 2.
4. SPACING OF ANCHORS FOR PIPE SLOPES BETWEEN VALUES SHOWN IN TABLE "A" MAY BE PROPORTIONED.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009



PIPE ANCHORS AND BACKFILL STABILIZERS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

221-2

SHEET 1 OF 2

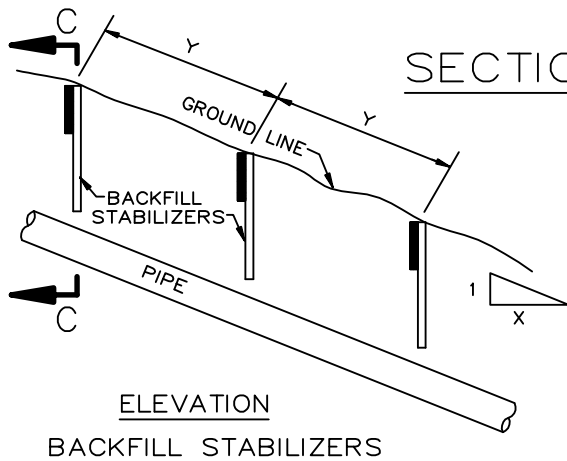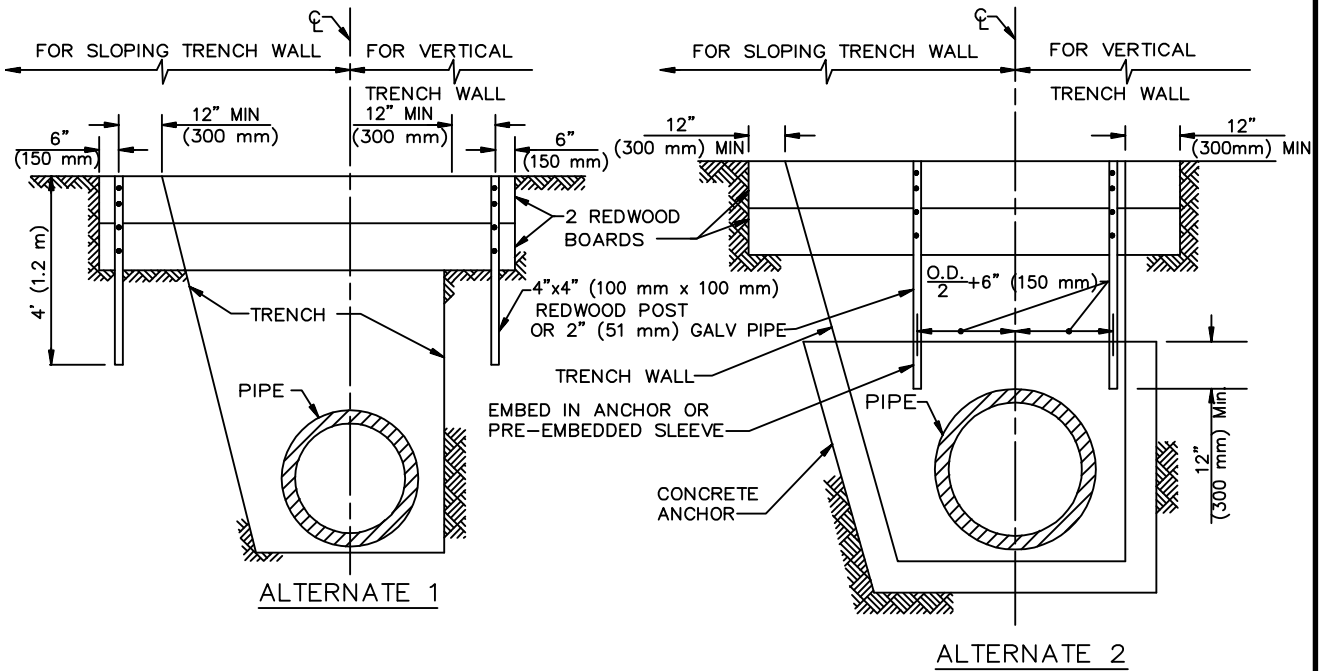

SECTION C-C


TABLE B

GROUND SLOPE X:1	TABLE B Y (MAX)
1:1	5' (1.5 m)
1 1/2:1	9' (2.75 m)
2:1	12' (3.65 m)
2 1/2:1	16' (4.9 m)
3:1	20' (6.0 m)


STABILIZERS

NOTES:


1. REDWOOD BOARDS SHALL BE 2" x 12" (50 x 300 mm) WHERE DEPTH OF COVER OVER PIPE PERMITS, OTHERWISE USE 2" x 10" (50 x 250 mm).
2. REDWOOD BOARDS SHALL BE PLACED ON THE HIGH GROUND SIDE OF THE POSTS.
3. EACH REDWOOD BOARD SHALL BE FASTENED BY USING 2-16d NAILS TO EACH REDWOOD POST OR A 3/8" (10 mm) BOLT AND NUT WITH WASHERS TO EACH GALVANIZED PIPE. ALL HARDWARE SHALL BE GALVANIZED.
4. TRENCH BACKFILL SHALL BE CONSOLIDATED BY MECHANICAL COMPACTION. IN LIEU OF MECHANICALLY COMPACTION, SOIL CEMENT MAY BE USED; HOWEVER, THE TOP 12" (300 mm) OF BACKFILL SHALL BE NATIVE SOIL, MECHANICALLY COMPACTIONED.
5. SPACING OF STABILIZERS FOR GROUND SLOPES BETWEEN VALUES SHOWN IN TABLE "B" MAY BE PROPORTIONED.
6. THE CONTRACTOR MAY, AT ITS OPTION, SUBSTITUTE DOUGLAS FIR FOR THE REDWOOD PROVIDED IT HAS BEEN TREATED WITH PRESERVATIVES.

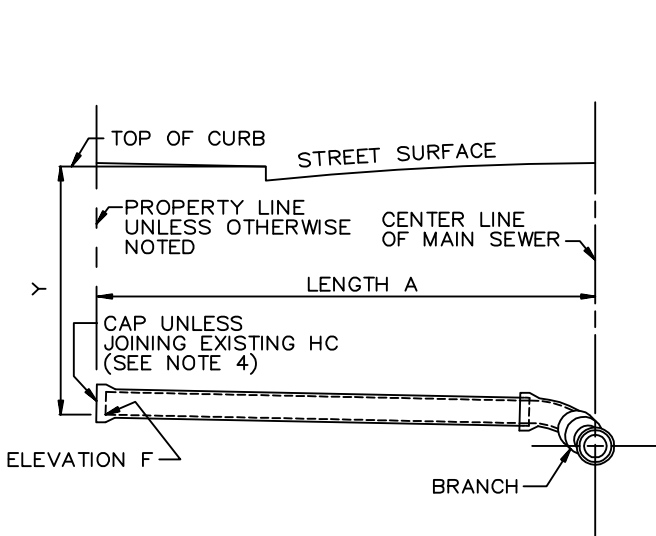


PROFILE TYPE A

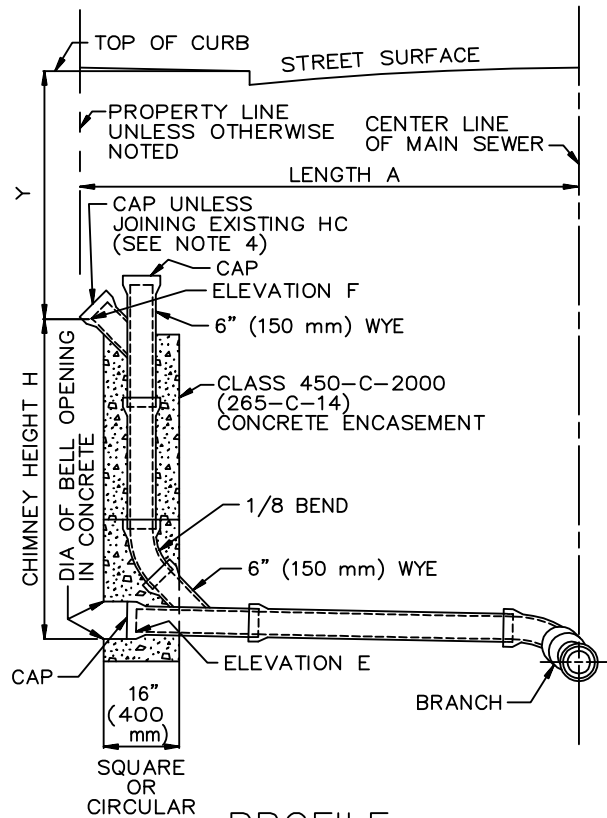

PROFILE TYPE B

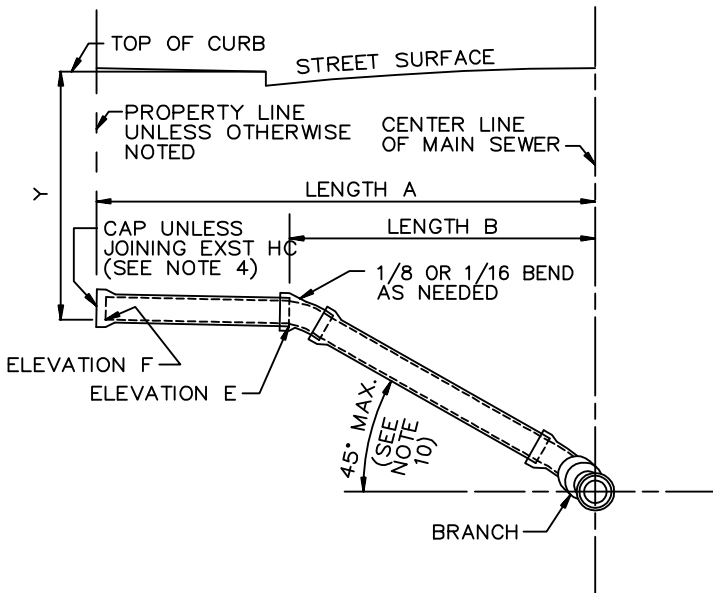

PROFILE TYPE C

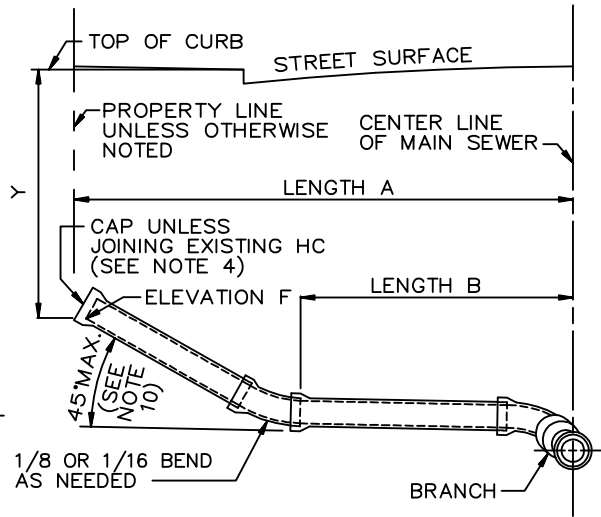

PROFILE TYPE D

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

HOUSE CONNECTION SEWER

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

222-2

SHEET 1 OF 2

NOTES

1. EXCEPT AS OTHERWISE INDICATED ON THE PLANS, ALL HOUSE CONNECTION SEWERS SHALL BE TYPE "A" AND SHALL BE CONSTRUCTED ON STRAIGHT LINES AND GRADES BETWEEN CONTROL POINTS AND ELEVATIONS.
2. DIMENSIONS:
 - A. $Y = 6'$ (1.85 m)
 - B. LENGTHS "A" AND "B" – SEE PLANS
 - C. HEIGHT "H" – SEE PLANS
 - D. ELEVATIONS "E" AND "F" – SEE PLANS
3. ALL HOUSE CONNECTION SEWER PIPE SHALL BE 150 mm (6") UNLESS OTHERWISE INDICATED AND MAY BE ANY OF THE FOLLOWING:
 - A. VC PIPE
 - B. PE PIPE
 - C. ABS SOLID WALL PIPE
 - D. ABS COMPOSITE PIPE
 - E. PVC PLASTIC PIPE

PROVIDED THAT CHANGES FROM ONE TYPE OF MATERIAL OR SIZE TO ANOTHER SHALL BE MADE ONLY BY MEANS OF SUITABLE ADAPTERS APPROVED BY THE ENGINEER.

4. THE UPPER END OF THE HOUSE CONNECTION SHALL BE SEALED BY INSTALLING A CAP AND SEALING THE CAP WITH 1" (25 mm) THICK TYPE "F" MORTAR AROUND THE CIRCUMFERENCE OF THE CAP.
5. EXCEPT AS CONTROLLED BY ELEVATIONS INDICATED ON THE PROJECT PLANS, THE MINIMUM SLOPE FOR ALL PIPE SHALL BE 2% (S=0.02 MINIMUM).
6. THE FIGURE IN A CIRCLE ON THE PLANS ADJACENT TO A HOUSE CONNECTION SEWER STATION INDICATES THE DEPTH IN FEET (METERS) BELOW THE EXISTING TOP OF CURB TO WHICH THE INVERT OF THE UPPER END OF THE HOUSE CONNECTION SEWER SHALL BE CONSTRUCTED. IF NO DEPTH IS INDICATED, THE INVERT OF THE UPPER END SHALL BE THE ELEVATION SHOWN ON THE PROFILE. WHERE NEITHER DEPTH NOR ELEVATION IS INDICATED, THE INVERT SHALL BE 6' (1.85 m) BELOW THE TOP OF THE EXISTING CURB.
7. BRANCHES SHALL BE EITHER TEES OR WYES AND SHALL BE ROTATED UPWARD FROM THE HORIZONTAL TO AN ANGLE OF 22-1/2° TO 45° WHEN TEES ARE USED. BENDS ARE NOT REQUIRED BUT MAY BE USED AT THE OPTION OF THE CONTRACTOR. WHEN THE BRANCH ROTATION DOES NOT CONFORM TO THE SLOPE OF THE HOUSE CONNECTION SEWER, PULLED JOINTS MAY BE USED FOR ADJUSTMENT.
8. THE MAXIMUM DEFLECTION AT EACH JOINT FOR 4" (100 mm) AND 6" (150 mm) VITRIFIED CLAY PIPE HOUSE CONNECTION SEWERS SHALL BE 4", WHICH IS EQUAL TO A PULL OF 9/16" (14 mm) FOR A 6" (150 mm) PIPE AND 3/8" (10 mm) FOR A 4" (100 mm) PIPE. (PULL IS DEFINED AS THE SEPARATION OF THE ABUTTING PIPE ENDS ON THE CONVEX SIDE OF THE CURVE MEASURED AT THE OUTSIDE PIPE BARREL.)
9. CONNECTION OF A BUILDING SEWER SMALLER THAN 6" (150 mm) TO A 6" (150 mm) HOUSE CONNECTION SEWER SHALL BE MADE USING AN APPROVED INCREASER TEE OR AN INCREASER FOLLOWED BY A TEE.
10. ALL HOUSE CONNECTION SEWERS OR PORTIONS THEREOF CONSTRUCTED ON A SLOPE EXCEEDING 45° SHALL BE ANCHORED PER SPPWC 221.
11. HOUSE CONNECTION SEWERS CONSTRUCTED PURSUANT TO A HOUSE CONNECTION PERMIT SHALL CONFORM TO ALL APPLICABLE STATUTES AND ORDINANCES.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


HOUSE CONNECTION SEWER

222-2


SHEET 2 OF 2

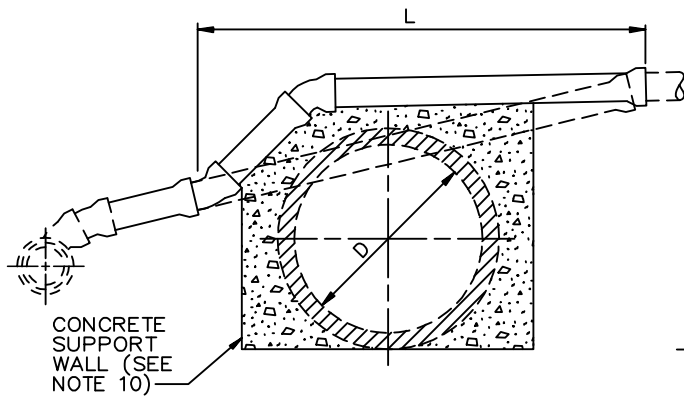


CASE A

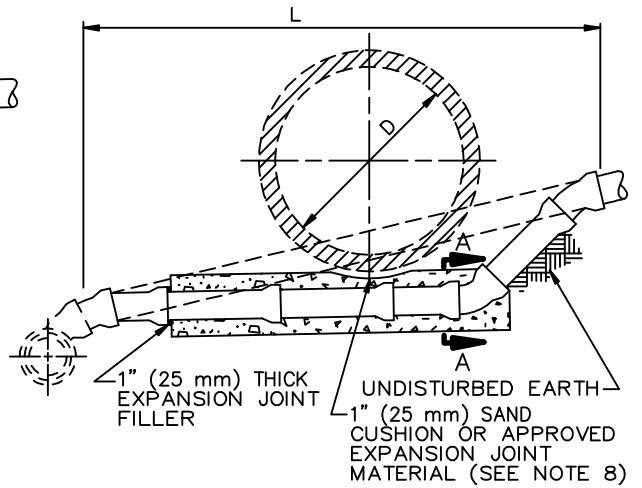


CASE D

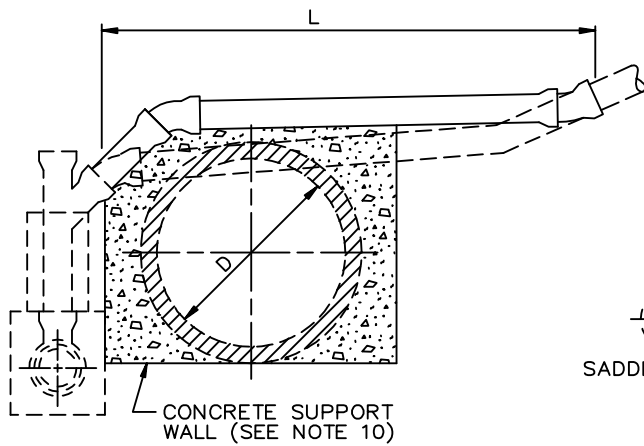


CASE B

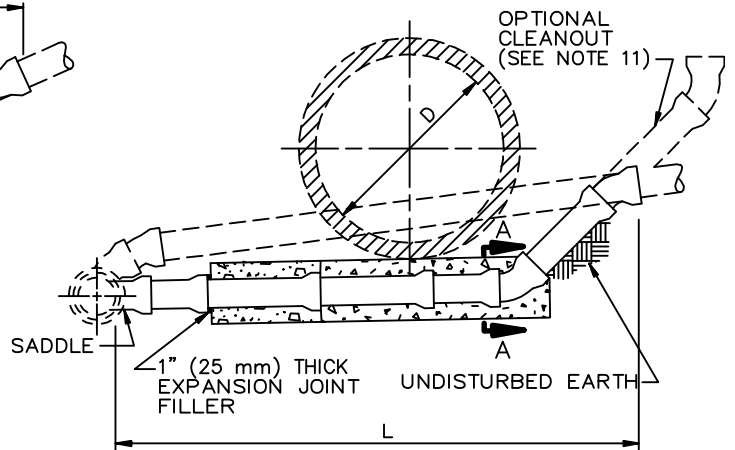

CASE E

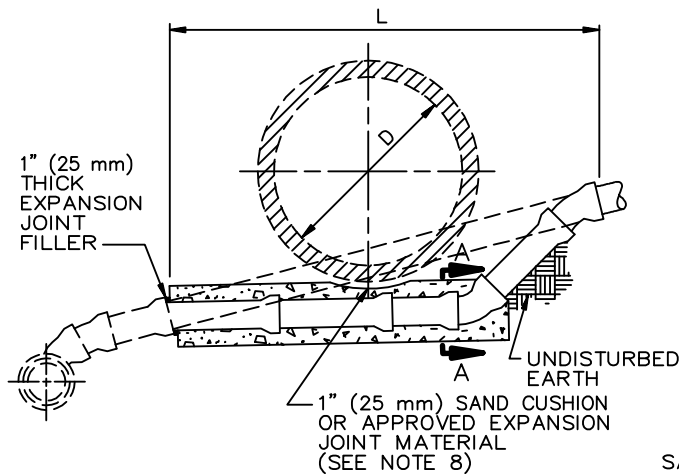

CASE C

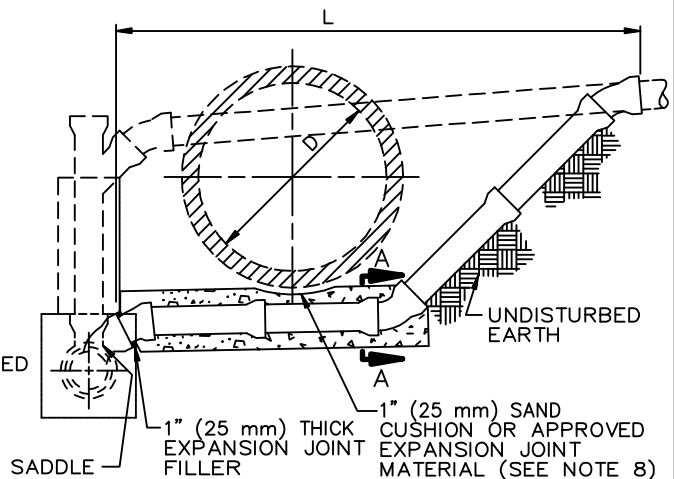

CASE F

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARD, INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009


HOUSE CONNECTION REMODELING

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

223-2


SHEET 1 OF 3

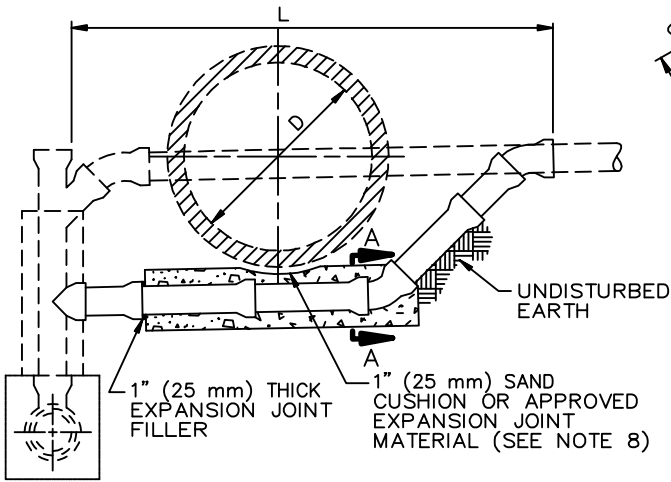


CASE G

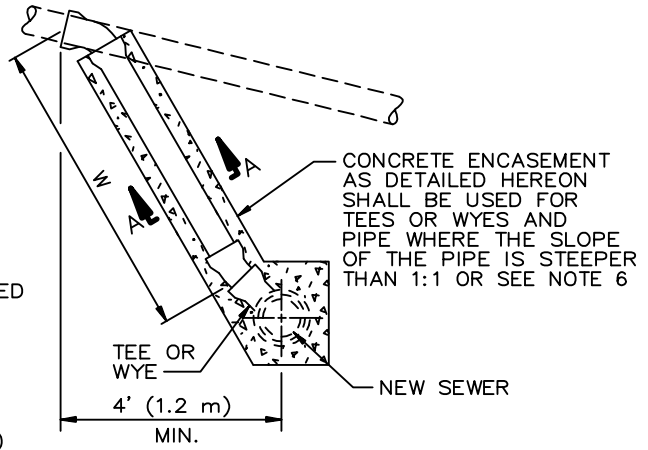


CASE R

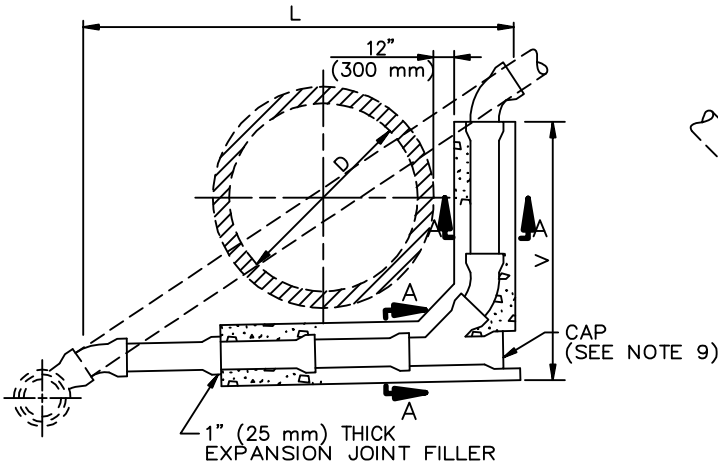


CASE H

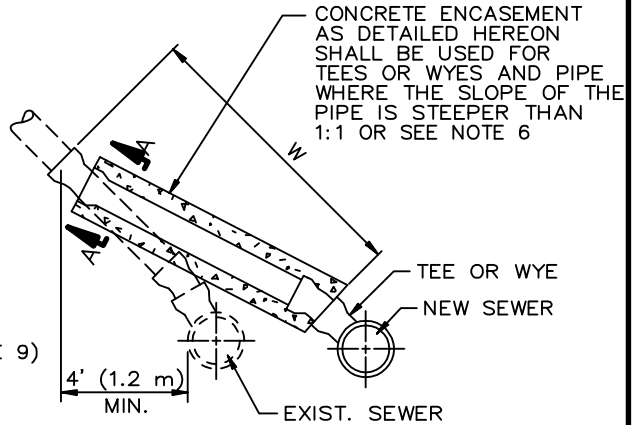

CASE S

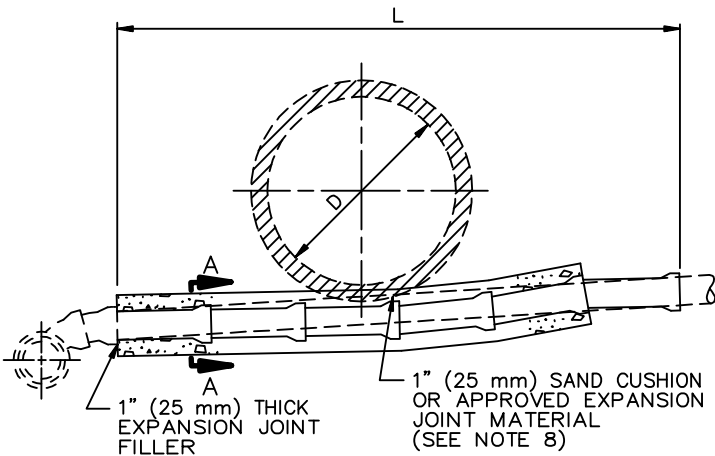

CASE K



NOMINAL DIAMETER OF PIPE INCHES (mm)	MINIMUM DIMENSIONS X INCHES (mm)
6 (150)	3 (75)
8 (200)	4 (100)
10 (250)	5 (125)
12 (300)	6 (150)

SECTION A-A
CONCRETE ENCASEMENT DETAIL
(SEE NOTE 5)

NOTES

1. EXCEPT AS OTHERWISE INDICATED HEREON OR ON THE PLANS, ALL HOUSE CONNECTION REMODELING SHALL CONFORM TO THE APPLICABLE PORTIONS OF SPPWC 222, HOUSE CONNECTION SEWER.
2. SEE PROJECT PLANS FOR VALUES OF D, L, V, AND W. (DIMENSION L IS THE HORIZONTAL LENGTH OF THE HOUSE CONNECTION REMODELING).
3. EXISTING SEWERS ARE INDICATED BY DASHED LINES. HOUSE CONNECTION SEWERS TO BE CONSTRUCTED ARE INDICATED BY SOLID LINES AND SHALL BE OF THE SAME MATERIAL AS THE EXISTING SEWER. THE CONTRACTOR MAY CONSTRUCT THE SEWER WITH OTHER MATERIALS ALLOWED BY SPPWC 222 PROVIDED APPROVED ADAPTORS ARE UTILIZED.
4. 1/16 (22.5°) OR 1/8 (45°) BENDS SHALL BE USED TO REMODEL OR CONSTRUCT ANY SEWER ON A CURVE OR AT ANY CHANGE IN ALIGNMENT. WHERE PHYSICAL OR GEOMETRIC LIMITATIONS PRECLUDE THE USE OF 1/16 (22.5°) OR 1/8 (45°) BENDS, THE CONTRACTOR SHALL SUBMIT TO THE ENGINEER FOR APPROVAL THE PROPOSED METHOD OF REMODELING OR CONSTRUCTION.
5. ALL HOUSE CONNECTION SEWERS TO BE CONSTRUCTED UNDER A PROPOSED CONDUIT SHALL BE ENCASED IN CONCRETE AS SHOWN HEREON. WHEN THE HOUSE CONNECTION SEWER SLOPE EXCEEDS 1:1 THE CONTRACTOR MAY, AT ITS OPTION, PLACE A CIRCULAR CROSS SECTION WITH MINIMUM COVER EQUAL TO DIMENSION "X" AS SHOWN ON SECTION A-A HEREON IN LIEU OF A SQUARE CROSS SECTION OF CONCRETE. CONCRETE BEDDING AND ENCASEMENT SHALL BE CLASS 450-C-2000 (250-C-14) AND SHALL EXTEND TO THE FIRST PIPE JOINT AT LEAST 1' (300 mm) BEYOND THE OD OF EACH SIDE OF THE PROPOSED CONDUIT.
6. FOR CASE R AND S, WHEN THE SLOPE OF THE PIPE EXCEEDS 1:1, THE CONTRACTOR MAY, AT ITS OPTION, CONSTRUCT A CHIMNEY CONFORMING TO SPPWC 220 ON THE NEW SEWER IN LIEU OF CONSTRUCTING THE ENCASEMENT SHOWN HEREON.
7. FOR CASES E AND F, SADDLES SHALL BE CONNECTED EITHER TO THE LENGTH OF PIPE CONTAINING THE EXISTING TEE OR WYE OR TO THE ADJACENT DOWNSTREAM PIPE LENGTH.
8. CONDUITS TO BE INSTALLED OVER OR WITHIN 1" (25 mm) OF ANY CONCRETE ENCASEMENT OR STRUCTURE, WHETHER EXISTING OR TO BE PLACED IN CONFORMITY WITH THE REQUIREMENTS HEREIN, SHALL BE INSTALLED ON A 1" (25 mm) SAND CUSHION OR APPROVED EXPANSION JOINT MATERIAL. CONCRETE ENCASEMENT INSTALLED PURSUANT TO THIS STANDARD PLAN SHALL BE SEPARATED FROM EXISTING CONDUIT WITH 1" (25 mm) THICK EXPANSION JOINT MATERIAL.
9. THOSE PORTIONS OF AN ABANDONED PIPE LOCATED BENEATH OR WITHIN 6" (150 mm) OF A RELOCATED HOUSE CONNECTION SEWER SHALL BE REMOVED. THE EXCAVATION SHALL BE REFILLED TO THE GRADE OF THE NEW PIPE INVERT WITH CLASS 100-E-100 (60-E-0.7) CONCRETE. THE CONTRACTOR MAY, AT ITS OPTION, SUBSTITUTE MECHANICALLY COMPACTED BACKFILL IN LIEU OF THE CLASS 100-E-100 (60-E-0.7) CONCRETE. THOSE PORTIONS OF ABANDONED PIPE NOT REMOVED SHALL BE SEALED. WHERE CAPS ARE USED, THEY SHALL BE SEALED BY FILLING THE SPACE ABOVE THE CAP WITH SAND AND A 1" (25 mm) THICK COATING OF TYPE "F" MORTAR.
10. SUPPORT WALLS SHALL CONFORM TO SPPWC 224.
11. WHEN INDICATED ON THE PLANS OR THE SPECIAL PROVISIONS, A CLEANOUT SHALL BE CONSTRUCTED IN CONJUNCTION WITH CASE E AS FOLLOWS:
 - A. SUBSTITUTE A "Y" FOR THE 45° BEND.
 - B. PLACE A 45° BEND ON THE UPPER END OF THE "Y".
 - C. CAP TOP OF 45° BEND WITH A CAP AND SEAL WITH 1" (25 mm) THICK TYPE "F" MORTAR AROUND THE CIRCUMFERENCE OF THE CAP.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

HOUSE CONNECTION REMODELING

223-2

SHEET 3 OF 3

CASE 1
REINFORCED CONCRETE BEAM
 FOR 4" (100 mm) TO 24" (610 mm) ID PIPE

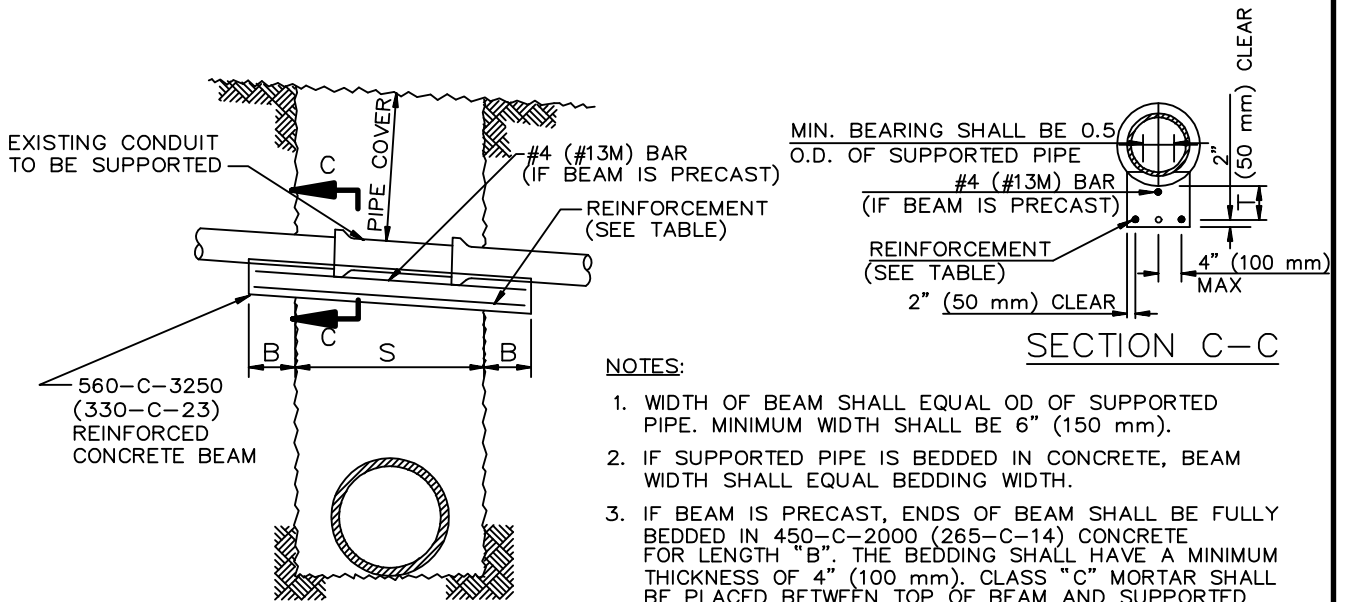

NOTES:

1. WIDTH OF BEAM SHALL EQUAL OD OF SUPPORTED PIPE. MINIMUM WIDTH SHALL BE 6" (150 mm).
2. IF SUPPORTED PIPE IS BEDDED IN CONCRETE, BEAM WIDTH SHALL EQUAL BEDDING WIDTH.
3. IF BEAM IS PRECAST, ENDS OF BEAM SHALL BE FULLY BEDDED IN 450-C-2000 (265-C-14) CONCRETE FOR LENGTH "B". THE BEDDING SHALL HAVE A MINIMUM THICKNESS OF 4" (100 mm). CLASS "C" MORTAR SHALL BE PLACED BETWEEN TOP OF BEAM AND SUPPORTED PIPE TO PROVIDE MINIMUM BEARING SHOWN.
4. THIS CASE IS PERMITTED ONLY IF THE TRENCH WALLS ARE FIRM AND UNYIELDING.
5. MAXIMUM SPACING OF BARS SHALL BE 4" (100 mm) OC.

SEE REINFORCED CONCRETE BEAM TABLE (DIMENSIONS AND REINFORCEMENT) ON PAGE 2, THIS SECTION.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2009

**SUPPORTS FOR CONDUITS
 ACROSS TRENCHES**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

224-2

SHEET 1 OF 3

REINFORCED CONCRETE BEAM (DIMENSIONS AND REINFORCEMENT)


PIPE COVER

	0' TO 8'-0"		8'-0" TO 12'-0"		12'-0" TO 16'-0"		16'-0" TO 20'-0"		20'-0" TO 25'-0"	
	T	BARS	T	BARS	T	BARS	T	BARS	T	BARS
0' TO 4'-0" (8m TO 1.2m)	8"	#4 (#13M)	8"	#4 (#13M)	9"	#4 (#13M)	10"	#4 (#13M)	10 1/2"	#4 (#13M)
4'-0" TO 5'-0" (1.2m TO 1.50m)	8"	#4 (#13M)	9 1/2"	#4 (#13M)	11"	#4 (#13M)	12"	#4 (#13M)	12 1/2"	#5 (#16M)
5'-0" TO 6'-0" (1.5m TO 1.85m)	9"	#4 (#13M)	11"	#5 (#16M)	12 1/2"	#5 (#16M)	13 1/2"	#5 (#16M)	14 1/2"	#5 (#16M)
6'-0" TO 7'-0" (1.85m TO 2.15m)	10"	#5 (#16M)	12 1/2"	#5 (#16M)	14 1/2"	#5 (#16M)	15 1/2"	#5 (#16M)	16 1/2"	#6 (#19M)
7'-0" TO 8'-0" (2.15m TO 2.45m)	11"	#5 (#16M)	14"	#5 (#16M)	16"	#5 (#16M)	17 1/2"	#5 (#16M)	19"	#6 (#19M)
8'-0" TO 9'-0" (2.45m TO 2.75m)	12 1/2"	#5 (#16M)	15 1/2"	#6 (#19M)	17 1/2"	#6 (#19M)	19 1/2"	#6 (#19M)	21"	#6 (#19M)
9'-0" TO 10'-0" (2.75m TO 3.0m)	13 1/2"	#6 (#19M)	17"	#6 (#19M)	19 1/2"	#6 (#19M)	21 1/2"	#6 (#19M)	23"	#6 (#19M)
10'-0" TO 10'-0" (3.0m TO 3.35m)	14 1/2"	#6 (#19M)	18 1/2"	#6 (#19M)	21"	#6 (#19M)	23 1/2"	#7 (#22M)	25"	#7 (#22M)
11'-0" TO 12'-0" (3.35m TO 3.65m)	15 1/2"	#6 (#19M)	20"	#6 (#19M)	23"	#7 (#22M)	25 1/2"	#7 (#22M)	27"	#7 (#22M)
12'-0" TO 13'-0" (3.65m TO 4.00m)	17"	#6 (#19M)	21 1/2"	#7 (#22M)	24 1/2"	#7 (#22M)	27 1/2"	#7 (#22M)	29"	#7 (#22M)
13'-1" TO 14'-0" (4.00m TO 4.25m)	18"	#7 (#22M)	23"	#7 (#22M)	26 1/2"	#7 (#22M)	29 1/2"	#7 (#22M)	31 1/2"	#7 (#22M)
14'-0" TO 15'-0" (4.25m TO 4.60m)	19"	#7 (#22M)	25"	#7 (#22M)	28"	#7 (#22M)	31 1/2"	#7 (#22M)		
15'-0" TO 16'-0" (4.6m TO 4.90m)	20 1/2"	#7 (#22M)	26 1/2"	#7 (#22M)	30"	#8 (#25M)				
16'-0" TO 17'-0" (4.90 TO 5.20m)	21 1/2"	#7 (#22M)	28"	#8 (#25M)						
17'-0" TO 18'-0" (5.20m TO 5.50m)	22 1/2"	#8 (#25M)	29 1/2"	#8 (#25M)						

S

COLUMN SUPPORT WITH REINFORCED CONCRETE BEAM

CASE 4

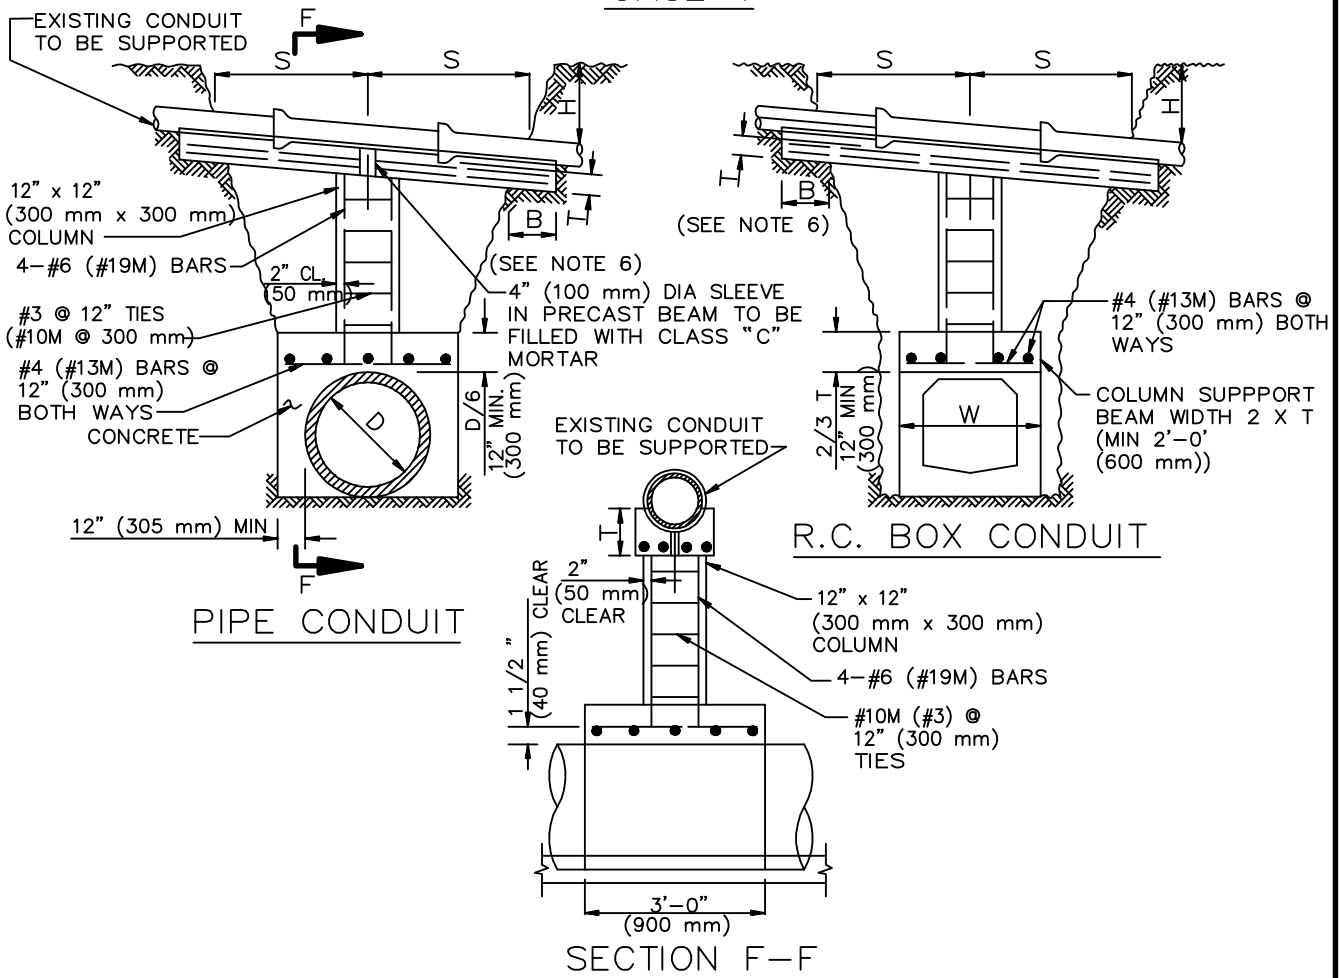

NOTES

- SPAN "S" SHALL BE MAXIMUM 18' (5.5 m) FOR EARTH COVER 8' (2.45 m) OR LESS, 12' (3.65 m) FOR EARTH COVER 16' (4.9 m) OR LESS, AND 10' (3.0 m) FOR OVER 16' (4.9 m) EARTH COVER.
- CONCRETE SHALL BE CLASS 560-C-3250 (330-C-23).
- WHEN THE PIPE TO BE SUPPORTED CROSSES THE TRENCH ON A SKEW ANGLE, THE WALL OR BEAM WHICH SUPPORTS THE COLUMN SHALL BE CONSTRUCTED AT RIGHT ANGLE TO THE TRENCH.
- SUPPORT SYSTEM MAY BE USED OVER CAST-IN-PLACE STRUCTURES.
- BACKFILL ABOVE THE SUPPORT BEAM SHALL NOT BE PLACED UNTIL 72 HOURS AFTER THE SUPPORT IS POURED.
- REINFORCED CONCRETE BEAM DIMENSIONED AND REINFORCED PER TABLE UNDER CASE 1.

GENERAL NOTES

- "S" IS THE SPAN OF THE PIPE SUPPORT MEASURED ALONG ITS CENTERLINE.
- "B" IS THE LENGTH OF BEARING OF THE SUPPORT AGAINST UNDISTURBED EARTH MEASURED ALONG THE PIPE CENTERLINE.
- CASE 2 SHALL BE USED FOR PARTIAL CROSSINGS, EXCEPT THAT WHERE THE DISTANCE FROM A SEWER CHIMNEY TO UNDISTURBED EARTH IS 18" (450 mm) OR LESS, THE TRENCH BACKFILL MAY BE DENSIFIED TO 18" (450 mm) ABOVE A HOUSE CONNECTION SEWER AND THEN RE-EXCAVATED FOR THE PIPE INSTALLATION.
- ANY SEWER OR STORM DRAIN EXPOSED OR PARTIALLY EXPOSED IN A TUNNEL EXCAVATION SHALL BE SUPPORTED WITH A WALL, CASE 2.
- IF BEDDING IS REMOVED FROM THE EXISTING PIPE THAT WILL REMAIN IN PLACE, THE PIPE SHALL BE EMBEDDED WITH CONCRETE AT NO EXTRA COST TO THE AGENCY.
- UNLESS OTHERWISE INDICATED, CONCRETE SHALL BE CLASS 450-C2000 (265-C-14).


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

SUPPORTS FOR CONDUITS ACROSS TRENCHES

224-2


SHEET 4 OF 3

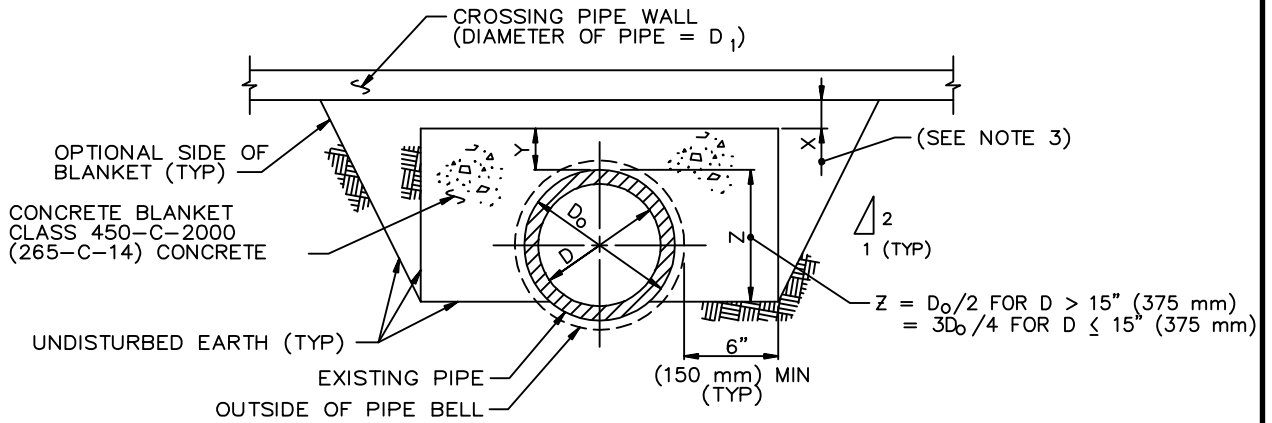

CONCRETE BLANKET
(FOR EXISTING PIPES CROSSED OVER BY A NEW PIPE)

NOTES:

1. CONCRETE BLANKET IS REQUIRED WHEN THE CLEARANCE BETWEEN THE TOP OF THE EXISTING PIPE AND THE BOTTOM OF THE CROSSING PIPE IS LESS THAN 18" (450 mm).
2. $Y = D/6$ (6" (150 mm) MIN). WHERE THE CLEARANCE BETWEEN THE TOP OF THE EXISTING PIPE AND THE BOTTOM OF THE CROSSING PIPE IS LESS THAN Y, THE CONCRETE SHALL BE PLACED BETWEEN THE PIPES AND AROUND THE SIDES OF THE CROSSING PIPE UP TO A LEVEL EQUAL TO Y ABOVE THE EXISTING PIPE, OR AS REQUIRED BY NOTE 3 BELOW, WHICHEVER IS HIGHER.
3. $X = D/12$, MINIMUM, TO PROVIDE BEDDING MATERIAL FOR THE CROSSING CONDUIT. WHEN X IS LESS THAN THIS MINIMUM, THE ENTIRE TOP SURFACE OF THE BLANKET SHALL BE RAISED TO MAKE CONTACT WITH THE LOWER 90° OF THE CROSSING PIPE.
4. THE BLANKET SHALL EXTEND LONGITUDINALLY TO THE FIRST JOINT BEYOND THE TRENCH EXCAVATION AT EACH END OF THE BLANKET, EXCEPT THAT THE BLANKET NEED NOT BE EXTENDED MORE THAN 4' (1.2m) BEYOND THE TRENCH.
5. WHENEVER A PIPE BELL IS ENCOUNTERED WITHIN THE LIMITS OF THE BLANKET, ALL DIMENSIONS SHALL REFER TO THE BELL.

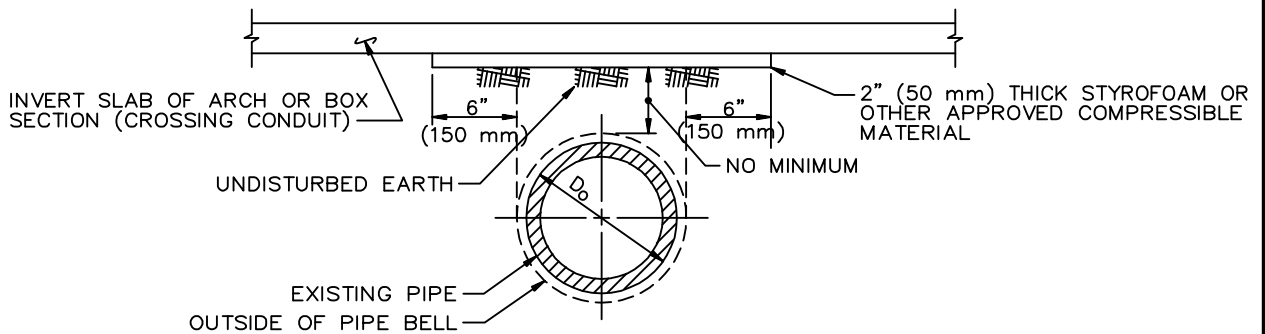

COMPRESSIBLE BLANKET
(FOR EXISTING PIPES CROSSED OVER BY A NEW BOX OR ARCH)

NOTES:

1. COMPRESSIBLE BLANKET IS REQUIRED WHEN THE CLEARANCE BETWEEN THE TOP OF THE EXISTING PIPE AND THE BOTTOM OF THE CROSSING CONDUIT (BOX OR ARCH) IS LESS THAN 18" (450 mm).
2. THE BLANKET SHALL EXTEND LONGITUDINALLY FOR THE FULL CROSSING CONDUIT TRENCH WIDTH.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

BLANKET PROTECTION FOR PIPES

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

225-2

SHEET 1 OF 1

SECTION 3

Flood Control and Storm Drain Facilities

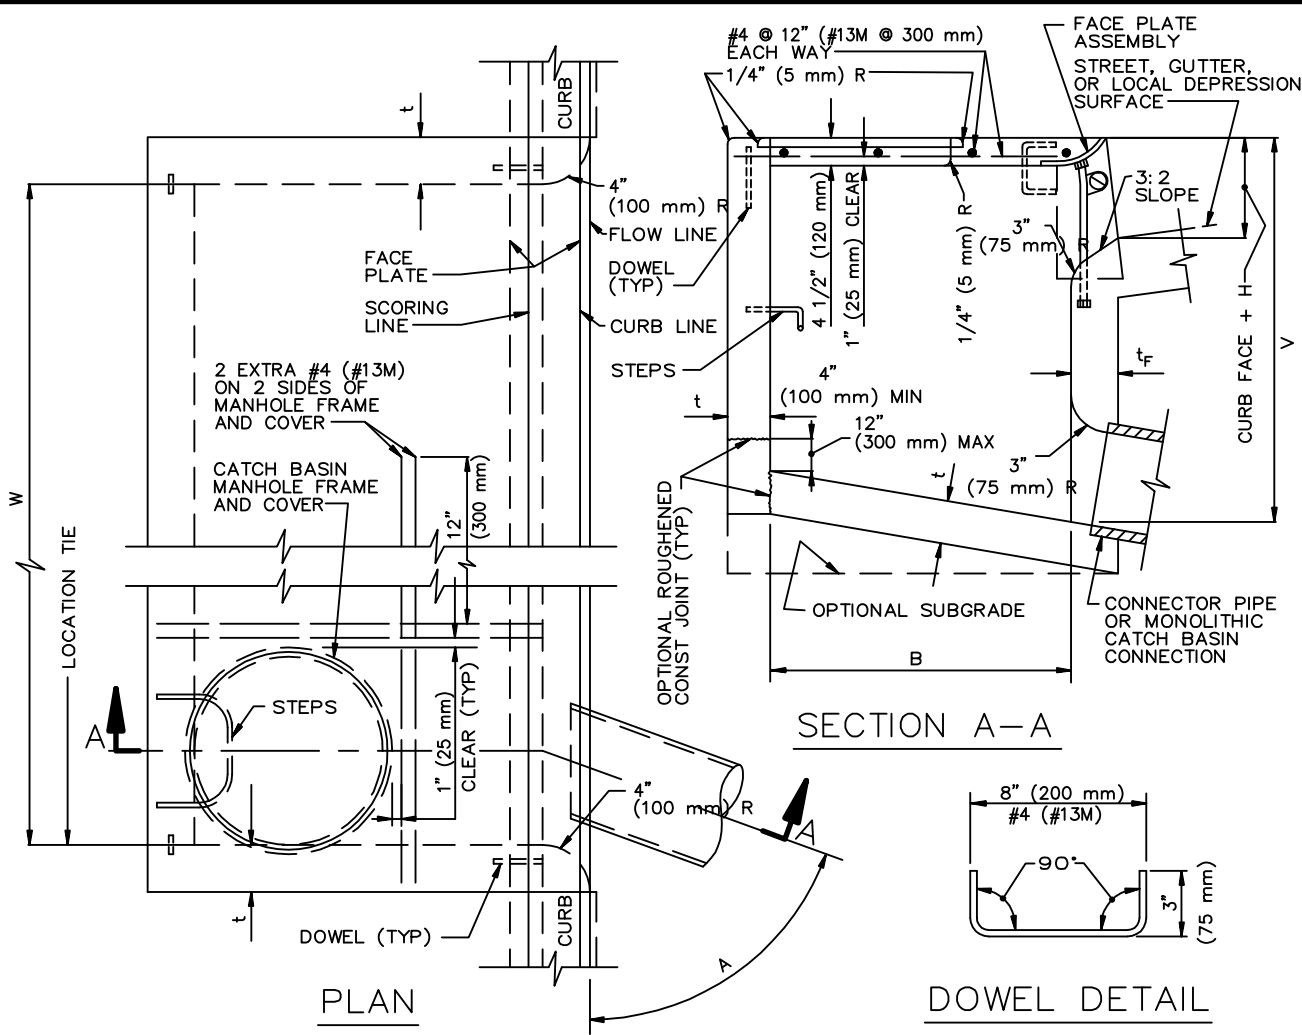

STRUCTURAL DATA							
WALL AND SLAB DIMENSIONS AND REINFORCEMENT REQUIREMENTS							
MAX W	MAX V	t	t _F	REINFORCEMENT REQUIRED IN			
				FRONT WALL	REAR WALL	BOTTOM SLAB	END WALL
3.5' (1.0 m)	8' (2.4 m)	6" (150 mm)	6" (150 mm)	NO	REINFORCEMENT	REINFORCEMENT	REQUIRED
3.5' (1.0 m)	12' (3.5 m)	8" (200 mm)	8" (200 mm)				
7' (2.0 m)	6' (1.8 m)	6" (150 mm)	6" (150 mm)				
7' (2.0 m)	12' (3.5 m)	8" (200 mm)	8" (200 mm)				
14' (4.0 m)	4' (1.2 m)	6" (150 mm)	6" (150 mm)	REINFORCEMENT	REINFORCEMENT	REINFORCEMENT	REQUIRED
	8' (2.4 m)	6" (150 mm)	8" (200 mm)				
14' (4.0 m)	12' (3.5 m)	8" (200 mm)	10" (250 mm)				
6 m (21') AND 9 m (28')	4' (1.2 m)	6" (150 mm)	6" (150 mm)				
	6' (1.8 m)	6" (150 mm)	8" (200 mm)				
	8' (2.4 m)	8" (200 mm)	8" (200 mm)				
	10' (3.0 m)	8" (200 mm)	10" (250 mm)				
	12' (3.5 m)	8" (200 mm)	10" (250 mm)				


FOR W > 28' (9 m), V > 12' (3.5 m) OR B > 4' (1.2 m) SEE PLANS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION


PROMULGATED BY THE PUBLIC WORKS STANDARDS, INC., GREENBOOK COMMITTEE 1984 REV. 1992, 1996, 2009	<h1 style="margin: 0;">CURB OPENING CATCH BASIN</h1>	STANDARD PLAN <h2 style="margin: 0;">300-3</h2>
USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION		SHEET 1 OF 2

NOTES:


1. WHERE THE BASIN IS TO BE CONSTRUCTED WITHIN THE LIMITS OF EXISTING OR PROPOSED SIDEWALK OR IS CONTIGUOUS TO SUCH SIDEWALK, THE TOP SLAB OF THE BASIN MAY BE POURED EITHER MONOLITHIC WITH THE SIDEWALK OR SEPARATELY, USING THE SAME CLASS OF CONCRETE AS IN THE BASIN. WHEN POURED MONOLITHICALLY, THE SIDEWALK SHALL BE PROVIDED WITH A WEAKENED PLANE OR A 1" (25 mm) DEEP SAWCUT CONTINUOUSLY AROUND THE EXTERNAL PERIMETER OF THE CATCH BASIN WALLS, INCLUDING ACROSS THE FULL WIDTH OF THE SIDEWALK. SURFACE OF ALL EXPOSED CONCRETE SHALL CONFORM IN SLOPE, GRADE, COLOR, FINISH, AND SCORING TO EXISTING OR PROPOSED CURB AND WALK ADJACENT TO THE BASIN.
2. ALL CURVED CONCRETE SURFACES SHALL BE FORMED BY CURVED FORMS, AND SHALL NOT BE SHAPED BY PLASTERING.
3. FLOOR OF BASIN SHALL BE GIVEN A STEEL TROWEL FINISH AND SHALL HAVE A LONGITUDINAL AND LATERAL SLOPE OF 1:12 MINIMUM AND 1:3 MAXIMUM, EXCEPT WHERE THE GUTTER GRADE EXCEEDS 8%, IN WHICH CASE THE LONGITUDINAL SLOPE OF THE FLOOR SHALL BE THE SAME AS THE GUTTER GRADE. SLOPE FLOOR FROM ALL DIRECTIONS TO THE OUTLET.
4. DIMENSIONS:
 - B = 3'-2" (970 mm)
 - V = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE CATCH BASIN AT THE OUTLET = 4.5' (1.35 m).
 - V_U = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT AT THE UPSTREAM END OF THE BASIN, AND SHALL BE DETERMINED BY THE REQUIREMENTS OF NOTE 3, BUT SHALL NOT BE LESS THAN CURB FACE PLUS 12" (300 mm).
 - V_I = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE INLET, NOTED ON THE PLANS.
 - H = NOTED ON THE PLANS.
 - W = NOTED ON THE PLANS.
 - A = THE ANGLE, IN DEGREES, INTERCEPTED BY THE CENTERLINE OF THE CONNECTOR PIPE AND THE CATCH BASIN WALL TO WHICH THE CONNECTOR PIPE IS ATTACHED.
5. PLACE CONNECTOR PIPES AS INDICATED ON THE PLANS. UNLESS OTHERWISE SPECIFIED, THE CONNECTOR PIPE SHALL BE LOCATED AT THE DOWNSTREAM END OF THE BASIN. WHERE THE CONNECTOR PIPE IS SHOWN AT A CORNER, THE CENTERLINE OF THE PIPE SHALL INTERSECT THE INSIDE CORNER OF THE BASIN. THE PIPE MAY BE CUT AND TRIMMED AT A SKEW NECESSARY TO INSURE MINIMUM 3" (80 mm) PIPE EMBEDMENT, ALL AROUND, WITHIN THE CATCH BASIN WALL, AND 3" (75 mm) RADIUS OF ROUNDING OF STRUCTURE CONCRETE, ALL AROUND, ADJACENT TO PIPE ENDS. A MONOLITHIC CATCH BASIN CONNECTION SHALL BE USED TO JOIN THE CONNECTOR PIPE TO THE CATCH BASIN WHENEVER ANGLE "A" IS LESS THAN 70° OR GREATER THAN 110°, OR WHENEVER THE CONNECTOR PIPE IS LOCATED IN A CORNER. THE OPTIONAL USE OF A MONOLITHIC CATCH BASIN CONNECTION IN ANY CASE IS PERMITTED. MONOLITHIC CATCH BASIN CONNECTIONS MAY BE CONSTRUCTED TO AVOID CUTTING STANDARD LENGTHS OF PIPE.
6. STEPS SHALL BE LOCATED AS SHOWN. IF THE CONNECTOR PIPE INTERFERES WITH THE STEPS, THEY SHALL BE LOCATED AT THE CENTERLINE OF THE DOWNSTREAM END WALL. STEPS SHALL BE SPACED 12" (300 mm) APART. THE TOP STEP SHALL BE 7" (175 mm) BELOW THE TOP OF THE MANHOLE AND PROJECT 2-1/2" (65 mm). ALL OTHER STEPS SHALL PROJECT 5" (130 mm).
7. DOWELS ARE REQUIRED AT EACH CORNER AND AT 7' (2 m) ON CENTER (MAXIMUM) ALONG THE BACKWALL.
8. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
 - 308 MONOLITHIC CATCH BASIN CONNECTION
 - 309 CATCH BASIN REINFORCEMENT
 - 310 CATCH BASIN FACE PLATE ASSEMBLY AND PROTECTION BAR
 - 312 CATCH BASIN MANHOLE FRAME AND COVER
 - 635 STEEL STEP
 - 636 POLYPROPYLENE PLASTIC STEP

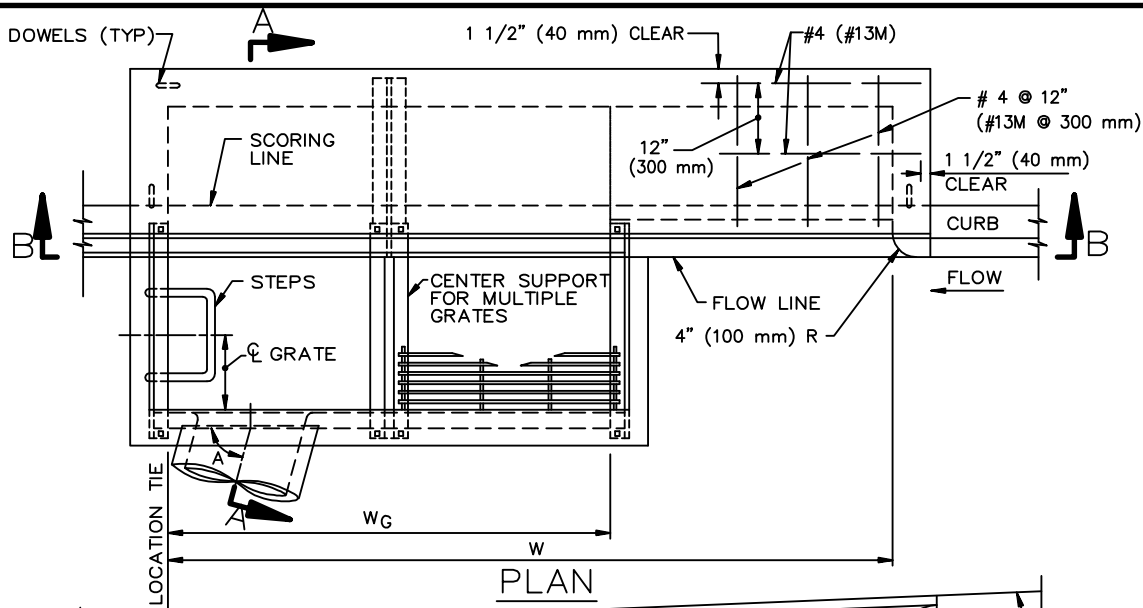


PLAN

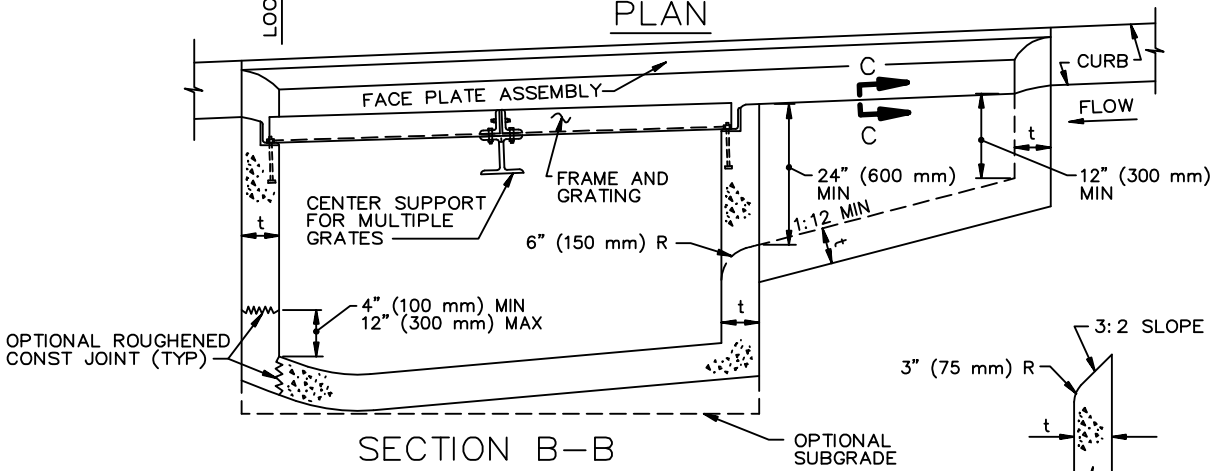


SECTION B-B

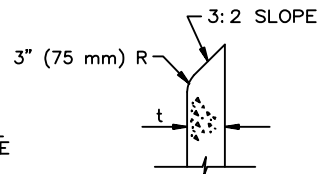

SECTION C-C

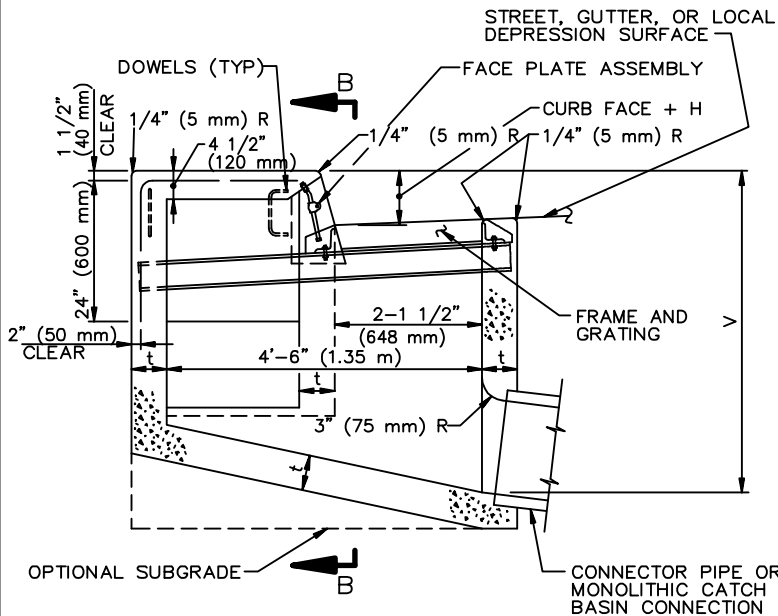

SECTION A-A



DOWEL DETAIL

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS, INC.,
GREENBOOK COMMITTEE
1984
REV. 1992, 1996, 2009

**CURB OPENING CATCH BASIN WITH
GRATING(S) AND DEBRIS SKIMMER**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

301-3

SHEET 1 OF 3

STRUCTURAL DATA							
WALL AND SLAB DIMENSIONS AND REINFORCEMENT REQUIREMENTS							
MAXIMUM			t	WALL			FLOOR
W	GRATES	V		FRONT	REAR	END	
7' (2.0 m)	1	4' (1.2 m)	6" (150 mm)	NO REINFORCEMENT REQUIRED			
7' (2.0 m)	1	8' (2.4 m)	8" (200 mm)				
7' (2.0 m)	1	10' (3.0 m)	10" (250 mm)				
14' (4.0 m)	3	4' (1.2 m)	6" (150 mm)				
14' (4.0 m)	2	8' (2.4 m)	8" (200 mm)	REINFORCEMENT REQUIRED			
14' (4.0 m)	2	10' (3.0 m)	10" (250 mm)				
14' (4.0 m)	2	12' (3.5 m)	10" (250 mm)	REINFORCEMENT REQUIRED			
28' (9.0 m)	6	4' (1.2 m)	6" (150 mm)				
28' (9.0 m)	6	6' (1.8 m)	8" (200 mm)				
28' (9.0 m)	7	4' (1.2 m)	6" (150 mm)				
28' (9.0 m)	7	8' (2.4 m)	8" (200 mm)				
28' (9.0 m)	7	10' (3.0 m)	10" (250 mm)				
28' (9.0 m)	7	12' (3.5 m)	10" (250 mm)				

FOR W > 28' (9 m), V > 12' (3.5 m) OR NO. OF GRATES > 7 SEE PLANS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**CURB OPENING CATCH BASIN WITH
GRATING(S) AND DEBRIS SKIMMER**

301-3

SHEET 2 OF 3

NOTES:

1. WHERE THE BASIN IS TO BE CONSTRUCTED WITHIN THE LIMITS OF EXISTING OR PROPOSED SIDEWALK OR IS CONTIGUOUS TO SUCH SIDEWALK, THE TOP SLAB OF THE BASIN MAY BE POURED EITHER MONOLITHIC WITH THE SIDEWALK OR SEPARATELY, USING THE SAME CLASS OF CONCRETE AS IN THE BASIN. WHEN POURED MONOLITHICALLY, THE SIDEWALK SHALL BE PROVIDED WITH A WEAKENED PLANE OR A 1" (25 mm) DEEP SAWCUT CONTINUOUSLY AROUND THE EXTERNAL PERIMETER OF THE CATCH BASIN WALLS, INCLUDING ACROSS THE FULL WIDTH OF THE SIDEWALK. SURFACE OF ALL EXPOSED CONCRETE SHALL CONFORM IN SLOPE, GRADE, COLOR, FINISH, AND SCORING TO EXISTING OR PROPOSED CURB AND WALK ADJACENT TO THE BASIN.
2. ALL CURVED CONCRETE SURFACES SHALL BE FORMED BY CURVED FORMS, AND SHALL NOT BE SHAPED BY PLASTERING.
3. FLOOR OF BASIN SHALL BE GIVEN A STEEL TROWEL FINISH. FLOOR OF GRATING PORTION SHALL HAVE A LONGITUDINAL AND LATERAL SLOPE OF 1:12 MINIMUM AND 1:3 MAXIMUM, EXCEPT WHERE THE GUTTER GRADE EXCEEDS 8%, IN WHICH CASE THE LONGITUDINAL SLOPE OF THE FLOOR SHALL BE THE SAME AS THE GUTTER GRADE, SLOPE FLOOR FROM ALL DIRECTIONS TO THE OUTLET.
4. DIMENSIONS:
 - V = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE CATCH BASIN AT THE OUTLET = 4.5' (1.35 m).
 - V_I = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE INLET, NOTED ON THE PLANS.
 - H = NOTED ON THE PLANS.
 - W = 7' (2 m) UNLESS OTHERWISE NOTED ON THE PLANS.
 - W_G = 2'-11 3/8" (900 mm) FOR ONE GRATING; ADD 3'-5 3/8" (1051 mm) FOR EACH ADDITIONAL GRATING. ONE GRATING IS REQUIRED UNLESS OTHERWISE SHOWN ON THE PLANS.
 - A = THE ANGLE, IN DEGREES, INTERCEPTED BY THE CENTERLINE OF THE CONNECTOR PIPE AND THE CATCH BASIN WALL TO WHICH THE CONNECTOR PIPE IS ATTACHED.
5. PLACE CONNECTOR PIPES AS INDICATED ON THE PLANS. UNLESS OTHERWISE SPECIFIED, THE CONNECTOR PIPE SHALL BE LOCATED AT THE DOWNSTREAM END OF THE BASIN. WHERE THE CONNECTOR PIPE IS SHOWN AT A CORNER, THE CENTERLINE OF THE PIPE SHALL INTERSECT THE INSIDE CORNER OF THE BASIN. THE PIPE MAY BE CUT AND TRIMMED AT A SKEW NECESSARY TO INSURE MINIMUM 3" (80 mm) PIPE EMBEDMENT, ALL AROUND, WITHIN THE CATCH BASIN WALL, AND 3" (75 mm) RADIUS OF ROUNDING OF STRUCTURE CONCRETE, ALL AROUND, ADJACENT TO PIPE ENDS. A MONOLITHIC CATCH BASIN CONNECTION SHALL BE USED TO JOIN THE CONNECTOR PIPE TO THE CATCH BASIN WHENEVER ANGLE "A" IS LESS THAN 70° OR GREATER THAN 110°, OR WHENEVER THE CONNECTOR PIPE IS LOCATED IN A CORNER. THE OPTIONAL USE OF A MONOLITHIC CATCH BASIN CONNECTION IN ANY CASE IS PERMITTED. MONOLITHIC CATCH BASIN CONNECTIONS MAY BE CONSTRUCTED TO AVOID CUTTING STANDARD LENGTHS OF PIPE.
6. STEPS SHALL BE LOCATED AS SHOWN. IF THE CONNECTOR PIPE INTERFERES WITH THE STEPS, THEY SHALL BE LOCATED ON THE FRONT WALL AT THE CENTERLINE OF THE DOWNSTREAM GRATING. STEPS SHALL BE SPACED 12" (80 mm) APART. THE TOP STEP SHALL BE 7" (175 mm) BELOW THE TOP OF THE GRATING AND PROJECT 2-1/2" (65 mm). ALL OTHER STEPS SHALL PROJECT 5" (130 mm).
7. DOWELS ARE REQUIRED AT EACH CORNER AND AT 7' (2 m) ON CENTER (MAXIMUM) ALONG THE BACKWALL.
8. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
 - 308 MONOLITHIC CATCH BASIN CONNECTION
 - 309 CATCH BASIN REINFORCEMENT
 - 310 CATCH BASIN FACE PLATE ASSEMBLY AND PROTECTION BAR
 - 311 FRAME AND GRATING FOR CATCH BASINS
 - 635 STEEL STEP
 - 636 POLYPROPYLENE PLASTIC STEP


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**CURB OPENING CATCH BASIN WITH
GRATING(S) AND DEBRIS SKIMMER**


301-3

SHEET 3 OF 3

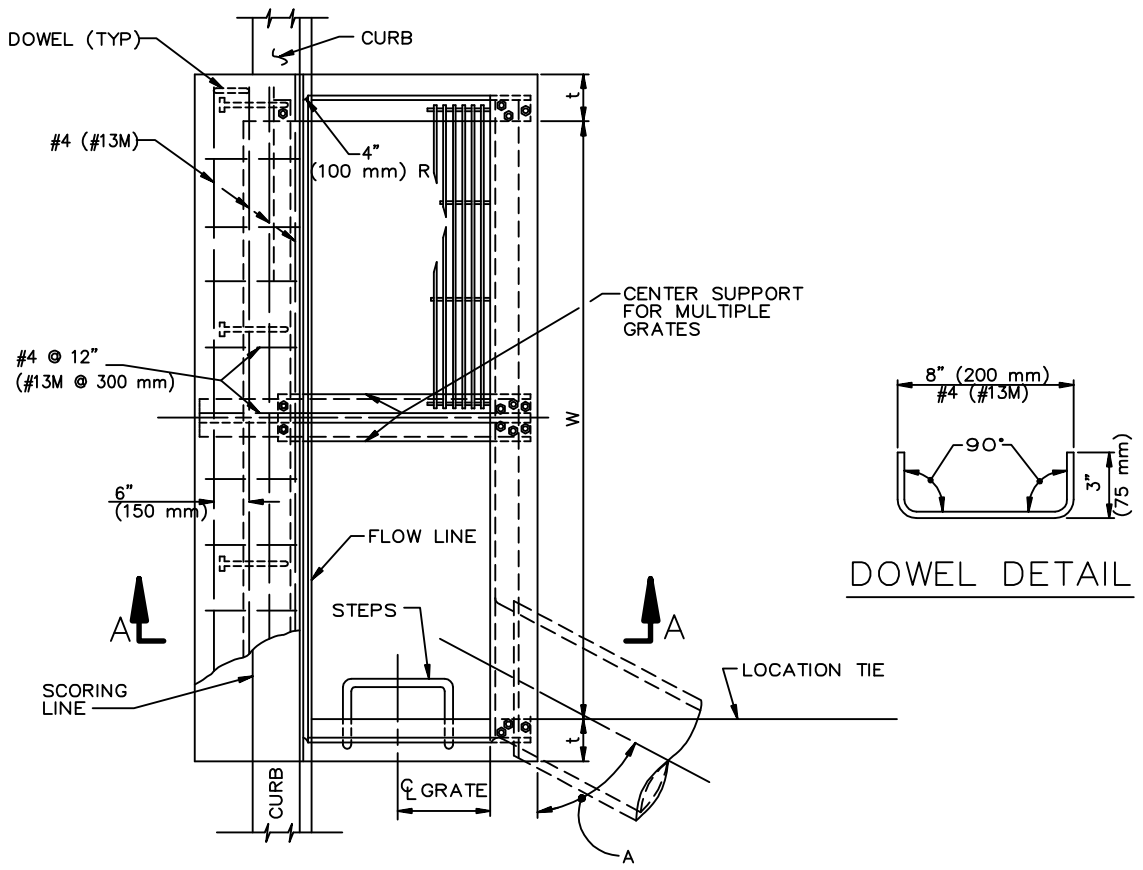

PLAN

DOWEL DETAIL

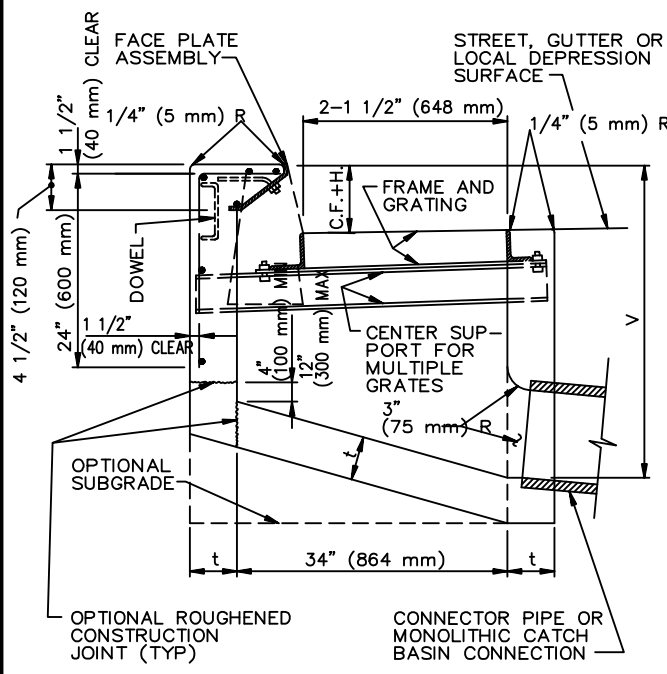

SECTION A-A

STRUCTURAL DATA			
WALL AND SLAB DIMENSIONS AND REINFORCEMENT REQUIREMENTS			
NO. OF GRATES	MAXIMUM V	t	REINFORCEMENT FOR WALLS AND SLABS
1-2	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
1-2	8' (2.4 m)	8" (200 mm)	
1-2	10' (3.0 m)	10" (250 mm)	
1-2	12' (3.5 m)	10" (250 mm)	REQUIRED
3-4	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
3-4	7' (2.0 m)	8" (200 mm)	
3-4	8' (2.4 m)	8" (200 mm)	REQUIRED
3-4	12' (3.5 m)	10" (250 mm)	
5-6	4' (1.2 m)	6" (150 mm)	
5-6	6' (1.8 m)	8" (200 mm)	
5-6	8' (2.4 m)	8" (200 mm)	
5-6	12' (3.5 m)	10" (250 mm)	REQUIRED
> 6	4' (1.2 m)	6" (150 mm)	
> 6	8' (2.4 m)	8" (200 mm)	
> 6	12' (3.5 m)	10" (250 mm)	

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS, INC.,
GREENBOOK COMMITTEE
1984
REV. 1992, 1996, 2009

**CURB OPENING CATCH BASIN
WITH GRATING(S)**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
302-3
SHEET 1 OF 2

NOTES:

1. WHERE THE BASIN IS TO BE CONSTRUCTED WITHIN THE LIMITS OF EXISTING OR PROPOSED SIDEWALK OR IS CONTIGUOUS TO SUCH SIDEWALK, THE TOP SLAB OF THE BASIN MAY BE POURED EITHER MONOLITHIC WITH THE SIDEWALK OR SEPARATELY, USING THE SAME CLASS OF CONCRETE AS IN THE BASIN. WHEN POURED MONOLITHICALLY, THE SIDEWALK SHALL BE PROVIDED WITH A WEAKENED PLANE OR A 1" (25 mm) DEEP SAWCUT CONTINUOUSLY AROUND THE EXTERNAL PERIMETER OF THE CATCH BASIN WALLS, INCLUDING ACROSS THE FULL WIDTH OF THE SIDEWALK. SURFACE OF ALL EXPOSED CONCRETE SHALL CONFORM IN SLOPE, GRADE, COLOR, FINISH, AND SCORING TO EXISTING OR PROPOSED CURB AND WALK ADJACENT TO THE BASIN.
2. ALL CURVED CONCRETE SURFACES SHALL BE FORMED BY CURVED FORMS, AND SHALL NOT BE SHAPED BY PLASTERING.
3. ONE GRATING IS REQUIRED UNLESS OTHERWISE SHOWN ON THE PROJECT PLAN.
4. FLOOR OF BASIN SHALL BE GIVEN A STEEL TROWEL FINISH AND SHALL HAVE A LONGITUDINAL AND LATERAL SLOPE OF 1:12 MINIMUM AND 1:3 MAXIMUM, EXCEPT WHERE THE GUTTER GRADE EXCEEDS 8%, IN WHICH CASE THE LONGITUDINAL SLOPE OF THE FLOOR SHALL BE THE SAME AS THE GUTTER GRADE. SLOPE FLOOR FROM ALL DIRECTIONS TO THE OUTLET.
5. DIMENSIONS:
 - V = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE CATCH BASIN AT THE OUTLET = 4.5' (1.35 m).
 - V_U = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT AT THE UPSTREAM END OF THE BASIN, AND SHALL BE DETERMINED BY THE REQUIREMENTS OF NOTE 4, BUT SHALL NOT BE LESS THAN CURB FACE PLUS 12" (300 mm).
 - V_I = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE INLET, NOTED ON THE PLANS.
 - H = NOTED ON THE PROJECT PLANS.
 - W = 2'-11 3/8" (900 mm) FOR ONE GRATING; ADD 3'-5 3/8" (1051 mm) FOR EACH ADDITIONAL GRATING.
 - A = THE ANGLE, IN DEGREES, INTERCEPTED BY THE CENTERLINE OF THE CONNECTOR PIPE AND THE CATCH BASIN WALL TO WHICH THE CONNECTOR PIPE IS ATTACHED.
6. PLACE CONNECTOR PIPES AS INDICATED ON THE PLANS. UNLESS OTHERWISE SPECIFIED, THE CONNECTOR PIPE SHALL BE LOCATED AT THE DOWNSTREAM END OF THE BASIN. WHERE THE CONNECTOR PIPE IS SHOWN AT A CORNER, THE CENTERLINE OF THE PIPE SHALL INTERSECT THE INSIDE CORNER OF THE BASIN. THE PIPE MAY BE CUT AND TRIMMED AT A SKEW NECESSARY TO INSURE MINIMUM 3" (80 mm) PIPE EMBEDMENT, ALL AROUND, WITHIN THE CATCH BASIN WALL, AND 3" (75 mm) RADIUS OF ROUNDING OF STRUCTURE CONCRETE, ALL AROUND, ADJACENT TO PIPE ENDS, A MONOLITHIC CATCH BASIN CONNECTION SHALL BE USED TO JOIN THE CONNECTOR PIPE TO THE CATCH BASIN WHENEVER ANGLE "A" IS LESS THAN 70° OR GREATER THAN 110°, OR WHENEVER THE CONNECTOR PIPE IS LOCATED IN A CORNER. THE OPTIONAL USE OF A MONOLITHIC CATCH BASIN CONNECTION IN ANY CASE IS PERMITTED. MONOLITHIC CATCH BASIN CONNECTIONS MAY BE CONSTRUCTED TO AVOID CUTTING STANDARD LENGTHS OF PIPE.
7. STEPS SHALL BE LOCATED AS SHOWN. IF THE CONNECTOR PIPE INTERFERES WITH THE STEPS, THEY SHALL BE LOCATED ON THE FRONT WALL AT THE CENTERLINE OF THE DOWNSTREAM GRATING. STEPS SHALL BE SPACED 12" (300 mm) APART. THE TOP STEP SHALL BE 7" (175 mm) BELOW THE TOP OF THE GRATING AND PROJECT 2 1/2" (65 mm). ALL OTHER STEPS SHALL PROJECT 5" (130 mm).
8. DOWELS ARE REQUIRED AT EACH CORNER AND AT 7' (2.1 m) ON CENTER (MAXIMUM) ALONG THE BACKWALL.
9. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
 - 308 MONOLITHIC CATCH BASIN CONNECTION
 - 309 CATCH BASIN REINFORCEMENT
 - 310 CATCH BASIN FACE PLATE ASSEMBLY AND PROTECTION BAR
 - 311 FRAME AND GRATING FOR CATCH BASINS
 - 635 STEEL STEP
 - 636 POLYPROPYLENE PLASTIC STEP



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**CURB OPENING CATCH BASIN
WITH GRATING(S)**

302-3

SHEET 2 OF 2

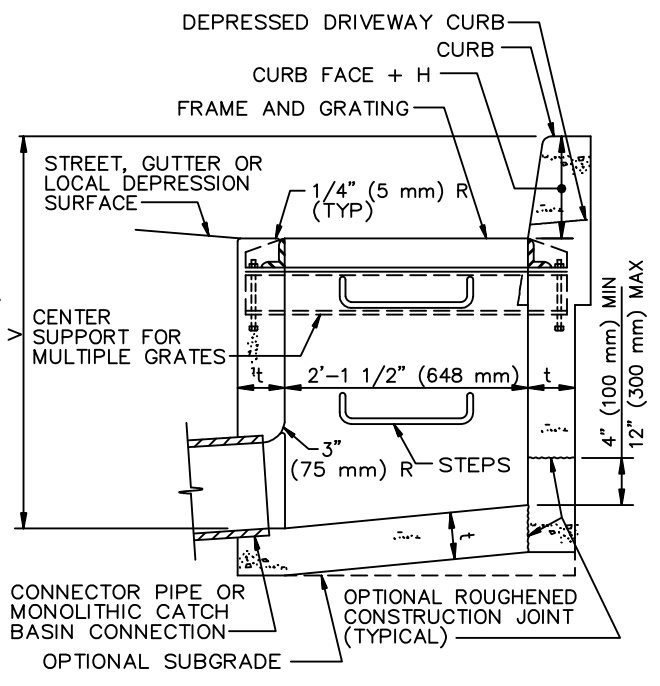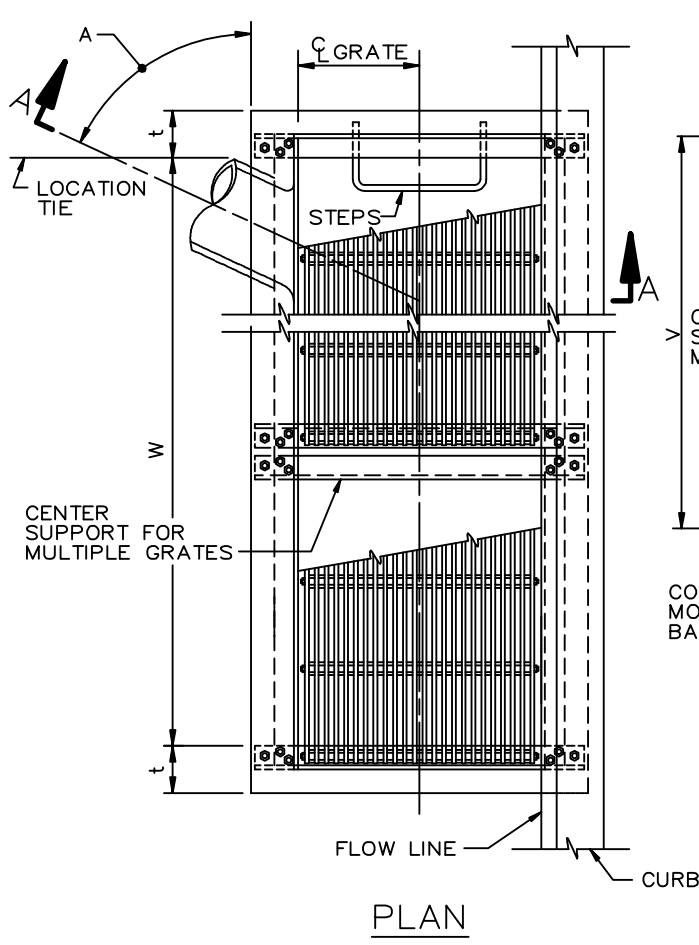

SECTION A-A

STRUCTURAL DATA			
WALL AND SLAB DIMENSIONS AND REINFORCEMENT REQUIREMENTS			
NO. OF GRATES	MAX V	t	REINFORCEMENT FOR WALLS AND SLABS
1-2	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
1-2	8' (2.4 m)	8" (200 mm)	
1-2	10' (3.0 m)	10" (250 mm)	
1-2	12' (3.5 m)	10" (250 mm)	REQUIRED
3-4	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
3-4	7' (2.0 m)	8" (200 mm)	
3-4	8' (2.4 m)	8" (200 mm)	
3-4	12' (3.5 m)	10" (250 mm)	REQUIRED
5-6	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
5-6	6' (1.8 m)	8" (200 mm)	
5-6	8' (2.4 m)	8" (200 mm)	
5-6	12' (3.5 m)	8" (200 mm)	REQUIRED
> 6	4' (1.2 m)	6" (150 mm)	
> 6	8' (2.4 m)	8" (200 mm)	
> 6	12' (3.5 m)	10" (250 mm)	

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS, INC.,
GREENBOOK COMMITTEE
1984
REV. 1992, 1996, 2009

CURBSIDE GRATING CATCH BASIN

STANDARD PLAN
303-3
SHEET 1 OF 2

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

NOTES:

1. SURFACE OF ALL EXPOSED CONCRETE SHALL CONFORM IN SLOPE GRADE, COLOR, FINISH, AND SCORING TO THE EXISTING OR PROPOSED CURB ADJACENT TO THE BASIN.
2. ALL CURVED CONCRETE SURFACES SHALL BE FORMED BY CURVED FORMS, AND SHALL NOT BE SHAPED BY PLASTERING.
3. FLOOR OF BASIN SHALL BE GIVEN A STEEL TROWEL FINISH AND SHALL HAVE A LONGITUDINAL AND LATERAL SLOPE OF 1:12 MINIMUM AND 1:3 MAXIMUM, EXCEPT WHERE THE GUTTER GRADE EXCEEDS 8%, IN WHICH CASE THE LONGITUDINAL SLOPE OF THE FLOOR SHALL BE THE SAME AS THE GUTTER GRADE. SLOPE FLOOR FROM ALL DIRECTIONS TO THE OUTLET.
4. ONE GRATING IS REQUIRED UNLESS OTHERWISE SHOWN ON THE PLANS.
5. DIMENSIONS:
 - V = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE CATCH BASIN AT THE OUTLET = 4.5' (1.35 m).
 - V_I = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT AT THE UPSTREAM END OF THE BASIN, AND SHALL BE DETERMINED BY THE REQUIREMENTS OF NOTE 3, BUT SHALL NOT BE LESS THAN CURB FACE PLUS 12" (300 mm).
 - V_U = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT AT THE INLET. NOTED ON THE PLANS.
 - H = NOTED ON THE PLANS.
 - W = 2'-11 3/8" (900 mm) FOR ONE GRATING; ADD 3'-5 3/8" (1051 mm) FOR EACH ADDITIONAL GRATING.
 - A = THE ANGLE, IN DEGREES, INTERCEPTED BY THE CENTERLINE OF THE CONNECTOR PIPE AND THE CATCH BASIN WALL TO WHICH THE CONNECTOR PIPE IS ATTACHED.
6. PLACE CONNECTOR PIPES AS INDICATED ON THE PLANS. UNLESS OTHERWISE SPECIFIED, THE CONNECTOR PIPE SHALL BE LOCATED AT THE DOWNSTREAM END OF THE BASIN. WHERE THE CONNECTOR PIPE IS SHOWN AT A CORNER, THE CENTERLINE OF THE PIPE SHALL INTERSECT THE INSIDE CORNER OF THE BASIN. THE PIPE MAY BE CUT AND TRIMMED AT A SKEW NECESSARY TO INSURE MINIMUM 3" (80 mm) PIPE EMBEDMENT, ALL AROUND, WITHIN THE CATCH BASIN WALL, AND 3" (80 mm) RADIUS OF ROUNDING OF STRUCTURE CONCRETE, ALL AROUND, ADJACENT TO PIPE ENDS. A MONOLITHIC CATCH BASIN CONNECTION SHALL BE USED TO JOIN THE CONNECTOR PIPE TO THE CATCH BASIN WHENEVER ANGLE "A" IS LESS THAN 70° OR GREATER THAN 110°, OR WHENEVER THE CONNECTOR PIPE IS LOCATED IN A CORNER. THE OPTIONAL USE OF A MONOLITHIC CATCH BASIN CONNECTION IN ANY CASE IS PERMITTED. MONOLITHIC CATCH BASIN CONNECTIONS MAY BE CONSTRUCTED TO AVOID CUTTING STANDARD LENGTHS OF PIPE.
7. STEPS SHALL BE LOCATED AS SHOWN. IF THE CONNECTOR PIPE INTERFERES WITH THE STEPS, THEY SHALL BE LOCATED AT THE CENTERLINE OF THE DOWNSTREAM GRATING. STEPS SHALL BE SPACED 12" (300 mm) APART. THE TOP STEP SHALL BE 7" (175 mm) BELOW THE TOP OF THE GRATING AND PROJECT 2 1/2" (65 mm). ALL OTHER STEPS SHALL PROJECT 5" (130 mm).
8. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
 - 308 MONOLITHIC CATCH BASIN CONNECTION
 - 309 CATCH BASIN REINFORCEMENT
 - 311 FRAME AND GRATING FOR CATCH BASINS
 - 635 STEEL STEP
 - 636 POLYPROPYLENE PLASTIC STEP


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

CURBSIDE GRATING CATCH BASIN

303-3

SHEET 2 OF 2

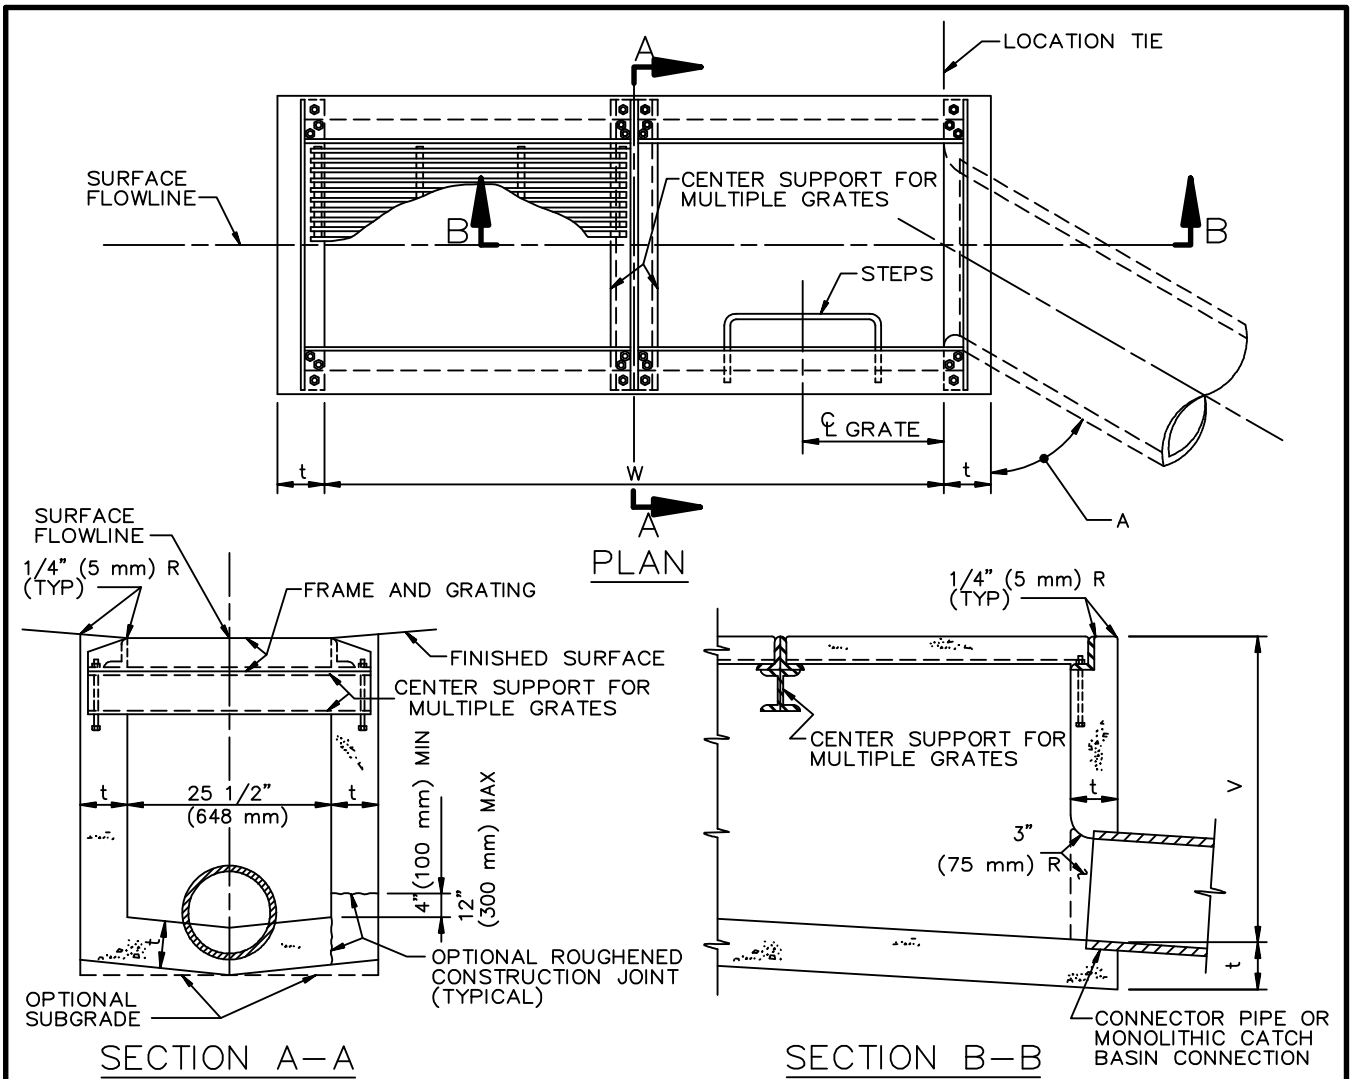

STRUCTURAL DATA			
WALL AND SLAB DIMENSIONS AND REINFORCEMENT REQUIREMENTS			
NO. OF GRATES	MAX V	t	REINFORCEMENT FOR WALLS AND SLABS
1-2	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
1-2	8' (2.4 m)	8" (200 mm)	
1-2	10' (3.0 m)	10" (250 mm)	
1-2	12' (3.5 m)	10" (250 mm)	REQUIRED
3-4	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
3-4	7' (2.0 m)	8" (200 mm)	
3-4	8' (2.4 m)	8" (200 mm)	
3-4	12' (3.5 m)	10" (250 mm)	REQUIRED
5-6	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
5-6	6' (1.8 m)	8" (200 mm)	
5-6	8' (2.4 m)	8" (200 mm)	
5-6	12' (3.5 m)	10" (250 mm)	REQUIRED
> 6	4' (1.2 m)	6" (150 mm)	
> 6	8' (2.4 m)	8" (200 mm)	
> 6	12' (3.5 m)	10" (250 mm)	

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS, INC.,
GREENBOOK COMMITTEE
1984
REV. 1992, 1996, 2009

**GRATING CATCH BASIN—ALLEY
(LONGITUDINAL)**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

304-3

SHEET 1 OF 2

NOTES:

1. ALL CURVED CONCRETE SURFACES SHALL BE FORMED BY CURVED FORMS, AND SHALL NOT BE SHAPED BY PLASTERING.
2. ONE GRATING IS REQUIRED UNLESS OTHERWISE SHOWN ON THE PLANS.
3. FLOOR OF BASIN SHALL BE GIVEN A STEEL TROWEL FINISH AND SHALL HAVE A LONGITUDINAL AND LATERAL SLOPE OF 1:12 MINIMUM AND 1:3 MAXIMUM, EXCEPT WHERE THE SURFACE GRADE EXCEEDS 8%, IN WHICH CASE THE LONGITUDINAL SLOPE OF THE FLOOR SHALL BE THE SAME AS THE SURFACE GRADE, SLOPE FLOOR FROM ALL DIRECTIONS TO THE OUTLET.
4. DIMENSIONS:
 - B = 3'-6" (1.0 m)
 - V_U = THE DEPTH AT THE UPSTREAM END OF THE BASIN AND SHALL BE DETERMINED BY THE REQUIREMENTS OF NOTE 3, BUT SHALL NOT BE LESS THAN 2.5' (750 mm).
 - V_I = THE DEPTH AT THE INVERT OF THE INLET. NOTED ON THE PLANS.
 - W = 2'-11 3/8" (900 mm) FOR ONE GRATING; ADD 3'-5 3/8" (1051 mm) FOR EACH ADDITIONAL GRATING.
 - A = THE ANGLE, IN DEGREES, INTERCEPTED BY THE CENTERLINE OF THE CONNECTOR PIPE AND THE CATCH BASIN WALL TO WHICH THE CONNECTOR PIPE IS ATTACHED.
5. PLACE CONNECTOR PIPES AS INDICATED ON THE PLANS. UNLESS OTHERWISE SPECIFIED, THE CONNECTOR PIPE SHALL BE LOCATED AT THE DOWNSTREAM END OF THE BASIN. WHERE THE CONNECTOR PIPE IS SHOWN AT A CORNER, THE CENTERLINE OF THE PIPE SHALL INTERSECT THE INSIDE CORNER OF THE BASIN. THE PIPE MAY BE CUT AND TRIMMED AT A SKEW NECESSARY TO INSURE MINIMUM 3" (80 mm) PIPE EMBEDMENT, ALL AROUND, WITHIN THE CATCH BASIN WALL, AND 3" (75 mm) RADIUS OF ROUNDING OF STRUCTURE CONCRETE, ALL AROUND, ADJACENT TO PIPE ENDS. A MONOLITHIC CATCH BASIN CONNECTION SHALL BE USED TO JOIN THE CONNECTOR PIPE TO THE CATCH BASIN WHENEVER ANGLE "A" IS LESS THAN 70° OR GREATER THAN 110°, OR WHENEVER THE CONNECTOR PIPE IS LOCATED IN A CORNER. THE OPTIONAL USE OF A MONOLITHIC CATCH BASIN CONNECTION IN ANY CASE IS PERMITTED. MONOLITHIC CATCH BASIN CONNECTIONS MAY BE CONSTRUCTED TO AVOID CUTTING STANDARD LENGTHS OF PIPE.
6. STEPS SHALL BE LOCATED AS SHOWN. IF THE CONNECTOR PIPE INTERFERES WITH THE STEPS, THEY SHALL BE LOCATED ON THE OPPOSITE WALL AT THE CENTERLINE OF THE DOWNSTREAM GRATING. STEPS SHALL BE SPACED 12" (300 mm) APART. THE TOP STEP SHALL BE 7" (175 mm) BELOW THE TOP OF THE GRATING AND PROJECT 2 1/2" (65 mm). ALL OTHER STEPS SHALL PROJECT 5" (130 mm).
7. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
 - 308 MONOLITHIC CATCH BASIN CONNECTION
 - 309 CATCH BASIN REINFORCEMENT
 - 311 FRAME AND GRATING FOR CATCH BASINS
 - 635 STEEL STEP
 - 636 POLYPROPYLENE PLASTIC STEP


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


GRATING CATCH BASIN—ALLEY (LONGITUDINAL)

304-3


SHEET 2 OF 2

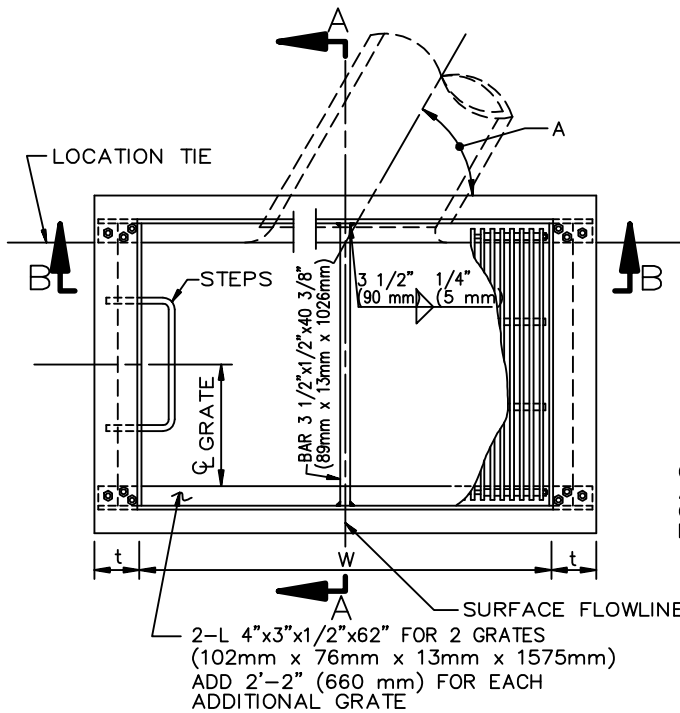

PLAN

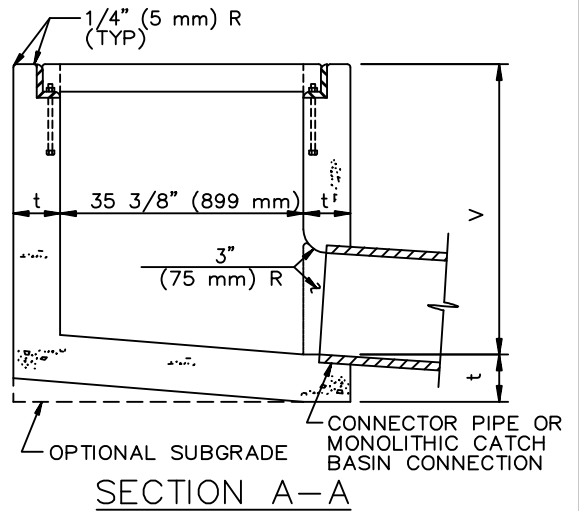

SECTION A-A

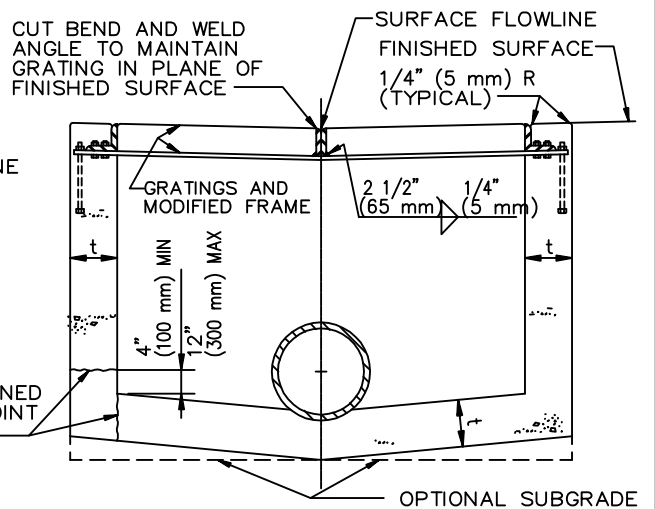

SECTION B-B

STRUCTURAL DATA

WALL AND SLAB DIMENSIONS AND REINFORCEMENT REQUIREMENTS

NO. OF GRATES	MAX V	t	REINFORCEMENT FOR WALLS AND SLABS
2-3	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
2-3	8' (2.4 m)	8" (200 mm)	
2-3	10' (3.0 m)	10" (250 mm)	
2-3	12' (3.5 m)	10" (250 mm)	REQUIRED
4-6	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
4-6	7' (2.0 m)	8" (200 mm)	
4-6	8' (2.4 m)	8" (200 mm)	
4-6	12' (3.5 m)	10" (250 mm)	REQUIRED
7-9	4' (1.2 m)	6" (150 mm)	NOT REQUIRED
7-9	6' (1.8 m)	8" (200 mm)	
7-9	8' (2.4 m)	8" (200 mm)	
7-9	12' (3.5 m)	10" (250 mm)	REQUIRED
> 9	4' (1.2 m)	6" (150 mm)	
> 9	8' (2.4 m)	8" (200 mm)	
> 9	12' (3.5 m)	10" (250 mm)	

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE PUBLIC WORKS STANDARDS, INC., GREENBOOK COMMITTEE 1984 REV. 1992, 1996, 2009

GRATING CATCH BASIN - ALLEY (TRANSVERSE)

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

305-3

SHEET 1 OF 2

NOTES:

1. ALL CURVED CONCRETE SURFACES SHALL BE FORMED BY CURVED FORMS, AND SHALL NOT BE SHAPED BY PLASTERING.
2. TWO GRATINGS ARE REQUIRED UNLESS OTHERWISE SHOWN ON THE PLANS.
3. FLOOR OF BASIN SHALL BE GIVEN A STEEL TROWEL FINISH AND SHALL HAVE A LONGITUDINAL AND LATERAL SLOPE OF 1:12 MINIMUM AND 1:3 MAXIMUM. SLOPE FLOOR FROM ALL DIRECTIONS TO THE OUTLET.
4. DIMENSIONS:
 $V = 3'-6"$ (1.0 m)
 $V_1 =$ THE DEPTH AT THE INVERT OF THE INLET. NOTED ON THE PLANS.
 $W = 4'-3 \frac{1}{2}"$ (1308 mm) FOR TWO GRATINGS; ADD $2'-2"$ (660 mm) FOR EACH ADDITIONAL GRATING.
 $A =$ THE ANGLE, IN DEGREES, INTERCEPTED BY THE CENTERLINE OF THE CONNECTOR PIPE AND THE CATCH BASIN WALL TO WHICH THE CONNECTOR PIPE IS ATTACHED.
5. PLACE CONNECTOR PIPES AS INDICATED ON THE PLANS. UNLESS OTHERWISE SPECIFIED, THE CONNECTOR PIPE SHALL BE LOCATED AT THE DOWNSTREAM END OF THE BASIN. WHERE THE CONNECTOR PIPE IS SHOWN AT A CORNER, THE CENTERLINE OF THE PIPE SHALL INTERSECT THE INSIDE CORNER OF THE BASIN. THE PIPE MAY BE CUT AND TRIMMED AT A SKEW NECESSARY TO INSURE MINIMUM $3"$ (80 mm) PIPE EMBEDMENT, ALL AROUND, WITHIN THE CATCH BASIN WALL, AND $3"$ (75 mm) RADIUS OF ROUNDING OF STRUCTURE CONCRETE, ALL AROUND, ADJACENT TO PIPE ENDS. A MONOLITHIC CATCH BASIN CONNECTION SHALL BE USED TO JOIN THE CONNECTOR PIPE TO THE CATCH BASIN WHENEVER ANGLE "A" IS LESS THAN 70° OR GREATER THAN 110° , OR WHENEVER THE CONNECTOR PIPE IS LOCATED IN A CORNER. THE OPTIONAL USE OF A MONOLITHIC CATCH BASIN CONNECTION IN ANY CASE IS PERMITTED. MONOLITHIC CATCH BASIN CONNECTIONS MAY BE CONSTRUCTED TO AVOID CUTTING STANDARD LENGTHS OF PIPE.
6. STEPS SHALL BE LOCATED AS SHOWN. IF THE CONNECTOR PIPE INTERFERES WITH THE STEPS, THEY SHALL BE LOCATED ON THE OPPOSITE WALL. STEPS SHALL BE SPACED 300 mm (12") APART. THE TOP STEP SHALL BE $7"$ (175 mm) BELOW THE TOP OF THE GRATING AND PROJECT $2-1/2"$ (65 mm). ALL OTHER STEPS SHALL PROJECT $5"$ (130 mm).
7. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
308 MONOLITHIC CATCH BASIN CONNECTION
309 CATCH BASIN REINFORCEMENT
311 FRAME AND GRATING FOR CATCH BASINS
635 STEEL STEP
636 POLYPROPYLENE PLASTIC STEP








STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

GRATING CATCH BASIN – ALLEY (TRANSVERSE)

305-3

SHEET 2 OF 2

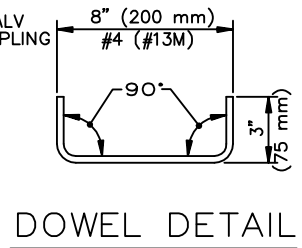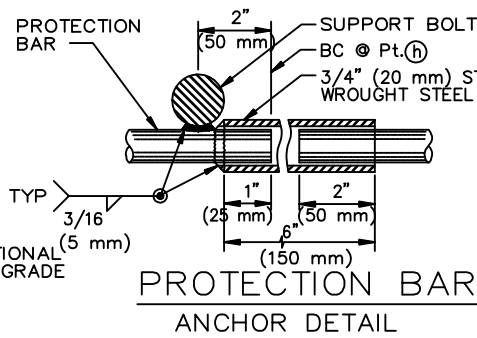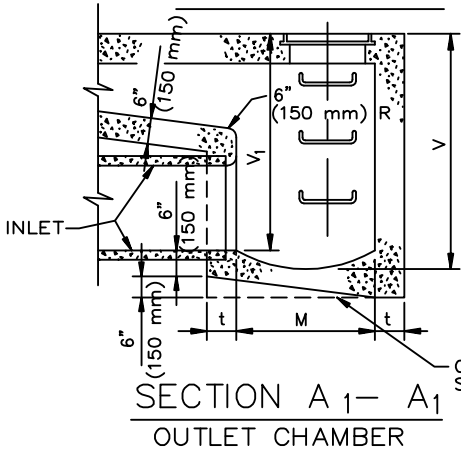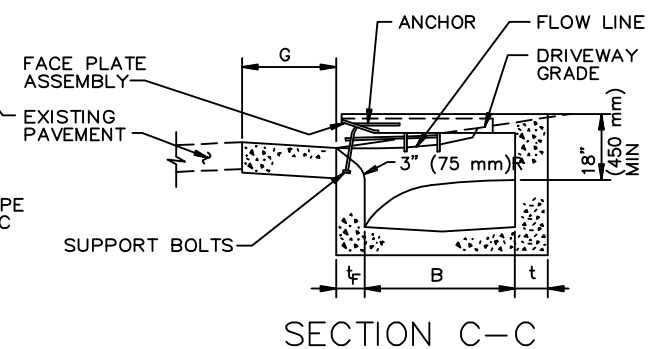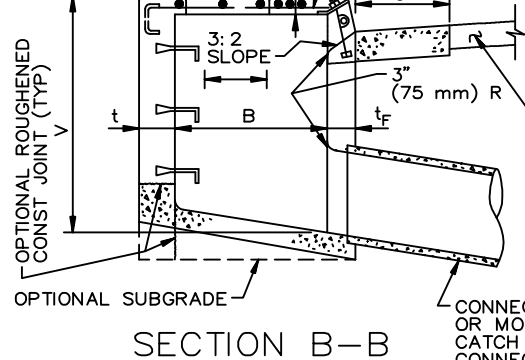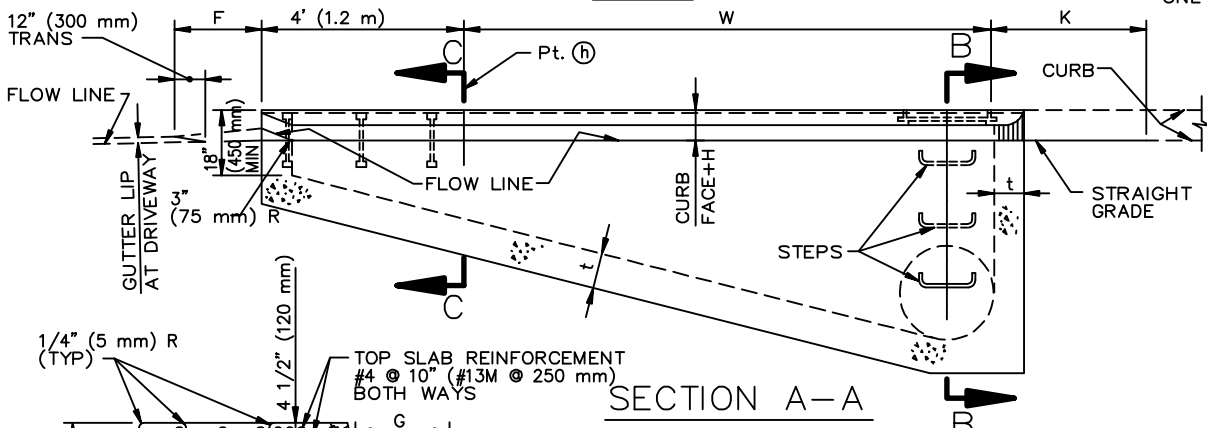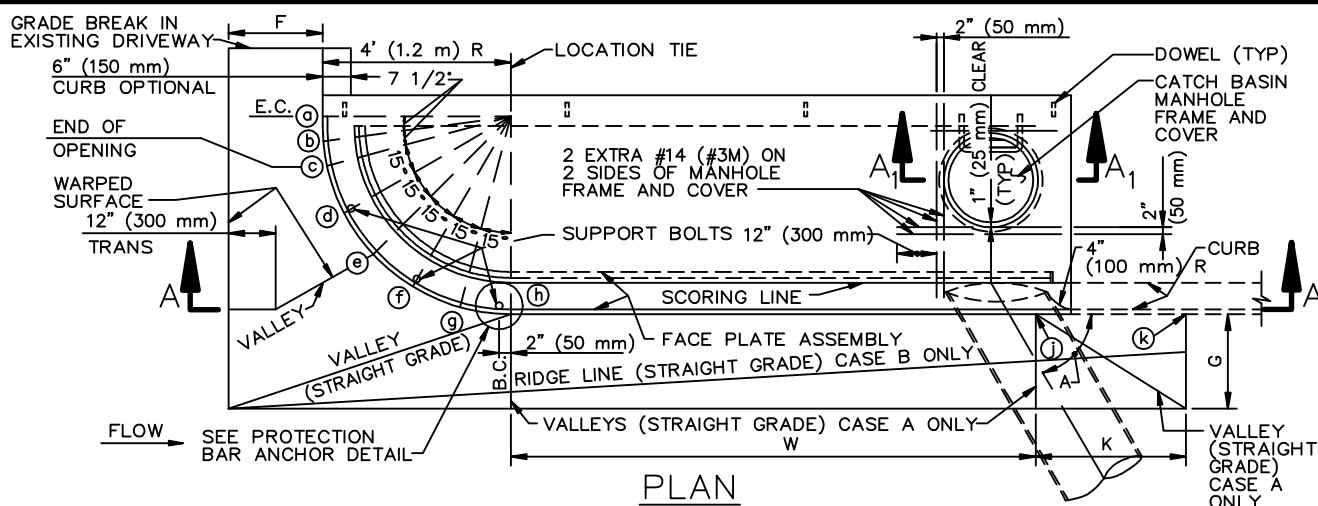


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS, INC.,
GREENBOOK COMMITTEE
1984
REV. 1992, 1996, 2009

**CURB OPENING CATCH BASIN
AT DRIVEWAY**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
306-3
SHEET 1 OF 3

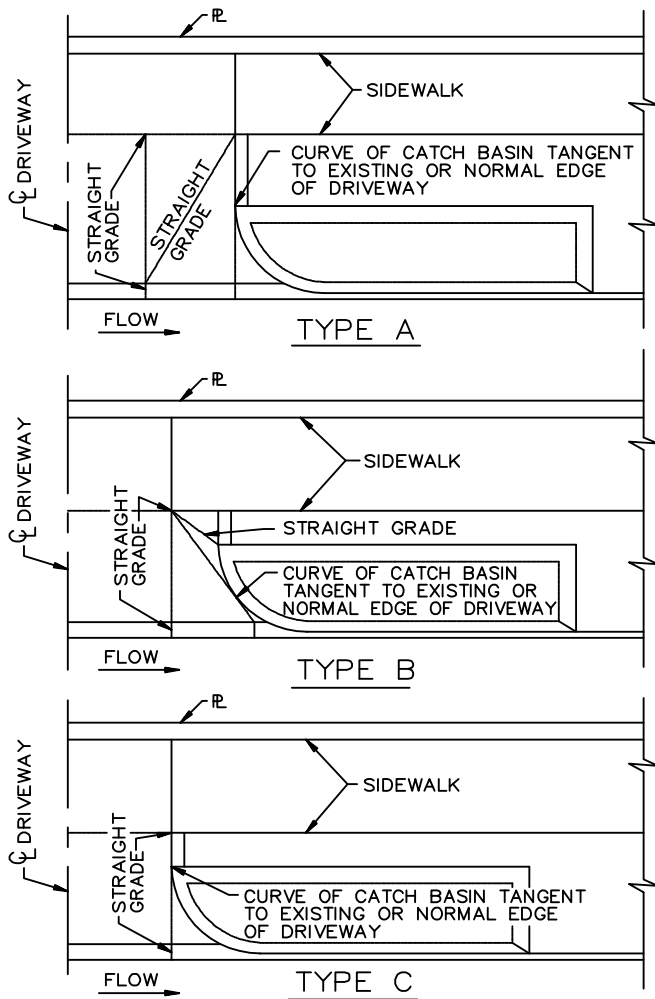

DIMENSIONS FOR CASE A AND CASE B		
	CASE A	CASE B
G	WIDTH OF EXISTING GUTTER WITH A 24" (600 mm) MINIMUM	4'-0" (1200 mm)
H	2" (50 mm)	4" (100 mm)
F	2'-0" (600 mm)	3'-0" (900 mm)
K	3'-0" (900 mm)	5'-0" (1500 mm)

POINT	CURB FACE HEIGHT	
	CASE A	CASE B
a	2-1/2" (65 mm)	4" (100 mm)
b	4" (100 mm)	6" (150 mm)
c	5-1/2" (140 mm)	7-3/4" (195 mm)
d	8-1/2" (215 mm)	10-1/2" (265 mm)
e	10" (250 mm)	12" (300 mm)
f	10" (250 mm)	12" (300 mm)
g	10" (250 mm)	12" (300 mm)
h	10" (250 mm)	12" (300 mm)
i	10" (250 mm)	12" (300 mm)
j	EXISTING	EXISTING

CATCH BASIN LOCATION AT DRIVEWAYS

STRUCTURAL DATA							
WALL AND SLAB DIMENSIONS AND REINFORCEMENT REQUIREMENTS							
MAX W	MAX V	t	t _F	REINFORCEMENT REQUIRED IN			
				FRONT WALL	REAR WALL	BOTTOM SLAB	END WALL
3.5' (1.0 m)	8' (2.4 m)	6" (150 mm)	6" (150 mm)	NO REINFORCEMENT REQUIRED			
3.5' (1.0 m)	12' (3.5 m)	8" (200 mm)	8" (200 mm)				
7' (2.0 m)	6' (1.8 m)	6" (150 mm)	6" (150 mm)				
7' (2.0 m)	12' (3.5 m)	8" (200 mm)	8" (200 mm)				
14' (4.0 m)	4' (1.2 m)	6" (150 mm)	6" (150 mm)				
14' (4.0 m)	8' (2.4 m)	6" (150 mm)	8" (200 mm)				
14' (4.0 m)	12' (3.5 m)	8" (200 mm)	10" (250 mm)				
21' (6 m) AND 28' (9 m)	4' (1.2 m)	6" (150 mm)	6" (150 mm)				
	6' (1.8 m)	6" (150 mm)	8" (200 mm)				
	8' (2.4 m)	8" (200 mm)	8" (200 mm)				
	10' (3.0 m)	8" (200 mm)	10" (250 mm)				
	12' (3.5 m)	8" (200 mm)	10" (250 mm)				

FOR W > 28' (9 m), V > 12' (3.5 m) OR B > 4' (1.2 m) SEE PLANS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

CURB OPENING CATCH BASIN AT DRIVEWAY

306-3

SHEET 2 OF 3

NOTES:

1. WHERE THE BASIN IS TO BE CONSTRUCTED WITHIN THE LIMITS OF EXISTING OR PROPOSED SIDEWALK OR IS CONTIGUOUS TO SUCH SIDEWALK, THE TOP SLAB OF THE BASIN MAY BE POURED EITHER MONOLITHIC WITH THE SIDEWALK OR SEPARATELY, USING THE SAME CLASS OF CONCRETE AS IN THE BASIN. WHEN POURED MONOLITHICALLY, THE SIDEWALK SHALL BE PROVIDED WITH A WEAKENED PLANE OR A 1" (25 mm) DEEP SAWCUT CONTINUOUSLY AROUND THE EXTERNAL PERIMETER OF THE CATCH BASIN WALLS, INCLUDING ACROSS THE FULL WIDTH OF THE SIDEWALK. SURFACE OF ALL EXPOSED CONCRETE SHALL CONFORM IN SLOPE, GRADE, COLOR, FINISH, AND SCORING TO EXISTING OR PROPOSED CURB AND WALK ADJACENT TO THE BASIN.
2. ALL CURVED CONCRETE SURFACES SHALL BE FORMED BY CURVED FORMS, AND SHALL NOT BE SHAPED BY PLASTERING.
3. FLOOR OF BASIN SHALL BE GIVEN A STEEL TROWEL FINISH AND SHALL HAVE A LONGITUDINAL AND LATERAL SLOPE OF 1:12 MINIMUM AND 1:3 MAXIMUM, EXCEPT WHERE THE GUTTER GRADE EXCEEDS 8%, IN WHICH CASE THE LONGITUDINAL SLOPE OF THE FLOOR SHALL BE THE SAME AS THE GUTTER GRADE, SLOPE FLOOR FROM ALL DIRECTIONS TO THE OUTLET.
4. CATCH BASIN SHALL BE CASE A UNLESS OTHERWISE SPECIFIED.
5. DIMENSIONS:
W = 10' (3 m)
B = 3'-2" (970 mm)
M = 3' (900 mm)
V = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE CATCH BASIN AT THE OUTLET = 5.0' (1.5 m).
V_I = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE INLET, NOTED ON THE PLANS.
A = THE ANGLE, IN DEGREES, INTERCEPTED BY THE CENTERLINE OF THE CONNECTOR PIPE AND THE CATCH BASIN WALL TO WHICH THE CONNECTOR PIPE IS ATTACHED.
6. PLACE CONNECTOR PIPES AS INDICATED ON THE PLANS. UNLESS OTHERWISE SPECIFIED, THE CONNECTOR PIPE SHALL BE LOCATED AT THE DOWNSTREAM END OF THE BASIN. WHERE THE CONNECTOR PIPE IS SHOWN AT A CORNER, THE CENTERLINE OF THE PIPE SHALL INTERSECT THE INSIDE CORNER OF THE BASIN. THE PIPE MAY BE CUT AND TRIMMED AT A SKEW NECESSARY TO INSURE MINIMUM 3" (80 mm) PIPE EMBEDMENT, ALL AROUND, WITHIN THE CATCH BASIN WALL, AND 3" (75 mm) RADIUS OF ROUNDING OF STRUCTURE CONCRETE, ALL AROUND, ADJACENT TO PIPE ENDS, A MONOLITHIC CATCH BASIN CONNECTION SHALL BE USED TO JOIN THE CONNECTOR PIPE TO THE CATCH BASIN WHENEVER ANGLE "A" IS LESS THAN 70° OR GREATER THAN 110°, OR WHENEVER THE CONNECTOR PIPE IS LOCATED IN A CORNER. THE OPTIONAL USE OF A MONOLITHIC CATCH BASIN CONNECTION IN ANY CASE IS PERMITTED. MONOLITHIC CATCH BASIN CONNECTIONS MAY BE CONSTRUCTED TO AVOID CUTTING STANDARD LENGTHS OF PIPE.
7. STEPS SHALL BE LOCATED AS SHOWN. IF THE CONNECTOR PIPE INTERFERES WITH THE STEPS, THEY SHALL BE LOCATED AT THE CENTERLINE OF THE DOWNSTREAM WALL. STEPS SHALL BE SPACED 12" (300 mm) APART. THE TOP STEP SHALL BE 7" (175 mm) BELOW THE TOP OF THE MANHOLE AND PROJECT 2-1/2" (65 mm). ALL OTHER STEPS SHALL PROJECT 5" (130 mm).
8. DOWELS ARE REQUIRED AT EACH CORNER AND AT 7' (2.1 m) ON CENTER (MAXIMUM) ALONG THE BACKWALL.
9. WHEN CONNECTOR INLETS INTO THE UPSTREAM END OF THE CATCH BASIN, CONSTRUCT AN OUTLET CHAMBER AS SHOWN IN SECTION A₁-A₁.
10. FACE PLATE ASSEMBLY:
THE FACE PLATE FOR THE CIRCULAR PORTION OF THE CATCH BASIN OPENING SHALL BE CAST STEEL OF MILD TO MEDIUM STRENGTH. SEGMENTED CASTINGS SHALL BE BEVELED AND BUTT WELDED TO THE REQUIRED FULL LENGTH ALONG A TRUE ARC AND SECURED TO THE TOP SLAB BY ANCHORS. ONE ANCHOR SHALL BE PLACED AT EACH END OF THE ASSEMBLY AND THE OTHERS SPACED EQUALLY BETWEEN THE END ANCHORS. THERE SHALL BE AT LEAST ONE ANCHOR ON EACH CASTING. BEND PROTECTION BAR TO 4' (1.2 m) RADIUS AROUND CURB RETURN. WELD TO SUPPORT BOLTS AT POINTS D, F, & H. END BAR AT POINT D
11. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
308 MONOLITHIC CATCH BASIN CONNECTION
309 CATCH BASIN REINFORCEMENT
310 CATCH BASIN FACE PLATE ASSEMBLY AND PROTECTION BAR
312 CATCH BASIN MANHOLE FRAME AND COVER
635 STEEL STEP
636 POLYPROPYLENE PLASTIC STEP



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


CURB OPENING CATCH BASIN AT DRIVEWAY

306-3

SHEET 3 OF 3

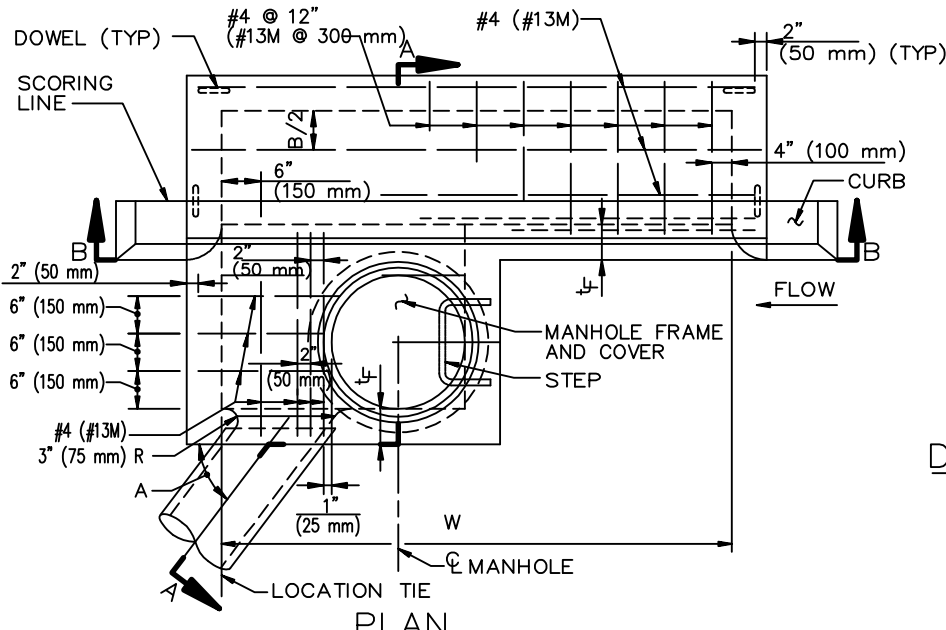


DOWEL DETAIL

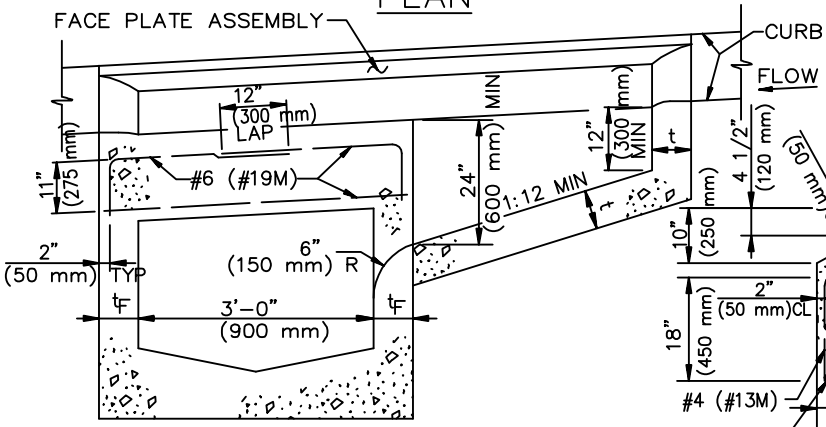


SECTION B-B

NOTE:
FOR DETAILS NOT SHOWN
SEE SECTION A-A (CASE A)

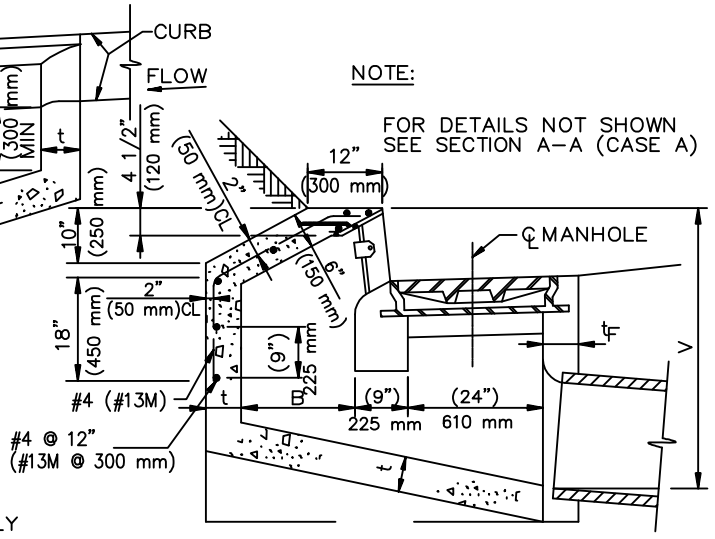

SECTION A-A
CASE B

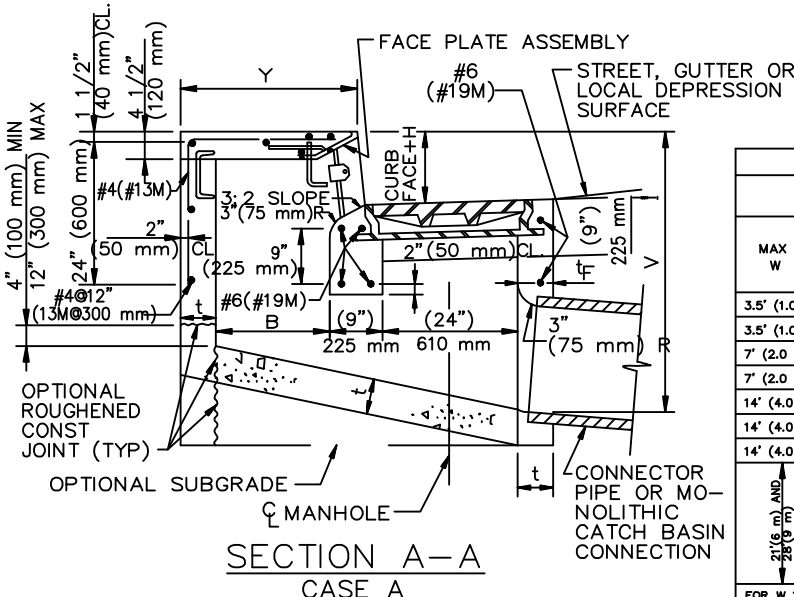

SECTION A-A
CASE A

STRUCTURAL DATA							
WALL AND SLAB DIMENSIONS AND REINFORCEMENT REQUIREMENTS							
MAX W	MAX V	t	t _F	REINFORCEMENT REQUIRED IN			
				FRONT WALL	REAR WALL	BOTTOM SLAB	END WALL
3.5' (1.0 m)	8' (2.4 m)	6" (150 mm)	6" (150 mm)	NO REINFORCEMENT REQUIRED	REINFORCEMENT REQUIRED	REINFORCEMENT REQUIRED	REINFORCEMENT REQUIRED
3.5' (1.0 m)	12' (3.5 m)	8" (200 mm)	8" (200 mm)				
7' (2.0 m)	6' (1.8 m)	6" (150 mm)	6" (150 mm)				
7' (2.0 m)	12' (3.5 m)	8" (200 mm)	8" (200 mm)				
14' (4.0 m)	4' (1.2 m)	6" (150 mm)	6" (150 mm)				
14' (4.0 m)	8' (2.4 m)	6" (150 mm)	8" (200 mm)				
14' (4.0 m)	12' (3.5 m)	8" (200 mm)	10" (250 mm)				
2 1/2' (6 m) AND 2 3/4' (7 m)	4' (1.2 m)	6" (150 mm)	6" (150 mm)				
	6' (1.8 m)	6" (150 mm)	8" (200 mm)				
	8' (2.4 m)	8" (200 mm)	8" (200 mm)				
	10' (3.0 m)	8" (200 mm)	10" (250 mm)				
	12' (3.5 m)	8" (200 mm)	10" (250 mm)				

FOR W > 28'(9 m), V > 12'(3.5 m) OR B > 4'(1.2 m) SEE PLANS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS, INC.,
GREENBOOK COMMITTEE
1984
REV. 1992, 1996, 2009


**CURB OPENING CATCH BASIN
WITH MANHOLE IN STREET**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN
307-3
SHEET 1 OF 2

NOTES:

1. WHERE THE BASIN IS TO BE CONSTRUCTED WITHIN THE LIMITS OF EXISTING OR PROPOSED SIDEWALK OR IS CONTIGUOUS TO SUCH SIDEWALK, THE TOP SLAB OF THE BASIN MAY BE POURED EITHER MONOLITHIC WITH THE SIDEWALK OR SEPARATELY, USING THE SAME CLASS OF CONCRETE AS IN THE BASIN. WHEN POURED MONOLITHICALLY, THE SIDEWALK SHALL BE PROVIDED WITH A WEAKENED PLANE OR A 1" (25 mm) DEEP SAWCUT CONTINUOUSLY AROUND THE EXTERNAL PERIMETER OF THE CATCH BASIN WALLS, INCLUDING ACROSS THE FULL WIDTH OF THE SIDEWALK. SURFACE OF ALL EXPOSED CONCRETE SHALL CONFORM IN SLOPE, GRADE, COLOR, FINISH, AND SCORING TO EXISTING OR PROPOSED CURB AND WALK ADJACENT TO THE BASIN.
2. ALL CURVED CONCRETE SURFACES SHALL BE FORMED BY CURVED FORMS, AND SHALL NOT BE SHAPED BY PLASTERING.
3. FLOOR OF BASIN SHALL BE GIVEN A STEEL TROWEL FINISH, FLOOR OF MANHOLE CHAMBER SHALL HAVE A LONGITUDINAL AND LATERAL SLOPE OF 1:12 MINIMUM AND 1:3 MAXIMUM SLOPE FLOOR FROM ALL DIRECTIONS TO THE OUTLET.
4. CATCH BASIN SHALL BE CASE A UNLESS OTHERWISE SPECIFIED.
5. DIMENSIONS:
 - W = 7' (2 m)
 - B = 20" (500 mm)
 - Y = 24" (600 mm)
 - V = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE CATCH BASIN AT THE OUTLET = 4.5' (3.5 m).
 - V_I = THE DIFFERENCE IN ELEVATION BETWEEN THE TOP OF THE CURB AND THE INVERT OF THE INLET, NOTED ON THE PLANS.
 - H = NOTED ON THE PLANS.
 - A = THE ANGLE, IN DEGREES, INTERCEPTED BY THE CENTERLINE OF THE CONNECTOR PIPE AND THE CATCH BASIN WALL TO WHICH THE CONNECTOR PIPE IS ATTACHED.
6. PLACE CONNECTOR PIPES AS INDICATED ON THE PLANS. UNLESS OTHERWISE SPECIFIED, THE CONNECTOR PIPE SHALL BE LOCATED AT THE DOWNSTREAM END OF THE BASIN. WHERE THE CONNECTOR PIPE IS SHOWN AT A CORNER, THE CENTERLINE OF THE PIPE SHALL INTERSECT THE INSIDE CORNER OF THE BASIN. THE PIPE MAY BE CUT AND TRIMMED AT A SKEW NECESSARY TO INSURE MINIMUM 3" (80 mm) PIPE EMBEDMENT, ALL AROUND, WITHIN THE CATCH BASIN WALL, AND 3" (75 mm) RADIUS OF ROUNDING OF STRUCTURE CONCRETE, ALL AROUND, ADJACENT TO PIPE ENDS. A MONOLITHIC CATCH BASIN CONNECTION SHALL BE USED TO JOIN THE CONNECTOR PIPE TO THE CATCH BASIN WHENEVER ANGLE "A" IS LESS THAN 70° OR GREATER THAN 110°, OR WHENEVER THE CONNECTOR PIPE IS LOCATED IN A CORNER. THE OPTIONAL USE OF A MONOLITHIC CATCH BASIN CONNECTION IN ANY CASE IS PERMITTED. MONOLITHIC CATCH BASIN CONNECTIONS MAY BE CONSTRUCTED TO AVOID CUTTING STANDARD LENGTHS OF PIPE.
7. STEPS SHALL BE LOCATED AS SHOWN. IF THE CONNECTOR PIPE INTERFERES WITH THE STEPS, THEY SHALL BE LOCATED ON THE FRONT WALL OF THE MANHOLE CHAMBER OR THE DOWNSTREAM WALL OF THE MANHOLE CHAMBER AND THE MANHOLE MOVED DOWNSTREAM 12" (300 mm). STEPS SHALL BE SPACED 12" (300 mm) APART. THE TOP STEP SHALL BE 7" (175 mm) BELOW THE TOP OF THE MANHOLE AND PROJECT 2-1/2" (65 mm). ALL OTHER STEPS SHALL PROJECT 5" (130 mm).
8. DOWELS ARE REQUIRED AT EACH CORNER AND AT 7' (2.1 m) ON CENTER (MAXIMUM) ALONG THE BACKWALL.
9. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
 - 308 MONOLITHIC CATCH BASIN CONNECTION
 - 309 CATCH BASIN REINFORCEMENT
 - 310 CATCH BASIN FACE PLATE ASSEMBLY AND PROTECTION BAR
 - 630 24" (610 mm) MANHOLE FRAME AND COVER
 - 635 STEEL STEP

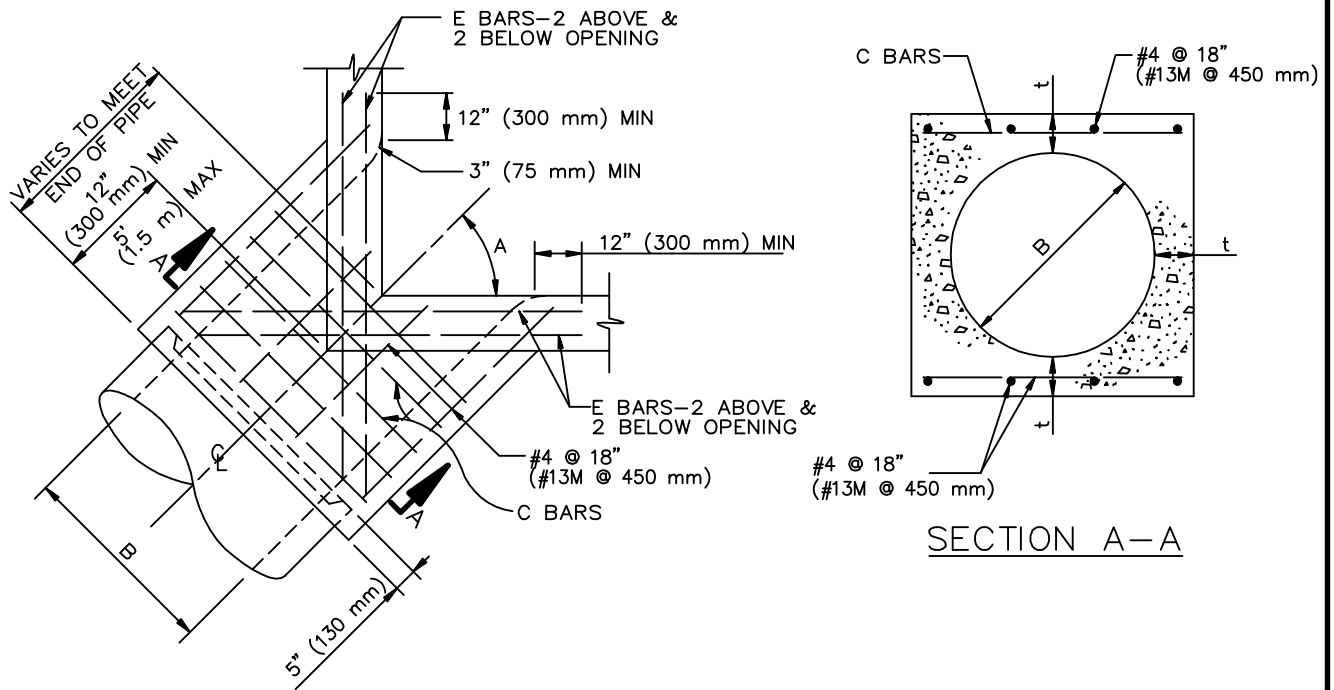

PLAN
CORNER CONNECTION

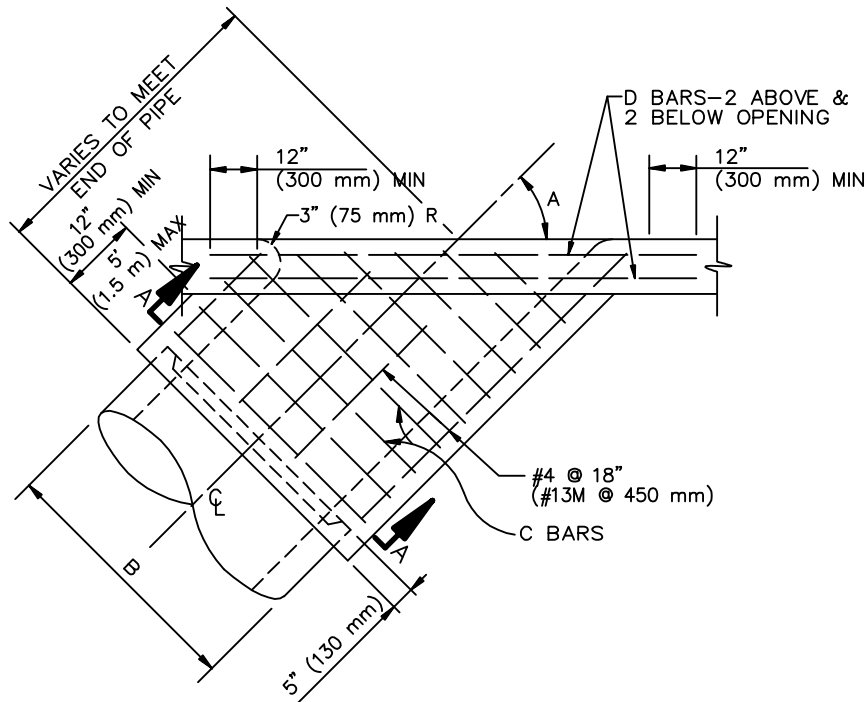

PLAN
SIDE CONNECTION

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS, INC.,
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

MONOLITHIC CATCH BASIN CONNECTION

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

308-2

SHEET 1 OF 2

STRUCTURAL DATA							
B	t	C BARS	D&E BARS	B	t	C BARS	D&E BARS
12" (300 mm)	4" (115 mm)	#4 @ 6" (#13M @ 150 mm)	#5 (#16M)	42" (1050 mm)	7 1/2" (190 mm)	#5 @ 6" (#16M @ 150 mm)	#6 (#19M)
15" (375 mm)	4-1/4" (115 mm)			45" (1125 mm)	7 3/4" (190 mm)		
18" (450 mm)	4-1/2" (115 mm)			48" (1200 mm)	8" (215 mm)		
21" (525 mm)	5" (140 mm)			51" (1275 mm)	8 1/2" (215 mm)		
24" (600 mm)	5 1/4" (140 mm)			54" (1350 mm)	9" (240 mm)		
27" (675 mm)	5 1/2" (140 mm)			57" (1425 mm)	9 1/4" (240 mm)		
30" (750 mm)	6" (165 mm)			60" (1500 mm)	9 1/2" (240 mm)		
33" (825 mm)	6 1/4" (165 mm)			63" (1575 mm)	10" (260 mm)		
36" (900 mm)	6 1/2" (165 mm)			66" (1650 mm)	10 1/4" (260 mm)		
39" (975 mm)	7" (190 mm)			69" (1725 mm)	10 3/4" (280 mm)		
				72" (1800 mm)	11" (280 mm)		
FOR B GREATER THAN 72" (1800 mm) SEE PLANS							

NOTES

1. REINFORCING STEEL SHALL BE 1-1/2" (40 mm) CLEAR FROM FACE OF CONCRETE UNLESS OTHERWISE SHOWN.
2. REINFORCING STEEL FOR INSIDE FACE OF CATCH BASIN SHALL BE CUT AT CENTER OF OPENING AND BENT INTO WALLS OF MONOLITHIC CATCH BASIN CONNECTION. REINFORCING STEEL FOR OUTSIDE FACE OF CATCH BASIN SHALL BE CUT 2" (50 mm) CLEAR OF OPENING.
3. CONNECTION SHALL BE PLACED MONOLITHIC WITH CATCH BASIN. THE ROUNDED EDGE OF OUTLET SHALL BE CONSTRUCTED BY PLACING CONCRETE WITH THE SAME CLASS OF CONCRETE AS THE CATCH BASIN AGAINST A CURVED FORM WITH A RADIUS OF 3" (75 mm).
4. CONNECTIONS SHALL BE CONSTRUCTED WHEN:
 - (A) PIPES INLET OR OUTLET THROUGH CORNER OF CATCH BASIN
 - (B) ANGLE A FOR PIPES THROUGH 30" (750 mm) IN DIAMETER IS LESS THAN 70° OR GREATER THAN 110°.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

MONOLITHIC CATCH BASIN CONNECTION

308-2

SHEET 2 OF 2

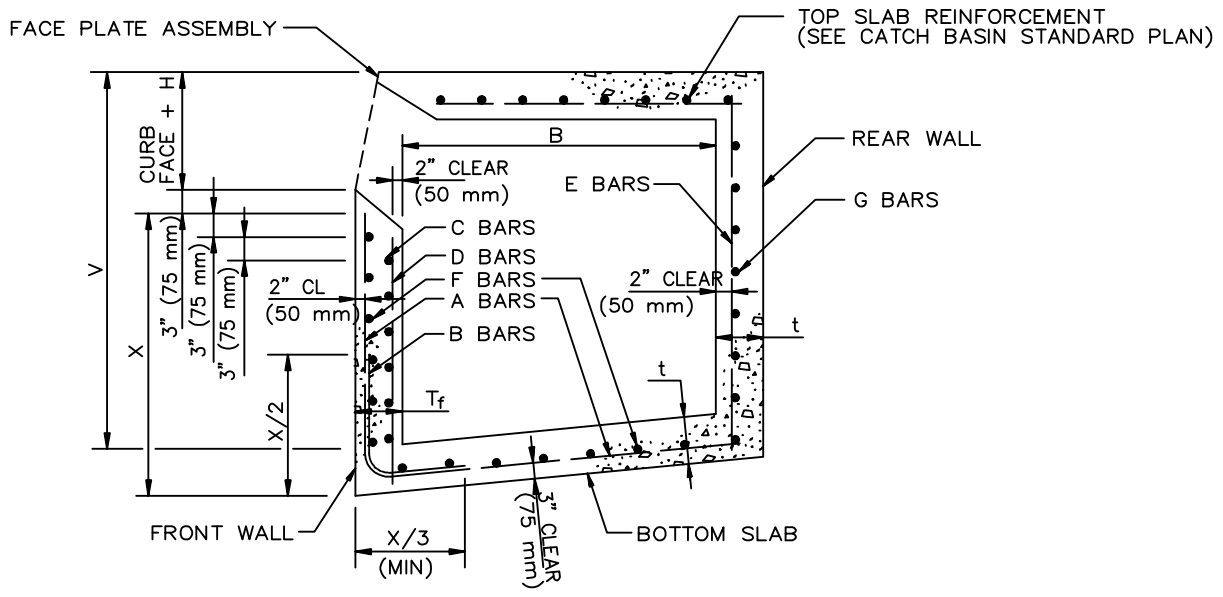


TYPICAL REINFORCEMENT DETAILS

MAX. W	MAX. V	t	tf	A & B BARS	C BARS	D BARS	E BARS	F BARS	G BARS
3.5' (1 m)	8' (2.4m)	6" (150 mm)	6" (150 mm)	—	—	—	—	—	—
3.5' (1 m)	12' (3.5m)	8" (200 mm)	8" (200 mm)	—	—	—	—	—	—
7' (2 m)	6' (1.8m)	6" (150 mm)	6" (150 mm)	—	—	—	—	—	—
7' (2 m)	12' (3.5m)	8" (200 mm)	8" (200 mm)	—	—	—	—	—	—
14' (4 m)	4' (1.2m)	6" (150 mm)	6" (150 mm)	—	#4 @ 12" (13M @ 300 mm)	#4 @ 18" (13M @ 450 mm)	—	—	—
14' (4 m)	8' (2.4m)	6" (150 mm)	8" (200 mm)	—	#4 @ 12" (13M @ 300 mm)	#4 @ 18" (13M @ 450 mm)	—	—	—
14' (4 m)	12' (3.5 m)	8" (200 mm)	10" (250 mm)	—	#4 @ 6" (13M @ 150 mm)	#4 @ 18" (13M @ 450 mm)	—	—	—
28' (9 m)	4' (1.2m)	6" (150 mm)	6" (150 mm)	#4 @ 24" (13M @ 600 mm)	—	—	—	#4 @ 18" (13M @ 450 mm)	—
28' (9 m)	5' (1.5m)	6" (150 mm)	8" (200 mm)	#4 @ 24" (13M @ 600 mm)	—	—	—	#4 @ 18" (13M @ 450 mm)	—
28' (9 m)	6' (1.8m)	6" (150 mm)	8" (200 mm)	#4 @ 18" (13M @ 450 mm)	—	—	—	#4 @ 18" (13M @ 450 mm)	—
28' (9 m)	7' (2.1m)	8" (200 mm)	8" (200 mm)	#4 @ 17" (13M @ 425 mm)	—	—	—	#4 @ 18" (13M @ 450 mm)	—
28' (9 m)	8' (2.4m)	8" (200 mm)	8" (200 mm)	#4 @ 13" (13M @ 325 mm)	—	—	—	#4 @ 18" (13M @ 450 mm)	—
28' (9 m)	9' (2.7m)	8" (200 mm)	10" (250 mm)	#4 @ 15" (13M @ 375 mm)	—	—	—	#4 @ 18" (13M @ 450 mm)	—
28' (9 m)	10' (3.0m)	8" (200 mm)	10" (250 mm)	#4 @ 12" (13M @ 300 mm)	—	—	—	#4 @ 18" (13M @ 450 mm)	—
28' (9 m)	11' (3.3m)	8" (200 mm)	10" (250 mm)	#5 @ 15" (16M @ 375 mm)	—	—	#4 @ 10" (13M @ 250 mm)	#4 @ 18" (13M @ 450 mm)	#4 @ 18" (13M @ 450 mm)
28' (9 m)	12' (3.5m)	8" (200 mm)	10" (250 mm)	#4 @ 18" (13M @ 450 mm)	—	—	#4 @ 10" (13M @ 250 mm)	#4 @ 18" (13M @ 450 mm)	#4 @ 18" (13M @ 450 mm)

FOR W > 28' (9 m) OR B > 4' (1200 mm) SEE PLANS

CURB OPENING CATCH BASIN REINFORCEMENT

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION		
PROMULGATED BY THE PUBLIC WORKS STANDARDS, INC., GREENBOOK COMMITTEE 1984 REV. 1996, 2009	<h2 style="margin: 0;">CATCH BASIN REINFORCEMENT</h2>	STANDARD PLAN <h1 style="margin: 0;">309-2</h1>
USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION		SHEET 1 OF 2

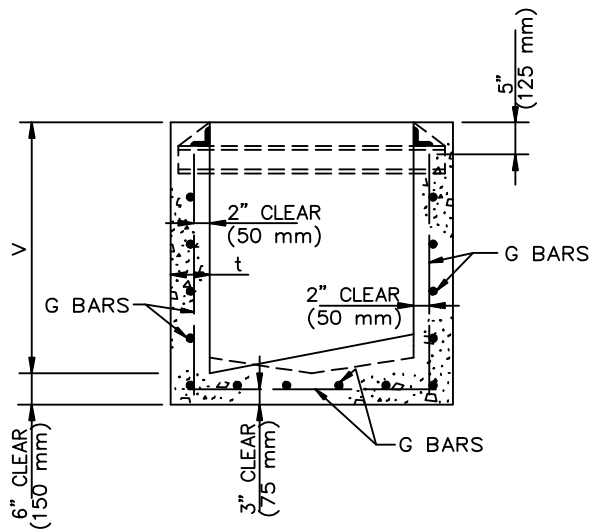

TYPICAL REINFORCEMENT DETAILS


V MAX	t	SIDE AND END WALL STEEL
		G BARS
4' (1.2 m)	6" (150 mm)	#4 @ 10" (#13M @ 250 mm)
8' (2.4 m)	8" (200 mm)	#4 @ 6" (#13M @ 150 mm)
12' (3.5 m)	10" (250 mm)	#5 @ 6" (#16M @ 150 mm)
FOR V > 12' (3.5 m) SEE PLANS		

GRATING CATCH BASIN REINFORCEMENT


NOTE

UNLESS OTHERWISE SPECIFIED, REINFORCEMENT FOR CURB OPENINGS AND GRATING CATCH BASINS SHALL TERMINATE 2" (50 mm) FROM FACE OF CONCRETE.

SUPPORT BOLT AND FACE PLATE 4 1/2" (120 mm) TOP SLAB

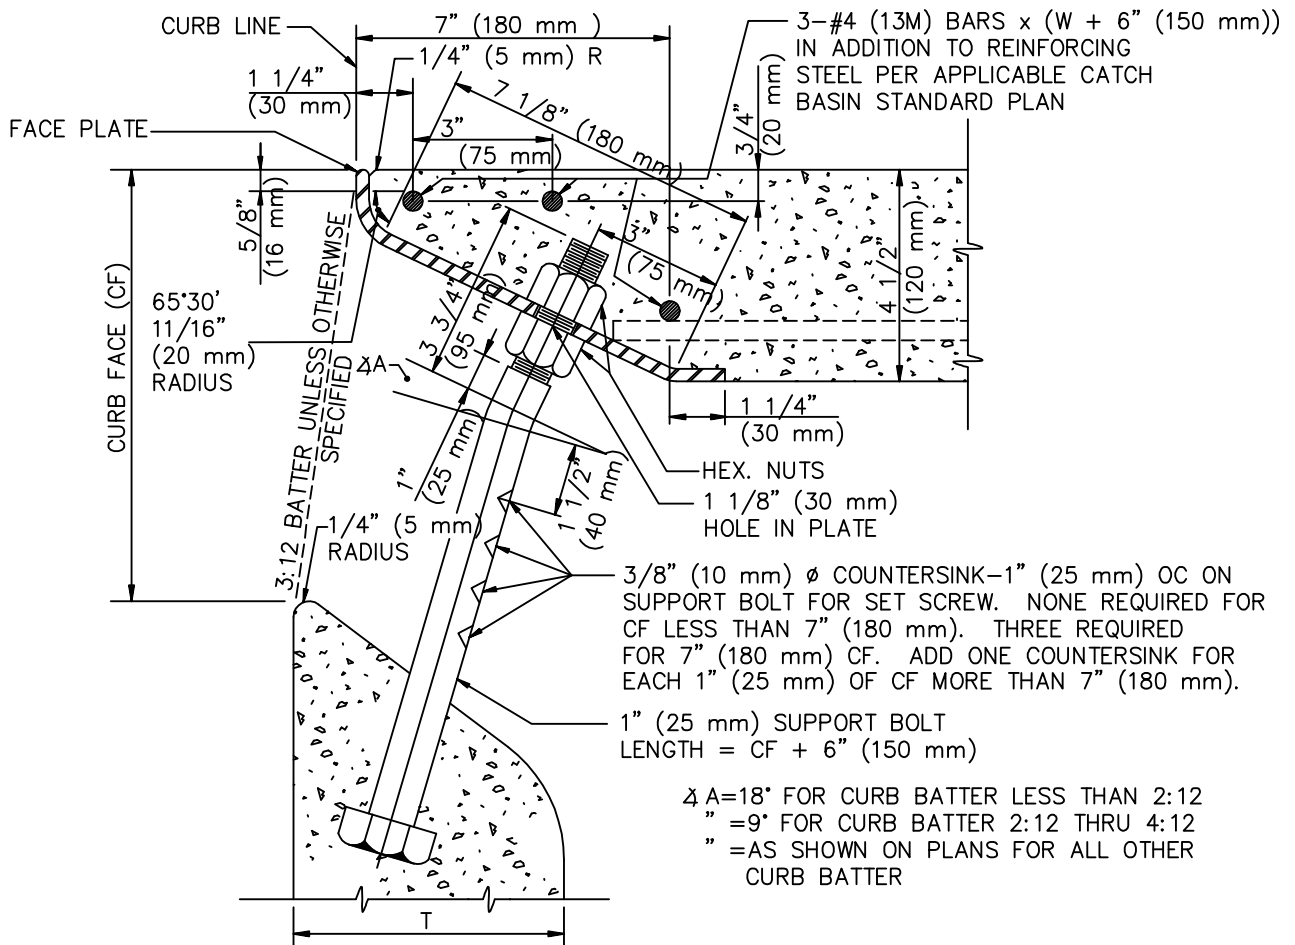

SECTION

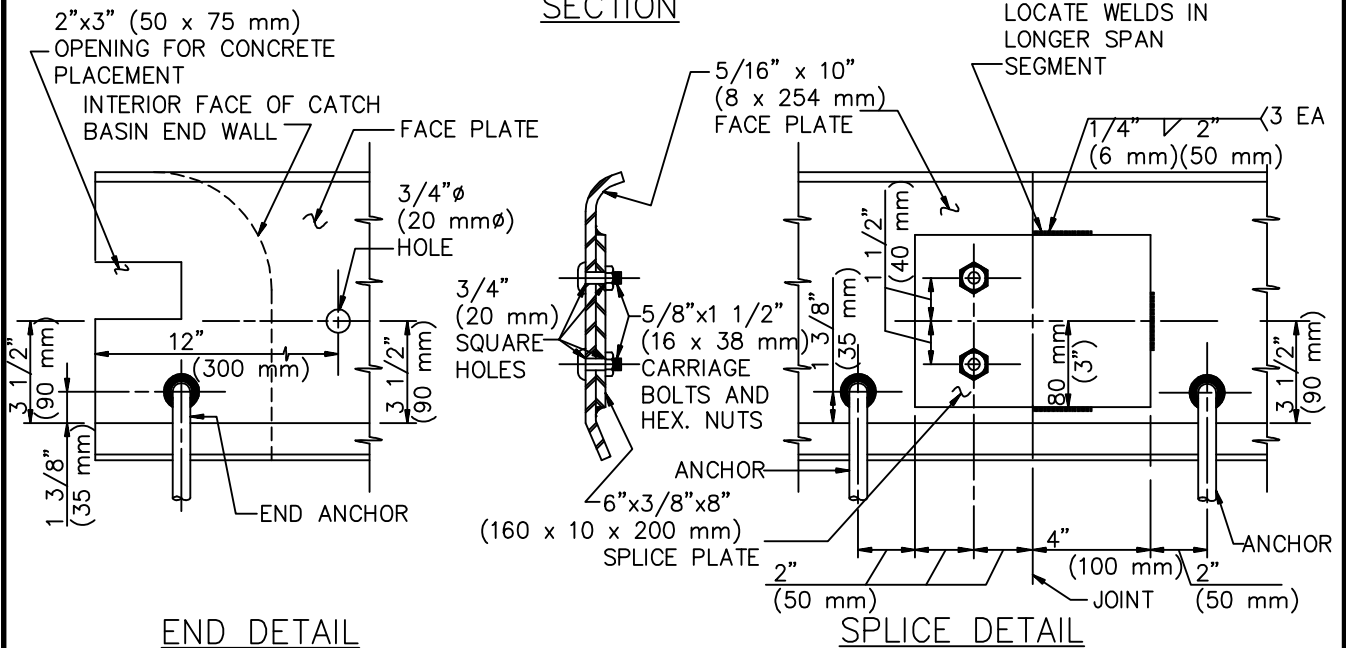

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009

**CATCH BASIN FACE PLATE ASSEMBLY
 AND PROTECTION BAR**



USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

310-3

SHEET 1 OF 6

SUPPORT BOLT AND FACE PLATE 150 mm (6") TOP SLAB

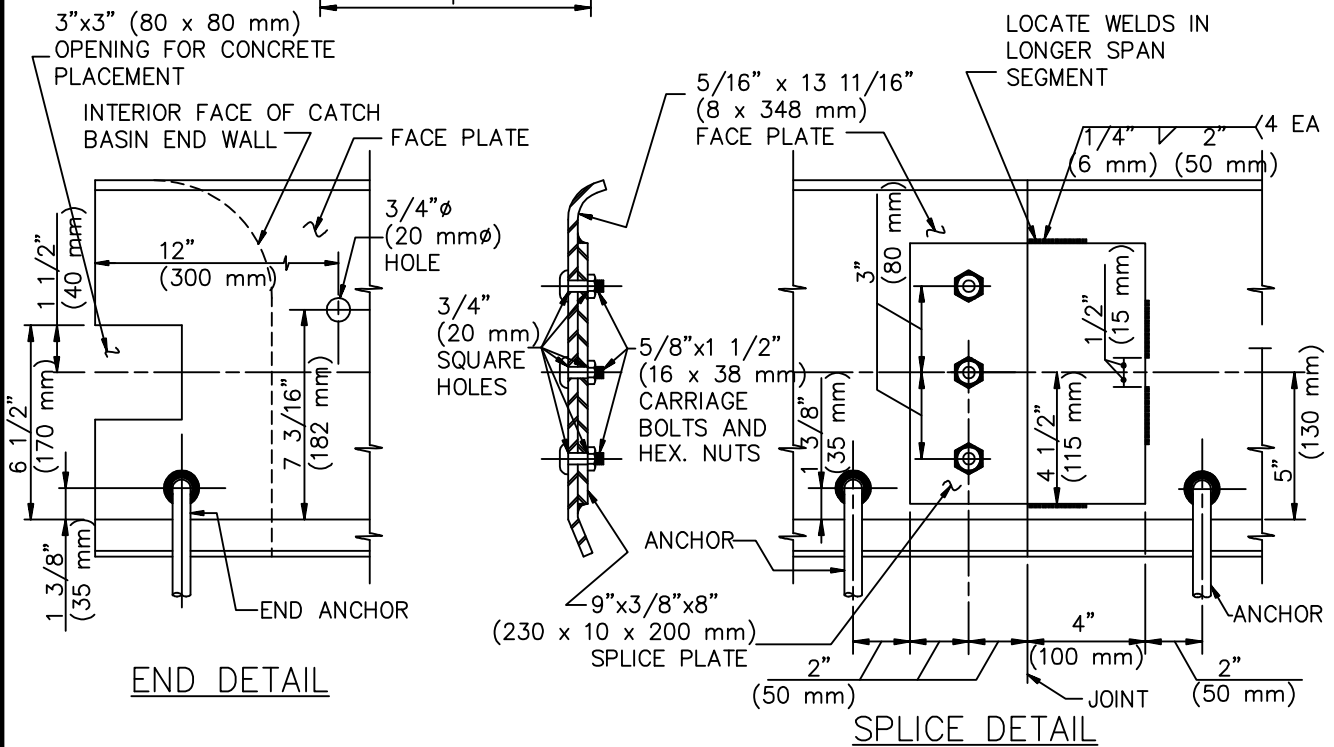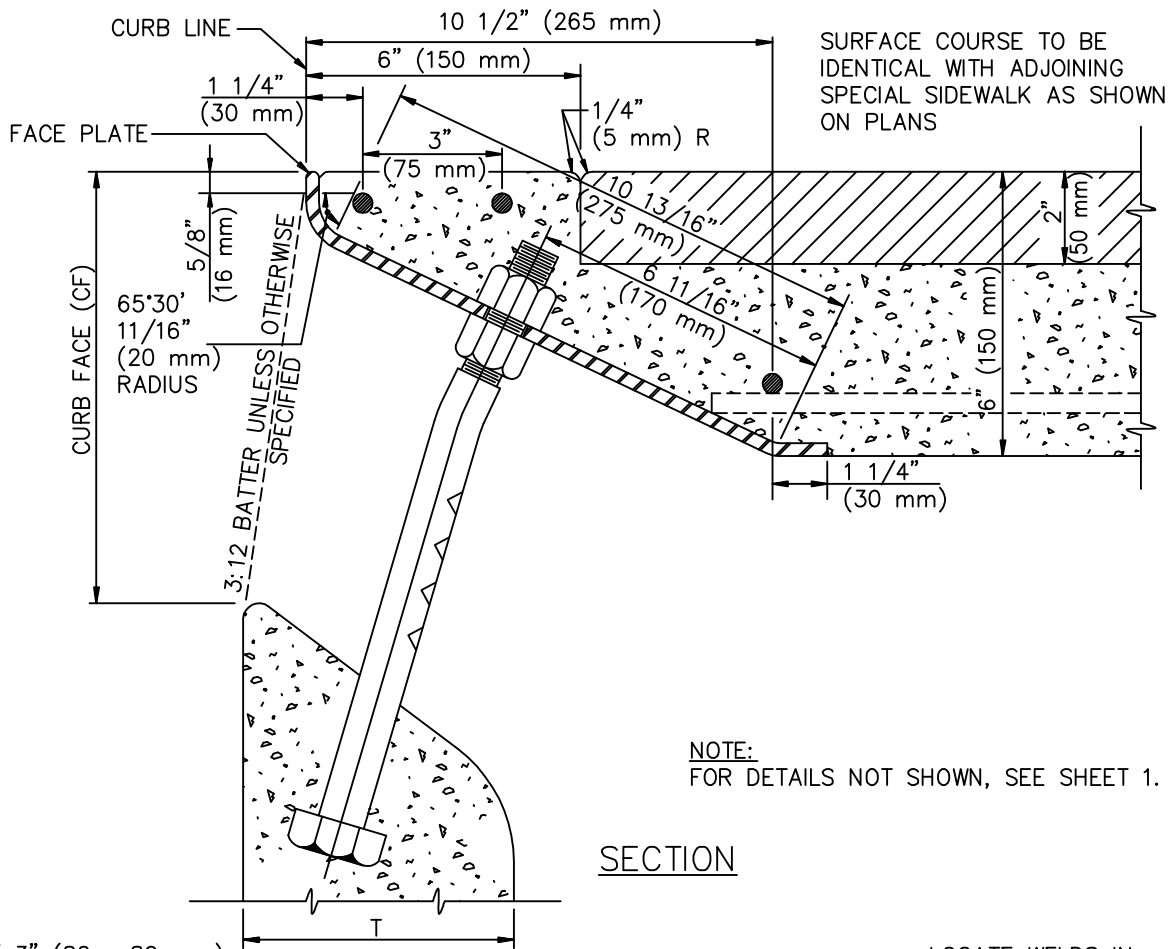

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

CATCH BASIN FACE PLATE ASSEMBLY AND PROTECTION BAR


310-3

SHEET 2 OF 6


FACE PLATE ANCHORS

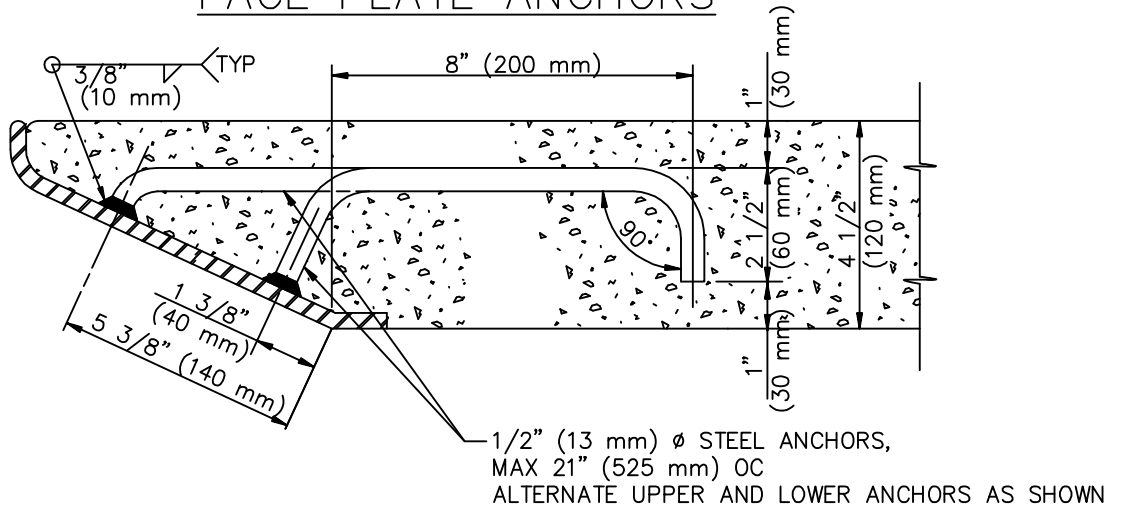

HOOK ANCHOR - 4 1/2" (120 mm) TOP SLAB





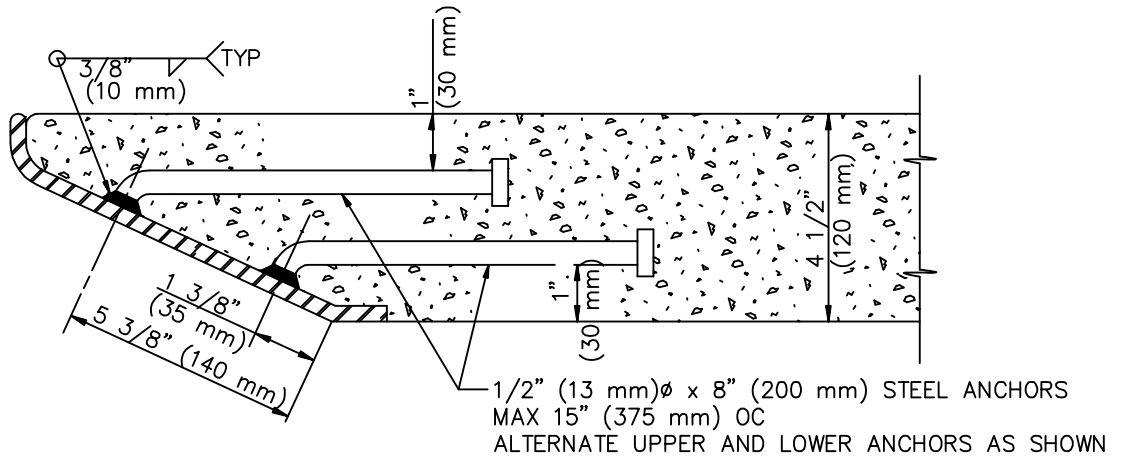


ROUND HEAD ANCHOR - 4 1/2" (120 mm) TOP SLAB

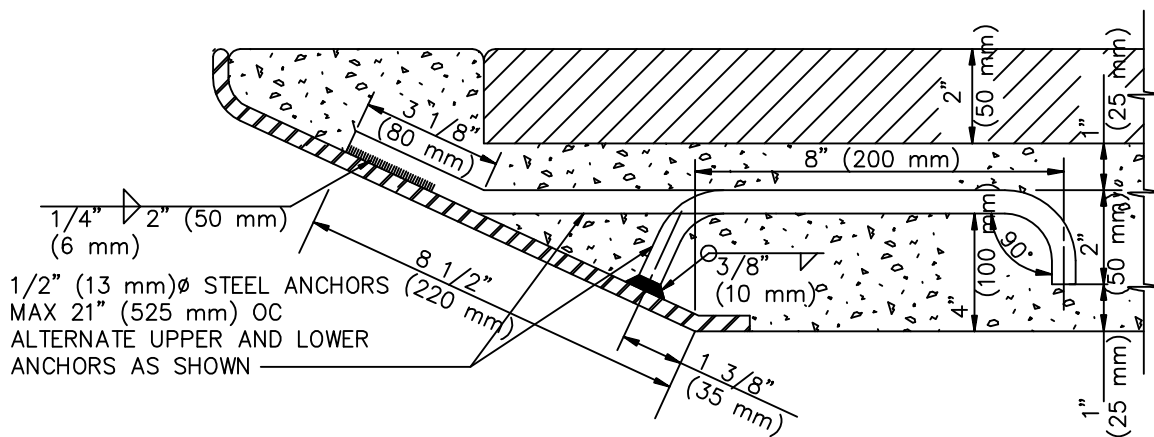

HOOK ANCHOR - 6" (150 mm) TOP SLAB


PROTECTION BAR AND SUPPORT BOLT(S) WITH ADJUSTABLE STIRRUP(S) – (TYPE A)

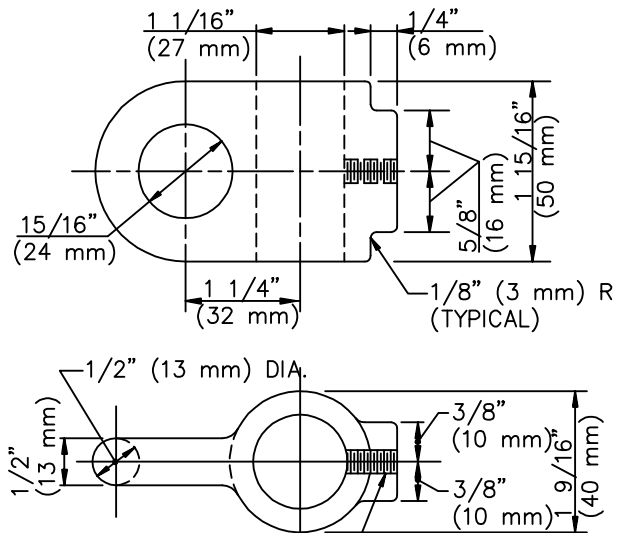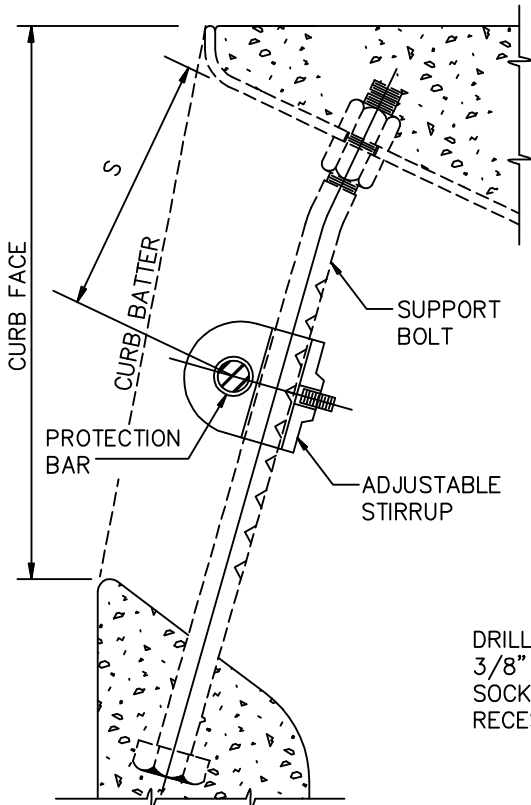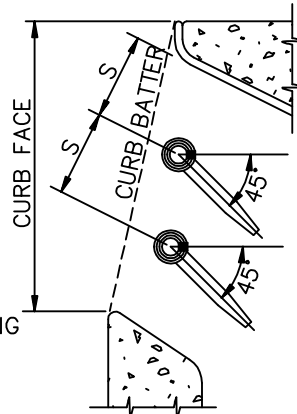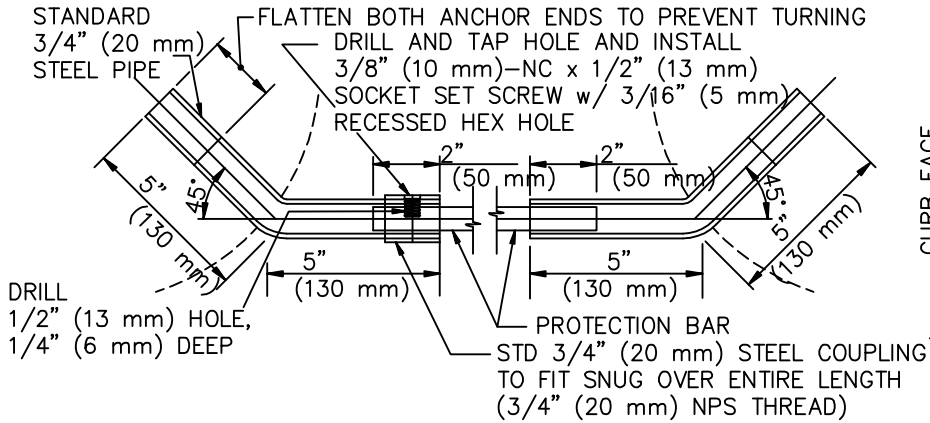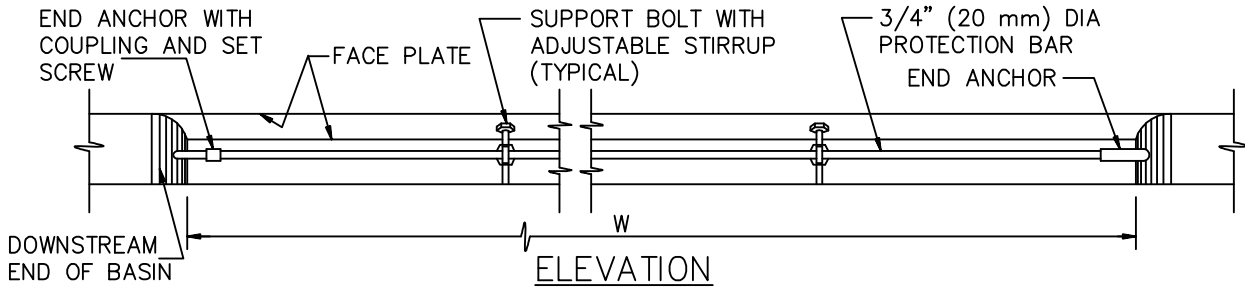


DRILL AND TAP HOLE AND INSTALL
3/8" (10 mm)-NC x 1/2" (13 mm)
SOCKET SET SCREW WITH 3/16" (5 mm)
RECESSED HEX HOLE

PROTECTION BAR & STIRRUP LOCATION


PROTECTION BAR AND SUPPORT BOLT(S) WITH FIXED STIRRUP(S) – (TYPE B)

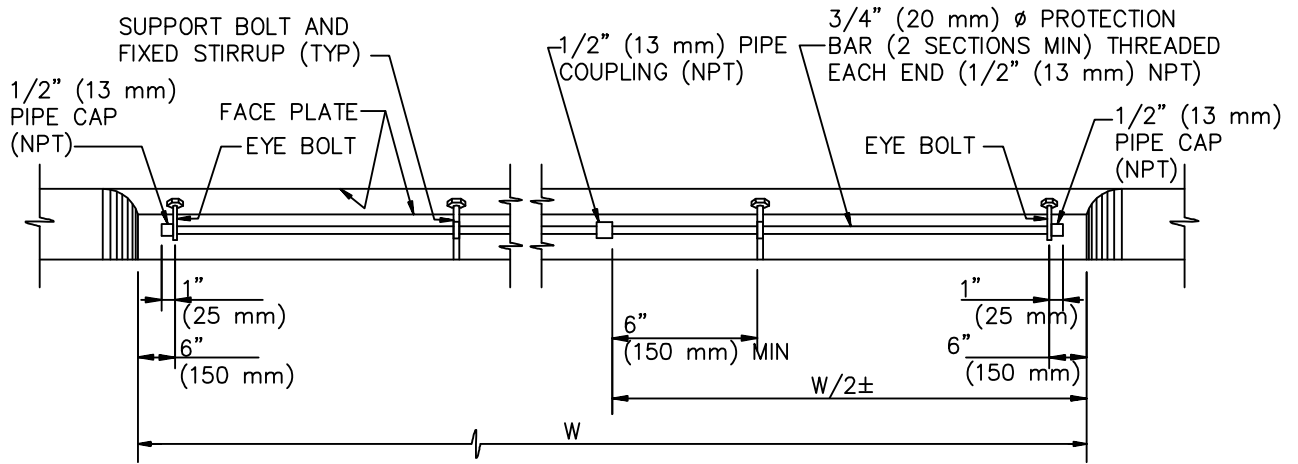

ELEVATION

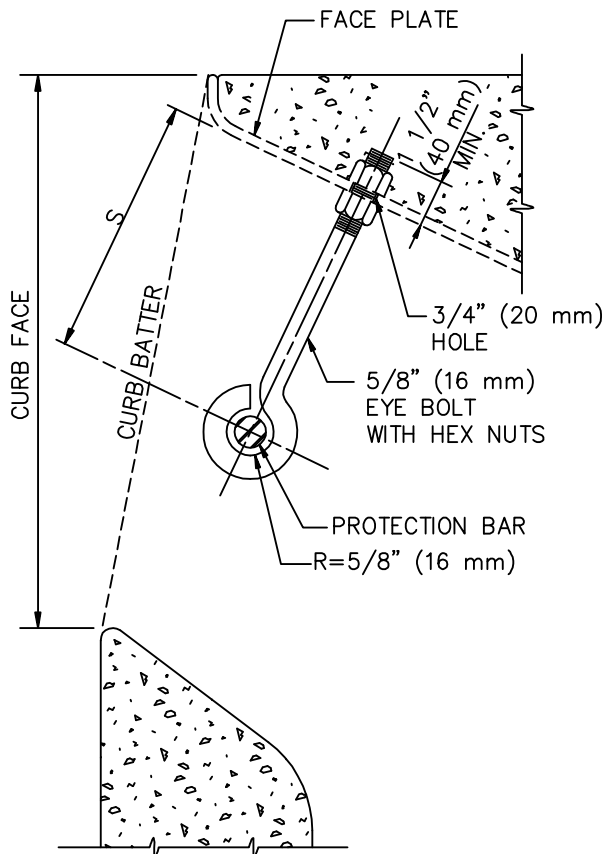

EYE BOLT DETAIL

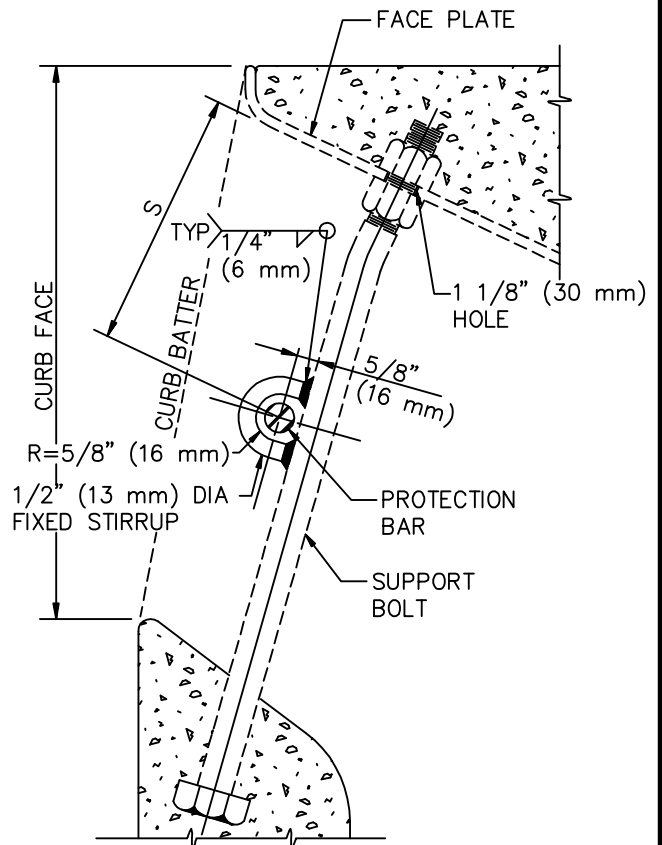

STIRRUP DETAIL

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

CATCH BASIN FACE PLATE ASSEMBLY AND PROTECTION BAR

STANDARD PLAN

310-3

SHEET 5 OF 6

NOTES:

GENERAL

1. ALL PARTS SHALL BE STEEL, EXCEPT SET SCREWS, WHICH SHALL BE STAINLESS STEEL OR BRASS.
2. EXCLUDING SET SCREWS, ALL EXPOSED METAL PARTS SHALL BE GALVANIZED AFTER FABRICATION.
3. CURB FACE SHALL BE AS NOTED ON THE PLANS.
4. CURB BATTER SHALL BE 3:12 UNLESS OTHERWISE SPECIFIED.

FACE PLATE

5. FACE PLATE LENGTHS SHALL BE CATCH BASIN W PLUS 12" (300 mm) EXCEPT AS MODIFIED FOR "A" CURB OPENING CATCH BASIN AT DRIVEWAY".
6. WHEN THE LENGTH OF THE FACE PLATE IS BETWEEN 22' (6.5 m) AND 43' (13 m), TWO SECTIONS MAY BE USED. WHEN THE LENGTH EXCEEDS 43' (13 m), THREE SECTIONS MAY BE USED. SECTIONS SHALL BE SPLICED ACCORDING TO THE APPLICABLE SPLICE DETAIL. SPLICE SHALL BE PLACED 1' (300 mm) FROM A SUPPORT BOLT.
7. WHERE CATCH BASINS ARE TO BE CONSTRUCTED ON CURVES, THE MAXIMUM CHORD LENGTH FOR THE FACE PLATE SHALL BE SUCH THAT THE MAXIMUM PERPENDICULAR DISTANCE TO THE TRUE CURVE SHALL NOT EXCEED 1" (25 mm). WHERE MORE THAN ONE CHORD IS REQUIRED, CHORD LENGTHS SHALL BE EQUAL. CHORD SECTIONS SHALL BE SPLICED ACCORDING TO THE APPLICABLE SPLICE DETAIL (MODIFIED TO FIT THE CHORD DEFLECTION) AND A SUPPORT BOLT SHALL BE PLACED 1' (300 mm) FROM THE SPLICE.
8. ROUND HEAD ANCHORS FOR THE FACE PLATE SHALL BE NELSON H-4F SHEAR CONNECTOR, KSN WELDING SYSTEMS DIVISION SHEAR CONNECTOR OR EQUAL.

SUPPORT BOLT

9. SUPPORT BOLTS ARE REQUIRED WHEN THE LENGTH OF THE CATCH BASIN OPENING IS 7' (2 m) OR GREATER, AND SHALL BE EVENLY SPACED ACROSS THE OPENING. SPACING SHALL NOT BE LESS THAN 3'-6" (1 m) ON CENTER NOR GREATER THAN 5' (1.5 m) ON CENTER.

STIRRUP

10. FOR TYPE A, MATERIAL SHALL BE CAST STEEL.


PROTECTION BAR

11. TYPE A SHALL BE USED UNLESS OTHERWISE SPECIFIED.
12. FOR TYPE A, THE BAR SHALL BE CUT TO FIT IN THE FIELD. WHEN "W" IS OVER 21' (6 m), THE PROTECTION BAR SHALL CONSIST OF 2 OR MORE SECTIONS. A SPECIAL CONNECTOR BETWEEN THE PROTECTION BAR PIECES SHALL CONSIST OF A 5" (125 mm) LENGTH OF STANDARD 3/4" (20 mm) PIPE WITH STANDARD COUPLINGS FULLY THREADED ONTO EACH END DRILLED AND TAPPED FOR A SOCKET SET SCREW AS DETAILED FOR THE DOWNSTREAM END ANCHOR.
13. FOR TYPE B, THE BAR SHALL BE TWO PIECES. TWO EYE BOLTS AND A WELDED STIRRUP ON EACH SUPPORT BOLT ARE REQUIRED.
14. NUMBER OF PROTECTION BARS AND LOCATIONS ARE AS FOLLOWS:

		MAXIMUM CURB FACE, INCHES (mm)												S DIMENSION	
		6" (150)	7" (175)	8" (200)	9" (225)	10" (250)	11" (275)	12" (300)	13" (325)	14" (350)	15" (375)	16" (400)	17" (425)		18" (450)
CURB BATTER	0:12	0	0	3.5" (90)	3.5" (90)	4.5" (115)	4.5" (115)	4.5" (115)	5.5" (140)	3.5" (90)	3.5" (90)	4.5" (115)	4.5" (115)	4.5" (115)	
	1:12	0	0	3.5" (90)	3.5" (90)	4.5" (115)	4.5" (115)	4.5" (115)	5.5" (140)	3.5" (90)	3.5" (90)	4.5" (115)	4.5" (115)	5.5" (140)	
	2:12	0	0	3.5" (90)	3.5" (90)	4.5" (115)	4.5" (115)	5.5" (140)	3.5" (90)	3.5" (90)	4.5" (115)	4.5" (115)	5.5" (140)	5.5" (140)	
	3:12	0	0	3.5" (90)	3.5" (90)	4.5" (115)	4.5" (115)	5.5" (140)	3.5" (90)	4.5" (115)	4.5" (115)	5.5" (140)	5.5" (140)	4.5" (115)	
	4:12	0	3.5" (90)	3.5" (90)	4.5" (115)	4.5" (115)	5.5" (140)	3.5" (90)	3.5" (90)	4.5" (115)	4.5" (115)	5.5" (140)	4.5" (115)	4.5" (115)	
		0	1					2*				3*			
		NUMBER OF PROTECTION BARS													


FOR OTHER CURB FACE OR BATTER SEE PLANS
 * TYPE A PROTECTION BAR ONLY

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION	STANDARD PLAN
CATCH BASIN FACE PLATE ASSEMBLY AND PROTECTION BAR	310-3
	SHEET 6 OF 6

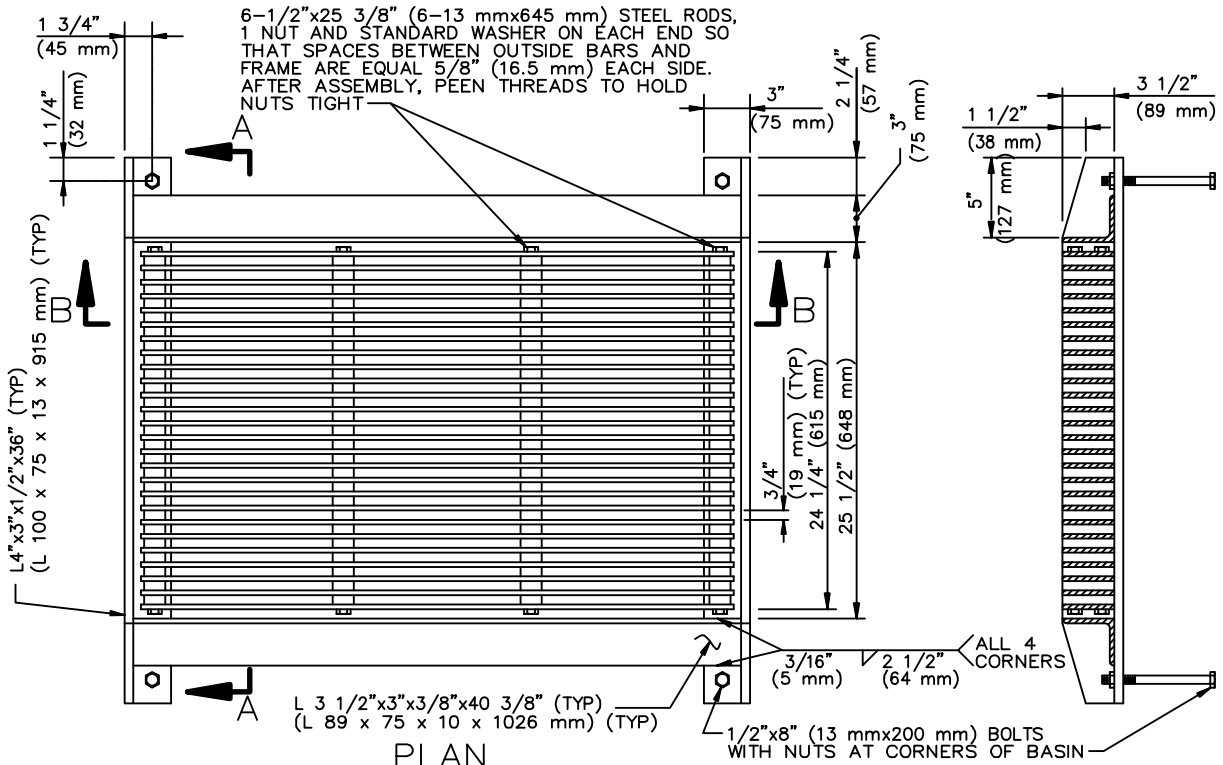


PLAN

SECTION A-A

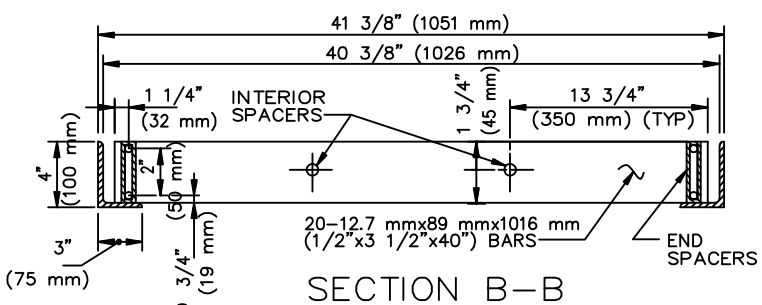


SECTION B-B


STANDARD 13 mm (1/2") PIPE
INTERIOR SPACERS

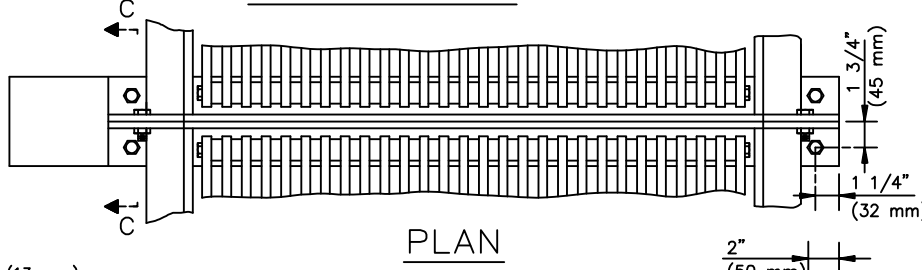

PLAN

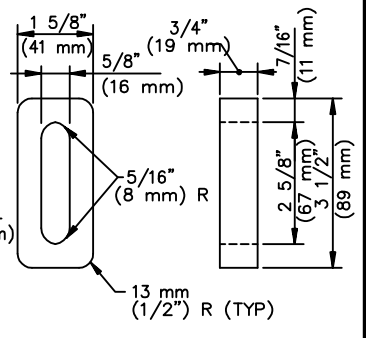

END SPACERS

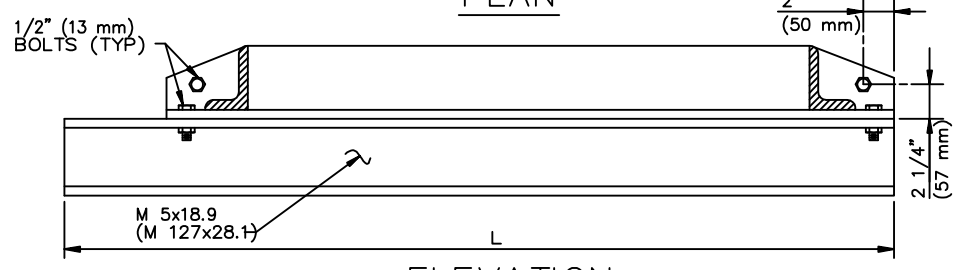

ELEVATION

SECTION C-C

CENTER SUPPORT ASSEMBLY

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS, INC.,
GREENBOOK COMMITTEE
1984
REV. 1993, 1996, 2009

FRAME AND GRATING FOR
CATCH BASINS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
311-3
SHEET 1 OF 2

NOTES:

1. ALL PARTS SHALL BE STEEL, EXCEPT THAT END SPACERS MAY BE CAST IRON.
2. ALL PARTS SHALL BE GALVANIZED AFTER FABRICATION, EXCEPT THAT GRATINGS SHALL BE ASSEMBLED AFTER COMPONENT PARTS ARE GALVANIZED.
3. ALL DIMENSIONS ARE FINISHED DIMENSIONS AND INCLUDE GALVANIZING.
4. ALL BOLT HOLES SHALL BE 5/8" (16 mm) DIAMETER.
5. ALL THREADS SHALL BE NATIONAL COARSE SERIES (NC).
6. CENTER SUPPORT ASSEMBLY REQUIRED WHEN TWO OR MORE GRATINGS ARE SPECIFIED ON PLANS.
 - L = 64" (1626 mm) FOR CURB OPENING CATCH BASIN WITH GRATING(S) AND DEBRIS SKIMMER (SPPWC 301).
 - L = 44" (1118 mm) FOR CURB OPENING CATCH BASIN WITH GRATING(S) (SPPWC 320.)
 - L = 36" (914 mm) FOR CURBSIDE GRATING CATCH BASIN (SPPWC 303).
 - L = 36" (914 mm) FOR GRATING CATCH BASIN—ALLEY (LONGITUDINAL) (SPPWC 304).

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

FRAME AND GRATING FOR CATCH BASINS


311-3

SHEET 2 OF 2


DRILL AND TAP HOLE AND INSTALL
 $3/4" \times 1 1/4"$ (20 mm x 32 mm)
 STAINLESS STEEL SOCKET SET
 SCREW WITH $3/8"$ (10 mm)
 RECESSED HEX HOLE ALL
 THREADS TO BE NC

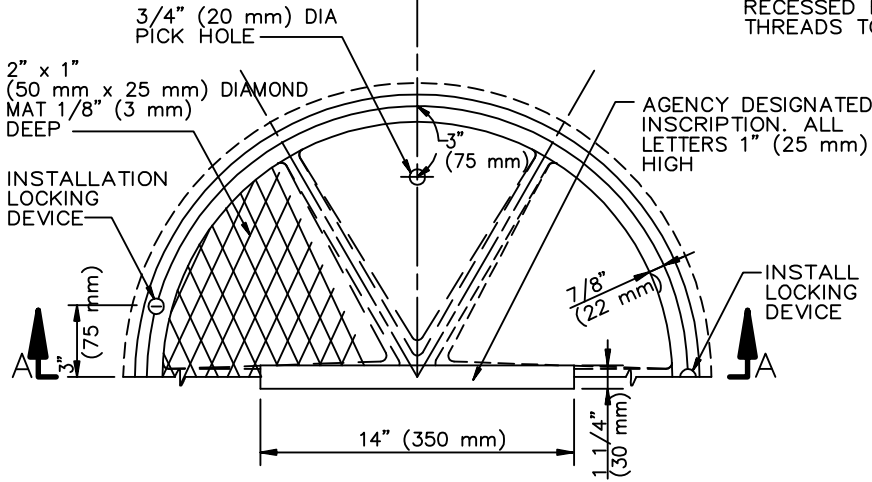


PLAN

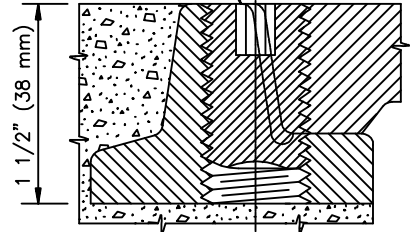


LOCKING DEVICE

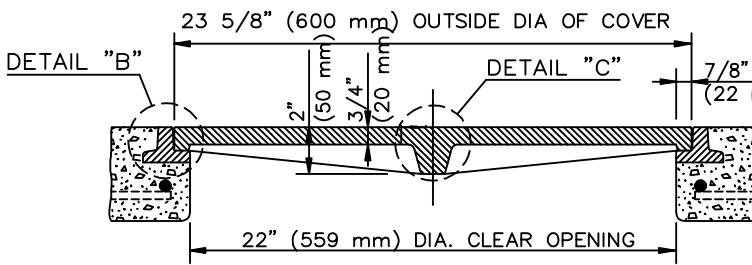


SECTION A-A

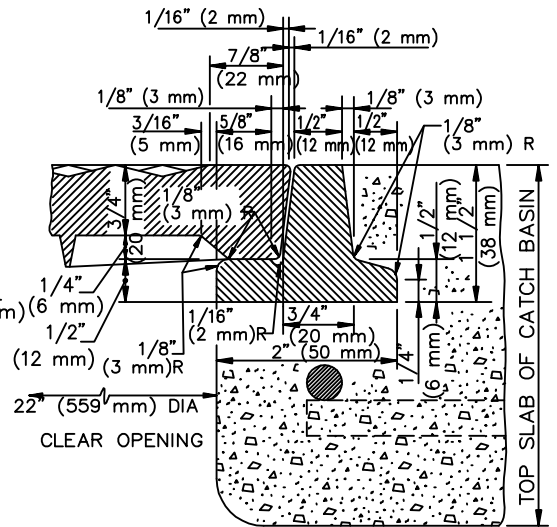

DETAIL "B"

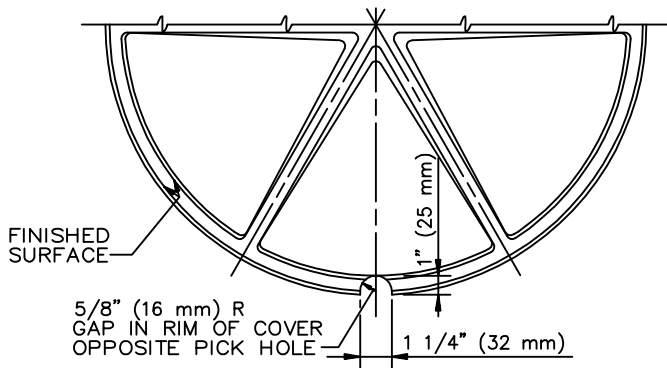

BOTTOM OF MANHOLE COVER

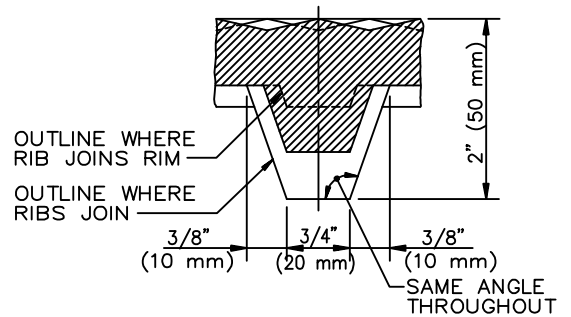

DETAIL "C"

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1993, 1996, 2009

**CATCH BASIN
 MANHOLE FRAME AND COVER**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

312-3

SHEET 1 OF 2

NOTES

1. THE CAST IRON USED SHALL CONFORM TO ASTM A48M CLASS 35B.
2. THE FRAME AND COVER SHALL BE COATED WITH ASPHALTUM OR BITUMINOUS PAINT AFTER TESTING AND INSPECTION.
3. FOUNDRY IDENTIFYING MARK, HEAT AND DATE SHALL BE CAST ON THE BOTTOM OF THE COVER AND ON THE INSIDE OF THE FRAME.
4. IMPORTED COVERS AND FRAMES SHALL HAVE THE COUNTRY OF ORIGIN MARKING IN COMPLIANCE WITH FEDERAL REGULATIONS.
5. WEIGHT OF FRAME SHALL BE 30 POUNDS (15 kg). WEIGHT OF COVER SHALL BE 85 POUNDS (40 kg). ACTUAL WEIGHTS SHALL BE WITHIN A RANGE OF 95% TO 110%.
6. THE MANHOLE FRAME AND COVER SHALL BE INSPECTED BY THE ENGINEER PRIOR TO SHIPMENT TO THE WORK SITE. ACCEPTANCE WILL BE INDICATED BY THE AGENCY'S MARK.
7. THE PROOF-LOAD FOR TEST METHOD B OF SSPWC 206-3.2 IS 28,600 POUNDS (127 kN).
8. AGENCY INSCRIPTION SHALL BE AS SPECIFIED ON THE PLANS OR SPECIAL PROVISIONS.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

CATCH BASIN MANHOLE FRAME AND COVER



312-3

SHEET 2 OF 2


CASE A

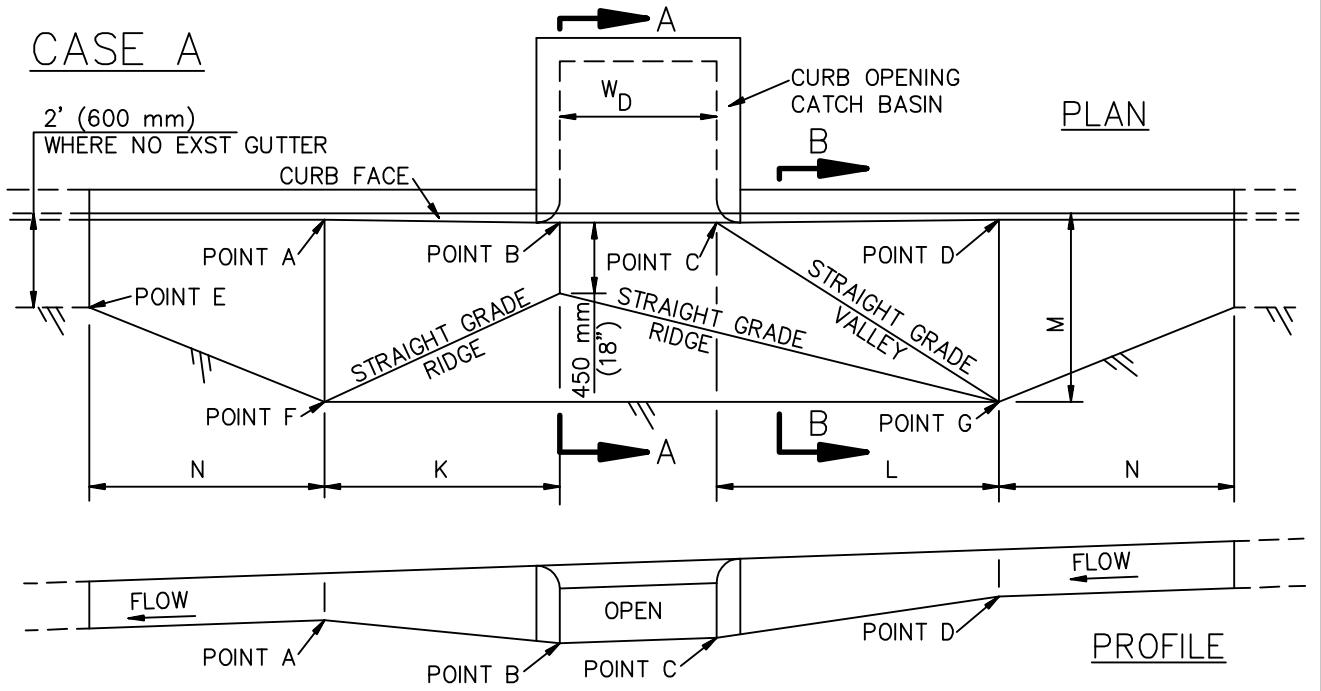


CASE B

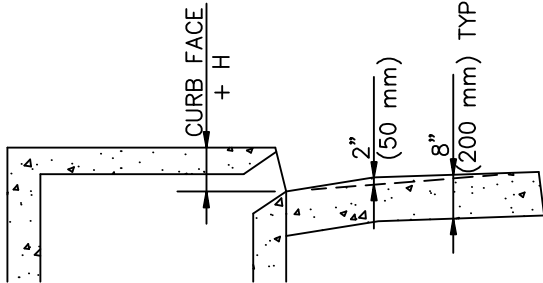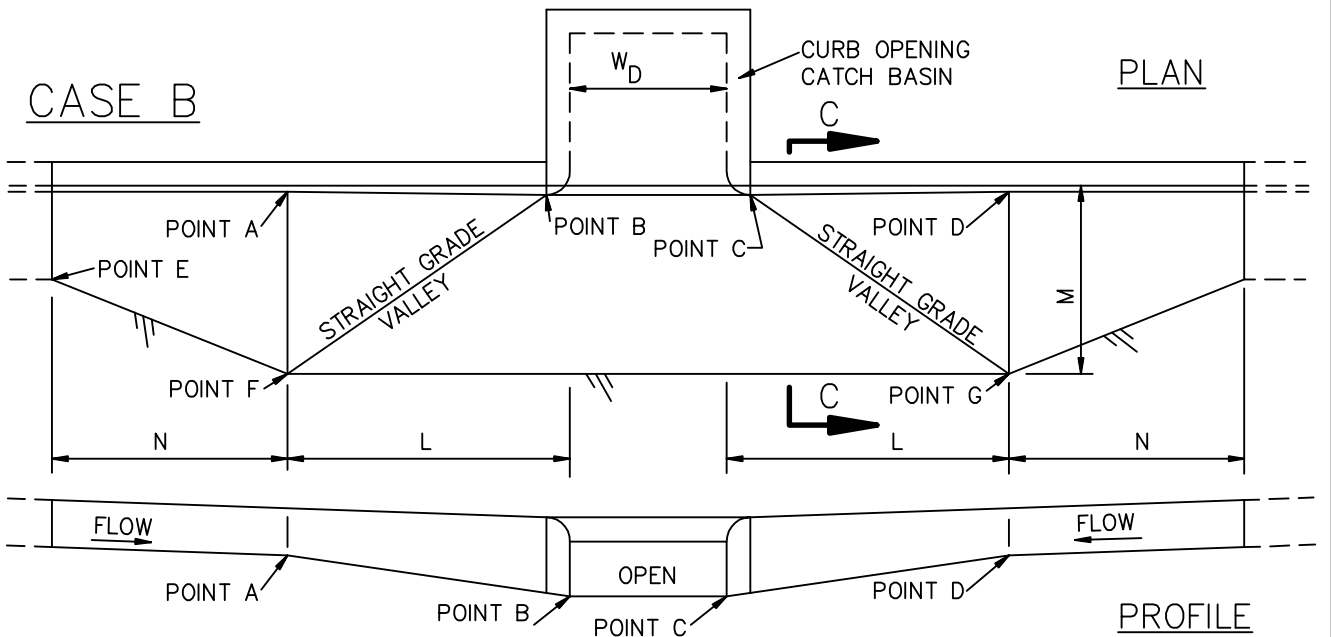

SECTION A-A

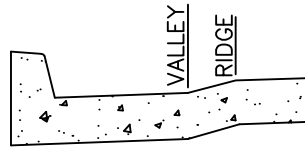

SECTION B-B

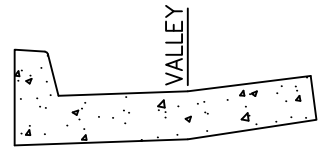

SECTION C-C

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2005, 2009

LOCAL DEPRESSIONS AT CATCH BASINS


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN




313-3

SHEET 1 OF 4

CASE C

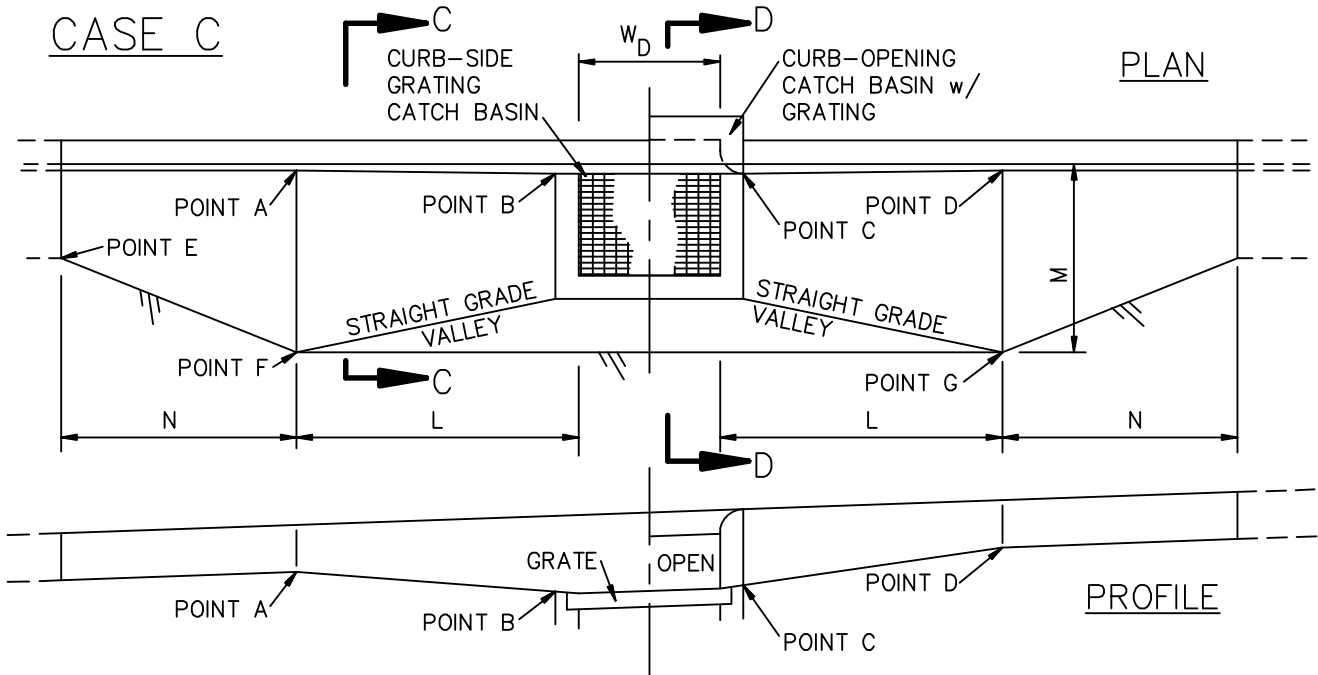

CASE D

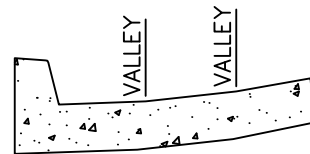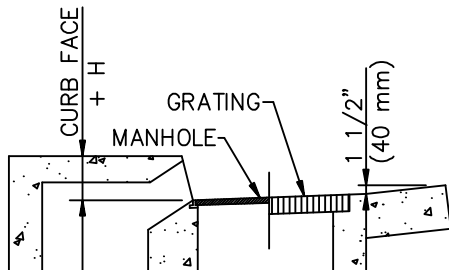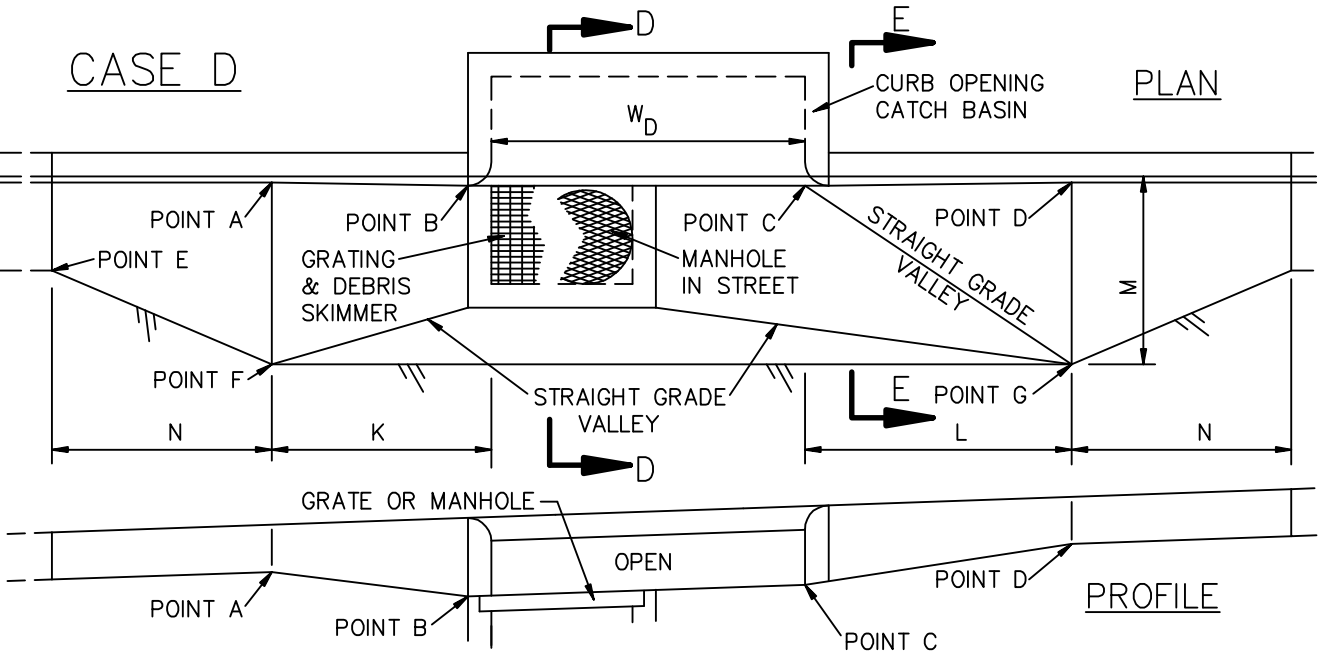

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION


LOCAL DEPRESSIONS AT CATCH BASINS

STANDARD PLAN


313-3

SHEET 2 OF 4



CASE E

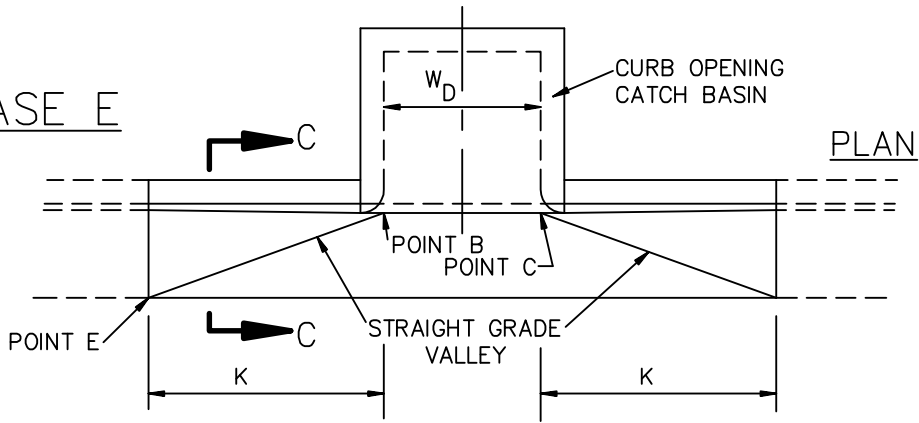

CASE F

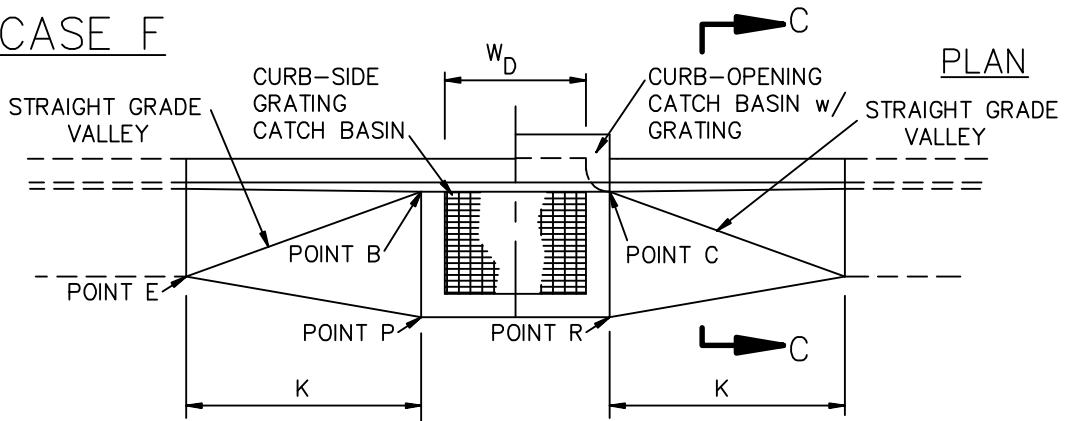

CASE G

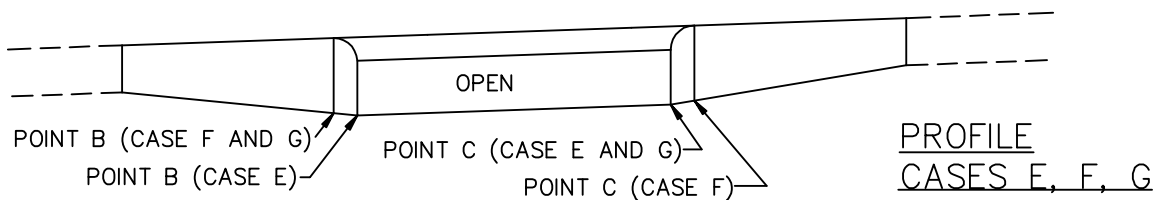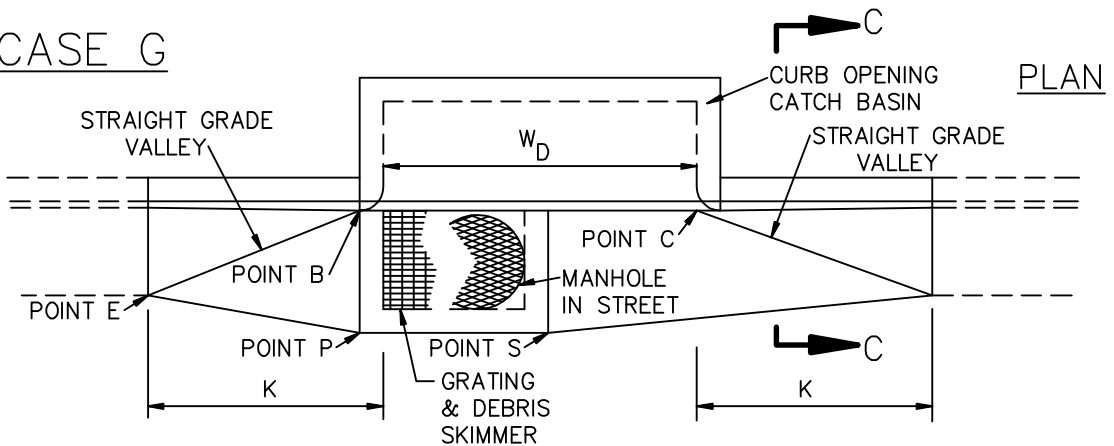

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

LOCAL DEPRESSIONS AT CATCH BASINS

STANDARD PLAN

313-3

SHEET 3 OF 4

NOTES:

1. ALL EXPOSED EDGES SHALL BE ROUNDED TO A 1/2" (15 mm) RADIUS.
2. THE CURB FACE AT POINTS A AND D SHALL BE THE NORMAL CURB FACE OF THE ADJACENT CURB. AT POINTS B AND C, THE CURB FACE SHALL BE THE NORMAL CURB FACE OF THE ADJACENT CURB PLUS H. (SEE APPLICABLE CATCH BASIN STANDARD PLAN.)
3. IN EXISTING STREETS WHERE NO PAVEMENT RECONSTRUCTION IS SPECIFIED ON THE PLANS, THE ELEVATION OF THE OUTER EDGE OF THE LOCAL DEPRESSION SHALL MEET THE FINISHED STREET SURFACE.
4. IN NEW STREETS OR IN EXISTING STREETS WHERE PAVEMENT RECONSTRUCTION IS SPECIFIED ON THE PLANS:

THE ELEVATIONS OF POINTS F AND G SHALL BE SET H1 HIGHER THAN THE GUTTER FLOW LINE ELEVATIONS AT POINTS A AND D, RESPECTIVELY.

THE ELEVATIONS OF POINTS P AND R SHALL BE SET H2 HIGHER THAN THE GUTTER FLOW LINE ELEVATIONS AT POINTS B AND C, RESPECTIVELY.

THE ELEVATION OF POINT S SHALL BE SET H2 HIGHER THAN THE ELEVATION AT THE NEAREST GUTTER FLOW LINE.

WHERE THERE IS NO GUTTER ADJACENT TO THE LOCAL DEPRESSION, THE ELEVATION OF POINT E SHALL BE SET H3 HIGHER THAN THE ELEVATION AT THE NEAREST TOE OF CURB.

5. DIMENSIONS:

H, H1, H2 AND H3 SHALL BE AS NOTED ON THE PLANS.

G = 24" (600 mm)

K = 5'-0" (1500 mm)

L = 6'-0" (1800 mm)

M = 4'-0" (1200 mm)

N = 5'-0" (1500 mm)

W_D = CATCH BASIN W FOR SINGLE CATCH BASIN OR DISTANCE BETWEEN EXTREME END WALLS FOR MULTIPLE CATCH BASINS.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

LOCAL DEPRESSIONS AT CATCH BASINS

STANDARD PLAN


313-3

SHEET 4 OF 4

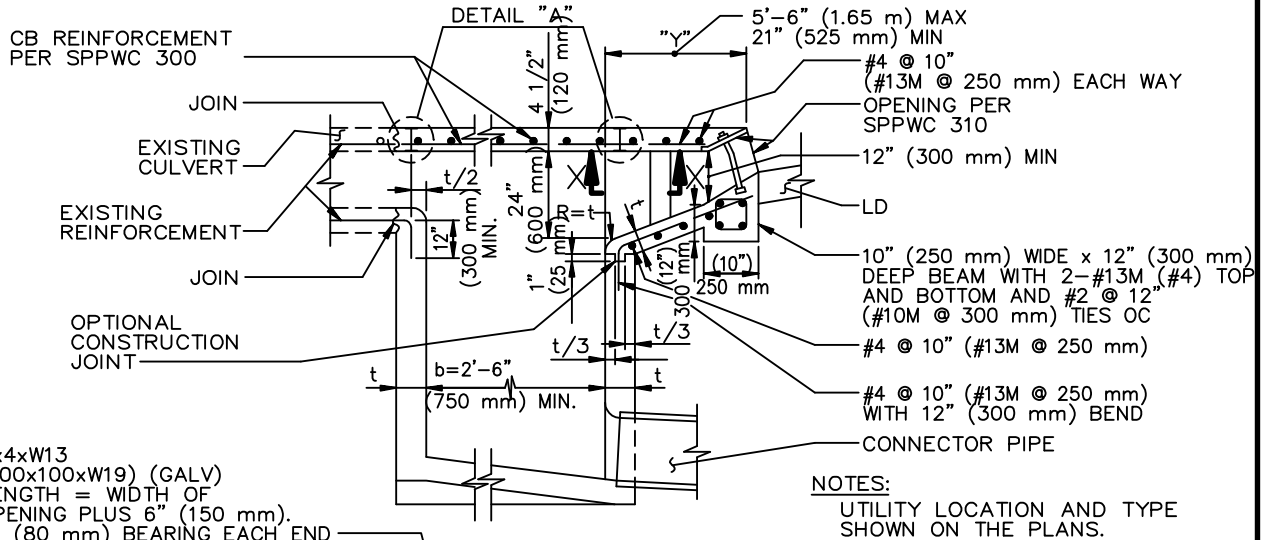


4x4xW13
(100x100xW19) (GALV)
LENGTH = WIDTH OF
OPENING PLUS 6" (150 mm).
3" (80 mm) BEARING EACH END


NOTES:
UTILITY LOCATION AND TYPE
SHOWN ON THE PLANS.

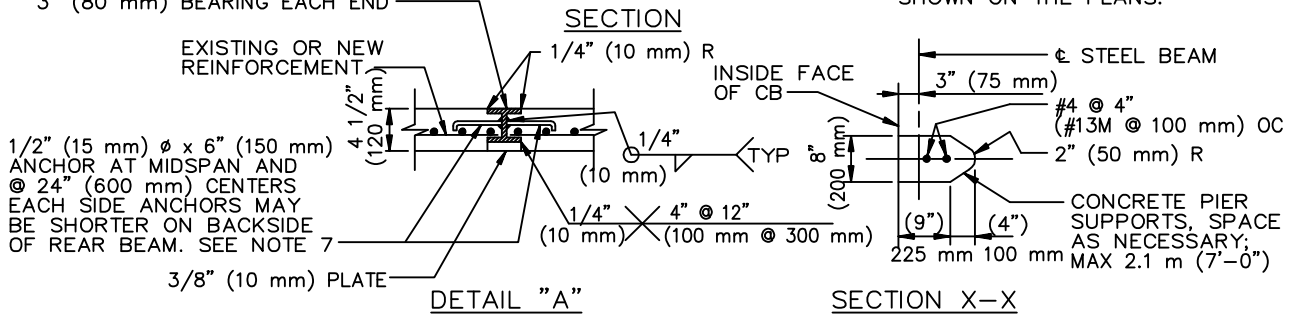

CASE 1
CATCH BASIN MODIFICATION
WITH REAR CULVERT ENTRANCE
AND/OR ENTRANCE PROJECTION

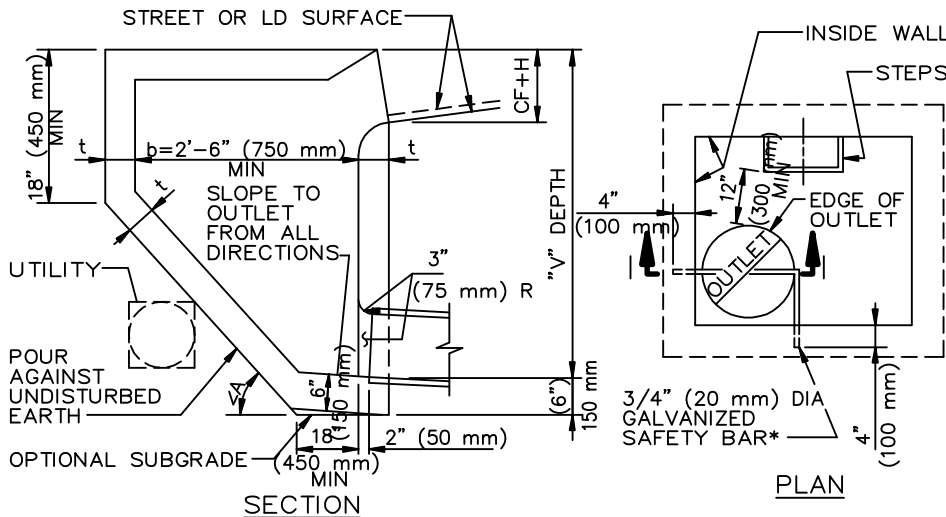

CASE 2
CATCH BASIN MODIFICATION
TO AVOID EXISTING UTILITY

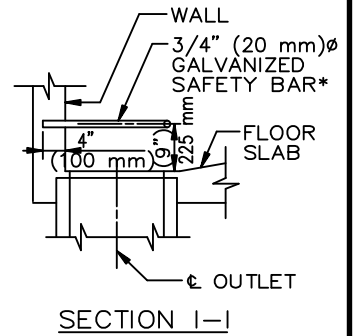

CASE 3
SAFETY BAR FOR DROP
OUTLET CATCH BASIN

*NOTE:
SAFETY BAR SHALL BE
3/4" (20 mm) DIA GALV,
HOT-ROLLED STEEL
CONFORMING TO ASTM A36M
(A36)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1993, 1996, 2009

MODIFICATIONS FOR SIDE
OPENING CATCH-BASIN

STANDARD PLAN

314-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 2

NOTES

1. MODIFICATIONS ARE TO BE USED AS REQUIRED BY THE PLANS. ANY ADDITIONAL CHANGES ARE SUBJECT TO THE APPROVAL OF THE ENGINEER.
2. DETAILS NOT SHOWN SHALL BE PER THE APPLICABLE CATCH BASIN STANDARD PLANS.
3. REFER TO THE PLANS FOR DETAILS OF THE UTILITY AND CULVERT.
4. INTERFERING PORTIONS OF EXISTING CULVERTS SHALL BE REMOVED ON A LINE NORMAL TO THE CULVERT CENTER LINE AND A PORTION OF THE CULVERT RECONSTRUCTED IF REQUIRED. SAWCUTTING SHALL BE USED TO PROVIDE A NEAT JOINT ON THE EXPOSED SURFACE AND TRANSVERSE STEEL SHALL BE RETAINED.
5. PLACE STEPS IN END WALL OF CATCH BASIN UNLESS OTHERWISE SHOWN.
6. WHEN REINFORCEMENT IS REQUIRED BY SPPWC 309, IT SHALL BE PLACED TO THE CONFIGURATION OF THE MODIFIED BASIN. IF ANGLE A EXCEEDS 45° THE SLOPING PORTION OF THE INVERT SHALL BE REINFORCED AS THE REAR WALL. LENGTH OF BARS SHALL BE INCREASED AS NECESSARY.
7. ELECTRICALLY WELDED STUDS 1/2" x 8" (15 mm x 200 mm), NELSON H4F OR EQUAL MAY BE USED IN LIEU OF THE DEFORMED BAR ANCHORS. IF THE TOP SLABS OF THE CATCH BASIN AND THE CULVERT ARE NOT IN THE SAME PLANE THE ANCHORS ON THE CULVERT SIDE SHALL BE OMITTED.
8. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
 - 300 CURB OPENING CATCH BASIN
 - 308 MONOLITHIC CATCH BASIN CONNECTION
 - 309 CATCH BASIN REINFORCEMENT
 - 310 CATCH BASIN FACE PLATE ASSEMBLY AND PROTECTION BAR
 - 312 CATCH BASIN MANHOLE FRAME AND COVER
 - 635 STEEL STEP
 - 636 POLYPROPYLENE PLASTIC STEP






STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

**MODIFICATIONS FOR SIDE
OPENING CATCH-BASIN**

STANDARD PLAN

314-3

SHEET 2 OF 2

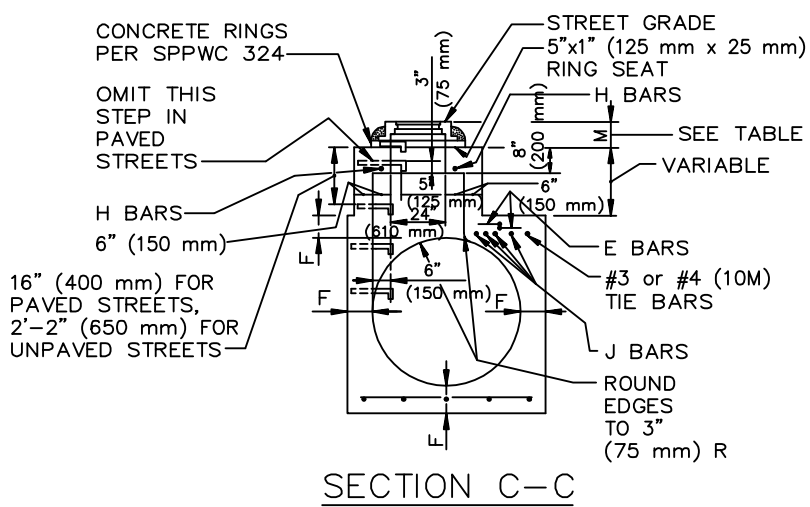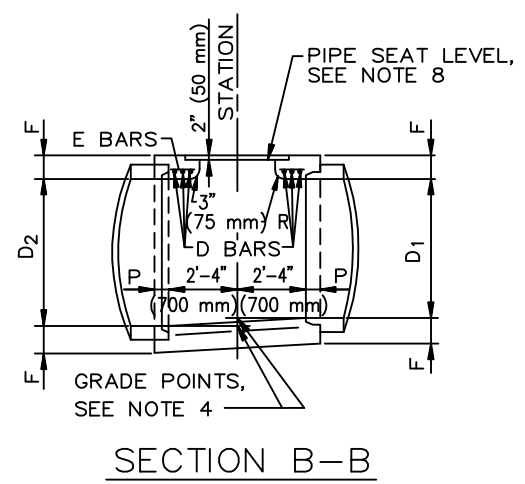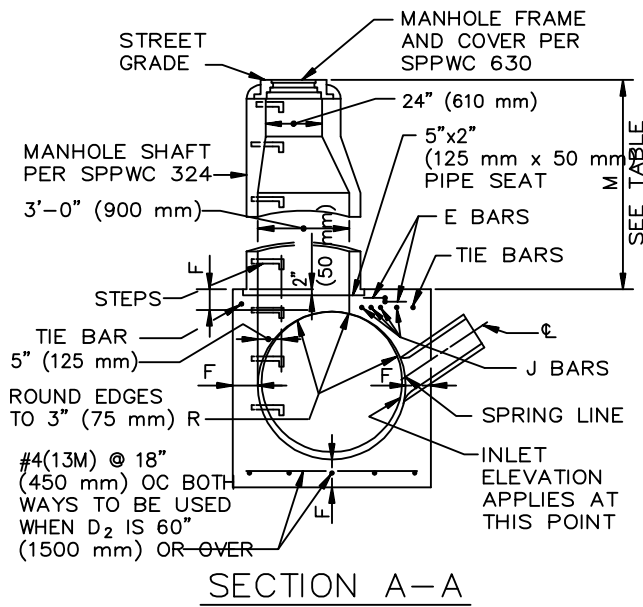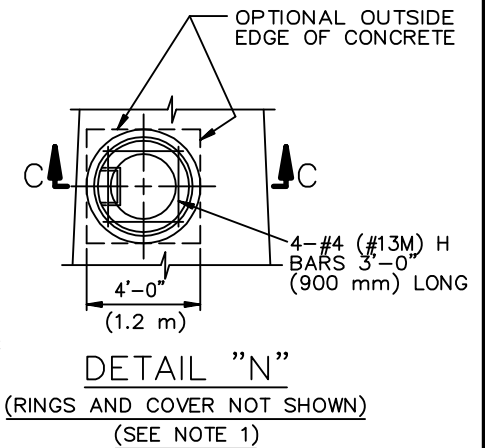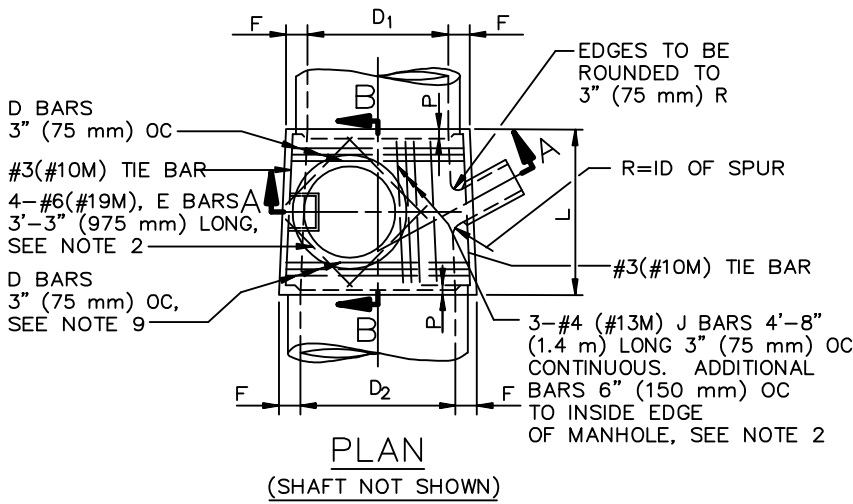

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1992
 REV. 1996, 2009

MANHOLE PIPE-TO-PIPE
MAIN LINE ID=36" (900 mm) OR LARGER
 USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
320-2
 SHEET 1 OF 4

TABLE OF VALUES FOR F	
D ₂	F
36" (900 mm)	6 1/2" (165 mm)
39" (975 mm)	7" (180 mm)
42" (1050 mm)	7 1/2" (190 mm)
45" (1125 mm)	7 3/4" (195 mm)
48" (1200 mm)	8" (205 mm)
51" (1275 mm)	8 1/2" (215 mm)
54" (1350 mm)	9" (230 mm)
57" (1425 mm)	9 1/4" (235 mm)
60" (1500 mm)	9 1/2" (240 mm)
63" (1575 mm)	10" (255 mm)
66" (1650 mm)	10 1/4" (260 mm)
69" (1725 mm)	10 3/4" (275 mm)
72" (1800 mm)	11" (280 mm)
78" (1950 mm)	11 3/4" (300 mm)
84" (2100 mm)	12 1/2" (320 mm)
90" (2250 mm)	13 1/4" (335 mm)
96" (2400 mm)	14" (355 mm)
102" (2550 mm)	15 1/2" (395 mm)
108" (2700 mm)	16" (405 mm)
114" (2850 mm)	16 1/2" (420 mm)
120" (3000 mm)	17" (430 mm)
126" (3150 mm)	17" (430 mm)
132" (3300 mm)	17 1/2" (445 mm)
138" (3450 mm)	17 1/2" (445 mm)
144" (3600 mm)	18" (455 mm)

TABLE OF VALUES FOR M (SEE NOTE 1)				
SECTION	PAVED STREET		UNPAVED STREET	
	MAX	MIN	MAX	MIN
A-A		2'-10 1/2" (867 mm)		3'-6" (1060 mm)
C-C	11" (282 mm)	8 1/2" (217 mm)	16" (410 mm)	15" (380 mm)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION	STANDARD PLAN
MANHOLE PIPE-TO-PIPE	320-2
MAIN LINE ID = 36" (900 mm) OR LARGER	SHEET 2 OF 4

NOTES

1. WHEN DEPTH M FROM STREET GRADE TO THE TOP OF THE BOX IS LESS THAN 2'-10 1/2" (867 mm) FOR PAVED STREETS OR 3'-6" (1060 mm) FOR UNPAVED STREETS, CONSTRUCT MONOLITHIC SHAFT PER SECTION C-C AND DETAIL "N". SHAFT FOR ANY DEPTH OF MANHOLE MAY BE CONSTRUCTED PER SECTION C-C. WHEN DIAMETER D₁ IS 48" (1200 mm) OR LESS, CENTER OF SHAFT MAY BE LOCATED PER NOTE 2.
2. CENTER OF MANHOLE SHAFT SHALL BE LOCATED OVER CENTER LINE OF STORM DRAIN WHEN DIAMETER D₁ IS 48" (1200 mm) OR LESS, IN WHICH CASE PLACE E BARS SYMMETRICALLY AROUND SHAFT AT 45° WITH CENTERLINE AND OMIT J BARS.
3. L AND P SHALL HAVE THE FOLLOWING VALUES UNLESS OTHERWISE SHOWN ON THE PROJECT DRAWINGS:
 - A. D₂=96" (2400 mm) OR LESS, L=5'-6" (1.7 m), P=5" (130 mm)
 - B. D₂ OVER 96" (2400 mm), L=6'-0" (1.8 m), P=8" (210 mm)L MAY BE INCREASED OR LOCATION OF MANHOLE SHIFTED TO MEET PIPE ENDS. WHEN L GREATER THAN THAT SHOWN ABOVE IS SPECIFIED, D BARS SHALL BE CONTINUED 6" (150 mm) OC.
4. STATIONS OF MANHOLES SHOWN ON PLANS APPLY AT CENTERLINE OF SHAFT. ELEVATIONS ARE SHOWN AT CENTERLINE OF SHAFT AND REFER TO THE PROLONGED INVERT GRADE LINES.
5. REINFORCEMENT SHALL CONFORM TO ASTM A 615M, GRADE 300 (ASTM A 615, GRADE 40), AND SHALL TERMINATE 1 1/2" (40 mm) CLEAR OF CONCRETE SURFACES UNLESS OTHERWISE SHOWN.
6. FLOOR OF MANHOLE SHALL BE STEEL TROWELED TO SPRING LINE.
7. BODY OF MANHOLE SHALL BE POURED IN ONE CONTINUOUS OPERATION EXCEPT THAT A CONSTRUCTION JOINT WITH A LONGITUDINAL KEYWAY MAY BE PLACED AT SPRING LINE.
8. THICKNESS OF THE DECK SHALL VARY WHEN NECESSARY TO PROVIDE A LEVEL SEAT BUT SHALL NOT BE LESS THAN THE TABULAR VALUES FOR F SHOWN ON SHEET 2.
9. D BARS SHALL BE #4 (#13M) FOR D₂=39" (975 mm) OR LESS, #5 (#16M) FOR D₂= 42" (1050 mm) TO 84" (2100 mm) INCLUSIVE AND #6 (#19M) FOR D₂= 90" (2250 mm) OR OVER.
10. CENTERLINE OF INLET PIPE SHALL INTERSECT INSIDE FACE OF CONE AT SPRING LINE UNLESS OTHERWISE SHOWN.
11. STEPS SHALL CONFORM TO SPPWC 635 OR 636. UNLESS OTHERWISE SHOWN, STEPS SHALL BE UNIFORMLY SPACED 14" (350 mm) TO 15" (375 mm) OC. THE LOWEST STEP SHALL NOT BE MORE THAN 24" (600 mm) ABOVE THE INVERT.
12. THE FOLLOWING CRITERIA SHALL BE USED FOR THIS MANHOLE:
 - A. MAIN LINE = 36" (900 mm) INSIDE DIAMETER OR LARGER. EXCEPT IF THE MAIN LINE RCP DOWNSTREAM OF MANHOLE IS 36" (900 mm) TO 42" (1050 mm) INSIDE DIAMETER AND THE MAIN LINE RCP UPSTREAM IS 33" (825 mm) OR LESS SPPWC 321 SHALL BE USED.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


MANHOLE PIPE-TO-PIPE
MAIN LINE ID = 36" (900 mm) OR LARGER

320-2


SHEET 3 OF 4

- B. THE OUTSIDE DIAMETER OF THE LATERAL MUST BE LESS THAN OR EQUAL TO 1/2 THE INSIDE DIAMETER OF THE MAIN LINE. IF THE UPSTREAM AND DOWNSTREAM DIAMETERS OF THE MANHOLE ARE NOT THE SAME, THE GOVERNING INSIDE DIAMETER OF THE MAIN LINE SHALL BE CONSIDERED TO BE THAT WHERE THE EXTENDED CENTERLINE OF THE LATERAL ENTERS THE MANHOLE.
 - C. IN NO INSTANCE SHALL THE INSIDE DIAMETER OF THE LATERAL TO THE MANHOLE BE GREATER THAN 30" (750 mm).
13. MANHOLE FRAME AND COVER SHALL CONFORM TO SPPWC 630 UNLESS OTHERWISE SHOWN.
 14. MANHOLE SHAFT SHALL CONFORM TO SPPWC 324 UNLESS OTHERWISE SHOWN.
 15. WHERE A MANHOLE SHAFT – 36" (900 mm) WITHOUT REDUCER IS SPECIFIED REFER TO SPPWC 326.
 16. WHERE A PRESSURE MANHOLE SHAFT – WITH ECCENTRIC REDUCER IS SPECIFIED REFER TO SPPWC 328.
 17. WHERE A PRESSURE MANHOLE SHAFT – 914 mm (36") WITHOUT REDUCER IS SPECIFIED REFER TO SPPWC 329.
 18. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
 - 324 MANHOLE SHAFT – WITH ECCENTRIC REDUCER
 - 326 MANHOLE SHAFT – 36" (900 mm) WITHOUT REDUCER
 - 328 PRESSURE MANHOLE SHAFT – WITH ECCENTRIC
 - 329 PRESSURE MANHOLE SHAFT 36" (914 mm) WITHOUT REDUCER
 - 630 24" (610 mm) MANHOLE FRAME AND COVER
 - 633 36" (914 mm) MANHOLE FRAME AND COVER
 - 635 STEEL STEP
 - 636 POLYPROPYLENE PLASTIC STEP


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION	STANDARD PLAN
MANHOLE PIPE-TO-PIPE	320-2
MAIN LINE ID = 36" (900 mm) OR LARGER	SHEET 4 OF 4

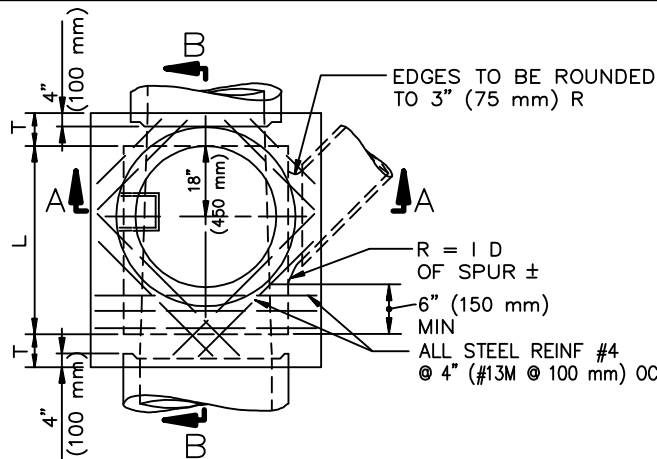


PLAN
(SHAFT NOT SHOWN)

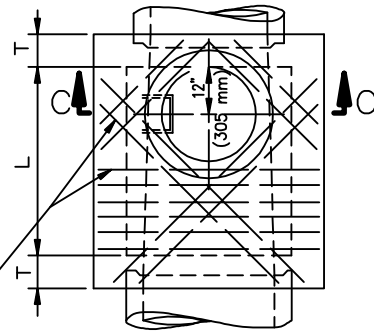


DETAIL "N" PLAN
(RINGS AND COVER NOT SHOWN)
SEE NOTE 1

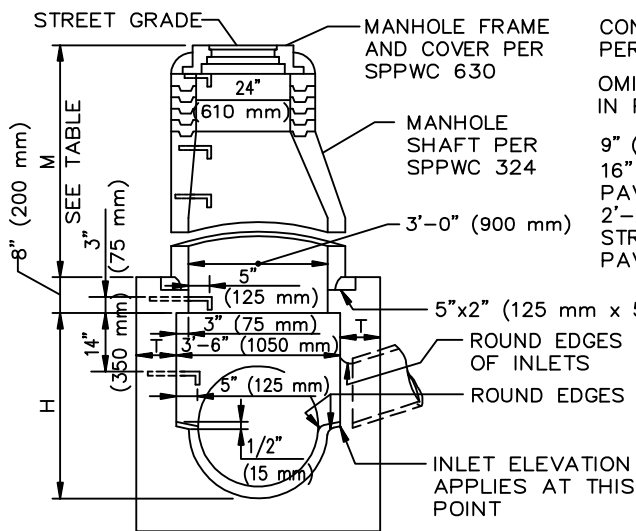

SECTION A-A

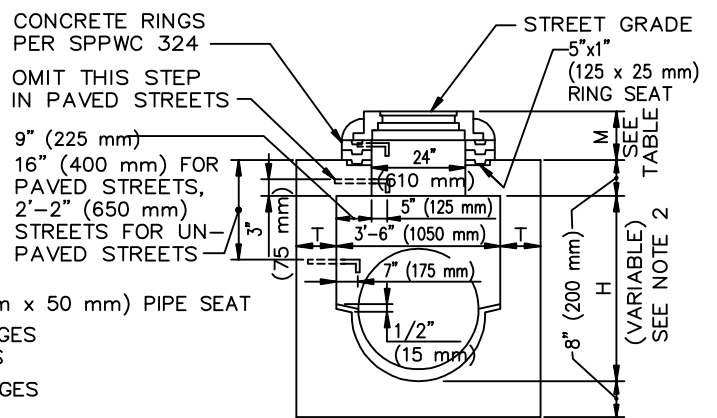

SECTION C-C

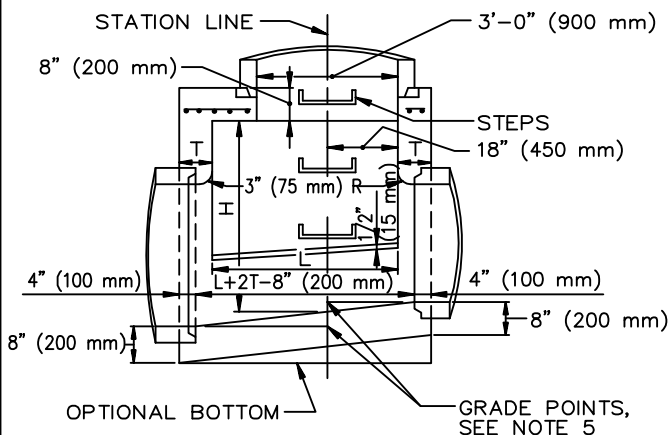

SECTION B-B

TABLE OF VALUES FOR M (SEE NOTE 1)				
SECTION	PAVED STREET		UNPAVED STREET	
	MAX	MIN	MAX	MIN
A-A		2'-10 1/2" (867 mm)		3'-6" (1060 mm)
C-C	11" (282 mm)	8 1/2" (217 mm)	16" (410 mm)	15" (380 mm)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1996, 2009

**MANHOLE PIPE-TO-PIPE (ONE OR BOTH
MAIN LINE IDS 33" (825 mm) OR SMALLER)**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

321-2

SHEET 1 OF 3

NOTES

1. WHEN DEPTH M FROM STREET GRADE TO THE TOP OF THE BOX IS LESS THAN 2'-10 1/2" (867 mm) FOR PAVED STREETS OR 3'-6" (1060 mm) FOR UNPAVED STREETS, CONSTRUCT SHAFT PER SECTION C-C AND DETAIL "N". DEPTH M MAY BE REDUCED TO AN ABSOLUTE LIMIT OF 6" (150 mm) WHEN LARGER VALUES OF M WOULD REDUCE H IN SECTION C-C TO 3'-6" (1060 mm) OR LESS.
2. H (IN SECTION A-A AND B-B) SHALL NOT BE LESS THAN 4'-0" (1.2 m), BUT MAY BE INCREASED PROVIDED THAT THE VALUE OF M SHALL NOT BE LESS THAN THE MINIMUM SPECIFIED AND THAT THE REDUCER SHALL BE USED. FOR H (IN SECTION C-C) SEE NOTE 1.
3. L SHALL BE 4'-0" (1.2 m) UNLESS OTHERWISE SHOWN. L MAY BE INCREASED OR LOCATION OF MANHOLE SHIFTED TO MEET PIPE ENDS, BUT ANY CHANGE IN LOCATION OF THE SPUR MUST BE APPROVED BY THE ENGINEER.
4. T SHALL BE 8" (200 mm) FOR VALUES OF H UP TO AND INCLUDING 8'-0" (2.4 m) AND 10" (250 mm) FOR VALUES OF H OVER 8'-0" (2.4 m).
5. STATIONS OF MANHOLES SHOWN ON PLANS APPLY AT CENTERLINE OF SHAFT. ELEVATIONS ARE SHOWN AT CENTERLINE OF SHAFT AND REFER TO THE PROLONGED INVERT GRADE LINES. SEE NOTE 3.
6. REINFORCEMENT SHALL CONFORM TO ASTM A 615, GRADE 40 (ASTM A 615M, GRADE 300), AND SHALL TERMINATE 1 1/2" (40 mm) CLEAR OF CONCRETE SURFACES UNLESS OTHERWISE SHOWN.
7. FLOOR OF MANHOLE SHALL BE STEEL TROWELED TO SPRING LINE.
8. BODY OF MANHOLE SHALL BE POURED IN ONE CONTINUOUS OPERATION EXCEPT THAT A CONSTRUCTION JOINT WITH A LONGITUDINAL KEYWAY MAY BE PLACED AT SPRING LINE.
9. THICKNESS OF THE DECK SHALL VARY WHEN NECESSARY TO PROVIDE A LEVEL SEAT BUT SHALL NOT BE LESS THAN 8" (200 mm).
10. STEPS SHALL CONFORM TO SPPWC 635 OR 636. UNLESS OTHERWISE SHOWN, STEPS SHALL BE UNIFORMLY SPACED 14" (350 mm) TO 15" (375 mm) OC. THE LOWEST STEP SHALL NOT BE MORE THAN 24" (600 mm) ABOVE THE LEDGE AT THE SIDE OF THE MANHOLE.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**MANHOLE PIPE-TO-PIPE (ONE OR BOTH
MAIN LINE IDS 33" (825 mm) OR SMALLER)**

321-2

SHEET 2 OF 3

11. THE FOLLOWING CRITERIA SHALL BE USED FOR THIS MANHOLE:

- A. MAIN LINE = 33" (825 mm) INSIDE DIAMETER OR LESS. (EXCEPTION – IF THE MAIN LINE RCP DOWNSTREAM OF THE MANHOLE IS 36" (900 mm) TO 42" (1050 mm) INSIDE DIAMETER AND THE MAIN LINE RCP UPSTREAM IS 33" (825 mm) OR LESS.) SPPWC 320 OR 322 IS NOT APPLICABLE WHERE THE MAIN LINE CONDUIT IS LESS THAN 36" (900 mm) IN DIAMETER.
- B. SEE SECTION A – A. THE MAXIMUM SIZE LATERAL THAT MAY BE CONNECTED TO THIS MANHOLE IS SUCH THAT THE DISTANCE FROM THE OUTSIDE (TOP) OF THE LATERAL TO THE BOTTOM OF THE 8" (200 mm) THICK TOP OF THE MANHOLE CHAMBER, MEASURED VERTICALLY FROM THE END OF THE RCP, SHALL BE A MINIMUM OF 6" (150 mm).
- C. IF THE SIZE OF THE LATERAL IS SUCH THAT THE ABOVE–SPECIFIED MINIMUM DISTANCES CANNOT BE MAINTAINED, THEN ONE OF THE FOLLOWING ALTERNATE SOLUTIONS MUST BE USED.
 - 1. PROVIDE A SPECIAL STRUCTURE.
 - 2. PROVIDE TWO STANDARD STRUCTURES, CONSISTING OF THIS MANHOLE PLACED UPSTREAM OR DOWNSTREAM FROM THE APPLICABLE JUNCTION STRUCTURE OR TRANSITION STRUCTURE.

12. MANHOLE FRAME AND COVER SHALL CONFORM TO SPPWC 630 UNLESS OTHERWISE SHOWN.

13. MANHOLE SHAFT SHALL CONFORM TO SPPWC 324 UNLESS OTHERWISE SHOWN.

14. WHERE A MANHOLE SHAFT – 36" (900 mm) WITHOUT REDUCER IS SPECIFIED REFER TO SPPWC 336.

15. WHERE A PRESSURE MANHOLE SHAFT – WITH ECCENTRIC REDUCER IS SPECIFIED REFER TO SPPWC 328.

16. WHERE A PRESSURE MANHOLE SHAFT – 36" (900 mm) WITHOUT REDUCER IS SPECIFIED REFER TO SPPWC 329.

17. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:

- 324 MANHOLE SHAFT – WITH ECCENTRIC REDUCER
- 326 MANHOLE SHAFT – 36" (900 mm) WITHOUT REDUCER
- 328 PRESSURE MANHOLE SHAFT – WITH ECCENTRIC
- 329 PRESSURE MANHOLE SHAFT – 36" (900 mm) WITHOUT REDUCER
- 630 24" (610 mm) MANHOLE FRAME AND COVER
- 633 36" (900 mm) MANHOLE FRAME AND COVER
- 635 STEEL STEP
- 636 POLYPROPYLENE PLASTIC STEP

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**MANHOLE PIPE-TO-PIPE (ONE OR BOTH
MAIN LINE IDS 33" (825 mm) OR SMALLER)**


321-2

SHEET 3 OF 3


3 - #4 (#13M) J BARS,
 4'-8" (1.4 m) LONG,
 3" (75 mm) OC CONTINUE
 ADDITIONAL BARS
 6" (150 mm) OC TO INSIDE
 EDGE OF MANHOLE

STATION
 5" x 2" PIPE SEAT
 (125 mm x 50 mm)
 3-D BARS, 3"
 (75 mm) OC CONTINUE
 6" (150 mm) OC
 4-#6 (#19M) E BARS
 SEE NOTE 3
 #3 OR #4 @ 18"
 (10M @ 450 mm) OC
 TIE BARS
 A & B BARS

STATION POINT
 STATION

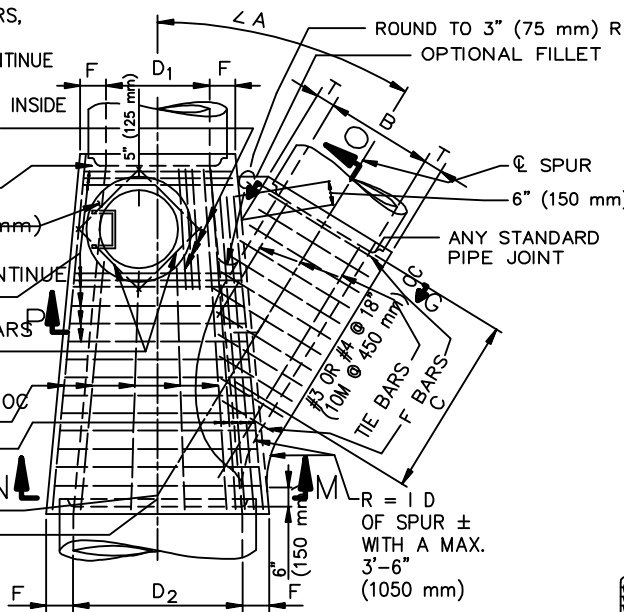


PLAN
 (SHAFT NOT SHOWN)

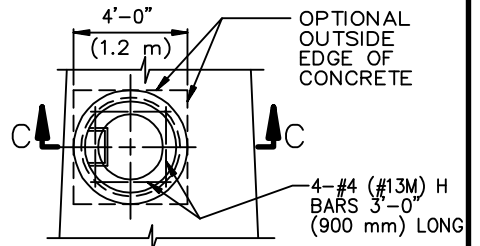


DETAIL "N"
 (RINGS AND COVER NOT SHOWN)
 SEE NOTE 2


R = 1 D
 OF SPUR ±
 WITH A MAX.
 3'-6"
 (1050 mm)

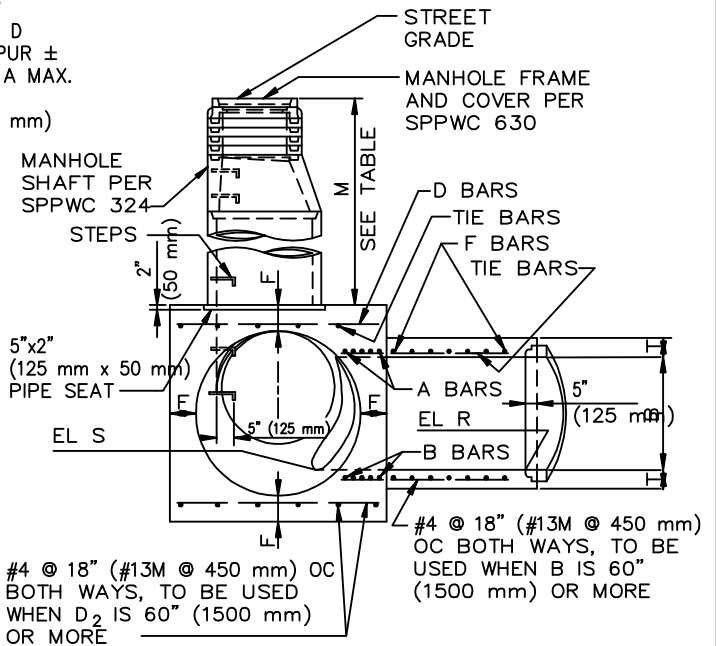

SECTION N-M-P-O



SECTION G-G

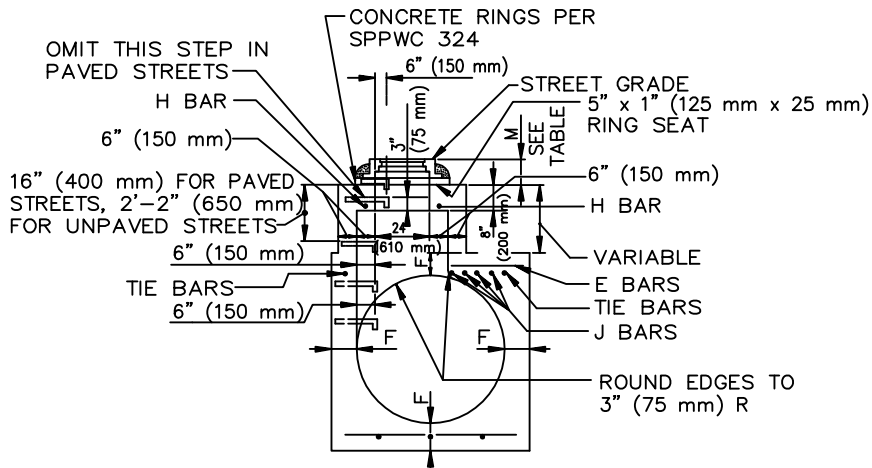

SECTION C-C

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1992
 REV. 1996, 2009


**MANHOLE PIPE-TO-PIPE
 (LARGE SIDE INLET)**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

322-2

SHEET 1 OF 4

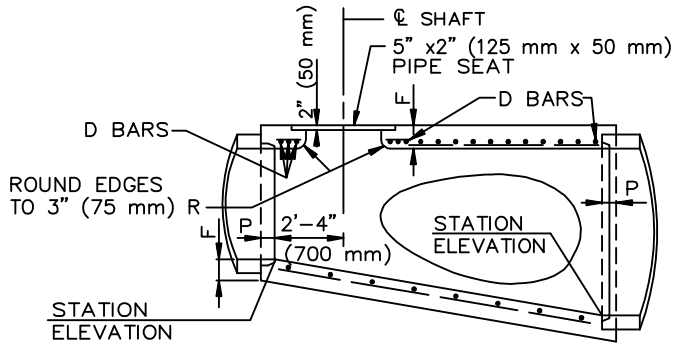

LONGITUDINAL SECTION

D ₂ OR B	A & B	D OR F
12" (300 mm)–39" (975 mm)	#5 @ 3" (#16M @ 75 mm)	#4 @ 6" (#13M @ 150 mm)
42" (1050 mm)–84" (2100 mm)	#6 @ 3" (#19M @ 75 mm)	#5 @ 6" (#16M @ 150 mm)
90" (2250 mm)–144" (3600 mm)	#7 @ 3" (#22M @ 75 mm)	#6 @ 6" (#19M @ 150 mm)

SECTION	PAVED STREET		UNPAVED STREET	
	MAX	MIN	MAX	MIN
N-M-P-O		2'-10 1/2" (867 mm)		3'-6" (1060 mm)
C-C	11" (282 mm)	8 1/2" (217 mm)	16" (410 mm)	15" (380 mm)

D ₂	F
36" (900 mm)	6 1/2" (165 mm)
39" (975 mm)	7" (180 mm)
42" (1050 mm)	7 1/2" (190 mm)
45" (1125 mm)	7 3/4" (195 mm)
48" (1200 mm)	8" (205 mm)
51" (1275 mm)	8 1/2" (215 mm)
54" (1350 mm)	9" (230 mm)
57" (1425 mm)	9 1/4" (235 mm)
60" (1500 mm)	9 1/2" (240 mm)
63" (1575 mm)	10" (255 mm)
66" (1650 mm)	10 1/4" (260 mm)
69" (1725 mm)	10 3/4" (275 mm)
72" (1800 mm)	11" (280 mm)
78" (1950 mm)	11 3/4" (300 mm)
84" (2100 mm)	12 1/2" (320 mm)
90" (2250 mm)	13 1/4" (335 mm)
96" (2400 mm)	14" (355 mm)
102" (2550 mm)	15 1/2" (395 mm)
108" (2700 mm)	16" (405 mm)
114" (2850 mm)	16 1/2" (420 mm)
120" (3000 mm)	17" (430 mm)
126" (3150 mm)	17" (430 mm)
132" (3300 mm)	17 1/2" (445 mm)
138" (3450 mm)	17 1/2" (445 mm)
144" (3600 mm)	18" (455 mm)

B	T
12" (300 mm)	4" (100 mm)
15" (375 mm)	4 1/4" (110 mm)
18" (450 mm)	4 1/2" (115 mm)
21" (525 mm)	5" (125 mm)
24" (600 mm)	5 1/4" (135 mm)
27" (675 mm)	5 1/2" (140 mm)
30" (750 mm)	6" (150 mm)
33" (825 mm)	6 1/4" (160 mm)
36" (900 mm)	6 1/2" (165 mm)
39" (975 mm)	7" (180 mm)
42" (1050 mm)	7 1/2" (190 mm)
45" (1125 mm)	7 3/4" (195 mm)
48" (1200 mm)	8" (205 mm)
51" (1275 mm)	8 1/2" (215 mm)
54" (1350 mm)	9" (230 mm)
57" (1425 mm)	9 1/4" (235 mm)
60" (1500 mm)	9 1/2" (240 mm)
63" (1575 mm)	10" (255 mm)
66" (1650 mm)	10 1/4" (260 mm)
69" (1725 mm)	10 3/4" (275 mm)
72" (1800 mm)	11" (280 mm)
78" (1950 mm)	11 3/4" (300 mm)
84" (2100 mm)	12 1/2" (320 mm)
90" (2250 mm)	13 1/4" (335 mm)
96" (2400 mm)	14" (355 mm)
102" (2550 mm)	15 1/2" (395 mm)
108" (2700 mm)	16" (405 mm)
114" (2850 mm)	16 1/2" (420 mm)
120" (3000 mm)	17" (430 mm)
126" (3150 mm)	17" (430 mm)
132" (3300 mm)	17 1/2" (445 mm)
138" (3450 mm)	17 1/2" (445 mm)
144" (3600 mm)	18" (455 mm)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**MANHOLE PIPE-TO-PIPE
(LARGE SIDE INLET)**

322-2

SHEET 2 OF 4

NOTES

1. VALUES FOR A, B, C, D₁, D₂, ELEVATION R AND ELEVATION S ARE SHOWN ON THE PLANS. ELEVATION S APPLIES AT INSIDE WALL OF STRUCTURE.
2. WHEN DEPTH M FROM STREET GRADE TO THE TOP OF THE BOX IS LESS THAN 2'-10 1/2" (867 mm) FOR PAVED STREETS OR 3'-6" (1060 mm) FOR UNPAVED STREETS, CONSTRUCT MONOLITHIC SHAFT PER SECTION C-C AND DETAIL "N". SHAFT FOR ANY DEPTH OF MANHOLE MAY BE CONSTRUCTED PER SECTION C-C. WHEN DIAMETER D₁ IS 48" (1200 mm) OR LESS, CENTER OF SHAFT MAY BE LOCATED PER NOTE 3.
3. CENTER OF MANHOLE SHAFT SHALL BE LOCATED OVER CENTERLINE OF STORM DRAIN WHEN DIAMETER D₁ IS 48" (1200 mm) OR LESS, IN WHICH CASE PLACE E BARS SYMMETRICALLY AROUND SHAFT AT 45° WITH CENTERLINE.
4. LENGTH OF MANHOLE MAY BE INCREASED AT OPTION TO MEET PIPE ENDS, BUT ANY CHANGE IN LOCATION OF SPUR MUST BE APPROVED BY THE ENGINEER.
5. P SHALL BE 5" (125 mm) FOR D₂=96" (2400 mm) OR LESS AND 8" (200 mm) FOR D₂ OVER 96" (2400 mm).
6. REINFORCEMENT SHALL CONFORM TO ASTM A 615, GRADE 40 (ASTM A 615M, GRADE 300), AND SHALL TERMINATE 1 1/2" (40 mm) CLEAR OF CONCRETE SURFACES UNLESS OTHERWISE SHOWN.
7. FLOOR OF MANHOLE SHALL BE STEEL TROWELED TO SPRING LINE.
8. BODY OF MANHOLE SHALL BE POURED IN ONE CONTINUOUS OPERATION EXCEPT THAT A CONSTRUCTION JOINT WITH A LONGITUDINAL KEYWAY MAY BE PLACED AT SPRING LINE.
9. THICKNESS OF THE DECK SHALL VARY WHEN NECESSARY TO PROVIDE A LEVEL SEAT BUT SHALL NOT BE LESS THAN THE TABULAR VALUES OF F SHOWN ON TABLE, SHEET 1.
10. IF LATERALS ENTER ON BOTH SIDES OF MANHOLE, SHAFT SHALL BE LOCATED ON SIDE RECEIVING THE SMALLER LATERAL.
11. STEPS SHALL CONFORM TO SPPWC 635 OR 636. UNLESS OTHERWISE SHOWN, STEPS SHALL BE UNIFORMLY SPACED 14" (350 mm) TO 15" (375 mm) OC. THE LOWEST STEP SHALL NOT BE MORE THAN 24" (600 mm) ABOVE THE INVERT.
12. THE FOLLOWING CRITERIA SHALL BE USED FOR THIS MANHOLE:
 - A. THIS STANDARD PLAN IS USED WHEN SPPWC 320 IS INADEQUATE.
MAIN LINE = 36" (900 mm) INSIDE DIAMETER OR LARGER.
 - B. LATERAL = 12" (300 mm) TO 144" (3600 mm) INSIDE DIAMETER; HOWEVER, THE INSIDE DIAMETER SHALL NOT EXCEED THE INSIDE DIAMETER OF THE MAIN LINE.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

**MANHOLE PIPE-TO-PIPE
(LARGE SIDE INLET)**

STANDARD PLAN

322-2

SHEET 3 OF 4

13. MANHOLE FRAME AND COVER SHALL CONFORM TO SPPWC 630 UNLESS OTHERWISE SHOWN.
14. MANHOLE SHAFT SHALL CONFORM TO SPPWC 324 UNLESS OTHERWISE SHOWN.
15. WHERE A MANHOLE SHAFT – 36" (900 mm) WITHOUT REDUCER IS SPECIFIED REFER TO SPPWC 326.
16. WHERE A PRESSURE MANHOLE SHAFT – WITH ECCENTRIC REDUCER IS SPECIFIED REFER TO SPPWC 328.
17. WHERE A PRESSURE MANHOLE SHAFT – 36" (914 mm) WITHOUT REDUCER IS SPECIFIED REFER TO SPPWC 329.
18. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
 - 324 MANHOLE SHAFT – WITH ECCENTRIC REDUCER
 - 326 MANHOLE SHAFT – 36" (900 mm) WITHOUT REDUCER
 - 328 PRESSURE MANHOLE SHAFT – WITH ECCENTRIC REDUCER
 - 329 PRESSURE MANHOLE SHAFT – 36" (914 mm) WITHOUT REDUCER
 - 630 24" (610 mm) MANHOLE FRAME AND COVER
 - 633 36" (914 mm) MANHOLE FRAME AND COVER
 - 635 STEEL STEP
 - 636 POLYPROPYLENE PLASTIC STEP

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

**MANHOLE PIPE-TO-PIPE
(LARGE SIDE INLET)**

322-2

SHEET 4 OF 4

SIZE AND SPACING OF STEEL AS SHOWN ON PROJECT DRAWINGS, EXCEPT THAT 5 BARS ON EACH SIDE OF SHAFT SHALL BE NOT SMALLER THAN #5 @ 4" (#16M @ 100 mm) OC OR EQUIVALENT

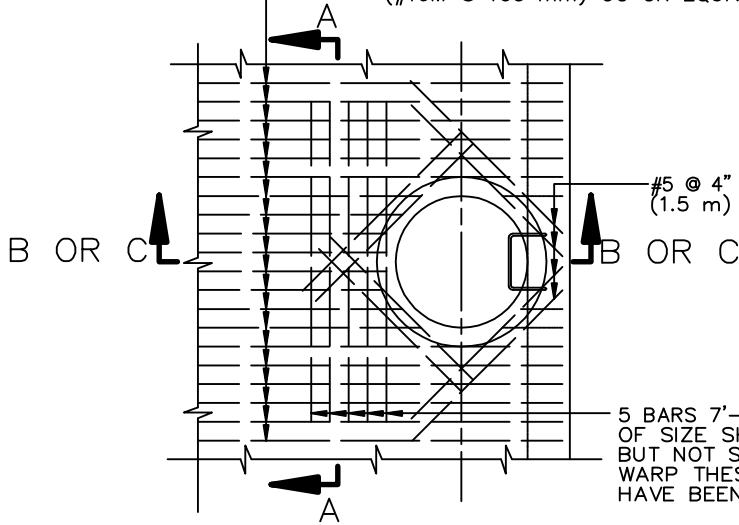


#5 @ 4" (#16M @ 100 mm) OC x 5'-0" (1.5 m) LONG


5 BARS 7'-0" (2.1 m) LONG, 4" (100 mm) OC, OF SIZE SHOWN FOR TRANSVERSE STEEL, BUT NOT SMALLER THAN #5 (#16M) BARS. WARP THESE BARS UNDER BARS THAT HAVE BEEN CUT FOR SHAFT OPENING

PLAN

(SHAFT NOT SHOWN)

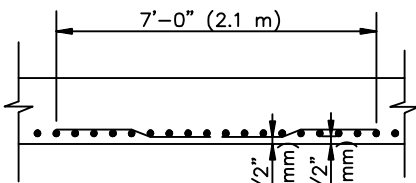

SECTION A - A

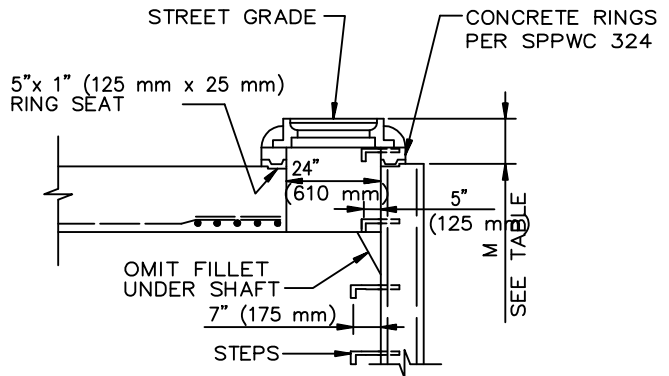


SECTION C - C

SEE NOTE 1

MANHOLE FRAME AND COVER PER SPPWC 630

MANHOLE SHAFT PER SPPWC 324

5" x 2" (125 mm x 50 mm) PIPE SEAT

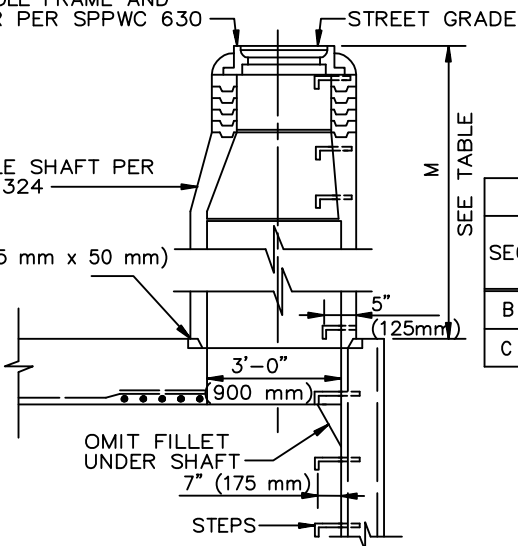

SECTION B - B

TABLE OF VALUES FOR M (SEE NOTE 1)

SECTION	PAVED STREET		UNPAVED STREET	
	MAX	MIN	MAX	MIN
B - B	-	2'-10 1/2" (867 mm)	-	3'-6" (1060 mm)
C - C	11" (282 mm)	8 1/2" (217 mm)	16" (410 mm)	15" (380 mm)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1992 REV. 1996, 2009

MANHOLE - CONCRETE BOX STORM DRAIN

STANDARD PLAN

323-2

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 2

NOTES

1. WHEN DEPTH M FROM STREET GRADE TO THE TOP OF THE BOX IS LESS THAN 2'-10 1/2" (867 mm) FOR PAVED STREETS OR 3'-6" (1060 mm) FOR UNPAVED STREETS, CONSTRUCT SHAFT PER SECTION C-C.
2. STATIONS OF MANHOLES SHOWN ON PLANS. APPLY AT CENTERLINE LINE OF SHAFT. ELEVATIONS ARE SHOWN AT CENTERLINE OF SHAFT.
3. REINFORCEMENT SHALL CONFORM TO ASTM A 615, GRADE 40 (ASTM A 615M, GRADE 300), AND SHALL TERMINATE 40 mm (1 1/2") CLEAR OF CONCRETE SURFACES UNLESS OTHERWISE SHOWN.
4. STEPS SHALL CONFORM TO SPPWC 635 OR 636. UNLESS OTHERWISE SHOWN, STEPS SHALL BE UNIFORMLY SPACED 14" (350 mm) TO 15" (375 mm) OC. THE LOWEST STEP SHALL NOT BE MORE THAN 24" (600 mm) ABOVE THE INVERT.
5. MANHOLE FRAME AND COVER SHALL CONFORM TO SPPWC 630 UNLESS OTHERWISE SHOWN.
6. MANHOLE SHAFT SHALL CONFORM TO SPPWC 324 UNLESS OTHERWISE SHOWN.
7. WHERE A MANHOLE SHAFT - 36" (900 mm) WITHOUT REDUCER IS SPECIFIED REFER TO SPPWC 326.
8. WHERE A PRESSURE MANHOLE SHAFT - WITH ECCENTRIC REDUCER IS SPECIFIED REFER TO SPPWC 328.
9. WHERE A PRESSURE MANHOLE SHAFT - 36" (900 mm) WITHOUT REDUCER IS SPECIFIED REFER TO SPPWC 329.
10. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
 - 324 MANHOLE SHAFT - WITH ECCENTRIC REDUCER
 - 326 MANHOLE SHAFT - 36" (900 mm) WITHOUT REDUCER
 - 328 PRESSURE MANHOLE SHAFT - WITH ECCENTRIC
 - 329 PRESSURE MANHOLE SHAFT - 36" (900 mm) WITHOUT REDUCER
 - 630 24" (600 mm) MANHOLE FRAME AND COVER
 - 633 36" (900 mm) MANHOLE FRAME AND COVER
 - 635 STEEL STEP
 - 636 POLYPROPYLENE PLASTIC STEP


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


**MANHOLE - CONCRETE
BOX STORM DRAIN**

323-2

SHEET 2 OF 2

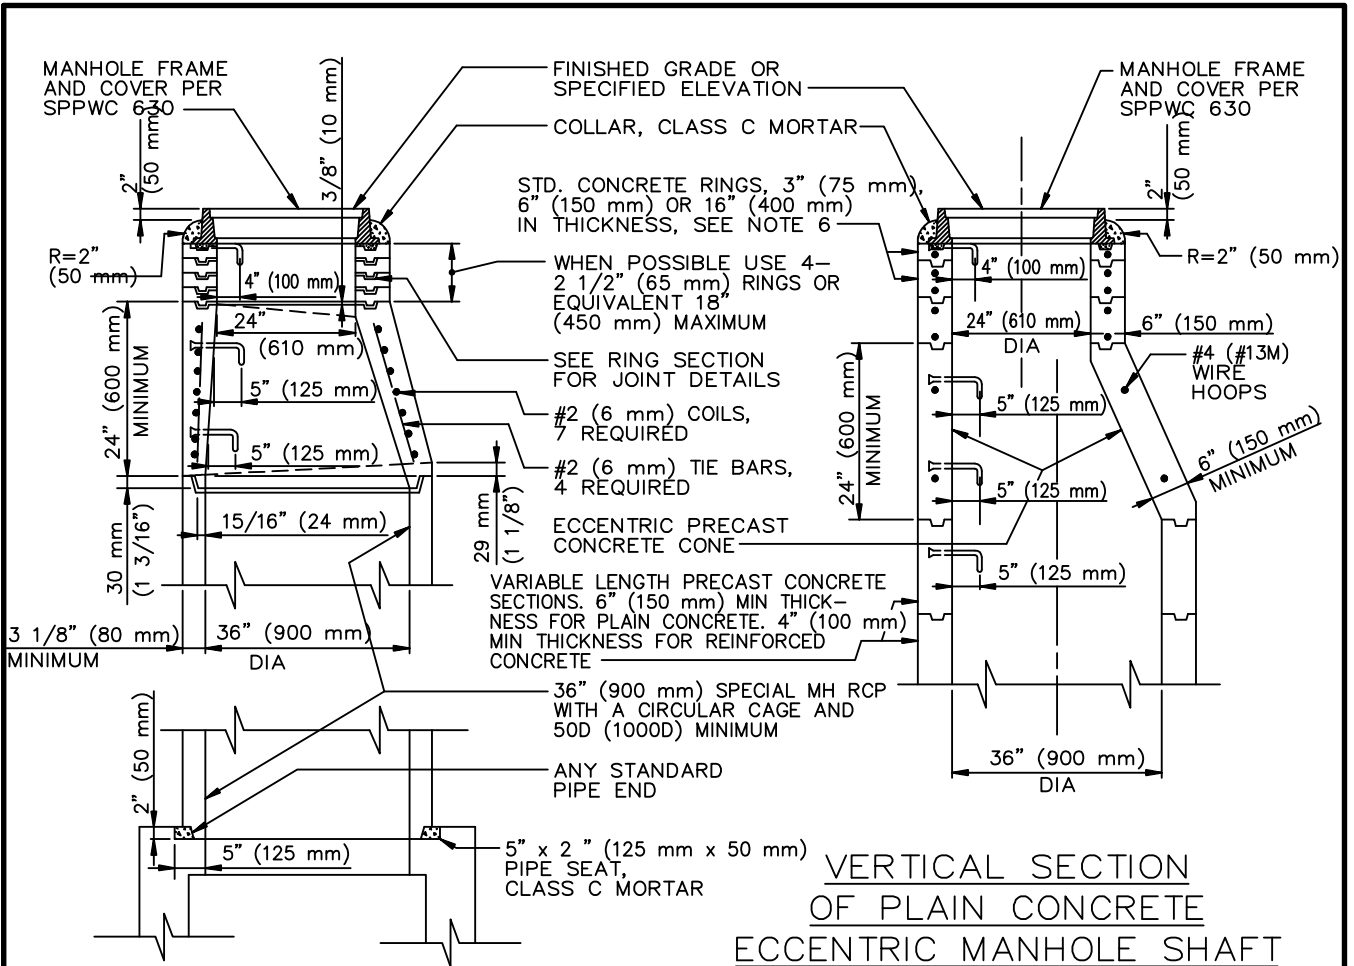

VERTICAL SECTION OF REINFORCED CONCRETE ECCENTRIC MANHOLE SHAFT

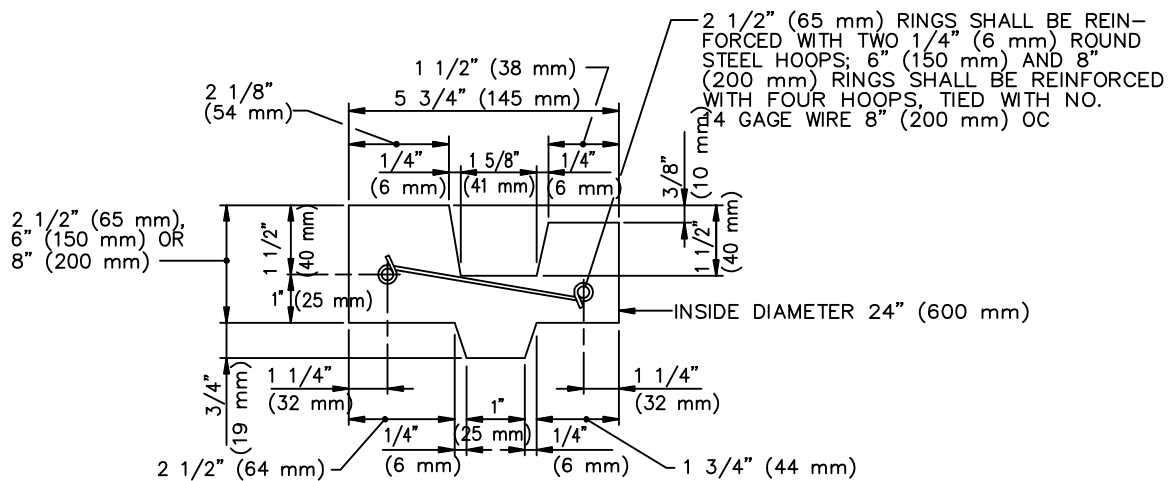

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1996, 2009

MANHOLE SHAFT WITH
ECCENTRIC REDUCER

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


324-2

SHEET 1 OF 2


NOTES

1. UNLESS OTHERWISE INDICATED THIS STRUCTURE SHALL CONFORM TO ASTM C 478M (ASTM C 478) AND ALL CONCRETE SHALL BE PER SSPWC 201-1.2.
2. MANHOLE FRAME AND COVER SHALL CONFORM TO SPPWC 630.
3. ALL JOINTS SHALL BE SEALED BY FILLING THE ANNULAR SPACES WITH CLASS C MORTAR. THE INSIDE OF THE SHAFT AT EACH JOINT SHALL BE WIPED CLEAN OF EXCESS MORTAR.
4. PROTECTIVE PLASTIC LINER (T LOCK) OR ENGINEER-APPROVED COATINGS WHERE REQUIRED BY THE PLANS SHALL BE IN ACCORDANCE WITH SSPWC AND THE MANUFACTURER'S DIRECTIONS.
5. STEPS SHALL CONFORM TO SPPWC 635 OR 636. THE TOP STEP SHALL BE PLACED DIRECTLY BENEATH THE MANHOLE FRAME. UNLESS OTHERWISE SHOWN, STEPS SHALL BE UNIFORMLY SPACED 14" (350 mm) TO 15" (375 mm) OC.
6. THE ECCENTRIC MANHOLE SHAFT REDUCER AND RINGS MAY BE PLAIN CONCRETE. FOR PLAIN CONCRETE SECTIONS THE MINIMUM THICKNESS SHALL BE 6" (150 mm).
7. THE PRECAST CONCRETE MANHOLE STRUCTURES WILL BE INSPECTED BY THE ENGINEER WHO WILL INDICATE ACCEPTANCE FOR SHIPMENT TO THE JOB BY MARKING THE STRUCTURES WITH THE AGENCY'S STAMP.
8. THE VERTICAL SIDES OF THE MANHOLE SHAFT AND THE ECCENTRIC REDUCER SHALL BE LOCATED ABOVE AND IN LINE WITH THE SIDE OF THE STORM DRAIN CONDUIT.
9. CONSTRUCT MANHOLE SAFETY LEDGE PER SPPWC 330 IF DEPTH OF MANHOLE TO INVERT IS GREATER THAN 20' (6 m) AND MANHOLE SHAFT IS GREATER THAN 10' (3 m). WHEN SAFETY LEDGE IS REQUIRED AND MANHOLE SHAFT IS LESS THAN 12' (4 m) SPPWC 326 MUST BE USED.
10. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:


630 24" (600 mm) MANHOLE FRAME AND COVER
635 STEEL STEP
636 POLYPROPYLENE PLASTIC STEP

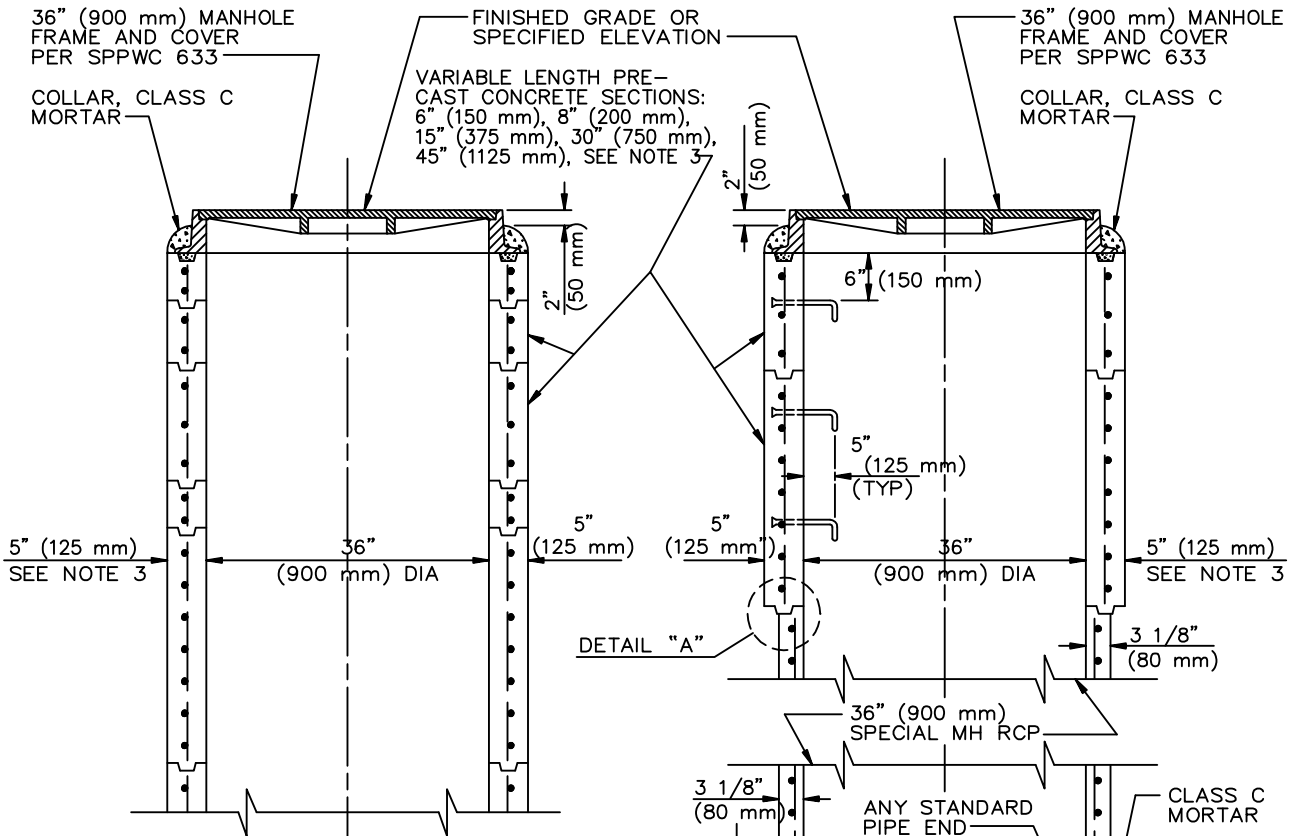

VERTICAL SECTION OF SPECIAL MANHOLE SHAFT WITH GRADE RING RISERS

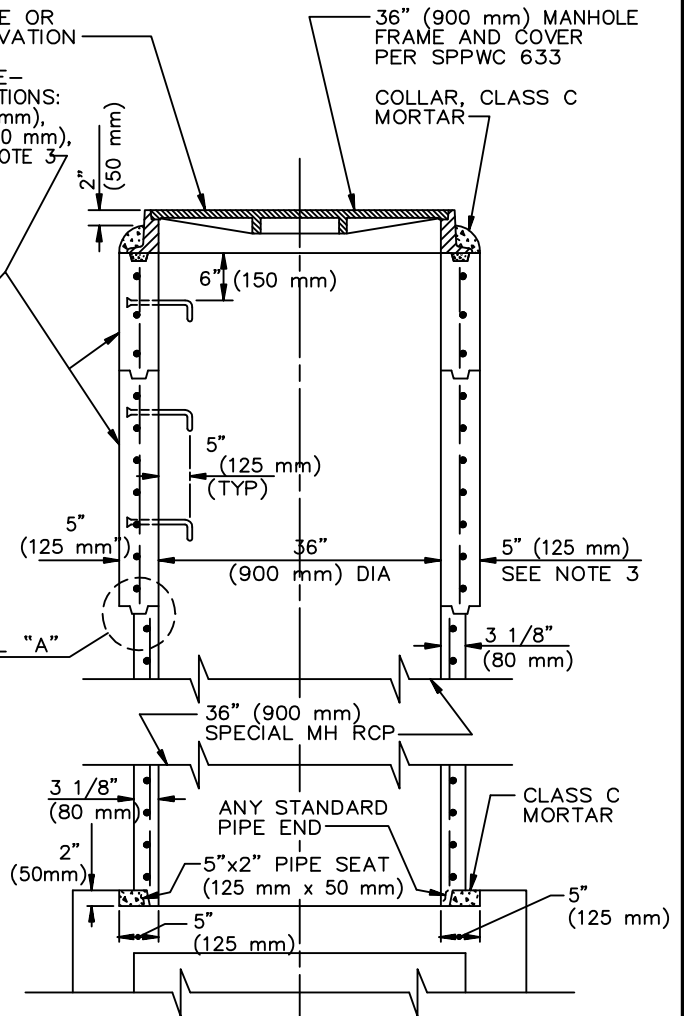

VERTICAL SECTION OF SPECIAL MANHOLE SHAFT WITH REINFORCED CONCRETE PIPE

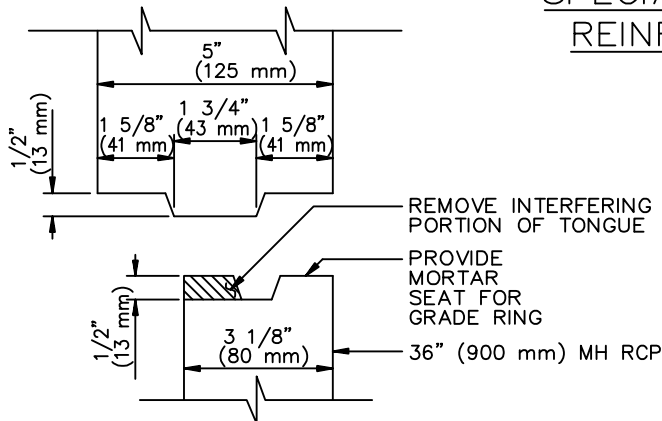

DETAIL "A"

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1996, 2009

**MANHOLE SHAFT
36"(900 mm) WITHOUT REDUCER**

STANDARD PLAN

326-2


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 2


NOTES

1. UNLESS OTHERWISE INDICATED THIS STRUCTURE SHALL CONFORM TO ASTM C 478 (ASTM C 478M). ALL STEEL SHALL TERMINATE 1 1/2" (40 mm) CLEAR OF CONCRETE SURFACES AND ALL CONCRETE SHALL BE PER SSPWC.
2. WHERE A 36" (900 mm) MANHOLE IS CONSTRUCTED WITH 36" (900 mm) MANHOLE RCP, THE RCP SECTION SHALL CONTAIN A CIRCULAR CAGE AND HAVE A LOAD CARRYING CAPACITY OF AT LEAST 1000D (50D). SPECIAL MANHOLE SHAFT SHALL BE PER THIS STANDARD AND 36" (900 mm) MANHOLE FRAME AND COVER SHALL BE PER SPPWC 633.
3. THE MANHOLE SHAFT AND RINGS MAY BE PLAIN CONCRETE. FOR PLAIN CONCRETE SECTIONS THE MINIMUM THICKNESS SHALL BE 6" (150 mm).
4. ALL JOINTS SHALL BE SEALED BY FILLING THE ANNULAR SPACES WITH CLASS C MORTAR. THE INSIDE OF THE SHAFT AT EACH JOINT SHALL BE WIPED CLEAN OF EXCESS MORTAR.
5. PROTECTIVE PLASTIC LINER (T LOCK) OR ENGINEER-APPROVED COATINGS WHERE REQUIRED BY THE PLANS SHALL BE IN ACCORDANCE WITH SSPWC AND THE MANUFACTURER'S DIRECTIONS.
6. STEPS SHALL CONFORM TO SPPWC 635 OR 636. THE TOP STEP SHALL BE PLACED 6" (150 mm) BENEATH THE MANHOLE COVER FRAME. UNLESS OTHERWISE SHOWN, STEPS SHALL BE UNIFORMLY SPACED 14" (350 mm) TO 15" (375 mm) OC.
7. THE PRECAST CONCRETE MANHOLE STRUCTURES WILL BE INSPECTED BY THE ENGINEER WHO WILL INDICATE ACCEPTANCE FOR SHIPMENT TO THE JOB BY MARKING THE STRUCTURES WITH THE AGENCY'S STAMP.
8. THE VERTICAL SIDES OF THE MANHOLE SHAFT SHALL BE LOCATED ABOVE AND IN LINE WITH THE SIDE OF THE STORM DRAIN CONDUIT.
9. CONSTRUCT MANHOLE SAFETY LEDGE PER SPPWC 330 IF DEPTH OF MANHOLE TO INVERT IS GREATER THAN 20' (6 m) AND MANHOLE SHAFT IS GREATER THAN 10' (3 m).
10. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:

633 36" (900 mm) MANHOLE FRAME AND COVER
635 STEEL STEP
636 POLYPROPYLENE PLASTIC STEP

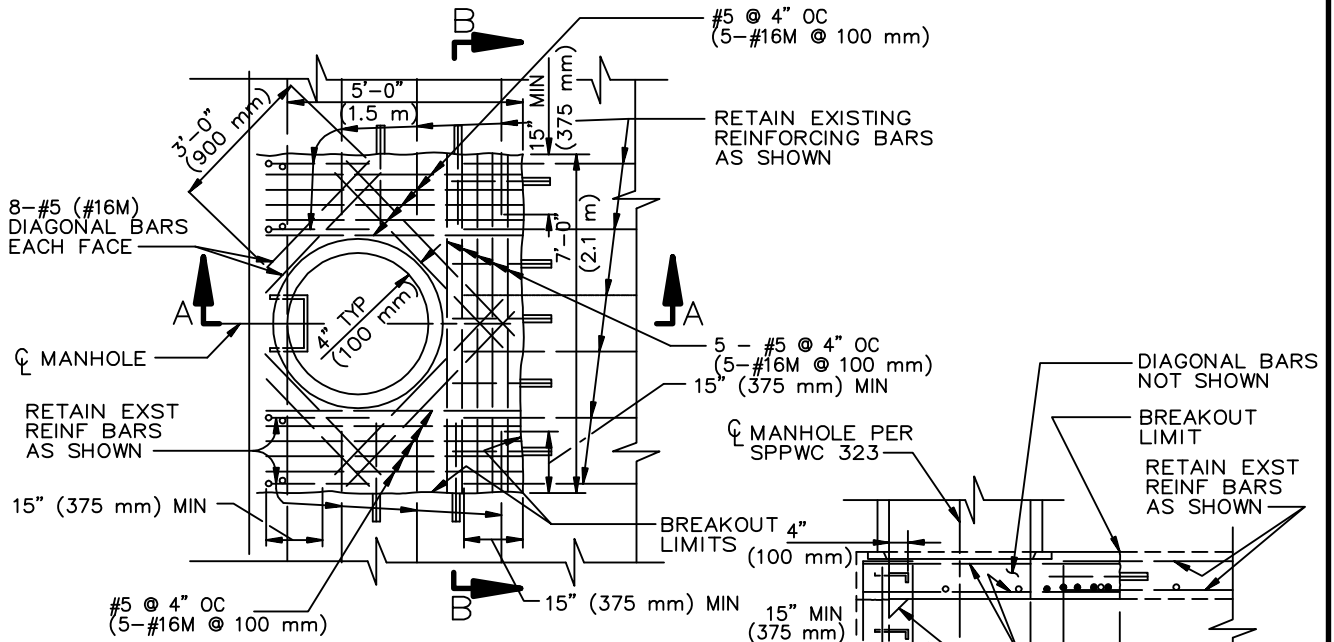


MANHOLE DETAIL

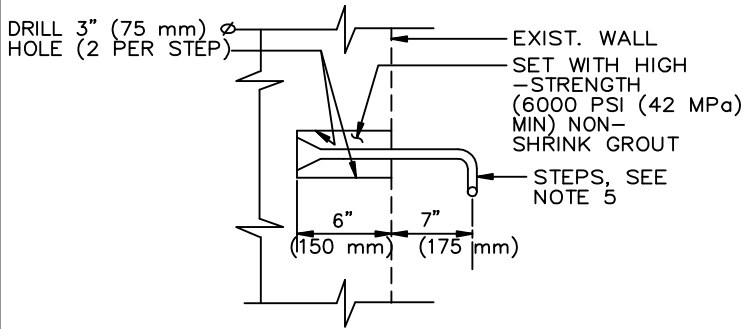


DETAIL "A"

PLACEMENT OF STEEL STEP IN EXISTING RCB

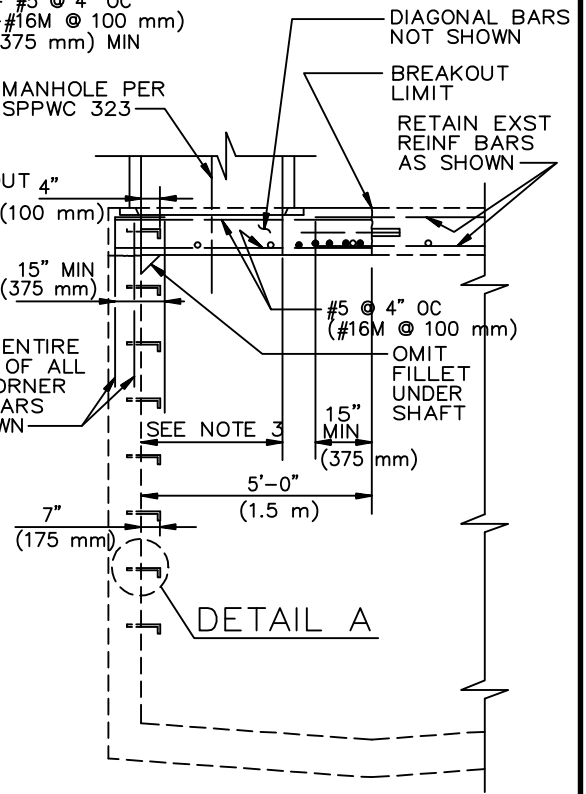

SECTION A-A

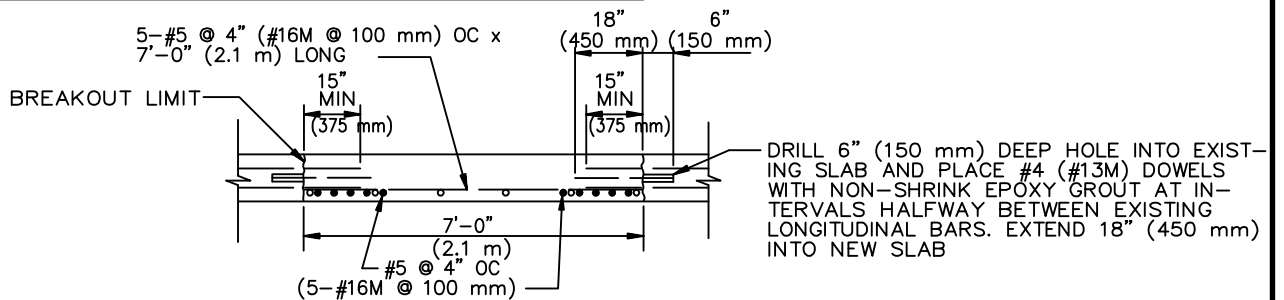

SECTION B-B

LEGEND

- EXISTING REINFORCING BARS
- ADDED REINFORCING BARS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1996, 2009

MANHOLE FOR EXISTING RCB

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

327-2

SHEET 1 OF 3

NOTES

1. THIS STRUCTURE MAY BE USED WHEN THE DEPTH OF COVER IS NO GREATER THAN THE DESIGN COVER OF EXISTING RCB. IF THIS DEPTH IS EXCEEDED, OR PROPOSED MANHOLE SHAFT EXCEEDS 36" (900 mm) IN DIAMETER A DETAILED PLAN WITH CALCULATIONS PREPARED BY A CIVIL OR STRUCTURAL ENGINEER REGISTERED IN THE STATE OF CALIFORNIA SHOWING THE PROPOSED MANHOLE SHALL BE SUBMITTED TO THE AGENCY FOR APPROVAL.
2. STRUCTURAL NOTES.
 - A. DIMENSIONS FROM FACE OF CONCRETE TO REINFORCING STEEL ARE TO CENTER OF BAR UNLESS OTHERWISE SHOWN.
 - B. CONCRETE DIMENSIONS SHALL BE MEASURED HORIZONTALLY OR VERTICALLY ON THE PROFILE, AND PARALLEL TO OR AT RIGHT ANGLES (OR RADially) TO CENTER LINE OF CONDUIT ON THE PLAN EXCEPT AS OTHERWISE SHOWN.
 - C. ALL BAR BENDS AND HOOKS SHALL CONFORM TO THE AMERICAN CONCRETE INSTITUTE'S "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE. LATEST EDITION."
 - D. PLACING OF REINFORCEMENT SHALL CONFORM TO THE AMERICAN CONCRETE INSTITUTE'S "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE". LATEST EDITION.
 - E. TRANSVERSE REINFORCING STEEL SHALL TERMINATE 1 1/2" (40 mm) FROM THE CONCRETE SURFACES UNLESS OTHERWISE SHOWN.
 - F. NO SPLICES IN TRANSVERSE STEEL REINFORCEMENT SHALL BE PERMITTED OTHER THAN SHOWN ON THE PLANS.
 - G. ALL STRUCTURAL CONCRETE SHALL BE PORTLAND CEMENT CONCRETE WITH A 28 DAY COMPRESSIVE STRENGTH OF 4000 PSI (28 MPa).
 - H. ALL REINFORCING STEEL SHALL CONFORM TO ASTM A 615, GRADE 40 (615M, GRADE 300).
3. WHERE REINFORCEMENT IS REQUIRED TO EXTEND THROUGH THE NEW JOINT, CONCRETE SHALL BE REMOVED IN THE FOLLOWING SEQUENCE:
 - A. A SAW CUT SHALL BE MADE 1 1/2" (40 mm) DEEP AT THE REMOVAL LIMITS. CARE SHALL BE EXERCISED IN SAWING AT THE REMOVAL LIMITS SO AS NOT TO CUT THE REINFORCING STEEL WHICH SHALL BE RETAINED AND EXTENDED INTO THE NEW CONSTRUCTION AS INDICATED ON THE PLANS.
 - B. USING HAND-HELD EQUIPMENT THE CONCRETE SHALL BE CAREFULLY REMOVED FOR THE FULL DEPTH OF THE WALL OR SLAB AND FOR A MINIMUM DISTANCE FROM THE SAW CUT EQUAL TO THE LONGEST EXTENSION OF THE EXISTING BARS TO BE EXTENDED INTO THE NEW CONSTRUCTION. THIS EXTENSION SHALL BE 30 BAR DIAMETERS UNLESS OTHERWISE SHOWN.
 - C. EXISTING REINFORCEMENT SHALL BE CUT TO THE REQUIRED BAR EXTENSION.
 - D. THE REMAINING CONCRETE MAY BE REMOVED BY ANY SUITABLE METHOD, UPON APPROVAL OF THE ENGINEER, WHO SHALL BE THE SOLE JUDGE OF THE USE OF ANY CONCRETE REMOVAL EQUIPMENT. EXPLOSIVES, WRECKING BALL OR OTHER SIMILAR DEVICES WHICH ARE LIKELY TO DAMAGE THE CONCRETE TO BE LEFT IN PLACE SHALL NOT BE USED.
 - E. INTERNAL SUPPORT OF THE EXISTING RCB SHALL BE PROVIDED DURING THE REMOVAL AND RECONSTRUCTION OF THE TOP SLAB. A DETAILED PLAN WITH CALCULATIONS PREPARED BY A CIVIL OR STRUCTURAL ENGINEER REGISTERED IN THE STATE OF CALIFORNIA SHOWING THE TEMPORARY SUPPORT SYSTEM SHALL BE SUBMITTED AND APPROVED BY THE AGENCY PRIOR TO THE START OF REMOVAL WORK.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

MANHOLE FOR EXISTING RCB

327-2

SHEET 2 OF 3

4. WHEN THE MANHOLE OPENING IS 24" (610 mm), THE BREAKOUT LIMIT DIMENSIONS MAY BE REDUCED FROM 5'-0" x 7'-0" (1.5 m x 2.1 m) TO 4'-0" x 6'-0" (1.2 m x 1.8 m).
5. STEPS SHALL CONFORM TO SPPWC 635. UNLESS OTHERWISE SHOWN STEPS SHALL BE SPACED 14" (350 mm) TO 15" (375 mm) OC. THE LOWEST STEP SHALL NOT BE MORE THAN 24" (600 mm) ABOVE THE INVERT.
6. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:

323	MANHOLE – CONCRETE BOX STORM DRAIN
630	24" (610 mm) MANHOLE FRAME AND COVER
635	STEEL STEP


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


MANHOLE FOR EXISTING RCB

327-2


SHEET 3 OF 3

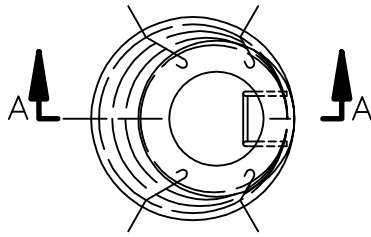

PLAN

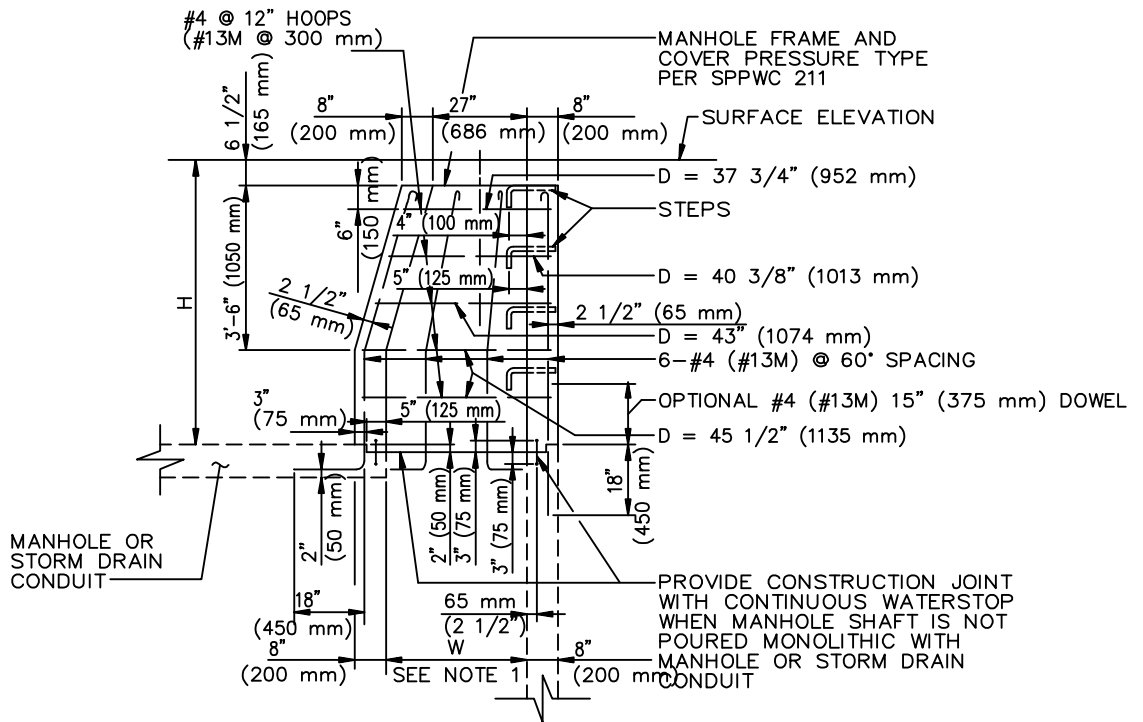

SECTION A-A

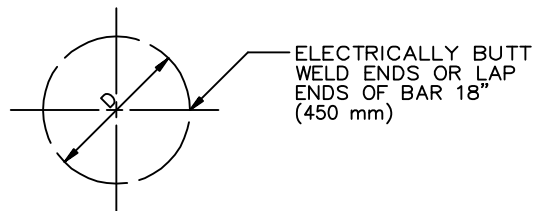

#4 (#13M) HOOP BARS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1996, 2009

**PRESSURE MANHOLE SHAFT
WITH ECCENTRIC REDUCER**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

328-2

SHEET 1 OF 2

NOTES

1. IF H IS LESS THAN 18" (450 mm), W=27" (675 mm)
IF H IS BETWEEN 18" (450 mm) AND 2'-6" (750 mm), W=2'-6" (750 mm).
IF H IS 2'-6" (750 mm) OR MORE, W=3'-0" (900 mm).
IF H IS MORE THAN 4'-0 1/2" (1215 mm), BRING WALL VERTICALLY TO 4'-0 1/2" (1215 mm) BELOW SURFACE AND TAPER FROM 3'-0" (900 mm) TO 27" (675 mm) AS SHOWN.
2. THIS STRUCTURE SHALL BE USED WITH MANHOLE FRAME AND COVER PRESSURE TYPE, SPPWC 211. IT MAY BE USED FOR HYDROSTATIC HEADS UP TO 25' (7.5 m) ABOVE THE STEEL PLATE.
3. THE VERTICAL SIDE OF THE MANHOLE SHAFT AND THE ECCENTRIC REDUCER SHALL BE LOCATED ABOVE AND IN LINE WITH THE SIDE OF THE STORM DRAIN CONDUIT.
4. REINFORCEMENT SHALL CONFORM TO ASTM A 615, GRADE 40 (ASTM A 615M, GRADE 300), AND SHALL TERMINATE 1 1/2" (40 mm) CLEAR OF CONCRETE SURFACES UNLESS OTHERWISE SHOWN.
5. STEPS SHALL CONFORM TO SPPWC 635 OR 636. THE TOP STEP SHALL BE PLACED DIRECTLY BENEATH THE MANHOLE FRAME. UNLESS OTHERWISE SHOWN, STEPS SHALL BE UNIFORMLY SPACED 14" (350 mm) TO 15" (375 mm) OC.
6. SEE CONTRACT SPECIFICATIONS FOR PHYSICAL REQUIREMENTS OF WATERSTOP.
7. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:

211 MANHOLE FRAME AND COVER PRESSURE TYPE
635 STEEL STEP
636 POLYPROPYLENE PLASTIC STEP


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN



**PRESSURE MANHOLE SHAFT
WITH ECCENTRIC REDUCER**

328-2

SHEET 2 OF 2

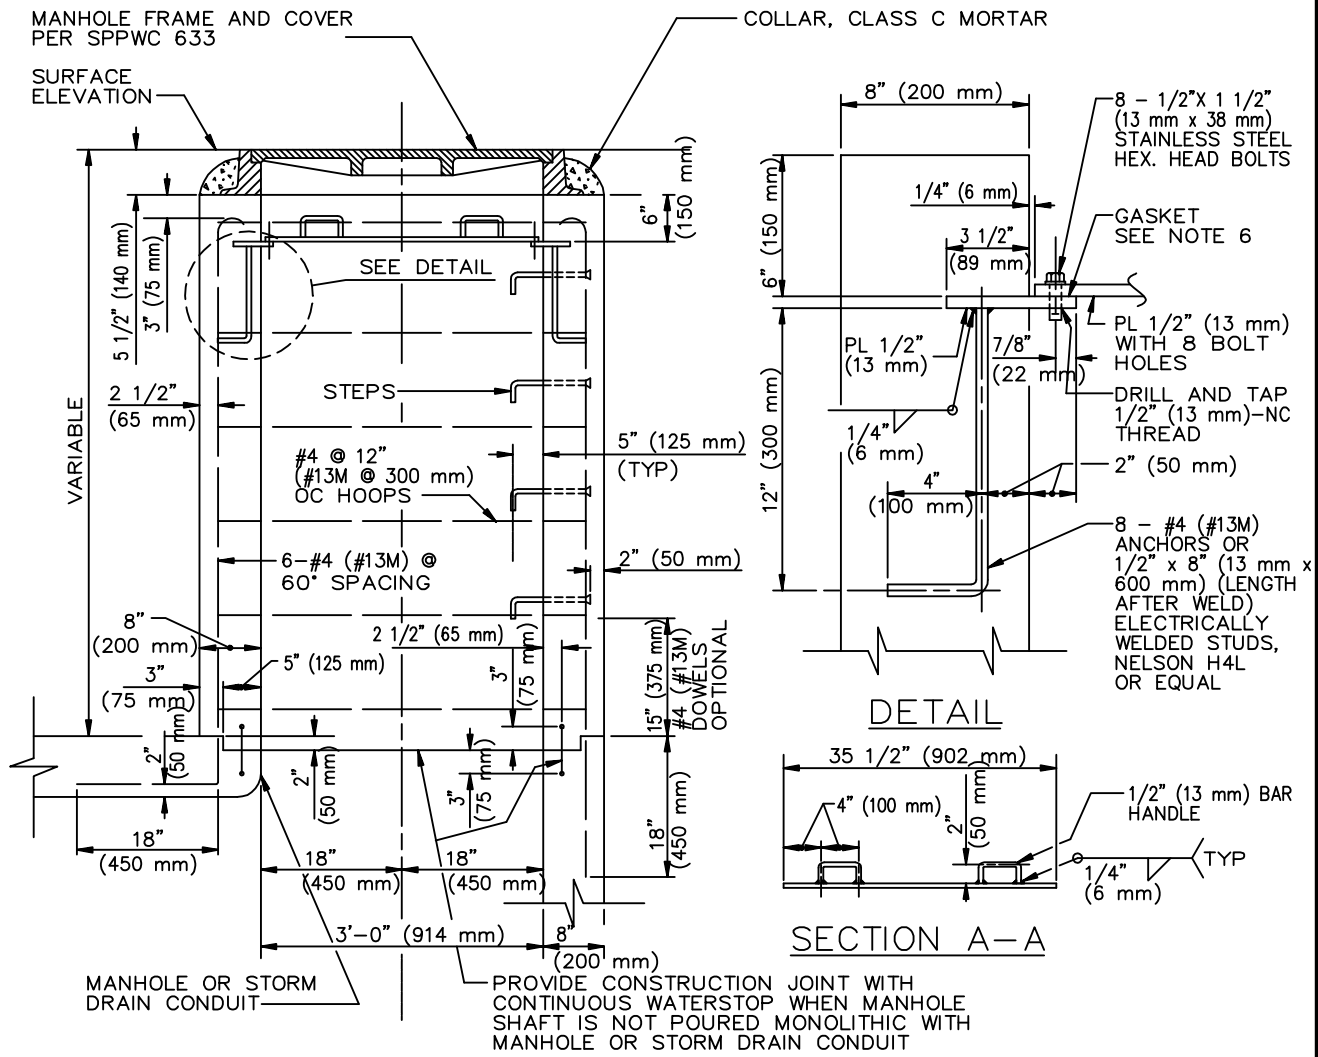

VERTICAL SECTION OF SPECIAL PRESSURE MANHOLE SHAFT

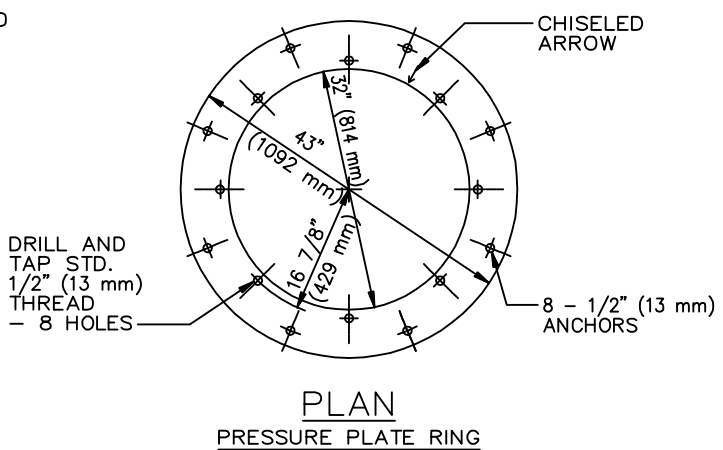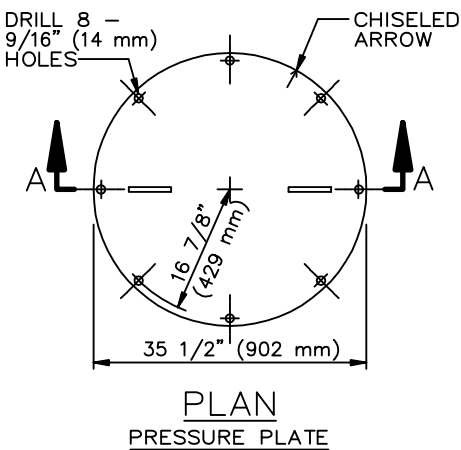

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1992 REV. 1996, 2009

PRESSURE MANHOLE SHAFT AND PRESSURE PLATE DETAIL 36" (914 mm) WITHOUT REDUCER

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN **329-2** SHEET 1 OF 2

NOTES

1. THIS STRUCTURE MAY BE USED FOR HYDROSTATIC HEADS UP TO 25' (7.5 m) ABOVE THE PRESSURE PLATE.
2. 36" (914 mm) MANHOLE FRAME AND COVER PER SPPWC 633 SHALL BE USED.
3. REINFORCEMENT SHALL BE PER ASTM A 615, GRADE 40 AND SHALL TERMINATE 1 1/2" (40 mm) CLEAR OF CONCRETE SURFACES UNLESS OTHERWISE SHOWN. HOOPS MAY BE ELECTRICALLY BUTT WELDED OR THE ENDS LAPPED 18" (450 mm).
4. THE MANHOLE SHAFT SHALL BE LOCATED ABOVE AND IN LINE WITH THE SIDE OF THE CONDUIT BELOW.
5. STEPS SHALL CONFORM TO SPPWC 635 OR 636. UNLESS OTHERWISE SHOWN, STEPS SHALL BE UNIFORMLY SPACED 14" (350 mm) TO 15" (375 mm) OC.
6. GASKET MATERIAL SHALL BE NEOPRENE (OR EQUAL) 1/16" (2 mm) THICK BY 1 1/4" (32 mm) WIDE.
7. BOLTS SHALL BE STAINLESS STEEL CONFORMING TO ASTM A 320 (ASTM A 320M), GRADE B8.
8. PRESSURE PLATE AND PRESSURE PLATE RING SHALL BE STEEL CONFORMING TO ASTM A 36 (ASTM A 36M) AND SHALL BE GALVANIZED. PLATES SHALL BE MARKED IN SETS AND A CHISELED ARROW STAMPED ON BOTH PLATES, AFTER DRILLING AND TAPPING, TO FACILITATE FIELD ASSEMBLY.
9. SEE CONTRACT SPECIFICATIONS FOR PHYSICAL REQUIREMENTS OF WATERSTOP.
10. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:
633 36" (914 mm) MANHOLE FRAME AND COVER
635 STEEL STEP
636 POLYPROPYLENE PLASTIC STEP


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


**PRESSURE MANHOLE SHAFT AND PRESSURE
PLATE DETAIL 36" (914 mm) WITHOUT REDUCER**

329-2


SHEET 2 OF 2

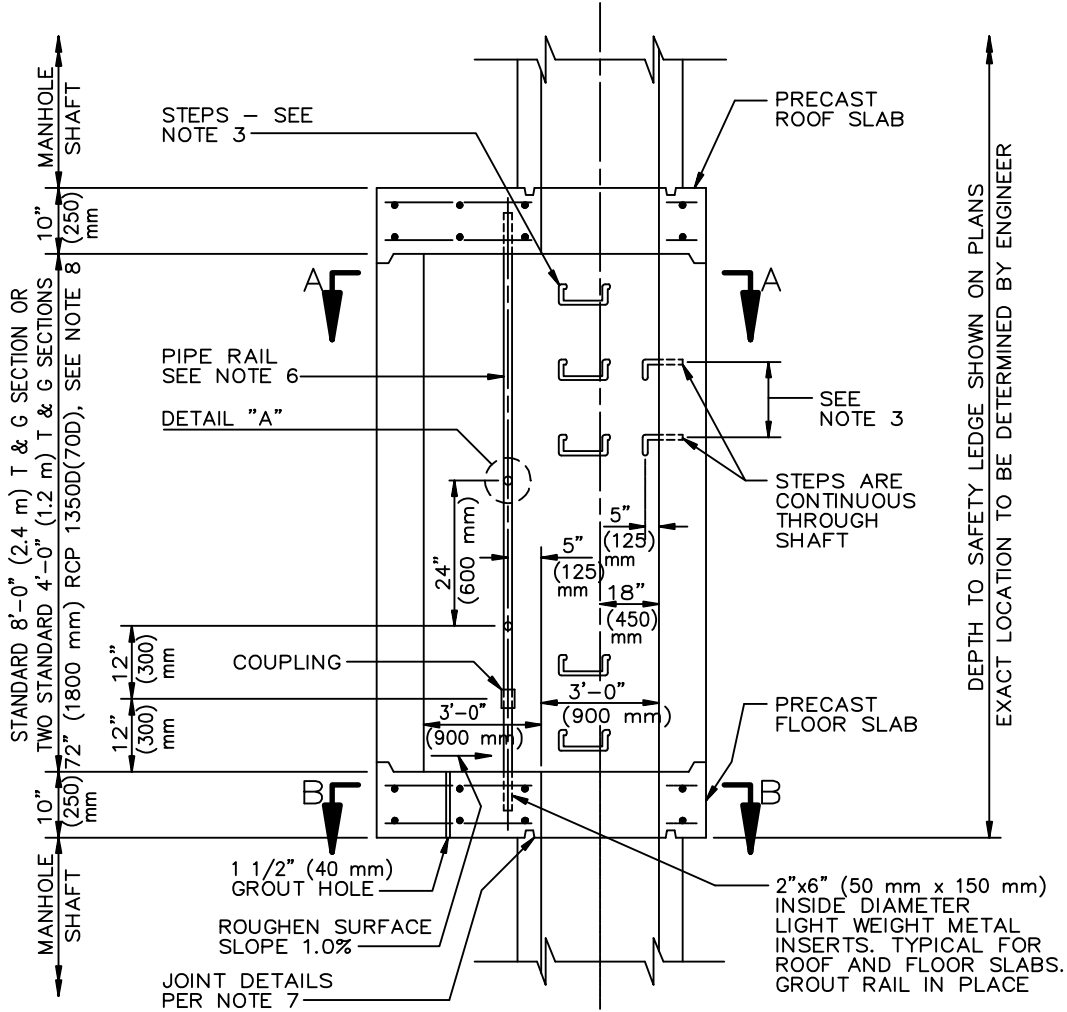


VERTICAL SECTION

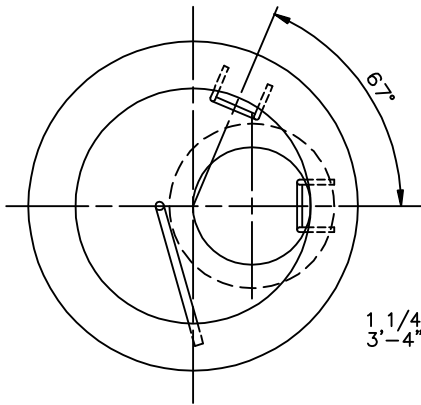

SECTION A-A



DETAIL "A"
ROTATED 90°

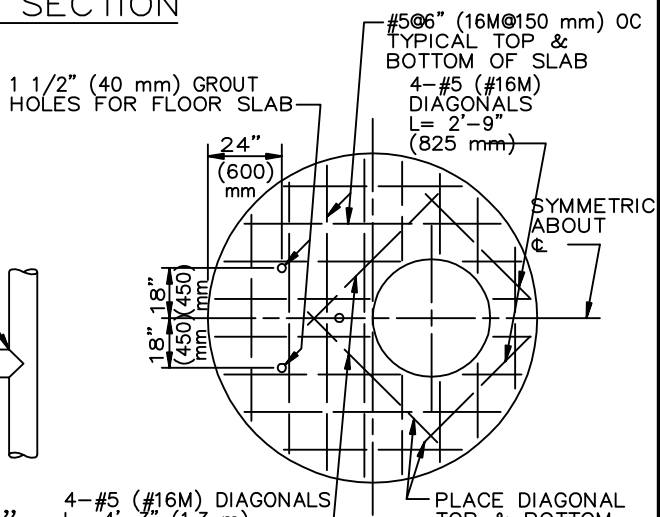

SECTION B-B
REINFORCEMENT DETAILS
FOR FLOOR AND ROOF SLABS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1996, 2009

MANHOLE SHAFT SAFETY LEDGE

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
330-2
SHEET 1 OF 2

NOTES

1. MANHOLE SHAFT SAFETY LEDGE WILL BE NOTED ON THE PLANS WHEN REQUIRED. IT IS TO BE CONSTRUCTED WHEN DEPTH OF MANHOLE TO INVERT IS GREATER THAN 20' (6 m) AND MANHOLE SHAFT IS GREATER THAN 10' (3 m).
2. A SAFETY LEDGE SHALL NOT BE USED IF A PRESSURE MANHOLE IS REQUIRED.
3. STEPS SHALL CONFORM TO SPPWC 635 OR 636 AND SHALL BE ANCHORED 4" (100 mm) IN THE WALL OF THE STRUCTURE. STEPS SHALL BE PLACED TO MATCH THE SPACING OF THE MANHOLE SHAFT.
4. REINFORCEMENT SHALL BE PER ASTM A 615, GRADE 40 (ASTM A 615M, GRADE 300) AND SHALL TERMINATE 2" (50 mm) CLEAR OF CONCRETE SURFACE UNLESS OTHERWISE SHOWN.
5. GROUT HOLES, PIPE AND FITTINGS SHALL BE PROVIDED IN THE FLOOR SLAB. PRESSURE GROUTING SHALL BE USED TO FILL VOIDS AND TO SECURE UNIFORM BEARING. THE GROUT SHALL BE NEAT CEMENT GROUT AND GROUTING PRESSURES SHALL BE AS DETERMINED IN THE FIELD BY THE ENGINEER.
6. PIPE RAIL SHALL BE FABRICATED OF 1 1/4" (32 mm) STANDARD GALVANIZED PIPE COMPOSED OF TWO SECTIONS 7'-6" (2.25 m) & 18" (450 mm) IN LENGTH JOINED BY A GALVANIZED COUPLING. THE COUPLING SHALL BE THREADED A MINIMUM OF 2" (50 mm) ON EACH PIPE LENGTH.
7. ROOF AND FLOOR SLABS SHALL BE PRECAST AND KEYED FOR REINFORCED CONCRETE PIPE SECTIONS AS SHOWN. ALL JOINTS SHALL BE FILLED WITH CLASS C MORTAR AND NEATLY POINTED OR WIPED ON THE INSIDE.
8. 72" (1800 mm) RCP SHALL BE PROVIDED WITH TWO CIRCULAR CAGES OF REINFORCEMENT.
9. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:

324 MANHOLE SHAFT – WITH ECCENTRIC REDUCER
326 MANHOLE SHAFT – 36" (900 mm) WITHOUT REDUCER
635 STEEL STEP
636 POLYPROPYLENE PLASTIC STEP

☉ MAIN LINE RCP OR REINFORCED MONOLITHIC ARCH, SEE NOTE 2



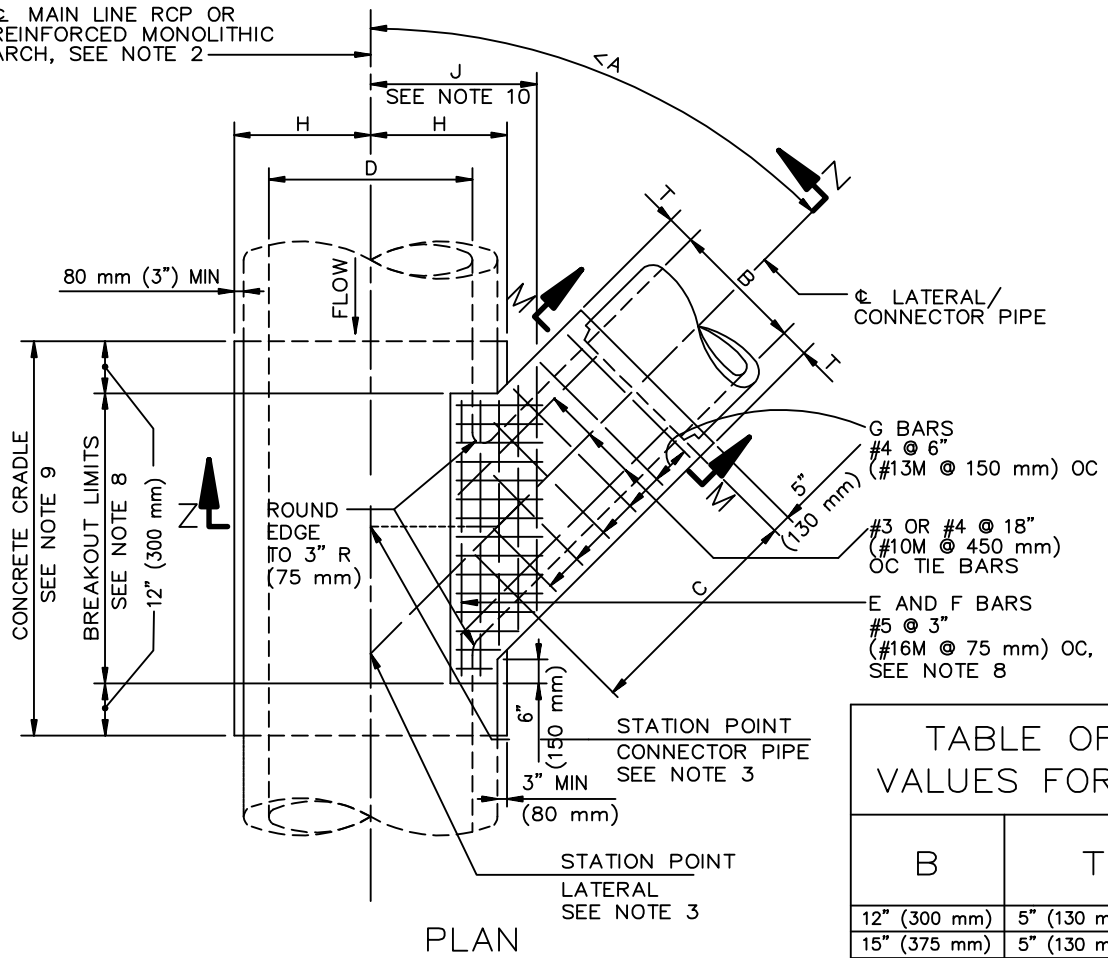


TABLE OF VALUES FOR T	
B	T
12" (300 mm)	5" (130 mm)
15" (375 mm)	5" (130 mm)
18" (450 mm)	5" (130 mm)
21" (525 mm)	5" (130 mm)
24" (600 mm)	5 1/2" (140 mm)
27" (675 mm)	5 1/2" (140 mm)
30" (750 mm)	6" (150 mm)
33" (825 mm)	6 1/2" (170 mm)
36" (900 mm)	6 1/2" (170 mm)
39" (975 mm)	7" (180 mm)

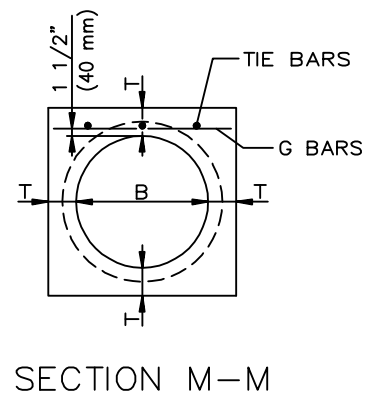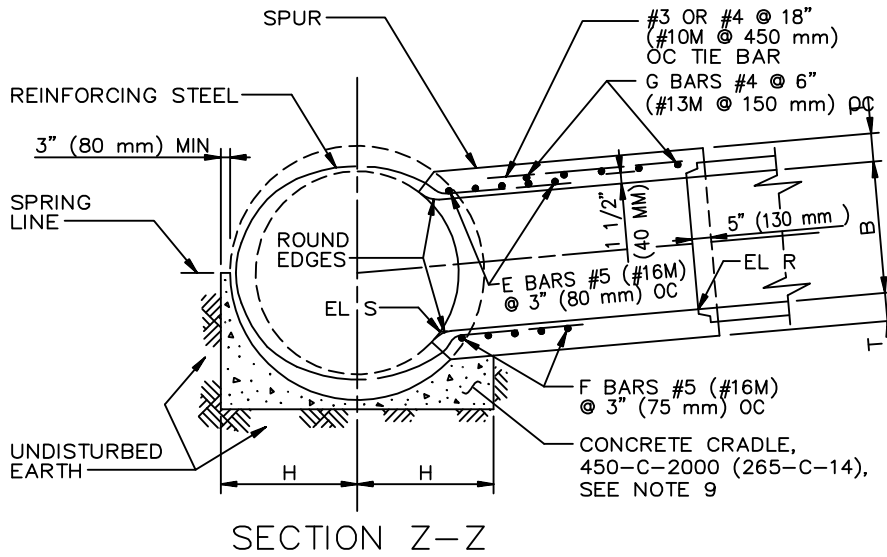

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1984 REV. 1996, 1999, 2009

JUNCTION STRUCTURE—PIPE TO PIPE
INLET ID ≥ 24" (600 mm) OR OD > 1/2 MAIN LINE ID

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

331-3

SHEET 1 OF 2

NOTES

1. THIS JUNCTION STRUCTURE SHALL BE USED WHEN THE OUTSIDE DIAMETER OF THE LATERAL IS GREATER THAN $1/2$ THE INSIDE DIAMETER D OF THE MAIN LINE; OR WHEN THE INSIDE DIAMETER B OF THE LATERAL IS GREATER THAN 24" (600 mm). B SHALL NOT EXCEED $0.75 D$ OR 39" (975 mm).
2. IF THE MAIN LINE IS A REINFORCED MONOLITHIC ARCH STORM DRAIN, D SHALL REFER TO THE CLEAR SPAN OF THE ARCH. REINFORCING STEEL SHALL BE CUT AND BENT INTO THE JUNCTION STRUCTURE IN THE SAME MANNER AS FOR A PIPE. A CONCRETE CRADLE IS NOT REQUIRED FOR A REINFORCED MONOLITHIC ARCH.
3. STATIONS SHOWN ON THE PLANS FOR LATERALS APPLY AT THE INTERSECTION OF CENTERLINES OF MAIN LINE AND LATERAL. STATIONS SHOWN ON THE PLANS FOR CATCH BASIN CONNECTOR PIPES APPLY AT THE INTERSECTION OF THE INSIDE WALL OF THE MAIN LINE WITH THE CONNECTOR PIPE CENTERLINE.
4. VALUES FOR A, B, C AND D SHALL BE SHOWN ON THE PLANS. ELEVATION R AND ELEVATION S SHALL BE SHOWN ONLY WHEN REQUIRED PER NOTE 5.
5.
 - a. ELEVATIONS R AND S NEED NOT BE SHOWN ON THE PLANS IF THE INLET PIPE IS TO ENTER THE MAIN LINE RADially.
 - b. ELEVATION R SHALL BE SHOWN ON THE PLANS ONLY IF A STUB IS TO BE PROVIDED IN THE MAIN LINE FOR FUTURE CONNECTION OF AN INLET PIPE.
 - c. ELEVATION S SHALL BE SHOWN ON THE PLANS IF AN INLET PIPE IS TO ENTER THE MAIN LINE OTHER THAN RADially. INLET PIPE SHALL BE LAID ON A STRAIGHT GRADE FROM ELEVATION S TO THE CATCH BASIN OR GRADE BREAK IN LINE.
6. THE INLET PIPE SHALL ENTER THE MAIN LINE RADially UNLESS OTHERWISE INDICATED. THE INLET PIPE MAY ENTER THE MAIN LINE OTHER THAN RADially IF ANGLE A IS GREATER THAN 45° ; B IS LESS THAN OR EQUAL TO 24" (600 mm) AND THE OUTSIDE DIAMETER OF THE INLET PIPE IS LESS THAN $0.5 D$; OTHERWISE, SPPWC 340 SHALL BE USED.
7. NO MORE THAN ONE OPENING SHALL BE MADE IN ANY ONE SECTION OF PIPE.
8. THE OPENING FOR THE BREAKOUT SHALL BE RECTANGULAR AND CUT NORMAL TO THE PIPE SURFACE WITHOUT DAMAGING THE REINFORCING STEEL. THE TRANSVERSE REINFORCEMENT OF THE MAIN LINE SHALL BE CUT AT THE CENTER OF THE OPENING AND BENT INTO THE TOP AND BOTTOM SLABS OF THE SPUR.
9. THE MAIN LINE SHALL BE REINFORCED WITH A CONCRETE CRADLE AND ENCASEMENT (AS APPLICABLE). A CONCRETE ENCASEMENT IS REQUIRED IF A JOINT IN THE MAIN LINE FALLS WITHIN THE LIMITS OF THE CRADLE. THE CONCRETE ENCASEMENT SHALL EXTEND 12" (300 mm) ABOVE THE TOP OF THE MAIN LINE AND TO THE LIMITS OF THE CRADLE. IF CONNECTING TO AN EXISTING STORM DRAIN, PORTION OF CRADLE OPPOSITE INLET MAY BE OMITTED.
10. REINFORCING STEEL SHALL CONFORM TO ASTM A 615, GRADE 40, (ASTM A 615M, GRADE 300), AND BE PLACED $1\ 1/2"$ (40 mm) CLEAR FROM CONCRETE SURFACES, UNLESS OTHERWISE SHOWN F BARS SHALL BE CARRIED TO A POINT NOT LESS THAN J DISTANCE FROM CENTER LINE WITH $J=7D/12 + 6"$ (150 mm).
11. FLOOR OF THE SPUR SHALL BE STEEL-TROWELED TO THE SPRING LINE OF THE SPUR.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


JUNCTION STRUCTURE—PIPE TO PIPE
INLET ID \geq 24" (600 mm) OR OD $>$ $1/2$ MAIN LINE ID

331-3


SHEET 2 OF 2

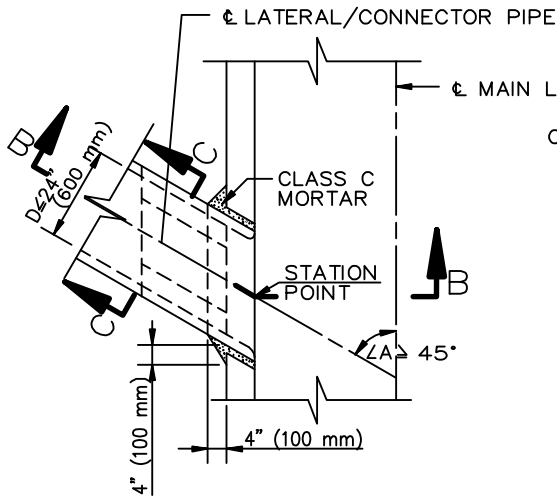


CASE 1
PLAN

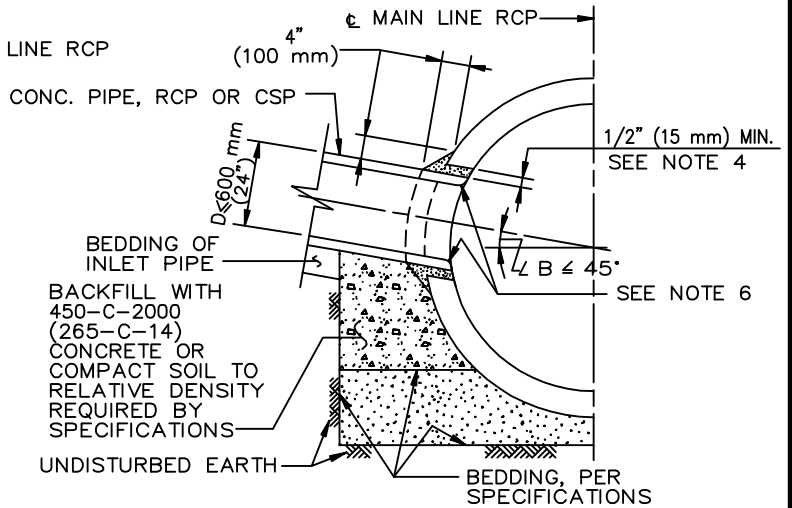



CASE 1
SECTION B-B

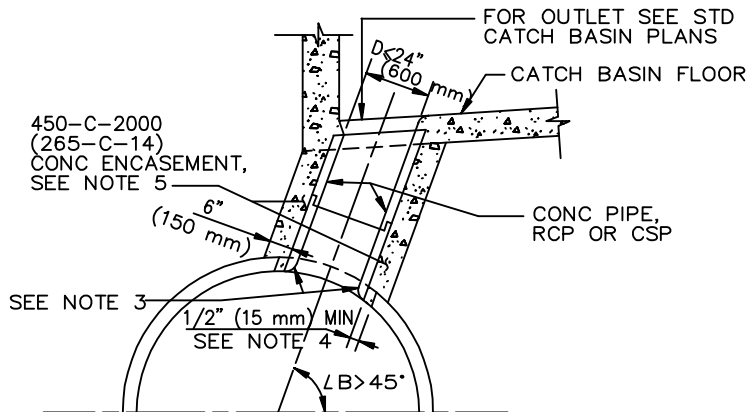

CASE 2
(SEE NOTES 9 & 10)

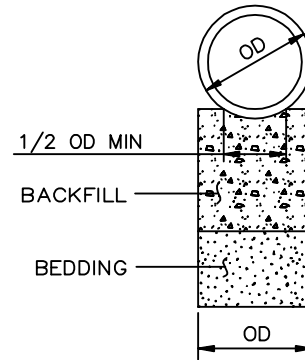

CASE 1
SECTION C-C

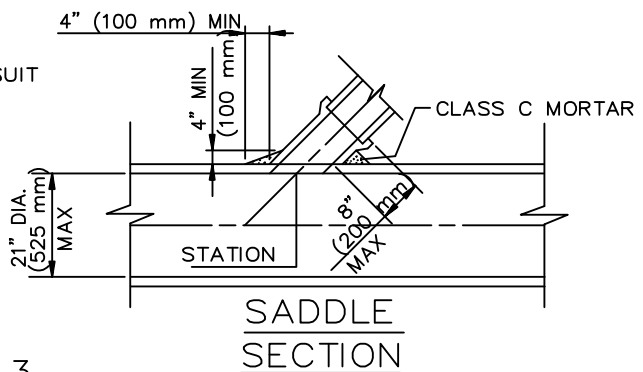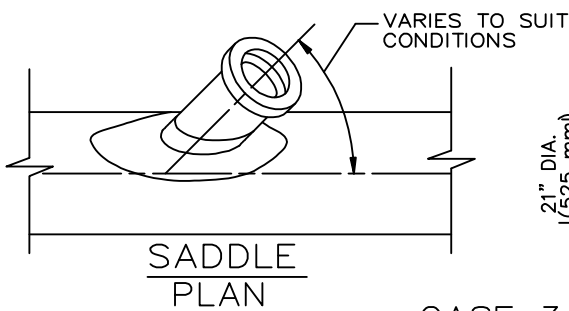

CASE 3
SADDLE CONNECTION

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

JUNCTION STRUCTURE - PIPE TO PIPE
(ID $\leq 24''$ (600 mm))

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

332-2

SHEET 1 OF 2

NOTES

CASE 1 AND CASE 2

1. IF ANGLE A IS LESS THAN 45 ° OR IF D IS LARGER THAN 24" (600 mm), THEN ANOTHER STANDARD STRUCTURE SHALL BE SPECIFIED.
2. THE OUTSIDE DIAMETER OF THE INLET PIPE SHALL NOT EXCEED 1/2 THE INSIDE DIAMETER OF THE MAIN LINE.
3. THE INLET PIPE SHALL ENTER THE MAIN LINE RADIALLY. IF THE INLET PIPE CANNOT ENTER RADIALLY, THEN ANOTHER STANDARD STRUCTURE SHALL BE SPECIFIED.
4. THE SIZE OF THE OPENING INTO THE MAIN LINE SHALL BE THE OUTSIDE DIAMETER OF THE INLET PIPE PLUS 1" (30 mm) MINIMUM TO 3" (75 mm) MAXIMUM.
5. ALL CONNECTOR PIPES FOR CASE 2 SHALL BE ENCASED IN CONCRETE IF LAID WITHIN THE MAIN LINE EXCAVATED TRENCH OR IF LAID ON FILL WHICH HAS NOT BEEN DENSIFIED.
6. BURN OR CHIP END OF CONNECTOR PIPE FLUSH WITH INNER SURFACE OF MAIN LINE. ROUND EDGE OF CONCRETE PIPE OR RCP.
7. ALL CSP AND FITTINGS SHALL BE GALVANIZED.
8. STATION SPECIFIED ON THE PLANS APPLIES AT THE INTERSECTION OF THE INSIDE WALL OF MAIN LINE AND THE CENTERLINE OF INLET PIPE.
9. CASE 2 SHALL NOT BE USED TO CONNECT TO THE FLOOR OF A GRATING CATCH BASIN WHERE THE GRATE WILL BE SUBJECT TO VEHICLE TRAFFIC.
10. FOR CASE 2, NOT MORE THAN 12' (3.5 m) OF INLET PIPE SHALL BE LOCATED WITHIN THE MAIN LINE EXCAVATED TRENCH.

CASE 3

11. CONNECTIONS TO PIPES 21" (525 mm) OR LESS IN DIAMETER WITHOUT JUNCTION STRUCTURES OR PRECAST Y BRANCHES SHALL BE MADE WITH SADDLES.
12. THE OUTSIDE DIAMETER OF THE INLET PIPE SHALL NOT EXCEED ONE-HALF THE INSIDE DIAMETER OF THE MAIN LINE.
13. TRIM OR CUT SADDLE TO FIT SNUGLY OVER THE OUTSIDE OF THE MAIN LINE SO ITS AXIS WILL BE ON THE LINE AND GRADE OF THE CONNECTOR PIPE.
14. THE OPENING INTO THE PIPE SHALL BE CUT AND TRIMMED TO FIT THE SADDLE SO THAT NO PART WILL PROJECT WITHIN THE BORE OF THE SADDLE PIPE.
15. THE CONNECTOR PIPE SHALL BE SUPPORTED AS SHOWN IN CASES 1 AND 2.




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

JUNCTION STRUCTURE – PIPE TO PIPE
(ID ≤ 24" (600 mm))

STANDARD PLAN

332-2

SHEET 2 OF 2

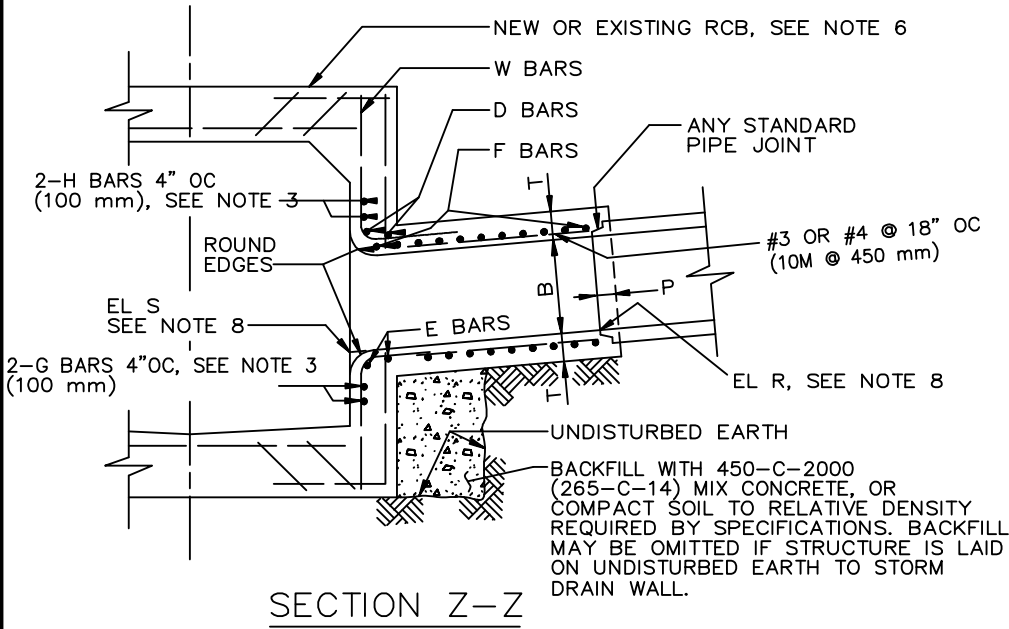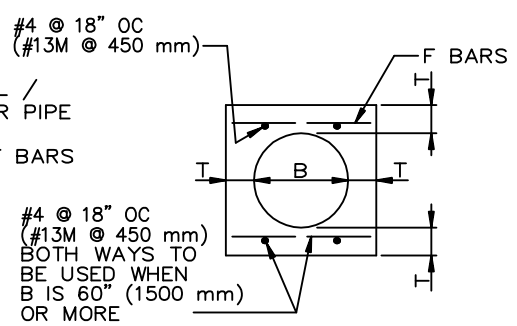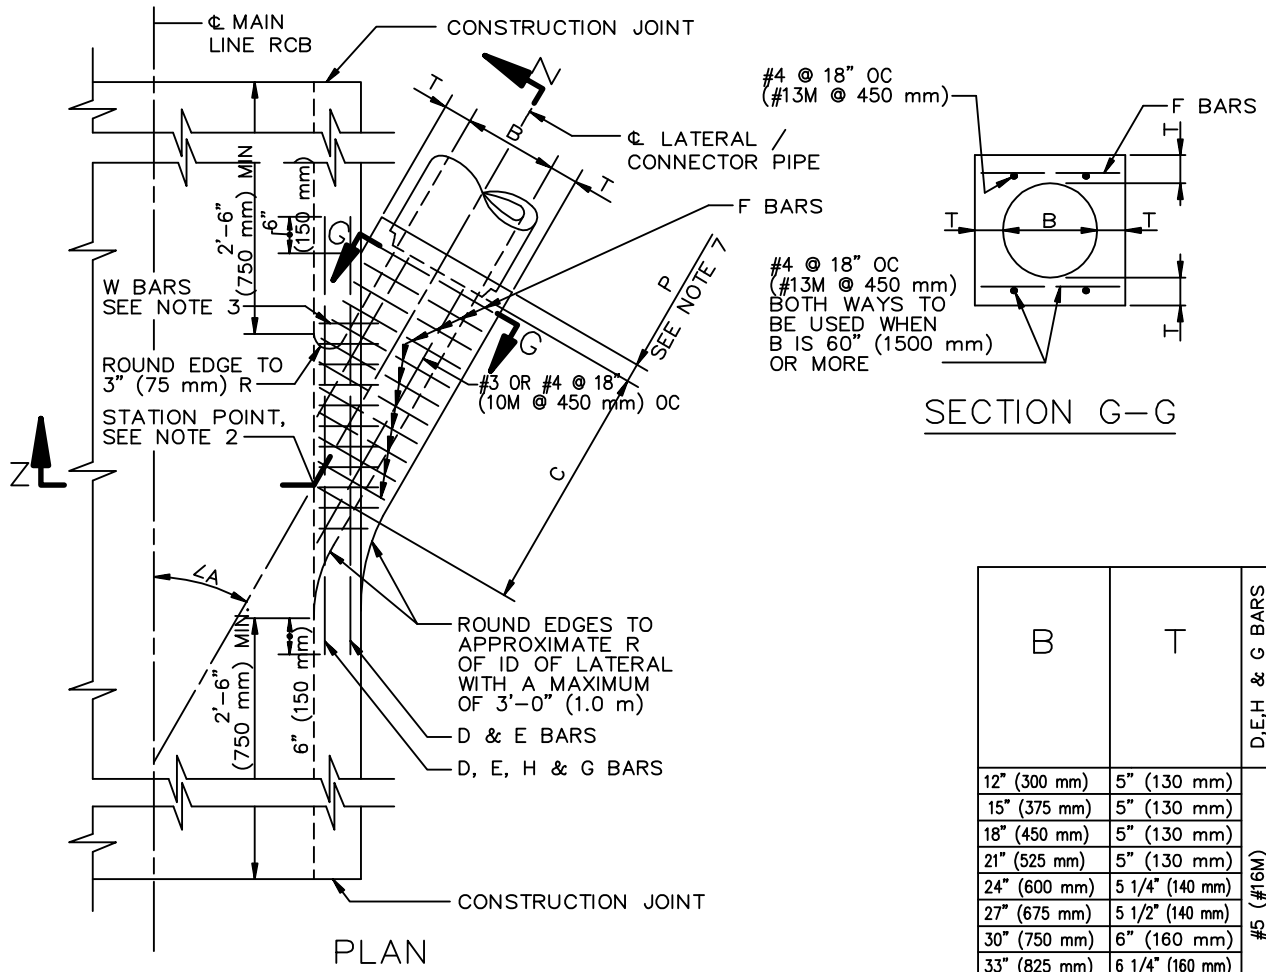

B	T	D, E, H & G BARS	F BARS
12" (300 mm)	5" (130 mm)	#5 (#16M)	#4 @ 6" (#13M @ 150 mm) OC
15" (375 mm)	5" (130 mm)		
18" (450 mm)	5" (130 mm)		
21" (525 mm)	5" (130 mm)		
24" (600 mm)	5 1/4" (140 mm)		
27" (675 mm)	5 1/2" (140 mm)		
30" (750 mm)	6" (160 mm)		
33" (825 mm)	6 1/4" (160 mm)		
36" (975 mm)	6 1/2" (170 mm)		
39" (990 mm)	7" (180 mm)		
42" (1050 mm)	7 1/2" (190 mm)	#6 (#19M)	#4 @ 6" (#13M @ 150 mm) OC
45" (1125 mm)	7 3/4" (200 mm)		
48" (1220 mm)	8" (210 mm)		
51" (1275 mm)	8 1/2" (220 mm)		
54" (1350 mm)	9" (230 mm)		
57" (1500 mm)	9 1/4" (240 mm)		
60" (1500 mm)	9 1/2" (240 mm)		
63" (1650 mm)	10" (260 mm)		
66" (1680 mm)	10 1/4" (260 mm)		
69" (1800 mm)	10 3/4" (280 mm)		
72" (1850 mm)	11" (280 mm)	#5 @ 6" (#16M @ 150 mm) OC	#5 @ 6" (#16M @ 150 mm) OC
78" (1950 mm)	11 3/4" (300 mm)		
84" (2100 mm)	12 1/2" (320 mm)		
90" (2400 mm)	13 1/4" (340 mm)		
96" (2440 mm)	14" (360 mm)		
102" (2550 mm)	15 1/2" (400 mm)		
108" (2700 mm)	16" (410 mm)		
114" (3000 mm)	16 1/2" (420 mm)		
120" (3050 mm)	17" (430 mm)		
126" (3150 mm)	17" (430 mm)		
132" (3300 mm)	17 1/2" (450 mm)	#7 (#22M)	#5 @ 6" (#16M @ 150 mm) OC
138" (3450 mm)	17 1/2" (450 mm)		
144" (3600 mm)	18" (460 mm)		
144" (3600 mm)	18" (460 mm)		

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2009

JUNCTION STRUCTURE - PIPE TO RCB

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
333-2
 SHEET 1 OF 2

NOTES

1. VALUES FOR A, B AND C SHALL BE SHOWN ON THE PLANS. ELEVATION R AND ELEVATION S SHALL BE SHOWN WHEN REQUIRED PER NOTE 8.
2. STATIONS SPECIFIED ON THE PLANS APPLY AT THE INTERSECTION OF CENTERLINES OF MAIN LINE AND LATERALS, EXCEPT THAT STATIONS FOR CATCH BASIN CONNECTOR PIPES APPLY AT INSIDE WALL OF STRUCTURE.
3. REINFORCING STEEL SHALL CONFORM TO ASTM A 615, GRADE 40, (ASTM A 615M, GRADE 300), AND SHALL TERMINATE 1 1/2" (40 mm) CLEAR OF CONCRETE SURFACE UNLESS OTHERWISE SHOWN.
 - a. W BARS ARE OF SIZE AND SPACING SPECIFIED FOR WALL STEEL ON PLANS, AND SHALL BE CUT IN CENTER OF OPENING AND BENT INTO TOP AND BOTTOM OF JUNCTION STRUCTURE.
 - b. OMIT H BARS WHEN SOFFIT OF SPUR IS 12" (300 mm) OR LESS BELOW SOFFIT OF MAIN LINE, AND OMIT G BARS WHEN INVERT OF SPUR IS 12" (300 mm) OR LESS ABOVE FLOOR OF MAIN LINE.
4. JUNCTION STRUCTURE SHALL BE POURED MONOLITHICALLY WITH MAIN LINE, MANHOLE OR TRANSITION STRUCTURE.
5. FLOOR OF STRUCTURE SHALL BE STEEL-TROWELED TO THE SPRING LINE.
6. WHEN CONNECTING TO EXISTING RCB, BREAKOUT LIMITS AND DETAILS SHALL BE SHOWN ON THE PLANS.
7. EMBEDMENT, P, SHALL BE 5" (130 mm) FOR B = 96" (2400 mm) OR LESS 8" (200 mm) FOR B OVER 96" (2400 mm).
8. IF ELEVATION R AND ELEVATION S ARE NOT SHOWN ON THE PLANS THEN THE INLET OPENING SHALL FALL 6" (150 mm) BELOW THE SOFFIT OF THE MAIN LINE WITH THE INLET PIPE LAID ON A STRAIGHT GRADE FROM MAIN LINE TO CATCH BASIN OR TO GRADE BREAK IN INLET LINE. ELEVATION S SHALL BE SHOWN ON THE PLANS IF THE INLET OPENING FALLS MORE THAN 6" (150 mm) BELOW THE SOFFIT OF THE MAIN LINE WITH THE INLET PIPE LAID ON A STRAIGHT GRADE AS STATED ABOVE.
ELEVATION R SHALL BE SHOWN ON THE PLANS ONLY WHEN A STUB IS TO BE PROVIDED FOR A FUTURE CONNECTION.
9. LATERALS OR CONNECTOR PIPES 24" (600 mm) OR LESS IN DIAMETER SHALL BE NO MORE THAN 5' (1.5 m) ABOVE THE INVERT. LATERALS OR CONNECTOR PIPES 27" (675 mm) OR LARGER IN DIAMETER SHALL BE NO MORE THAN 18" (450 mm) ABOVE THE INVERT, WITH THE EXCEPTION THAT CATCH BASIN CONNECTOR PIPES LESS THAN 50' (15 m) IN LENGTH SHALL NOT BE MORE THAN 5' (1.5 m) ABOVE THE INVERT.
10. THE NEED FOR AN EDGE BEAM AND/OR ADDITIONAL REINFORCEMENT SHALL BE INVESTIGATED BY THE ENGINEER FOR ANY ONE OF THE FOLLOWING CONDITIONS:
 - a. ANGLE A IS LESS THAN 30°
 - b. TOP OF INLET PIPE IS LESS THAN 6" (150 mm) BELOW THE SOFFIT
 - c. FLOW LINE OF INLET PIPE IS LESS THAN 7" (180 mm) ABOVE THE FLOOR OF THE RCB AT THE INSIDE FACE


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


JUNCTION STRUCTURE – PIPE TO RCB

333-2

SHEET 2 OF 2

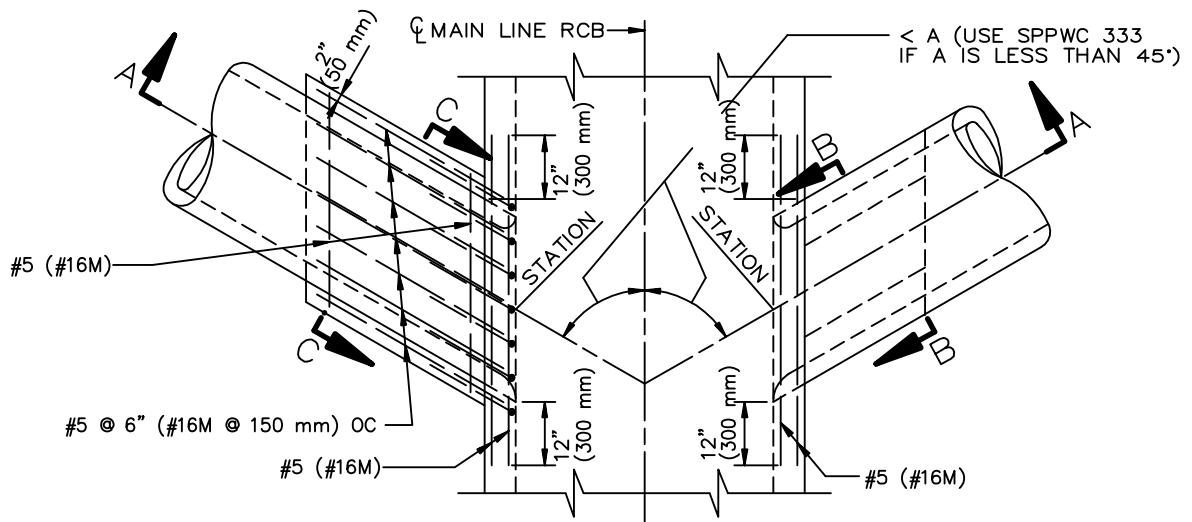

PLAN

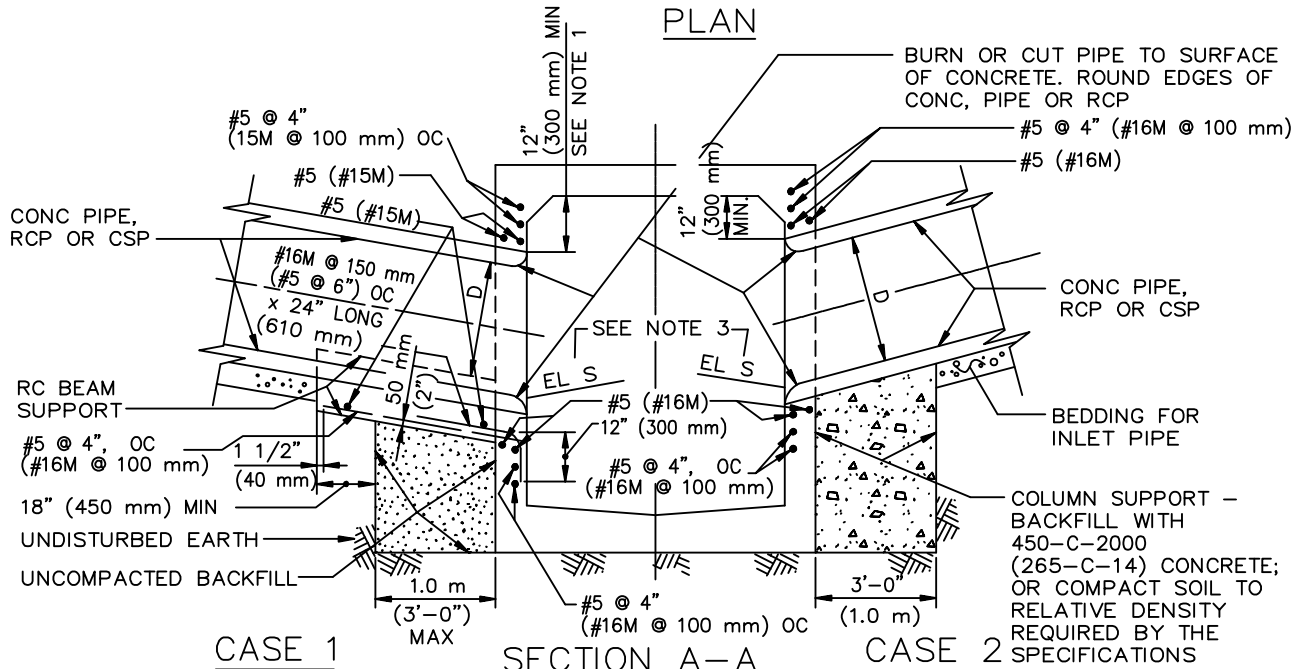

CASE 1


BEAM SUPPORT

D = 30" (750 mm) MAX


CASE 2

COLUMN SUPPORT

D = 30" (750 mm) MAX

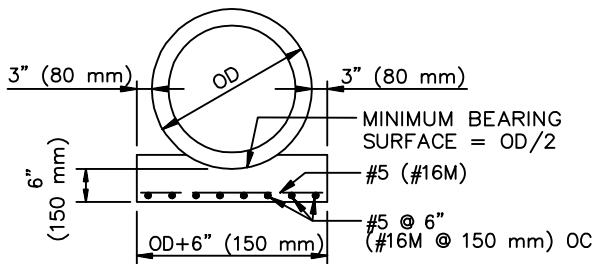

SECTION C-C

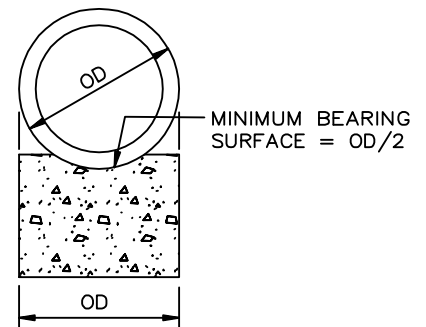

SECTION B-B

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

JUNCTION STRUCTURE – PIPE TO PIPE
INLET ID <math>< 30''</math> (750 mm)


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

334-2

SHEET 1 OF 3


B BARS - #6 @ 4" (#19M @ 100 mm) OC,
 LENGTH = $D + 3' - 0"$ (1.0 m)
 PLACED UNDER CUT BARS AND
 ON TOP OF UNCUT BARS. OMIT
 BARS THAT FALL OVER SIDEWALLS.

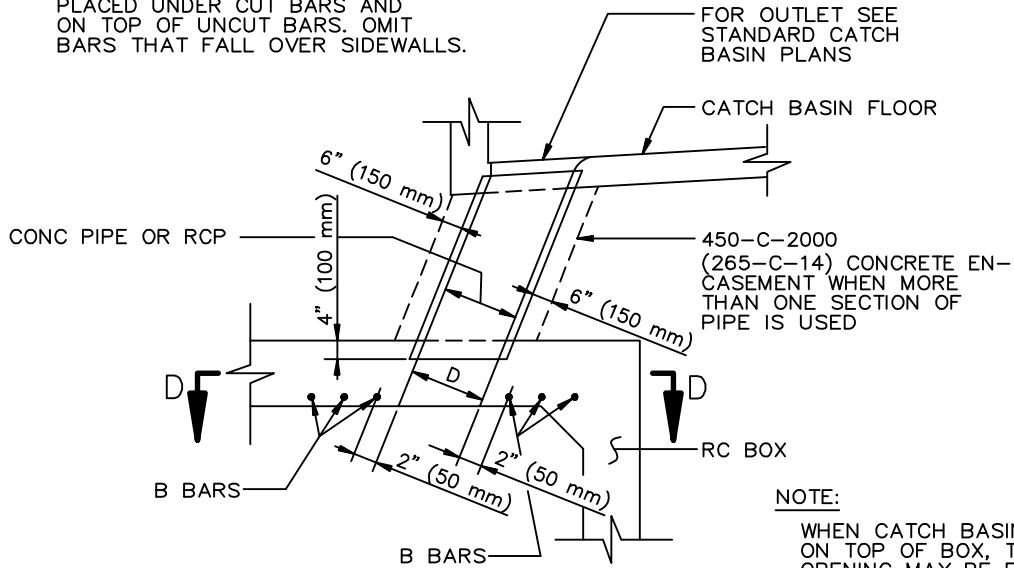

NOTE:

WHEN CATCH BASIN FALLS
 ON TOP OF BOX, THE
 OPENING MAY BE FORMED
 THROUGH FLOOR OF CATCH
 BASIN AND TOP SLAB OF BOX.

CASE 3
TOP SLAB ENTRANCE
 $D = 30" (750 \text{ mm}) \text{ MAX}$

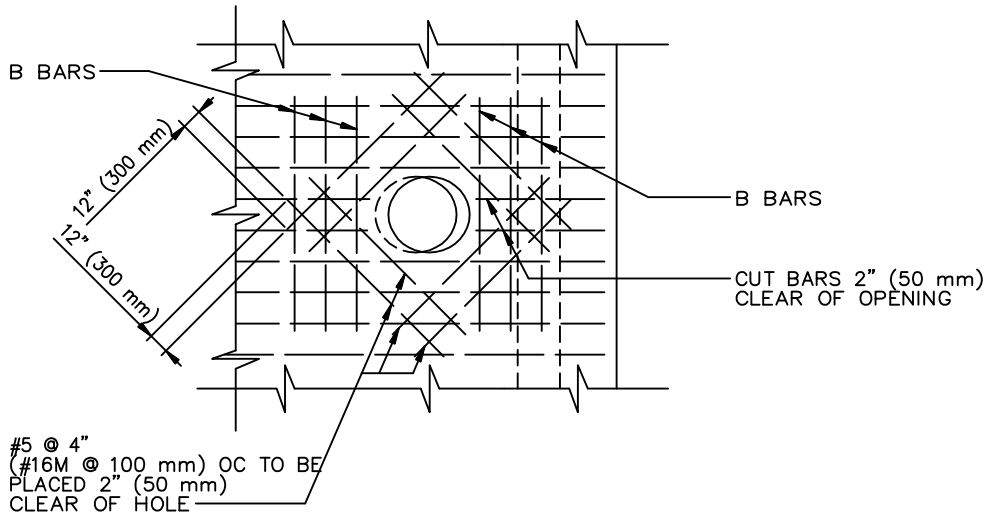

SECTION D-D

NOTES

1. USE JUNCTION STRUCTURE PER SPPWC 333 INSTEAD OF THIS JUNCTION STRUCTURE UNDER ANY ONE OF THE FOLLOWING CONDITIONS:
 - a. DIAMETER OF INLET PIPE EXCEEDS 30" (750 mm).
 - b. TOP OF PIPE IS LESS THAN 12" (300 mm) BELOW SOFFIT OF BOX.
 - c. FLOW LINE OF PIPE IS LESS THAN 13" (225 mm) ABOVE FLOOR OF THE BOX AT INSIDE FACE.
 - d. ANGLE A IS LESS THAN 45°.
2. ALL CSP AND FITTINGS SHALL BE GALVANIZED.
3. ELEVATION S SHALL BE SPECIFIED ON PLANS ONLY IF THE TOP OF PIPE IS MORE THAN 12" (300 mm) BELOW SOFFIT OF BOX.
4. LATERALS OR CONNECTOR PIPES 24" (600 mm) OR LESS IN DIAMETER SHALL BE NOT MORE THAN 5' (1.5 m) ABOVE THE INVERT. LATERALS OR CONNECTOR PIPES 27" (675 mm) OR LARGER IN DIAMETER SHALL BE NOT MORE THAN 18" (450 mm) ABOVE THE INVERT, WITH THE EXCEPTION THAT CATCH BASIN CONNECTOR PIPES LESS THAN 50" (15 m) IN LENGTH SHALL BE NOT MORE THAN 5' (1.5 m) ABOVE THE INVERT.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


**JUNCTION STRUCTURE – PIPE TO PIPE
INLET ID < 30" (750 mm)**

334-2


SHEET 3 OF 3

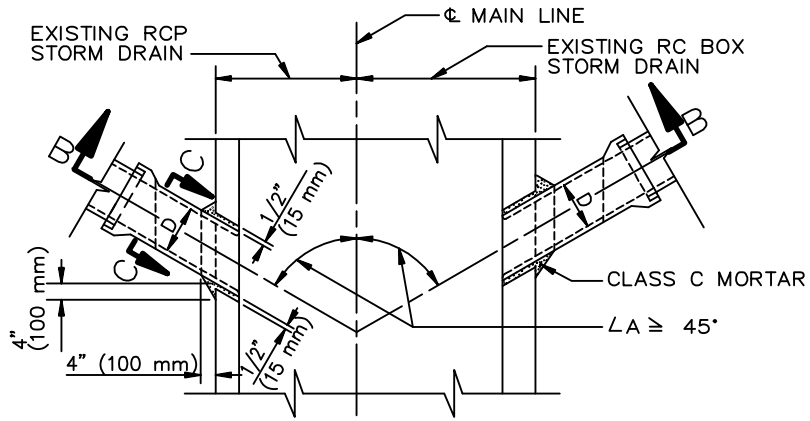

PLAN

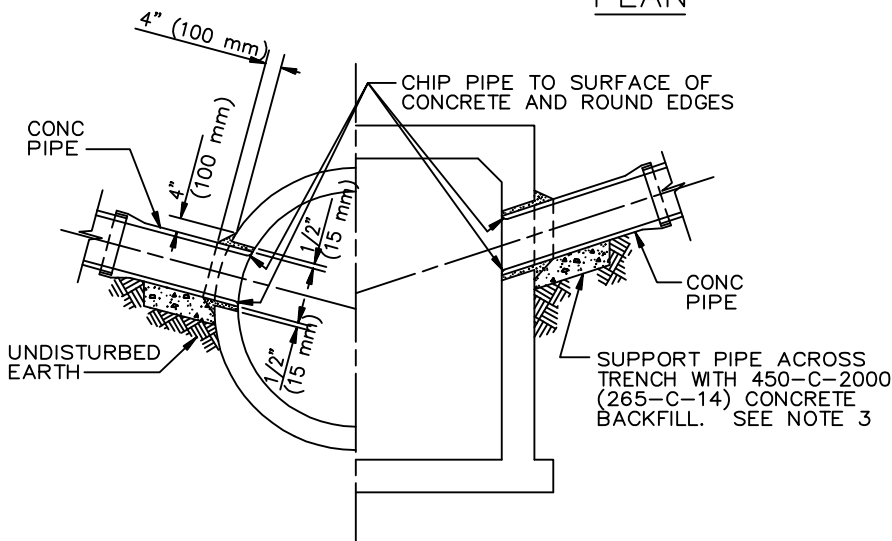


SECTION B-B

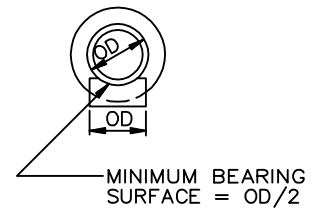


SECTION C-C

CASE 1
PLAIN CONCRETE PIPE

D = 24" (600 mm) MAX

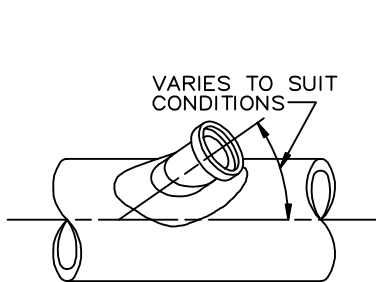

SADDLE
PLAN

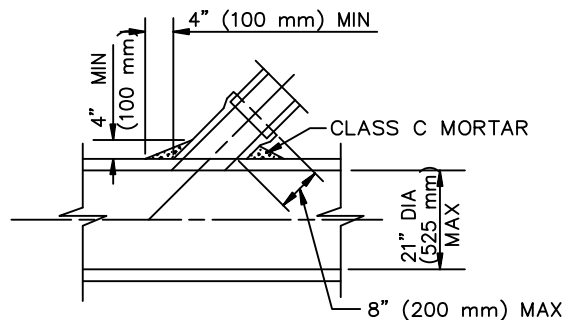

SADDLE
SECTION

CASE 2
SADDLE CONNECTION

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009


PIPE CONNECTIONS TO
EXISTING STORM DRAINS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

335-2


SHEET 1 OF 3

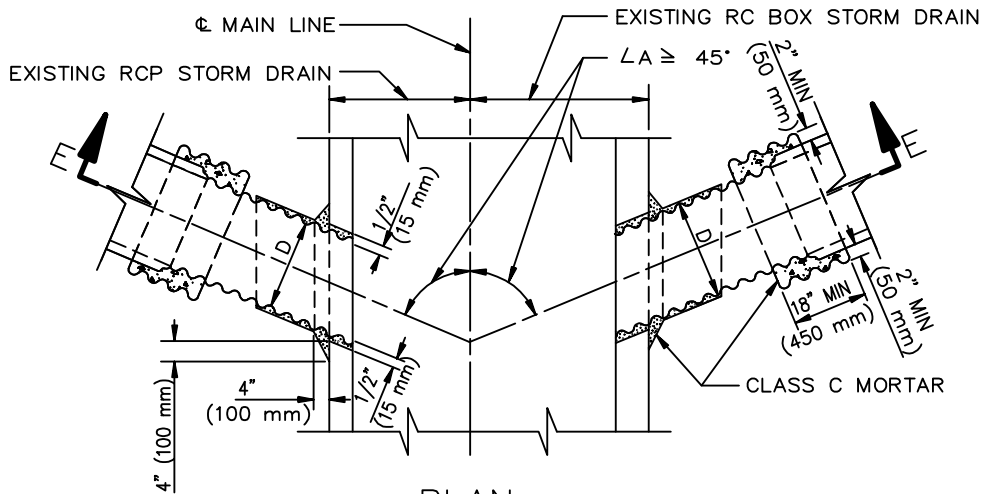

PLAN

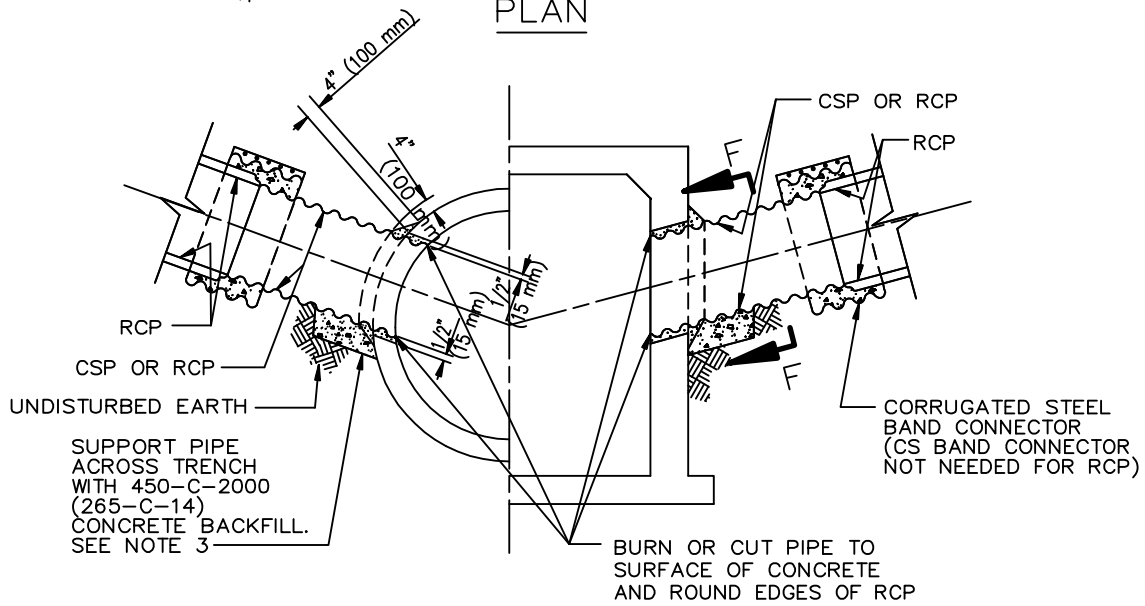

SECTION E-E

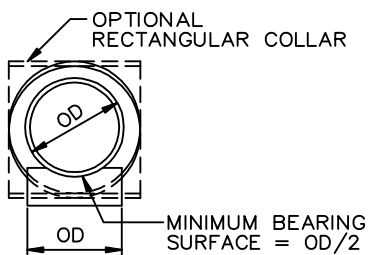

SECTION F-F

DIAMETER OF CSP	MIN GAGE
15" (375 mm) - 21" (525 mm)	16
24" (600 mm)	14

CASE 3
RCP OR CSP
D = 24" (600 mm) MAX

NOTES

CASE 1 AND CASE 3

1. OUTSIDE DIAMETER OF THE CONNECTOR PIPE SHALL NOT BE GREATER THAN 1/2 THE INSIDE DIAMETER OF THE RCP MAIN LINE.
2. INSIDE DIAMETER D OF THE CONNECTOR PIPE SHALL NOT BE GREATER THAN 24" (600 mm).
3. THE MINIMUM OPENING INTO THE EXISTING STORM DRAIN SHALL BE THE OUTSIDE DIAMETER OF THE CONNECTING PIPE PLUS 1" (30 mm). THE CONCRETE BACKFILL SUPPORTING THE CONNECTING PIPE MAY BE OMITTED IF THE PIPE IS LAID ON UNDISTURBED EARTH TO STORM DRAIN WALL.
4. ALL CSP AND FITTINGS SHALL BE GALVANIZED. BAND CONNECTORS MAY BE 2 GAGES LIGHTER THAN THE PIPE, BUT WITH A MINIMUM GAGE OF 16. THEY SHALL BE CONNECTED AT THE ENDS BY ANGLES HAVING MINIMUM DIMENSIONS OF 2"x2"x3/16" (50 mm x 50 mm x 5 mm) AND 5 1/2" (140 mm) BOLTS.
5. WHEN JOINING A RCP CONNECTOR PIPE TO A CSP CONNECTOR PIPE, THE INSIDE DIAMETER D OF THE CSP SHALL BE AT LEAST EQUAL TO BUT NOT MORE THAN 3" (75 mm) GREATER THAN THAT OF THE RCP.
6. CONNECTOR PIPES SHALL BE NOT MORE THAN 5' (1.5 m) ABOVE THE INVERT.
7. CONNECTOR PIPES SHALL ENTER MAIN LINE RCP RADIALLY.
8. WHEN CONNECTING TO A RCB, SPPWC 333 SHALL BE USED IF THE TOP OF THE CONNECTOR PIPE IS LESS THAN 12" (300 mm) BELOW THE SOFFIT OF THE RCB OR THE FLOW LINE OF THE PIPE IS LESS THAN 13" (330 mm) ABOVE THE FLOOR OF THE RCB AT THE INSIDE FACE.

CASE 2

9. SADDLE CONNECTIONS SHALL BE USED WHEN CONNECTING TO PIPES 21" (525 mm) OR LESS IN DIAMETER WITHOUT THE USE OF JUNCTION STRUCTURES OR PRECAST Y BRANCHES.
10. TRIM OR CUT SADDLE TO FIT SNUGLY OVER THE OUTSIDE OF THE MAIN PIPE SO ITS AXIS WILL BE ON THE LINE AND GRADE OF THE CONNECTING PIPE.
11. THE OPENING INTO THE PIPE SHALL BE CUT AND TRIMMED TO FIT THE SADDLE SO THAT NO PART WILL PROJECT WITHIN THE BORE OF THE SADDLE PIPE.
12. THE CONNECTOR PIPE SHALL BE SUPPORTED AS SHOWN IN CASE 1 AND CASE 3.



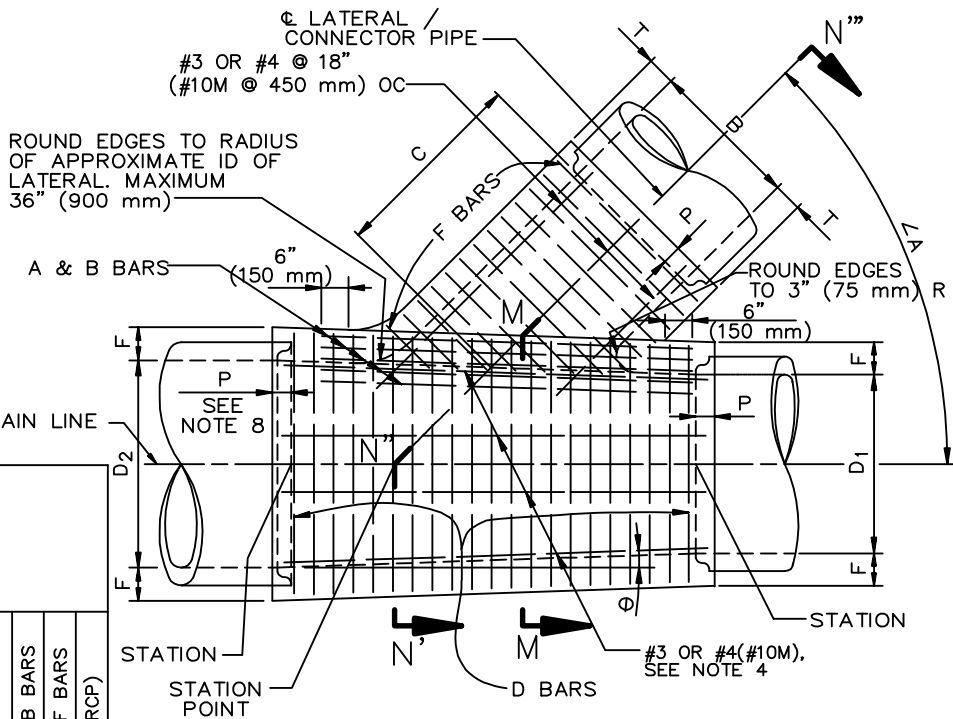


TABLE
 FOR DIMENSIONS AND BAR SIZES

D ₂ OR B (INCHES)	(mm)	F OR T (INCHES)		A OR B BARS (#5 @ 3" (#16M @ 75 mm) OC)	D OR F BARS (#4 @ 6" (#13M @ 150 mm) OC)	P (RCP)
		(INCHES)	(mm)			
12	300	4	110	#5 @ 3" (#16M @ 75 mm) OC	#4 @ 6" (#13M @ 150 mm) OC	5" (125 mm)
15	375	4 1/4	110			
18	450	4 1/2	120			
21	525	5	130			
24	600	5 1/4	140			
27	675	5 1/2	140			
30	750	6	160			
33	825	6 1/4	160			
36	900	6 1/2	170			
39	975	7	180			
42	1050	7 1/2	190	#6 @ 3" (#19M @ 75 mm) OC	#5 @ 6" (#16M @ 150 mm) OC	5" (125 mm)
45	1125	7 3/4	200			
48	1200	8	210			
51	1275	8 1/2	220			
54	1350	9	230			
57	1425	9 1/4	240			
60	1500	9 1/2	250			
63	1575	10	260			
66	1650	10 1/4	260			
69	1725	10 3/4	280			
72	1800	11	280	#6 @ 3" (#19M @ 75 mm) OC	#5 @ 6" (#16M @ 150 mm) OC	5" (125 mm)
78	1950	11 3/4	300			
84	2100	12 1/2	320			
90	2250	13 1/4	340			
96	2400	14	360			
102	2550	15 1/2	400			
108	2700	16	410			
114	2850	16 1/2	420			
120	3000	17	440			
126	3150	17	440			
132	3300	17 1/2	450	#7 @ 3" (#22M @ 75 mm) OC	#6 @ 6" (#19M @ 150 mm) OC	8" (200 mm)
138	3450	17 1/2	450			
144	3600	18	460			

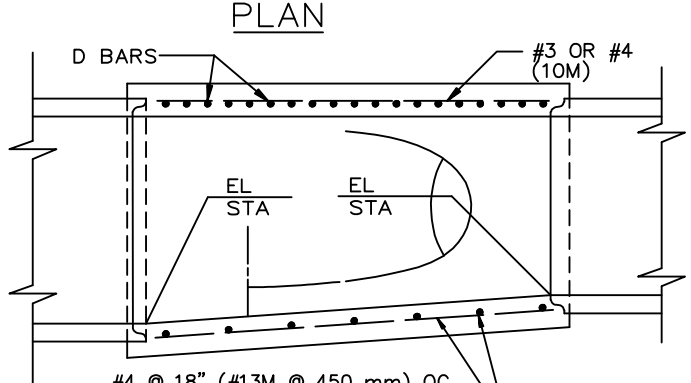

#4 @ 18" (#13M @ 450 mm) OC, BOTH WAYS, TO BE USED WHEN D₂ IS 60" (1500 mm) OR MORE
LONGITUDINAL SECTION

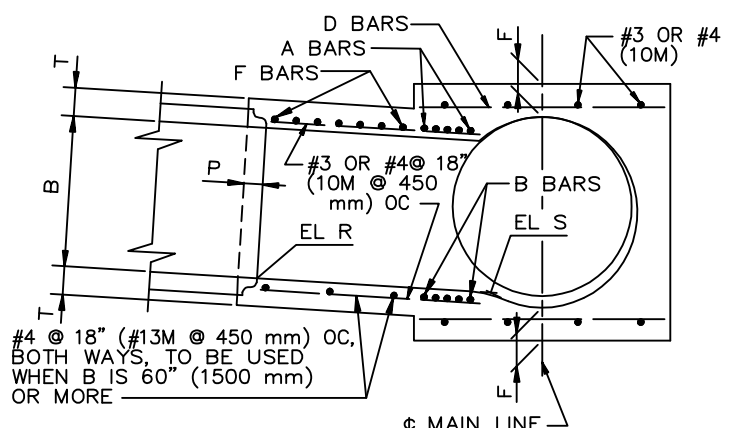

SECTION N'-N'-N' PROJECTED ON M-M-N'

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1992
 REV. 1995, 2009

**TRANSITION STRUCTURE
 PIPE TO PIPE**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

340-2

SHEET 1 OF 2

NOTES

1. THE HORIZONTAL ANGLE OF CONVERGENCE OR DIVERGENCE, θ , SHALL NOT EXCEED $5^{\circ} 45'$.
2. VALUES FOR A, B, C, D₁ AND D₂ ARE SHOWN ON THE PLANS. ELEVATION R AND ELEVATION S ARE SHOWN WHEN REQUIRED BY NOTE 10.
3. FLOOR OF STRUCTURE SHALL BE STEEL TROWELED TO SPRING LINE.
4. REINFORCEMENT STEEL SHALL CONFORM TO ASTM A 615 (A 615 M), GRADE 300 (40), AND SHALL TERMINATE $1\ 1/2"$ (40 mm) CLEAR OF CONCRETE SURFACES UNLESS OTHERWISE SHOWN. LONGITUDINAL BARS SHALL BE #3 OR #4 @ 18" (#10M @ 450 mm) OC OR LESS.
5. ELEVATION S APPLIES AT INSIDE WALL OF STRUCTURE.
6. TRANSITION STRUCTURE SHALL BE POURED IN ONE CONTINUOUS OPERATION, EXCEPT THAT THE CONTRACTOR SHALL HAVE THE OPTION OF PLACING AT THE SPRING LINE A CONSTRUCTION JOINT LONGITUDINAL KEYWAY.
7. THE LENGTH OF THE STRUCTURE MAY BE INCREASED AT THE OPTION OF THE CONTRACTOR TO MEET RCP ENDS, USING D BARS, LONGITUDINAL AND BOTTOM REINFORCEMENT IN EXTENDED PORTION OF SAME DIAMETER AND SPACING AS SPECIFIED IN THE TABLE, BUT ANY CHANGE IN THE LOCATION OF SPUR MUST BE APPROVED BY THE ENGINEER.
8. EMBEDMENT P SHALL BE AS SPECIFIED IN THE TABLE, UNLESS OTHERWISE SHOWN ON THE PLANS.
9. WHEN THERE IS NO SPUR REQUIRED, A & B BARS SHALL BE OMITTED.
10. WHEN ELEVATION R AND ELEVATION S ARE NOT SHOWN ON PLANS, INLET PIPE SHALL ENTER MAIN LINE RADially. WHEN INLET PIPE ENTERS MAIN LINE OTHER THAN RADially, ELEVATION S SHALL BE SHOWN ON PLANS, AND INLET PIPE SHALL BE LAID ON A STRAIGHT GRADE FROM ELEVATION S TO CATCH BASIN OR GRADE BREAK IN INLET LINE. ELEVATION R SHALL BE SHOWN ON THE PLANS ONLY WHEN STUB IS TO BE PROVIDED IN MAIN LINE FOR FUTURE CONSTRUCTION OF INLET PIPE.
11. THE MAXIMUM COVER ABOVE THIS STRUCTURE SHALL BE 25' (7.5 m). IF THE COVER EXCEEDS 25' (7.5 m') A SPECIAL STRUCTURE SHALL BE DESIGNED FOR THE COVER AND DETAILED ON THE PLANS.




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

**TRANSITION STRUCTURE
PIPE TO PIPE**

STANDARD PLAN

340-2

SHEET 2 OF 2

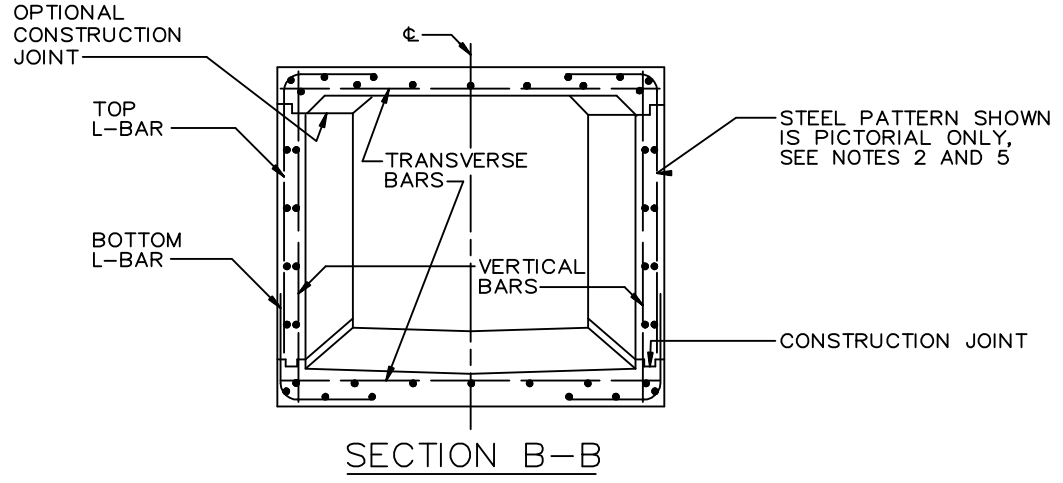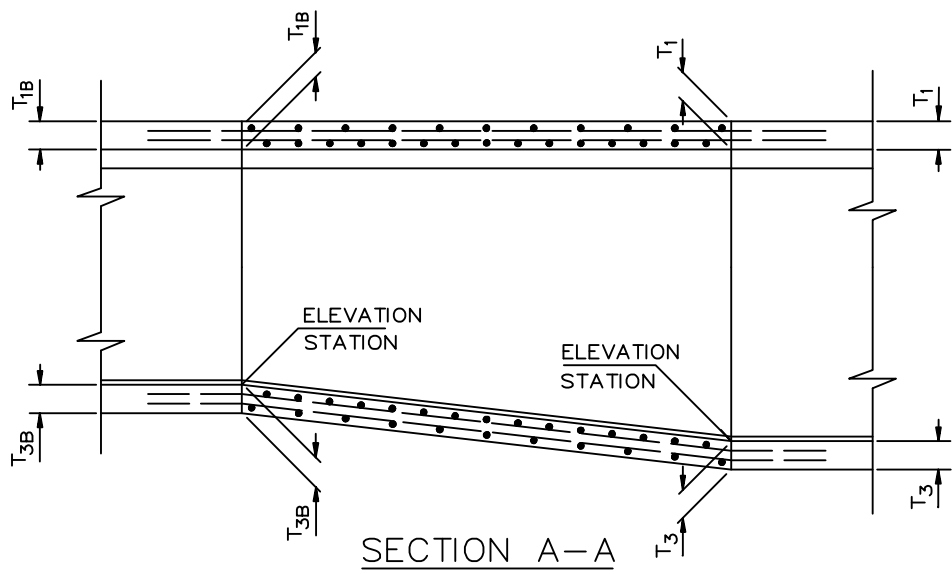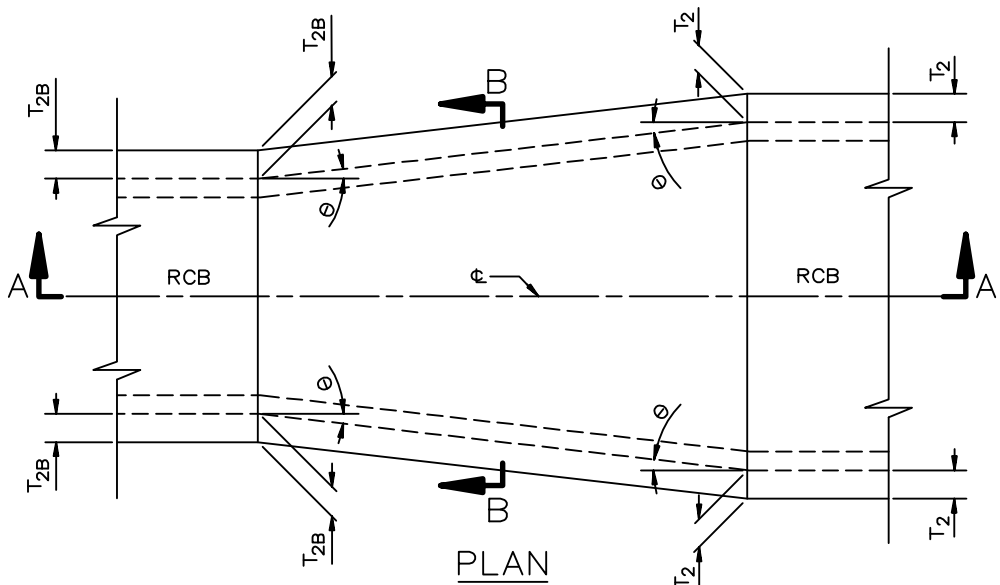

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1995, 2009

TRANSITION STRUCTURE
SINGLE RCB TO SINGLE RCB

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

341-2

SHEET 1 OF 2

NOTES

1. THE HORIZONTAL ANGLE OF DIVERGENCE OR CONVERGENCE, θ , SHALL NOT EXCEED $5^{\circ} 45'$.
2. THE REINFORCING STEEL BAR SIZE, SPACING AND COVER OVER THE STEEL OF STRAIGHT TRANSVERSE BARS IN TOP AND BOTTOM SLABS, OF L-BARS IN TOP AND BOTTOM CORNERS, OF STRAIGHT VERTICAL BARS IN SIDEWALLS AND/OR LONGITUDINAL DISTRIBUTION AND TIE BARS IN TOP OR BOTTOM SLABS OR SIDE WALLS SHALL BE THOSE OF WHICHEVER ADJOINING RCB SECTION PROVIDES THE GREATER STEEL AREA FOR EACH TYPE OF BAR AND GREATEST COVER. THE BAR LENGTHS SHALL VARY UNIFORMLY THROUGHOUT THE TRANSITION.
3. THE THICKNESS OF THE WALLS AND SLABS SHALL BE THOSE OF THE ADJOINING RCB SECTION AT EACH END OF THE TRANSITION AND SHALL VARY UNIFORMLY BETWEEN THE TWO ENDS.
4. $f'_c = 4000$ PSI (28 MPa) AT 28 DAYS AND THE CONCRETE SHALL BE THE SAME MIX AS THE ADJACENT RCB.
5. ALL STEEL EXCEPT LONGITUDINAL STEEL SHALL BE GRADE 60 (400) BILLET STEEL CONFORMING TO ASTM A 615 (A 615 M) AND SHALL TERMINATE $1\ 1/2"$ (40 mm) CLEAR OF CONCRETE SURFACE UNLESS OTHERWISE SHOWN.
6. THE TRANSITION STRUCTURE SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STRUCTURAL NOTES APPLYING TO RCB STRUCTURES SHOWN ON THE PLANS.
7. DETAILS OF CONSTRUCTION JOINTS AND KEYWAYS SHALL BE AS SHOWN ON THE PLANS FOR SINGLE RCB STRUCTURES.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN



**TRANSITION STRUCTURE
SINGLE RCB TO SINGLE RCB**

341-2

SHEET 2 OF 2

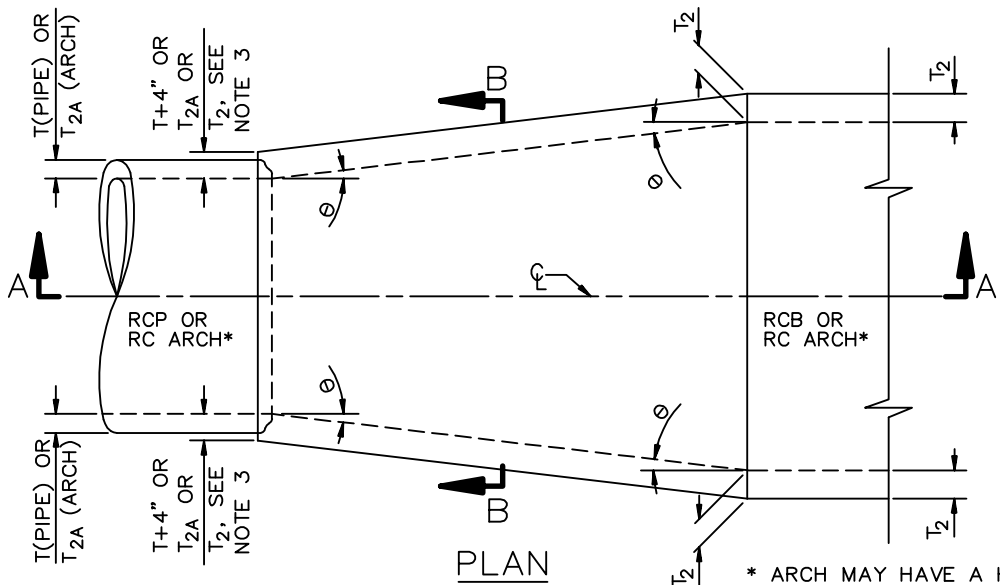

* ARCH MAY HAVE A HORSESHOE-SHAPED, CIRCULAR, ELLIPTICAL OR SIMILAR CROSS SECTION.

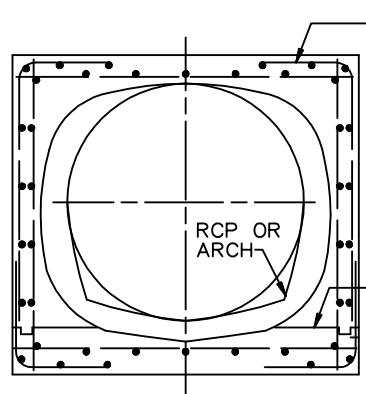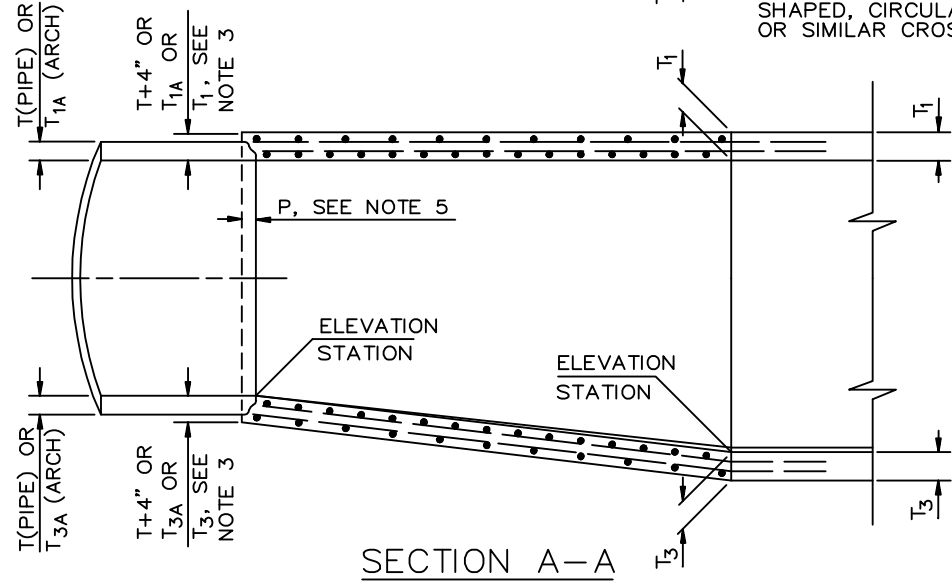

STEEL PATTERN SHOWN IS PICTORIAL ONLY, SEE NOTES 2 AND 7

OPTIONAL CONSTRUCTION JOINT:
 RCB OR ARCH TO RCP USE CONST JOINT OF RCB OR ARCH.
 RCB TO ARCH, USE CONST JOINT OF RCB

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1992
 REV. 1995, 2009

**TRANSITION STRUCTURE
 RCB TO PIPE**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION




STANDARD PLAN
342-2
 SHEET 1 OF 2

NOTES

1. THE HORIZONTAL ANGLE OF DIVERGENCE OR CONVERGENCE, θ , SHALL NOT EXCEED $5^{\circ} 45'$.
2. REINFORCING STEEL BAR SIZES, SPACING, PATTERN AND COVER OVER THE STEEL SHALL BE AS FOLLOWS:
RCB TO RCP AND RCB TO ARCH – THAT OF RCB SECTION.
ARCH TO RCP – THAT OF ARCH SECTION.
ARCH TO ARCH – THAT OF ARCH SECTION HAVING THE THICKER WALLS. THE BAR LENGTHS SHALL VARY UNIFORMLY THROUGHOUT THE TRANSITION.
3. THE CONCRETE THICKNESS SHALL BE AS FOLLOWS:
RCB TO RCP AND ARCH TO RCP – THAT OF ARCH OR RCB SECTION UNLESS THE WALL THICKNESS OF THE RCP PLUS 100 mm (4") GREATER, IN WHICH CASE THE CONCRETE THICKNESS SHALL VARY UNIFORMLY FROM THAT OF THE ARCH OR RCB SECTION TO THAT OF THE RCP WALL PLUS 100 mm (4").

RCB TO ARCH AND ARCH TO ARCH – THAT OF THE ADJOINING RCB OR ARCH SECTION AT EACH END OF THE TRANSITION AND SHALL VARY UNIFORMLY BETWEEN THE TWO ENDS.
4. THE INTERIOR SURFACE SHALL BE SMOOTH AND VARY UNIFORMLY BETWEEN THE TWO ADJOINING SECTIONS.
5. AT RCP JUNCTURE, EMBEDMENT P SHALL BE 130 mm (5") FOR PIPE SIZE OF 2400 mm (96") OR LESS, AND 200 mm (8") FOR PIPE SIZES OVER 2400 mm (96").
6. $f'_c = 28 \text{ MPa}$ (4000 PSI) AT 28 DAYS AND THE CONCRETE SHALL BE THE SAME MIX AS THE ADJACENT RCB.
7. ALL STEEL, EXCEPT LONGITUDINAL STEEL SHALL BE GRADE 400 (60) BILLET STEEL CONFORMING TO ASTM A 615 M (A 615) AND SHALL TERMINATE 40 mm (1 1/2") CLEAR OF CONCRETE SURFACE UNLESS OTHERWISE SHOWN.
8. KEYED CONSTRUCTION JOINTS OF THE SAME DIMENSIONS AS THOSE OF THE RCB OR ARCH SECTION MAY BE CARRIED THROUGH THE TRANSITION STRUCTURE AT THE CONTRACTOR'S OPTION. SEE SECTION B-B.
9. THE TRANSITION STRUCTURE SHALL BE CONSTRUCTED IN ACCORDANCE THE STRUCTURAL NOTES APPLYING TO RCB OR ARCH STRUCTURES SHOWN ON THE PLANS.

STRUCTURAL ANALYSIS REQUIRED WHEN THIS DIMENSION EXCEEDS 18" (450 mm)

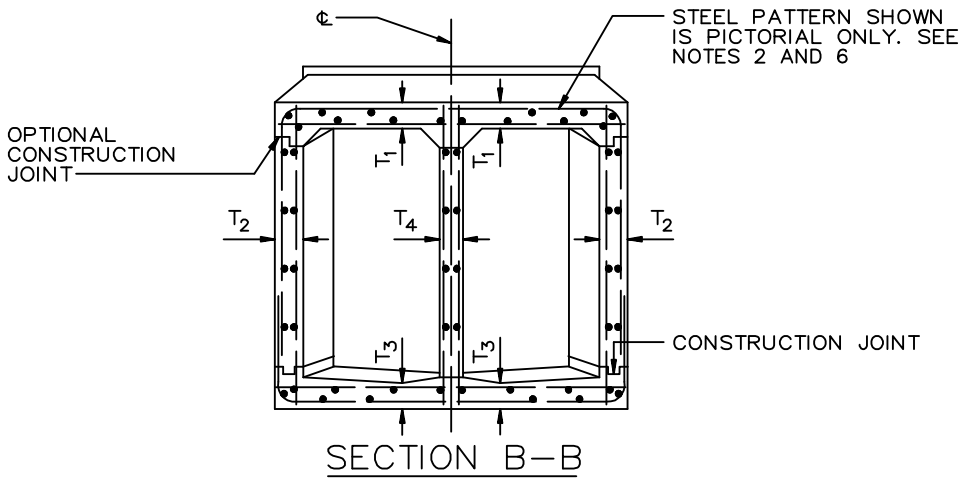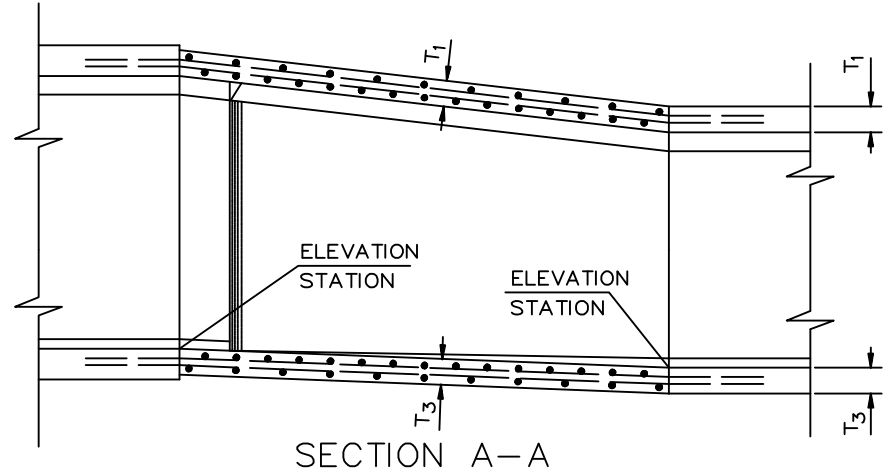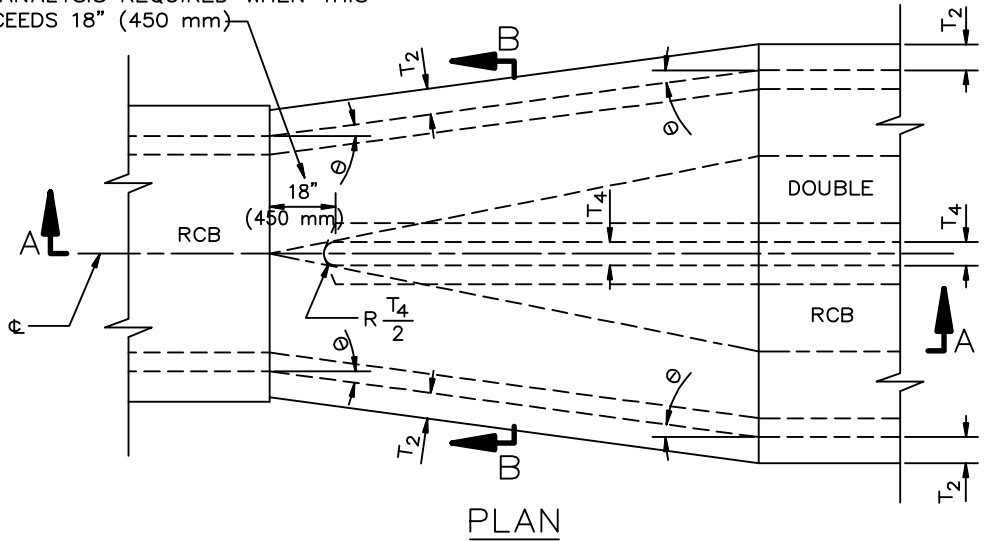

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1995, 2009

**TRANSITION STRUCTURE
SINGLE RCB TO DOUBLE RCB**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
343-2
SHEET 1 OF 2

NOTES

1. THE HORIZONTAL ANGLE OF DIVERGENCE OR CONVERGENCE, θ , SHALL NOT EXCEED $5^{\circ} 45'$.
2. REINFORCING STEEL BAR SIZE, SPACING AND OUTSIDE COVER SHALL BE THAT OF DOUBLE RCB SECTION. FOR CURVED TRANSITIONS, SPACE BARS ON CENTER LINE AND PLACE TRANSVERSE STEEL RADIALLY. THE BAR LENGTHS AND DIMENSIONS SHALL VARY UNIFORMLY THROUGHOUT TRANSITION. LONGITUDINAL BARS SHALL BE CONTINUED THROUGH THE JOINTS WITH THE TRANSITION STRUCTURE.
3. THE CONCRETE THICKNESS SHALL BE THAT OF THE DOUBLE RCB SECTION.
4. PLAN AS SHOWN IS FOR DOUBLE RCB SECTION DOWNSTREAM. WHEN DOUBLE RCB SECTION IS UPSTREAM TAPER THE LAST 24" (600 mm) OF CENTER WALL TO END IN 1 1/2" (40 mm) RADIUS.
5. $f'_c = 4000$ PSI (28 MPa) AT 28 DAYS AND THE CONCRETE SHALL BE THE SAME MIX AS THE ADJACENT RCB.
6. ALL STEEL, EXCEPT LONGITUDINAL STEEL SHALL BE GRADE 60 (400) BILLET STEEL CONFORMING TO ASTM A 615 (A 615 M) AND SHALL TERMINATE 1 1/2" (40 mm) CLEAR OF CONCRETE SURFACES UNLESS OTHERWISE SHOWN.
7. TRANSVERSE JOINT KEYWAYS, AS DETAILED FOR LONGITUDINAL JOINT KEYWAYS AT BASE OF OUTER WALLS ON THE PLANS, SHALL BE PLACED IN BOTH SLABS AND WALLS AT THE END OF EACH POUR.
8. THE TRANSITION STRUCTURE SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STRUCTURAL NOTES APPLYING TO RCB STRUCTURES SHOWN ON THE PLANS.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


**TRANSITION STRUCTURE
SINGLE RCB TO DOUBLE RCB**

343-2

SHEET 2 OF 2

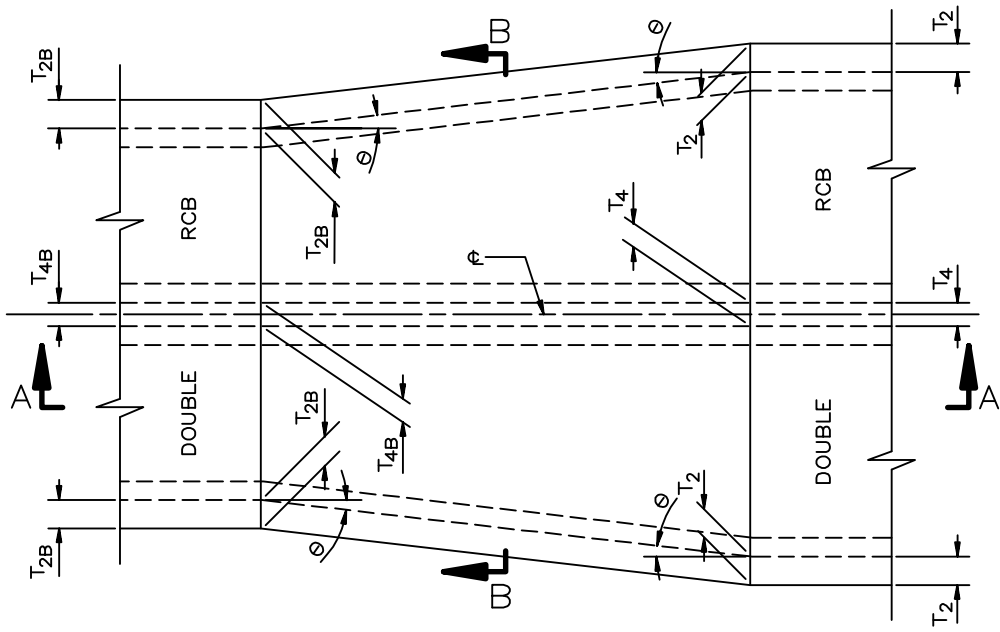


PLAN

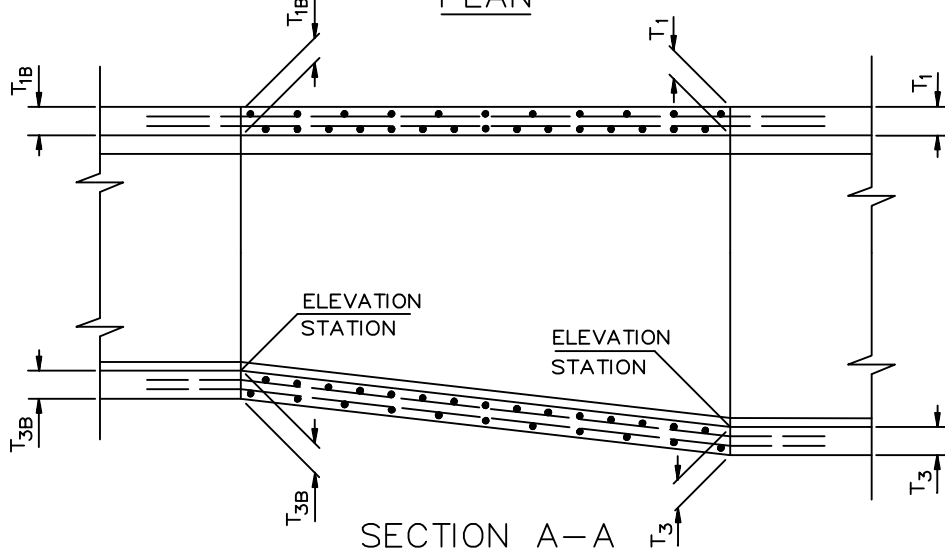

SECTION A-A

OPTIONAL
CONSTRUCTION
JOINT

VARIES
 T_2 TO T_{2B}

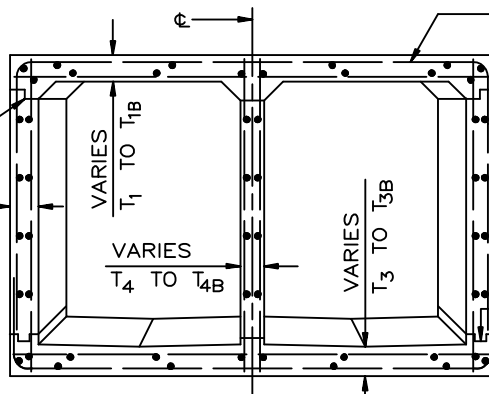

SECTION B-B

STEEL PATTERN SHOWN
IS PICTORIAL ONLY. SEE
NOTES 2 AND 5

CONSTRUCTION JOINT

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1995, 2009

**TRANSITION STRUCTURE
DOUBLE RCB TO DOUBLE RCB**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

344-2

SHEET 1 OF 2

NOTES

1. HORIZONTAL ANGLE OF DIVERGENCE OR CONVERGENCE, θ , SHALL NOT EXCEED $5^{\circ} 45'$.
2. REINFORCING STEEL BAR SIZE, SPACING, LENGTHS, AND OUTSIDE COVER SHALL BE THAT OF WHICHEVER ADJOINING DOUBLE RCB SECTION PROVIDES THE GREATER STEEL AREA FOR EACH TYPE OF BAR. LONGITUDINAL BARS SHALL BE CONTINUED THROUGH THE JOINTS WITH THE TRANSITION STRUCTURE.
3. THE THICKNESS OF THE WALLS AND SLABS SHALL BE THOSE OF THE ADJOINING DOUBLE RCB SECTION AT EACH END OF THE TRANSITION AND SHALL VARY UNIFORMLY BETWEEN THE TWO ENDS.
4. $f'_c = 4,000$ PSI (28 MPa) AT 28 DAYS AND THE CONCRETE SHALL BE THE SAME MIX AS THE ADJACENT RCB.
5. ALL STEEL, EXCEPT LONGITUDINAL STEEL SHALL BE GRADE 60 (400) BILLET STEEL CONFORMING TO ASTM A 615 (A 615 M) AND SHALL TERMINATE $1\ 1/2"$ (40 mm) CLEAR OF CONCRETE SURFACE UNLESS OTHERWISE SHOWN.
6. TRANSVERSE JOINT KEYWAYS, AS DETAILED FOR LONGITUDINAL JOINT KEYWAYS AT BASE OF OUTER WALLS ON THE PLANS, SHALL BE PLACED IN BOTH SLABS AND WALLS AT THE END OF EACH POUR.
7. THE TRANSITION STRUCTURE SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STRUCTURAL NOTES APPLYING TO DOUBLE RCB STRUCTURES SHOWN ON THE PLANS.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


**TRANSITION STRUCTURE
DOUBLE RCB TO DOUBLE RCB**

344-2

SHEET 2 OF 2


REINFORCING STEEL DETAILS SAME AS FOR DOUBLE RCB SECTION

REINFORCING STEEL DETAILS SAME AS FOR TRIPLE RCB SECTION

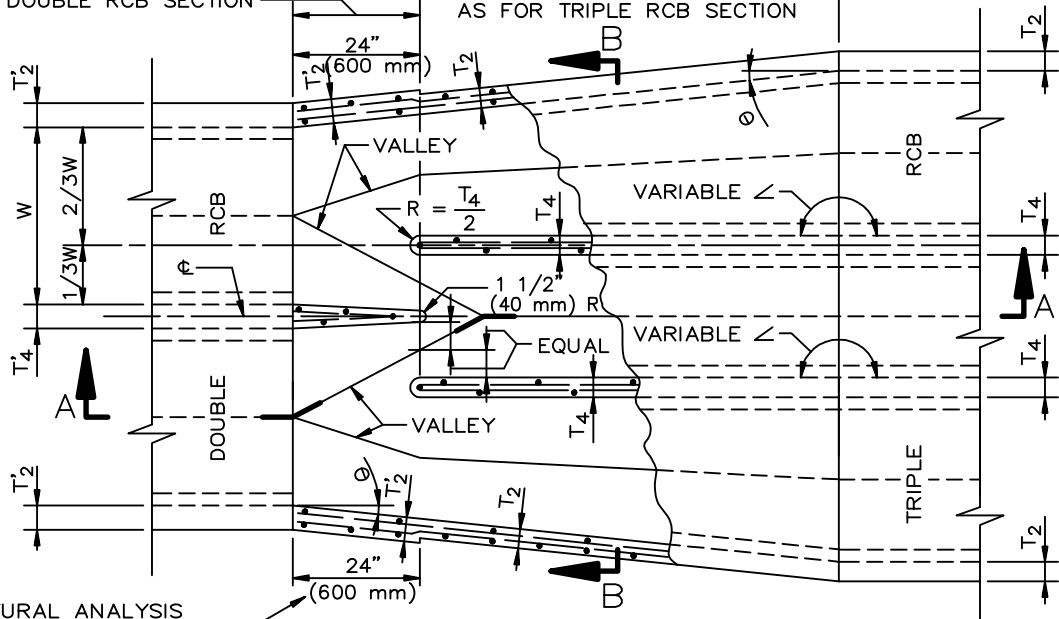


STRUCTURAL ANALYSIS REQUIRED WHEN THIS DIMENSION EXCEEDS 24" (600 mm)

SECTIONAL PLAN

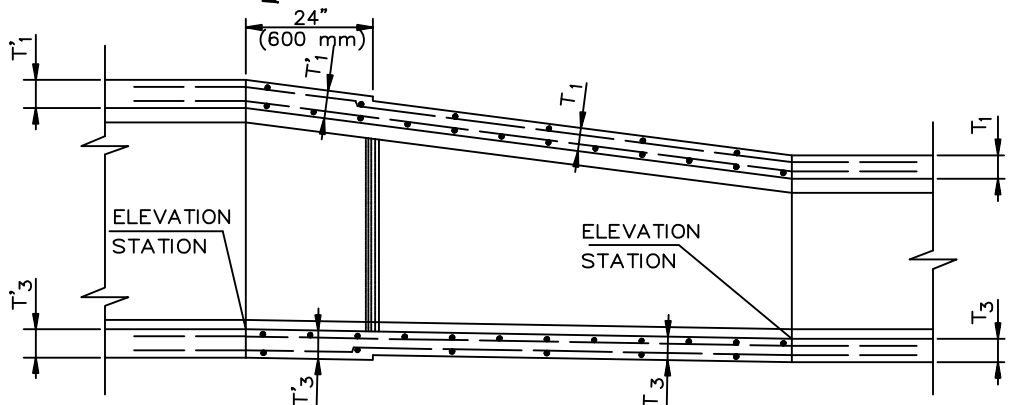

SECTION A-A

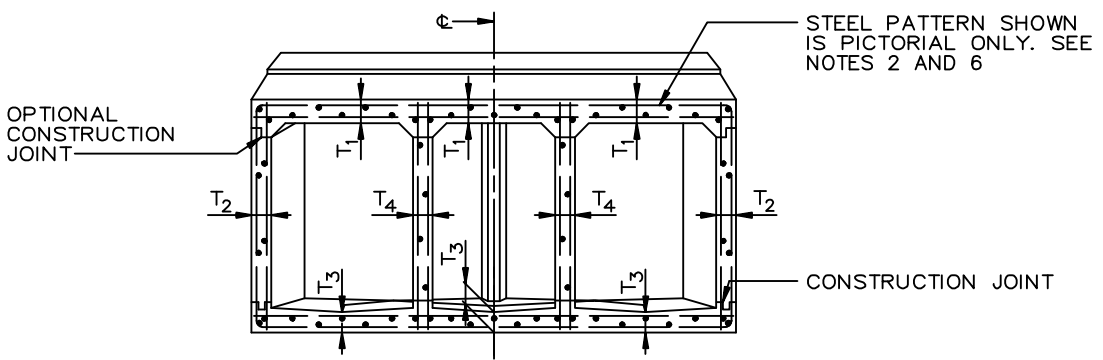

SECTION B-B

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1992 REV. 1995, 2009

TRANSITION STRUCTURE
DOUBLE RCB TO TRIPLE RCB

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

345-2


SHEET 1 OF 2

NOTES


1. HORIZONTAL ANGLE OF DIVERGENCE OR CONVERGENCE, θ , SHALL NOT EXCEED $5^{\circ} 45'$.
2. REINFORCING BAR STEEL SIZE, SPACING, AND OUTSIDE COVER SHALL BE THAT OF THE ADJOINING RCB SECTION WITHIN THE LIMITS INDICATED ON THE PLANS. FOR CURVED TRANSITIONS SPACE BARS ON CENTER LINE, AND PLACE TRANSVERSE STEEL RADIALLY. BAR LENGTHS AND DIMENSIONS SHALL VARY UNIFORMLY THROUGHOUT TRANSITION. LONGITUDINAL BARS SHALL BE CONTINUED THROUGH THE JOINTS WITH THE TRANSITION STRUCTURE.
3. CONCRETE THICKNESS SHALL BE THAT OF ADJOINING RCB SECTION WITHIN THE LIMITS INDICATED ON THE PLANS.
4. PLAN AS SHOWN IS FOR TRIPLE RCB SECTION DOWNSTREAM. WHEN TRIPLE RCB SECTION IS UPSTREAM REVERSE THE RADIUS AT ENDS OF DIVISION WALLS AS FOLLOWS:
 - (A) TAPER THE LAST 24" (600 mm) OF TRIPLE RCB DIVISION WALLS TO END IN 1 1/2" (40 mm) RADIUS.
 - (B) THE 24" (600 mm) EXTENSION OF CENTER WALL OF DOUBLE RCB SHALL BE OF UNIFORM THICKNESS, T_4 , ENDING IN RADIUS = $1/2T_4$.
5. $f'_c = 4000$ PSI (28 MPa) AT 28 DAYS AND CONCRETE SHALL BE THE SAME MIX AS THE ADJACENT RCB.
6. ALL STEEL, EXCEPT LONGITUDINAL STEEL SHALL BE GRADE 60 (400) BILLET STEEL CONFORMING TO ASTM A 615 (A 615 M) AND SHALL TERMINATE 1 1/2" (40 mm) CLEAR OF CONCRETE SURFACE UNLESS OTHERWISE SHOWN.
7. TRANSVERSE JOINT KEYWAYS, AS DETAILED FOR LONGITUDINAL JOINT KEYWAYS AT BASE OF OUTER WALLS ON THE PLANS, SHALL BE PLACED IN BOTH SLABS AND WALLS AT THE END OF EACH POUR.
8. THE TRANSITION STRUCTURE SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STRUCTURAL NOTES APPLYING TO THE RCB STRUCTURES SHOWN ON THE PLANS.

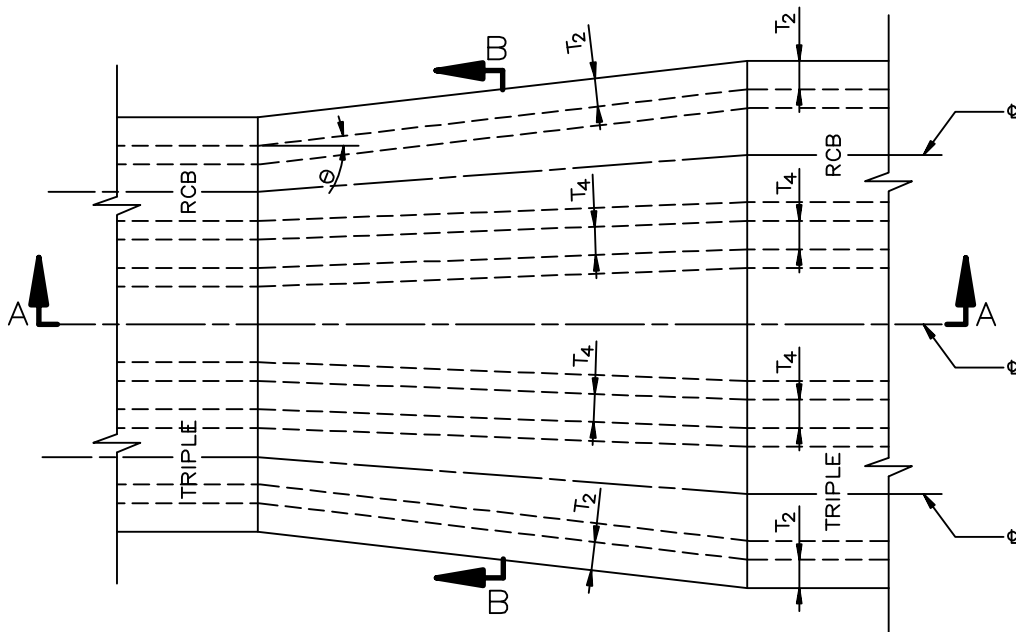

PLAN

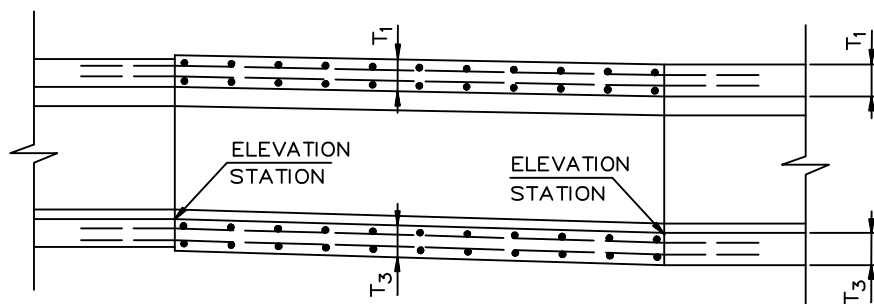

SECTION A-A

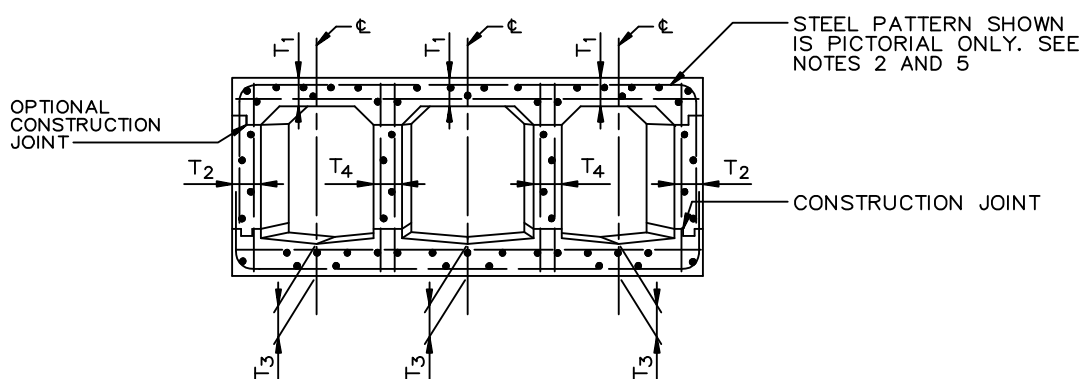

SECTION B-B

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1995, 2009

TRANSITION STRUCTURE
TRIPLE RCBI TO TRIPLE RCBI INLETS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

346-2

SHEET 1 OF 2

NOTES

1. THE HORIZONTAL ANGLE OF DIVERGENCE OR CONVERGENCE, θ , SHALL NOT EXCEED $5^{\circ} 45'$.
2. REINFORCING STEEL BAR SIZE, SPACING AND OUTSIDE COVER SHALL BE THAT OF THE LARGER SECTION. FOR CURVED TRANSITIONS, SPACE BARS ON CENTERLINE AND PLACE TRANSVERSE STEEL RADIALLY. BAR LENGTHS AND DIMENSIONS SHALL VARY UNIFORMLY THROUGHOUT TRANSITION. LONGITUDINAL BARS SHALL BE CONTINUED THROUGH THE JOINTS WITH THE TRANSITION STRUCTURE.
3. THE CONCRETE THICKNESS SHALL BE THAT OF THE LARGER RCB SECTION.
4. $f'_c = 4000$ PSI (28 MPa) AT 28 DAYS AND THE CONCRETE SHALL BE THE SAME MIX AS THE ADJACENT RCB.
5. ALL STEEL, EXCEPT LONGITUDINAL STEEL SHALL BE GRADE 60 (400) BILLET STEEL CONFORMING TO ASTM A 615 (A 615 M) AND SHALL TERMINATE $1\ 1/2"$ (40 mm) CLEAR OF CONCRETE SURFACE UNLESS OTHERWISE SHOWN.
6. TRANSVERSE JOINT KEYWAYS, AS DETAILED FOR LONGITUDINAL JOINT KEYWAYS AT BASE OF OUTER WALLS ON THE PLANS, SHALL BE PLACED IN BOTH SLABS AND WALLS AT THE END OF EACH POUR.
7. THE TRANSITION STRUCTURE SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STRUCTURAL NOTES APPLYING TO RCB STRUCTURES SHOWN ON THE PLANS.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


**TRANSITION STRUCTURE
TRIPLE RCB TO TRIPLE RCB INLETS**

346-2

SHEET 2 OF 2

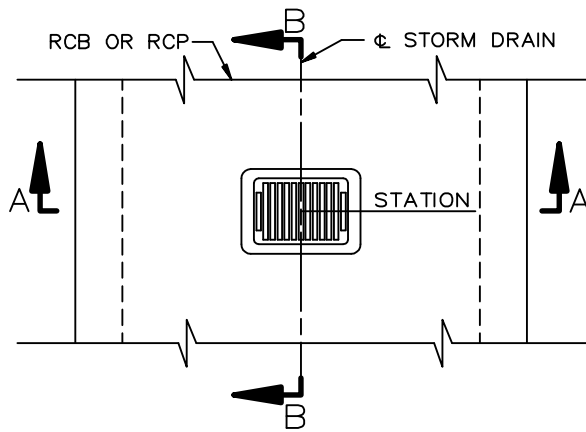

PLAN

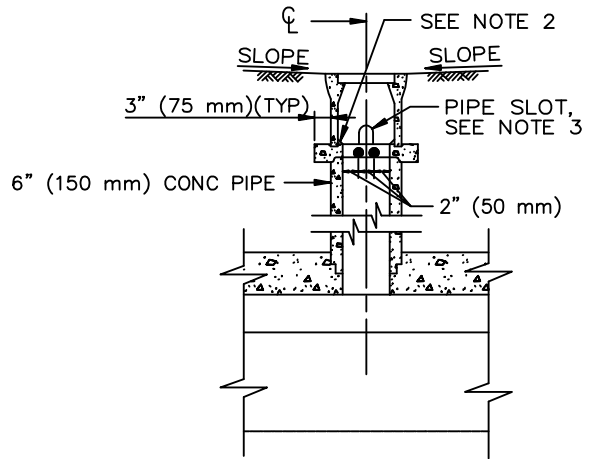


SECTION B - B


L BOLT GRATE LOCK SEE DETAIL "A" (TOP OF BOLT FLUSH WITH TOP OF GRATE)

SEE NOTE 2


9 1/2" (240 mm) x 16" (400 mm) UTILITY BOX WITH CAST IRON GRATE SUCH AS "QUIKSET" SERIES NO. WV-16, BROOKS PRODUCTS INC. NO. 3-TG, OR AGENCY APPROVED EQUAL

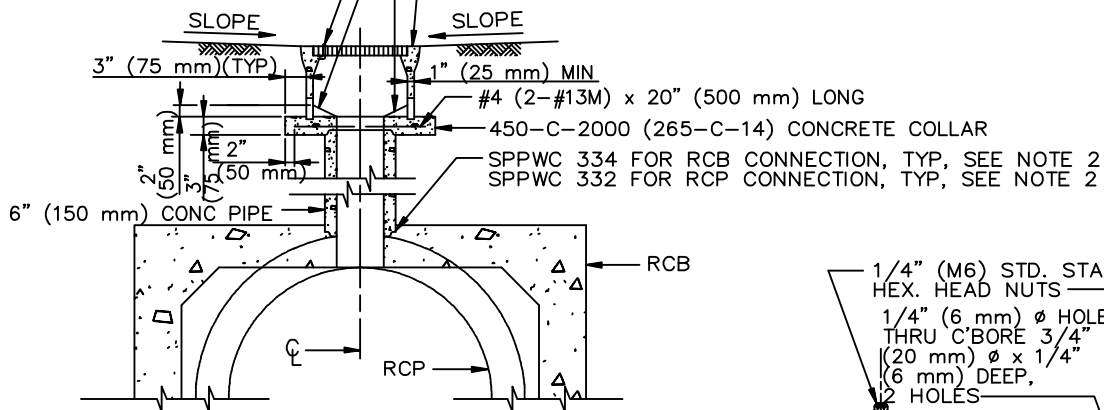

SECTION A - A

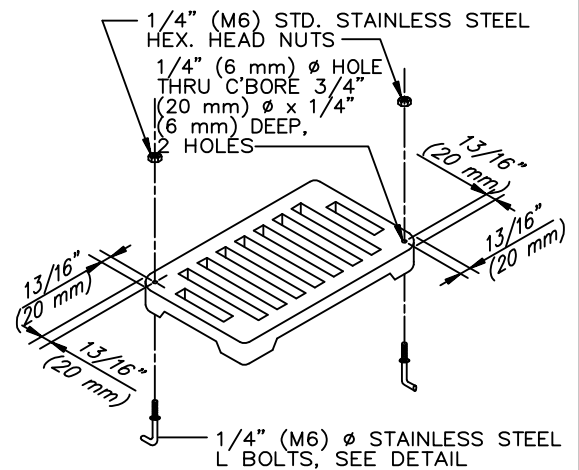

DETAIL "A"

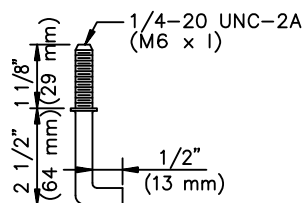

DETAIL OF L BOLT

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1984 REV. 1996, 2009

YARD INLET

STANDARD PLAN

350-2

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 2

NOTES

1. CONNECTOR PIPE

LOCATE PIPE AS INDICATED ON SHEET 1.

2. CONCRETE

FLOOR OF BASIN SHALL SLOPE FROM ALL WALLS TO THE OUTLET AND SHALL BE GIVEN A STEEL TROWELED SURFACE FINISH.

3" (75 mm) THICK CONCRETE ENCASEMENT SHALL BE USED IN LIEU OF 6" (150 mm) THICK CONCRETE ENCASEMENT WHEN REQUIRED BY SPPWC 332 OR 334.

3. GENERAL


GRATING AND BASIN ARE NOT DESIGNED FOR VEHICULAR TRAFFIC AND SHALL NOT BE USED IN LOCATIONS WHERE SUCH TRAFFIC WILL OCCUR.

EMBED UTILITY BOX 1/2" (15 mm) INTO CONCRETE COLLAR. SEAL PIPE SLOTS IN UTILITY BOX WALLS WITH CONCRETE.


4. THE FOLLOWING SPPWC ARE INCORPORATED HEREIN:

332 JUNCTION STRUCTURE PIPE TO PIPE (INLET I.D. \leq 24" (600 mm))

334 JUNCTION STRUCTURE PIPE TO BOX (INLET I.D. \leq 30" (750 mm))

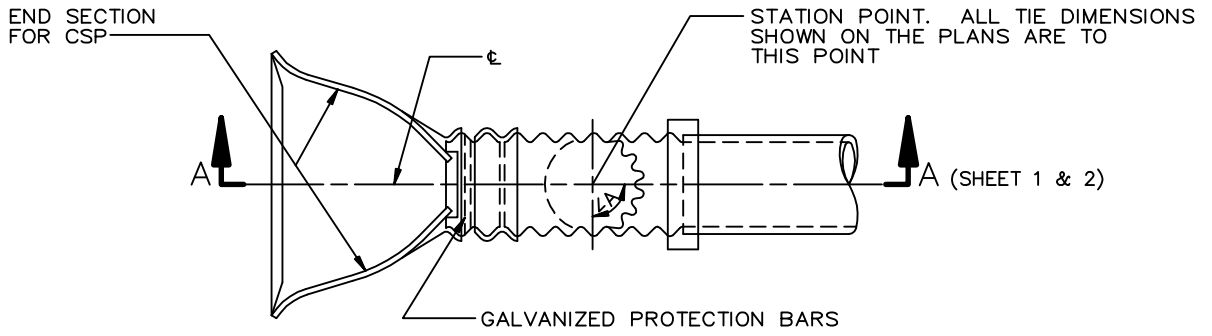

PLAN

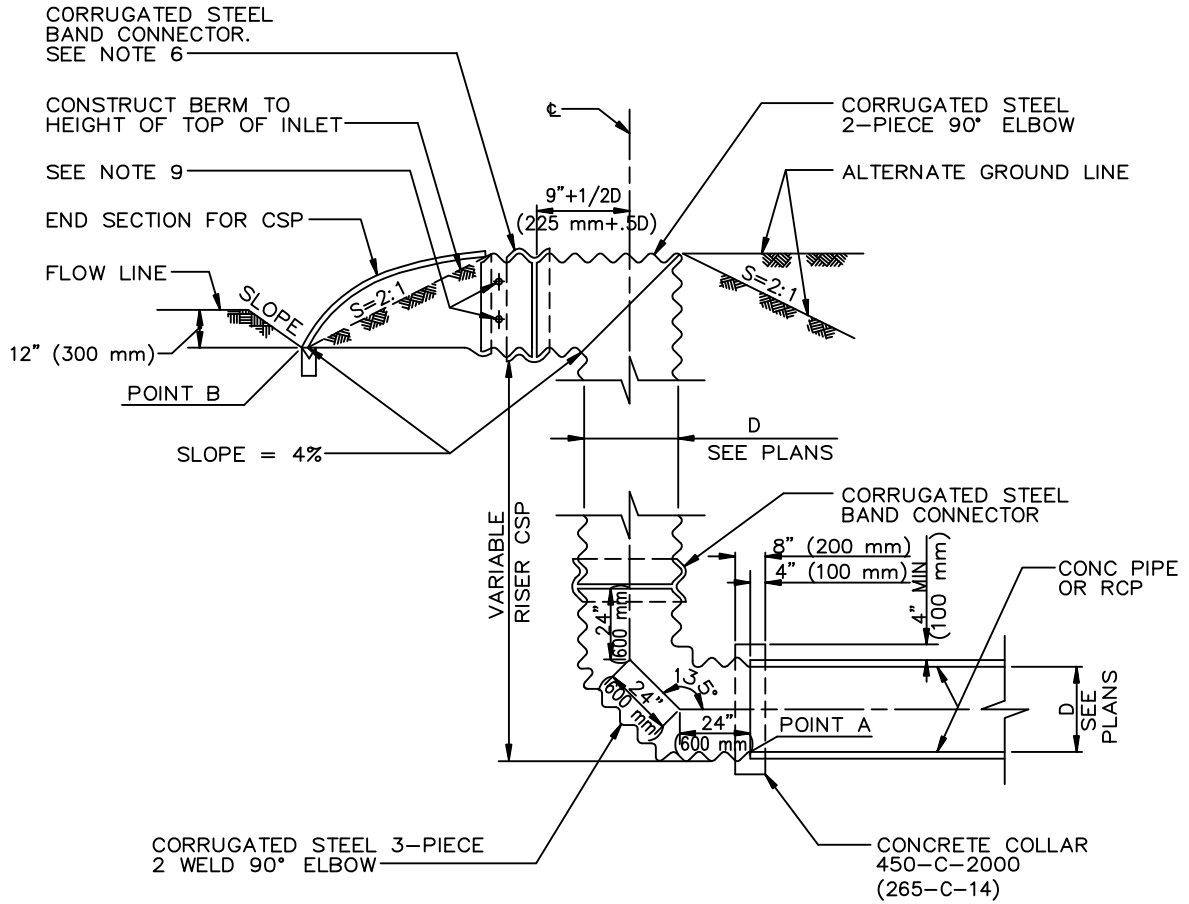

SECTION A-A
CASE 1

NOTE:
FOR CASE 2 & 3, SEE SHEET 2.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009


CSP FLARED INLET

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

351-2

SHEET 1 OF 3

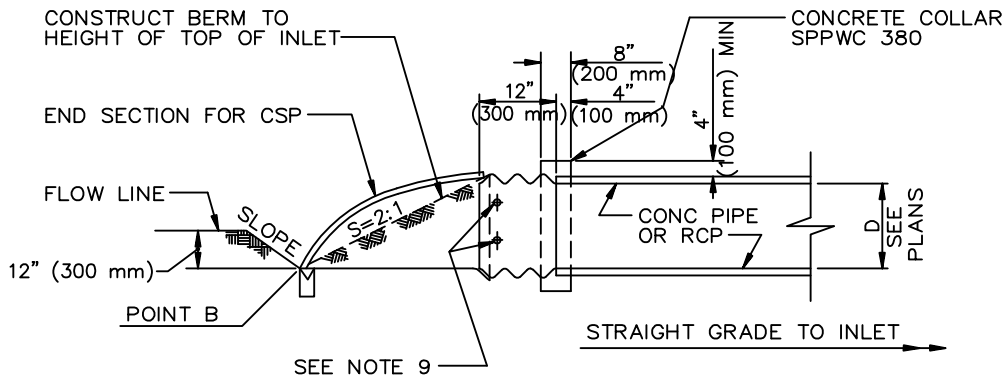


SECTION A-A (SHEET 1)
CASE 2

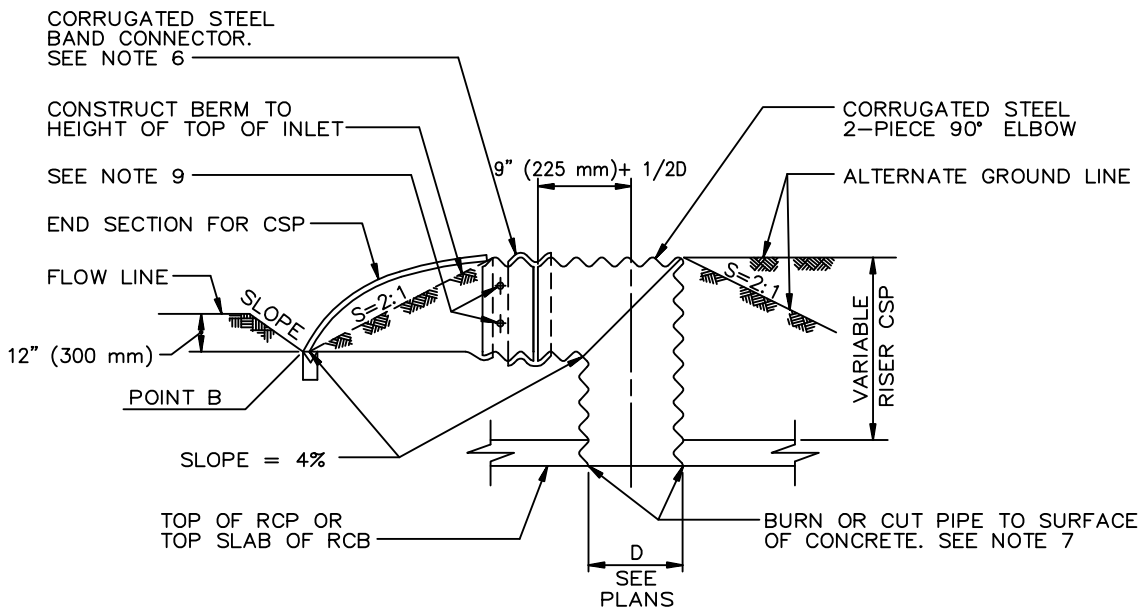


SECTION A-A (SHEET 1)
CASE 3

NOTES


1. ANGLE A MAY BE ANY ANGLE AS REQUIRED.
2. ELEVATION OF POINT A SHOWN ON PLANS.
3. POINT B SHALL BE PLACED 12" (300 mm) BELOW THE FLOW LINE OF EXISTING DITCH UNLESS OTHERWISE SPECIFIED ON PLANS. SLOPE SHALL BE SET IN FIELD BY THE ENGINEER.
4. THE HEIGHT OF THE RISER FOR CASE 1 & 3 SHALL VARY AS DETERMINED BY THE ELEVATION OF POINTS A & B, OR BY THE TOP OF STORM DRAIN CONDUIT AND ELEVATION OF POINT B.
5. CORRUGATED STEEL BAND CONNECTOR IS NOT REQUIRED FOR INLET SIZES 24" (600 mm) DIAMETER OR LESS.
6. IN ALL CASES, CONNECTION TO THE STORM DRAIN CONDUIT SHALL BE IN ACCORDANCE WITH THE APPLICABLE JUNCTION STRUCTURE, TRANSITION STRUCTURE, OR MANHOLE.
7. ALL CSP AND FITTINGS SHALL BE GALVANIZED.
8. PUNCH HOLES IN CSP AND WELD 3/4" (20 mm) GALVANIZED BARS HORIZONTALLY IN PLACE ACROSS OPENING.
9. COAT WELDED, CUT AND ABRADED SURFACES AS SPECIFIED IN SSPWC 210-3.5.
10. INLET SHALL NOT BE USED IN WATER COURSES SUBJECT TO DEBRIS FLOWS. A STRUCTURE HAVING A PROTECTION BARRIER SHOULD BE USED.
11. END SECTION MAY BE ARMCO STANDARD END SECTION, BETHLEHEM STEEL CO. FLARED END SECTION FOR CSP, OR AN AGENCY-APPROVED EQUAL.

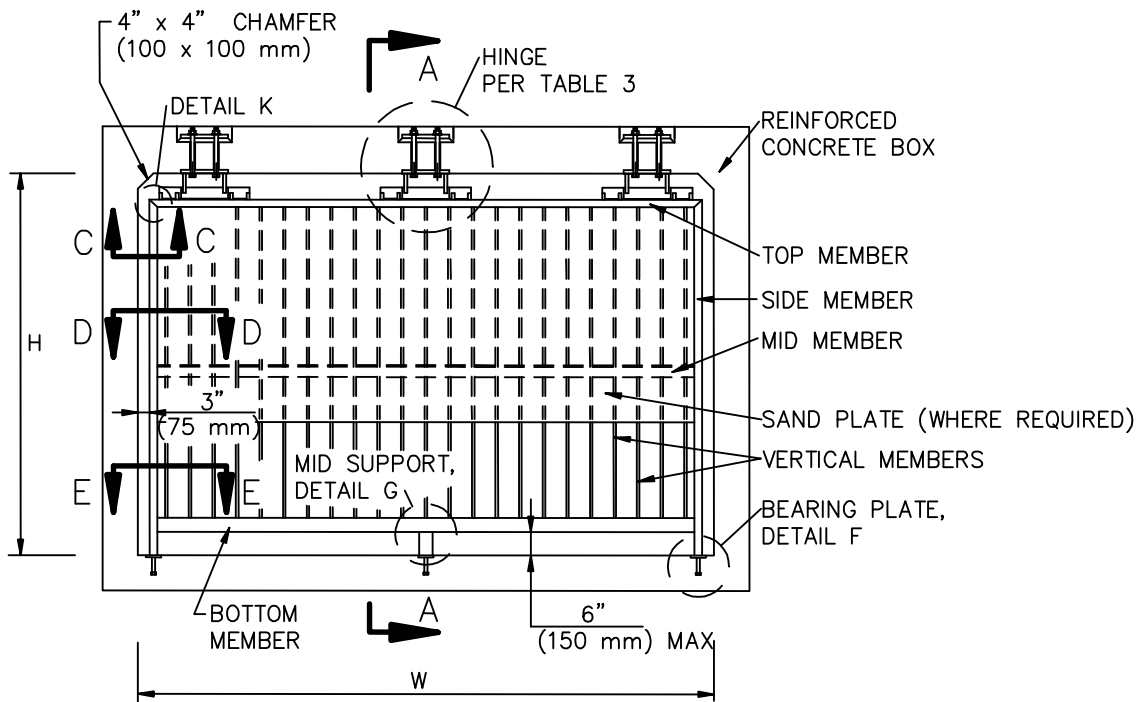

THREE-HINGED INLET/OUTLET BARRIER
FOR RCB

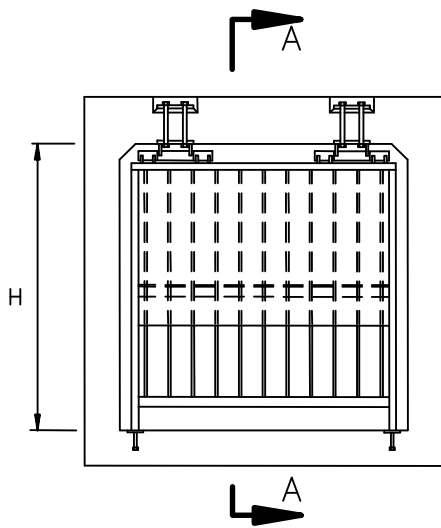

TWO-HINGED
INLET/OUTLET BARRIER
FOR RCB

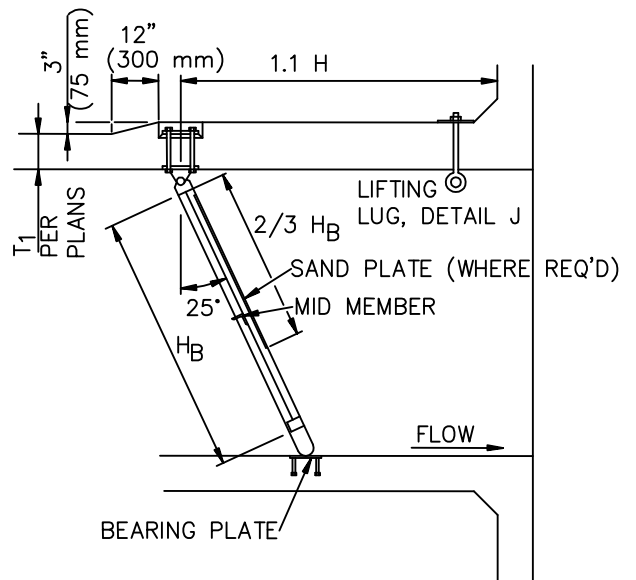

SECTION A-A

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 2005, 2009


SLOPED PROTECTION BARRIER

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


360-2

SHEET 1 OF 8

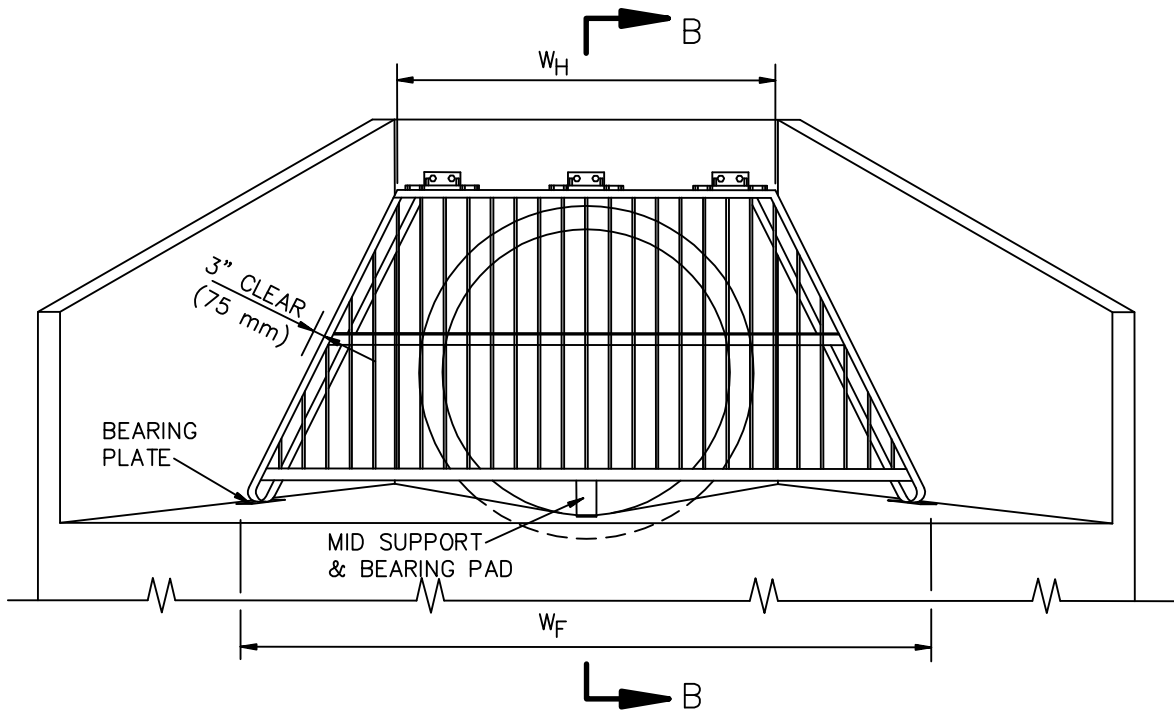

TRAPEZOIDAL OUTLET BARRIER
FOR RCP

FOR TRAPEZOIDAL OUTLET BARRIERS, USE W_H TO DETERMINE NUMBER AND SIZE OF HINGES AND USE W_F TO DETERMINE REQUIRED FRAME MEMBER SIZES.

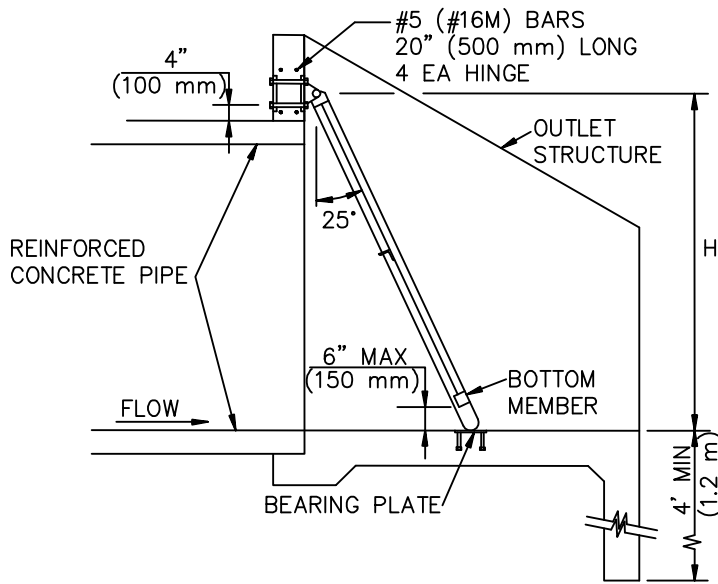

SECTION B-B

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

SLOPED PROTECTION BARRIER

360-2

SHEET 2 OF 8

TABLE 1 – STANDARD INLET/OUTLET

BOX SIZE, W x H	VERTICAL BARS, (mm)	TOP MEMBER	SIDE MEMBERS	BOTTOM MEMBER
4'x4'	(1.2 x 1.2 m)	C 4x7.25 (C 102 x 10.8)	C 4x7.25 (C 102 x 10.8)	TS 2x2x0.250 (TS 51 x 51 x 6)
4'x6'	(1.2 x 1.8)	C 4x7.25 (C 102 x 10.8)	C 4x7.25 (C 102 x 10.8)	TS 2x2x0.250 (TS 51 x 51 x 6)
4'x8'	(1.2 x 2.4)	C 5x9 (C 127 x 13.4)	C 5x9 (C 127 x 13.4)	TS 3x3x0.250 (TS 76 x 76 x 6)
6'x4'	(1.8 x 1.2)	C 4x7.25 (C 102 x 10.8)	C 4x7.25 (C 102 x 10.8)	TS 2x2x0.250 (TS 51 x 51 x 6)
6'x6'	(1.8 x 1.8)	C 4x7.25 (C 102 x 10.8)	C 4x7.25 (C 102 x 10.8)	TS 2.5x2.5x0.250 (TS 64 x 64 x 6)
6'x8'	(1.8 x 2.4)	C 5x9 (C 127 x 13.4)	C 5x9 (C 127 x 13.4)	TS 3.5x3.5x0.250 (TS 89 x 89 x 6)
6'x10'	(1.8 x 3.0)	C 6x10.5 (C 152 x 15.6)	C 6x10.5 (C 152 x 15.6)	TS 4.5x4.5x0.250 (TS 114 x 114 x 6)
8'x4'	(2.4 x 1.2)	C 4x7.25 (C 102 x 10.8)	C 4x7.25 (C 102 x 10.8)	TS 2x2x0.250 (TS 51 x 51 x 6)
8'x6'	(2.4 x 1.8)	C 4x7.25 (C 102 x 10.8)	C 4x7.25 (C 102 x 10.8)	TS 2.5x2.5x0.250 (TS 64 x 64 x 6)
8'x8'	(2.4 x 2.4)	C 5x9 (C 127 x 13.4)	C 5x9 (C 127 x 13.4)	TS 3x3x0.250 (TS 76 x 76 x 6)
8'x10'	(2.4 x 3.0)	C 6x10.5 (C 152 x 15.6)	C 6x10.5 (C 152 x 15.6)	TS 4.5x4.5x0.250 (TS 114 x 114 x 6)
10'x6'	(3.0 x 1.8)	C 4x7.25 (C 102 x 10.8)	C 4x7.25 (C 102 x 10.8)	TS 2.5x2.5x0.250 (TS 64 x 64 x 6)
10'x8'	(3.0 x 2.4)	C 5x9 (C 127 x 13.4)	C 5x9 (C 127 x 13.4)	TS 3.5x3.5x0.250 (TS 89 x 89 x 6)
10'x10'	(3.0 x 3.0)	C 6x10.5 (C 152 x 15.6)	C 6x10.5 (C 152 x 15.6)	TS 4.5x4.5x0.250 (TS 114 x 114 x 6)
12'x6'	(3.6 x 1.8)	C 5x9 (C 127 x 13.4)	C 5x9 (C 127 x 13.4)	TS 3x3x0.250 (TS 76 x 76 x 6)
12'x8'	(3.6 x 2.4)	C 5x9 (C 127 x 13.4)	C 5x9 (C 127 x 13.4)	TS 3.5x3.5x0.250 (TS 89 x 89 x 6)
12'x10'	(3.6 x 3.0)	C 6x10.5 (C 152 x 15.6)	C 6x10.5 (C 152 x 15.6)	TS 4.5x4.5x0.250 (TS 114 x 114 x 6)
14'x6'	(4.2 x 1.8)	C 5x9 (C 127 x 13.4)	C 5x9 (C 127 x 13.4)	TS 3x3x0.250 (TS 76 x 76 x 6)
14'x8'	(4.2 x 2.4)	C 6x10.5 (C 152 x 15.6)	C 6x10.5 (C 152 x 15.6)	TS 4x4x0.250 (TS 102 x 102 x 6)
14'x10'	(4.2 x 3.0 m)	C 7x12.25 (C 178 x 18.2)	C 7x12.25 (C 178 x 18.2)	TS 5x5x0.250 (TS 127 x 127 x 6)

TABLE 2 – OCEAN OUTLET

BOX SIZE, W x H	VERTICAL BARS, (mm)	TOP MEMBER	SIDE MEMBERS	BOTTOM MEMBER
4'x4'	(1.2 x 1.2 m)	C 5x9 (C 127 x 13.4)	C 5x9 (C 127 x 13.4)	TS 3x3x0.250 (TS 76 x 76 x 6)
4'x6'	(1.2 x 1.8)	C 6x13 (C 152 x 15.2)	C 6x8.2 (C 152 x 15.2)	TS 4x2x0.313 (TS 102 x 51 x 8)
4'x8'	(1.2 x 2.4)	C 8x18.75 (C 203 x 17.1)	C 8x11.5 (C 203 x 17.1)	TS 6x2x0.250 (TS 152 x 51 x 6)
6'x4'	(1.8 x 1.2)	C 6x13 (C 152 x 15.2)	C 6x8.2 (C 152 x 15.2)	TS 4x3x0.313 (TS 102 x 76 x 8)
6'x6'	(1.8 x 1.8)	C 6x13 (C 152 x 15.2)	C 6x8.2 (C 152 x 15.2)	TS 4x4x0.500 (TS 102 x 102 x 13)
6'x8'	(1.8 x 2.4)	C 8x18.75 (C 203 x 17.1)	C 8x11.5 (C 203 x 17.1)	TS 6x4x0.375 (TS 152 x 102 x 1)
6'x10'	(1.8 x 3.0)	C 9x20 (C 229 x 19.9)	C 9x13.4 (C 229 x 19.9)	TS 7x4x0.375 (TS 178 x 102 x 10)
8'x4'	(2.4 x 1.2)	C 5x9 (C 127 x 13.4)	C 5x9 (C 127 x 13.4)	TS 3x3x0.250 (TS 76 x 76 x 6)
8'x6'	(2.4 x 1.8)	C 6x13 (C 152 x 15.2)	C 6x8.2 (C 152 x 15.2)	TS 4x3x0.250 (TS 102 x 76 x 6)
8'x8'	(2.4 x 2.4)	C 8x18.75 (C 203 x 17.1)	C 8x11.5 (C 203 x 17.1)	TS 6x2x0.250 (TS 152 x 51 x 6)
8'x10'	(2.4 x 3.0)	C 9x20 (C 229 x 19.9)	C 9x13.4 (C 229 x 19.9)	TS 7x3x0.250 (TS 178 x 76 x 6)
10'x6'	(3.0 x 1.8)	C 6x13 (C 152 x 15.2)	C 6x8.2 (C 152 x 15.2)	TS 4x4x0.313 (TS 102 x 102 x 8)
10'x8'	(3.0 x 2.4)	C 8x18.75 (C 203 x 17.1)	C 8x11.5 (C 203 x 17.1)	TS 6x4x0.313 (TS 152 x 102 x 8)
10'x10'	(3.0 x 3.0)	C 9x20 (C 229 x 19.9)	C 9x13.4 (C 229 x 19.9)	TS 7x3x0.313 (TS 178 x 76 x 8)
12'x6'	(3.6 x 1.8)	C 7x14.75 (C 178 x 14.6)	C 7x9.8 (C 178 x 14.6)	TS 5x4x0.313 (TS 127 x 102 x 8)
12'x8'	(3.6 x 2.4)	C 8x18.75 (C 203 x 17.1)	C 8x11.5 (C 203 x 17.1)	TS 6x4x0.375 (TS 152 x 102 x 10)
12'x10'	(3.6 x 3.0)	C 9x20 (C 229 x 19.9)	C 9x13.4 (C 229 x 19.9)	TS 7x4x0.375 (TS 178 x 102 x 10)
14'x6'	(4.2 x 1.8)	C 8x18.75 (C 203 x 17.1)	C 8x11.5 (C 203 x 17.1)	TS 6x4x0.375 (TS 152 x 102 x 10)
14'x8'	(4.2 x 2.4)	C 8x18.75 (C 203 x 17.1)	C 8x11.5 (C 203 x 17.1)	TS 6x6x0.375 (TS 152 x 512 x 10)
14'x10'	(4.2 x 3.0 m)	C 9x20 (C 229 x 19.9)	C 9x13.4 (C 229 x 19.9)	TS 7x5x0.500 (TS 178 x 127 x 13)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

SLOPED PROTECTION BARRIER

360-2





SHEET 3 OF 8

TABLE 3 - HINGES


BOX SIZE, W x H	NO. OF HINGES	HINGE SIZE
4'x4' (1.2 x 1.2 m)	2	12" (300)
4'x6' (1.2 x 1.8)	2	12" (300)
4'x8' (1.2 x 2.4)	2	12" (300)
6'x4' (1.8 x 1.2)	2	18" (450)
6'x6' (1.8 x 1.8)	2	18" (450)
6'x8' (1.8 x 2.4)	2	18" (450)
6'x10' (1.8 x 3.0)	2	18" (450)
8'x4' (2.4 x 1.2)	3	12" (300)
8'x6' (2.4 x 1.8)	3	12" (300)
8'x8' (2.4 x 2.4)	3	12" (300)
8'x10' (2.4 x 3.0)	3	12" (300)
10'x6' (3.0 x 1.8)	3	18" (450)
10'x8' (3.0 x 2.4)	3	18" (450)
10'x10' (3.0 x 3.0)	3	18" (450)
12'x6' (3.6 x 1.8)	3	24" (600)
12'x8' (3.6 x 2.4)	3	24" (600)
12'x10' (3.6 x 3.0)	3	24" (600)
14'x6' (4.2 x 1.8)	3	24" (600)
14'x8' (4.2 x 2.4)	3	24" (600)
14'x10' (4.2 x 3.0 m)	3	24" (600)

TABLE 4 - HINGE CLEARANCES (mm)


D	X	Y
4" (10)	2" (50)	3" (75)
5" (127)	2 1/2" (65)	3 1/2" (90)
6" (152)	3" (75)	4" (100)
7" (178)	3 1/2" (90)	4 1/2" (115)
8" (203)	4" (100)	5" (125)
9" (229)	4" (100)	5" (125)

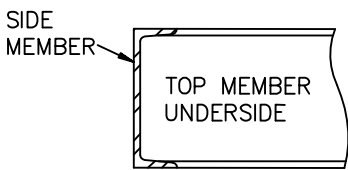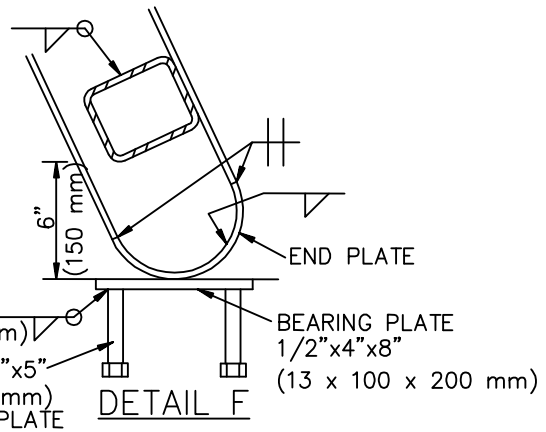


SECTION C-C

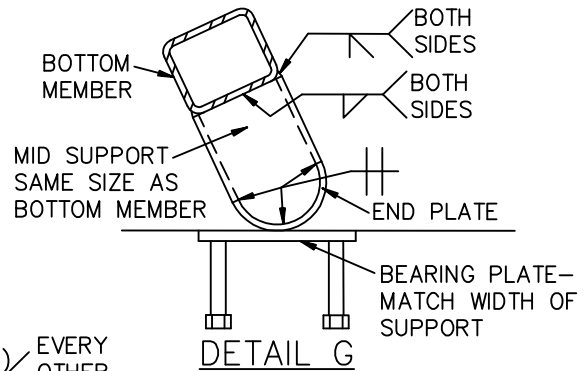


DETAIL G

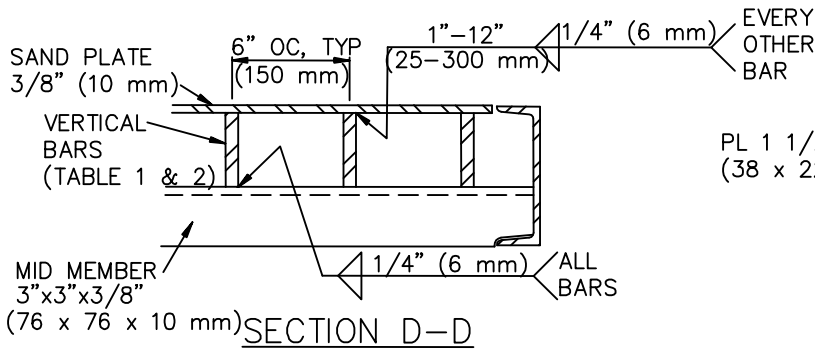

SECTION D-D

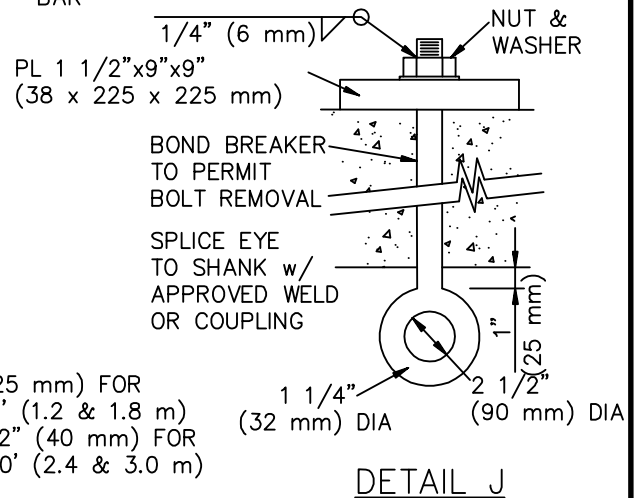


DETAIL J

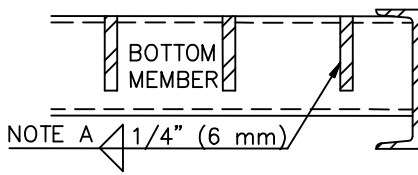


SECTION E-E


NOTE A:
 WELDS 1" (25 mm) FOR
 H = 4' & 6' (1.2 & 1.8 m)
 WELDS 1 1/2" (40 mm) FOR
 H = 8' & 10' (2.4 & 3.0 m)

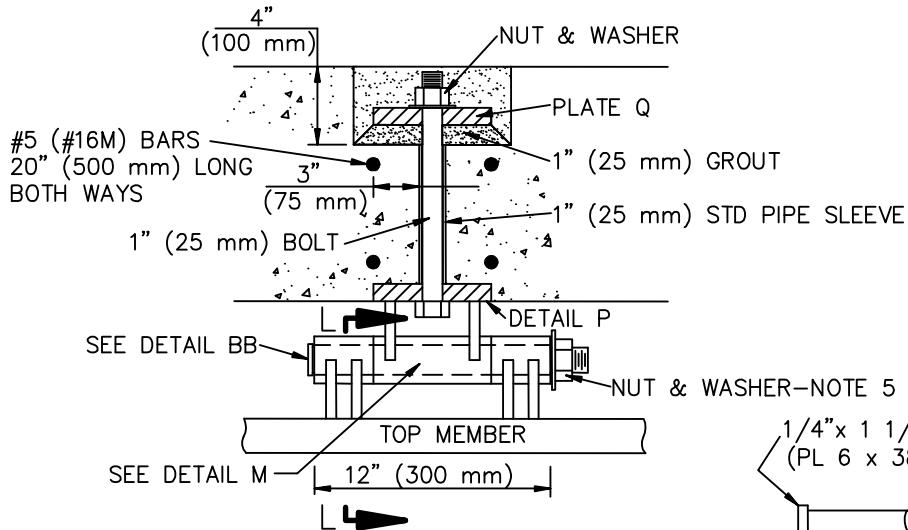

12" (300 mm) HINGE

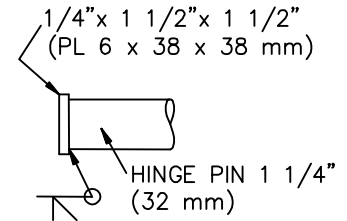


DETAIL BB

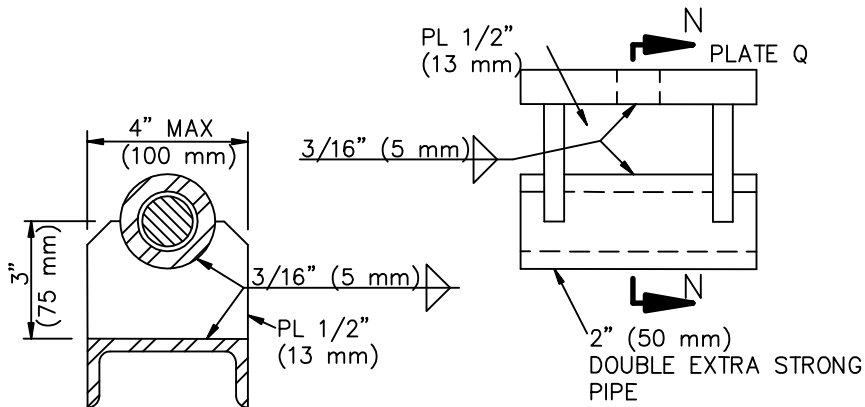


SECTION L-L

DETAIL M

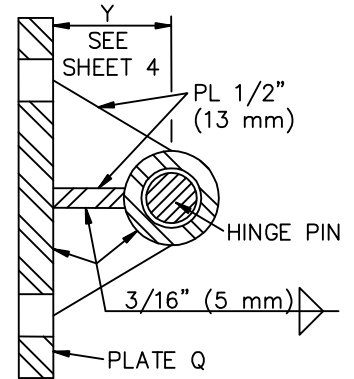

SECTION N-N

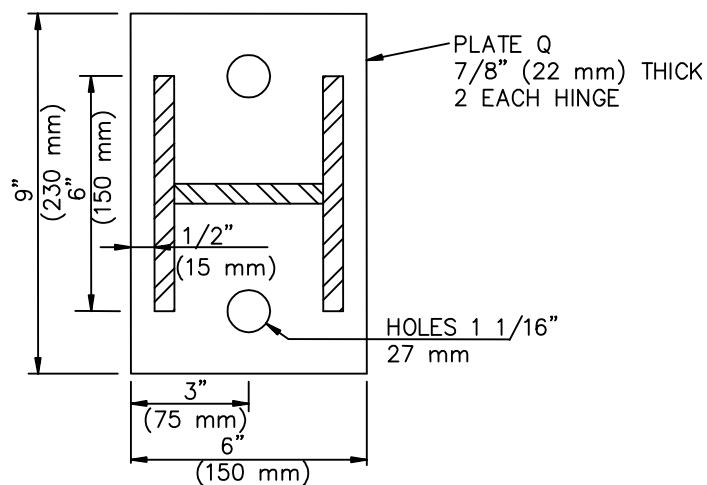

DETAIL P






STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION







STANDARD PLAN

SLOPED PROTECTION BARRIER

360-2

SHEET 5 OF 8

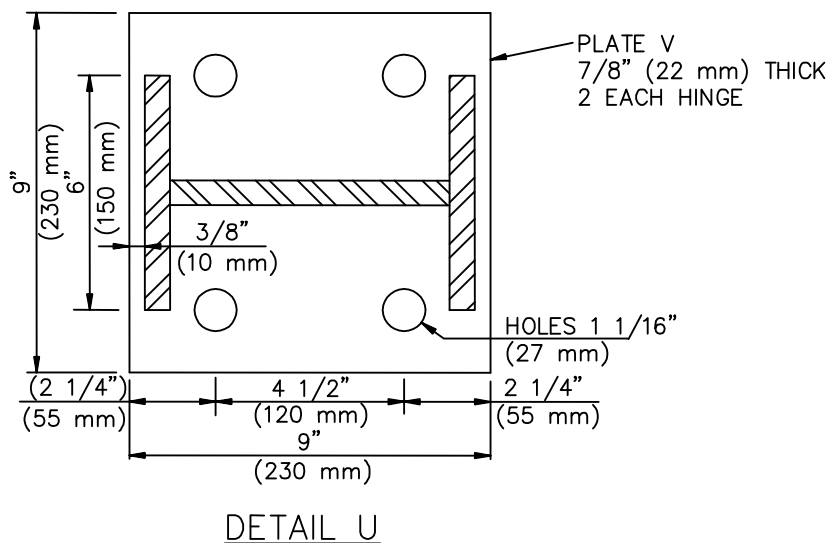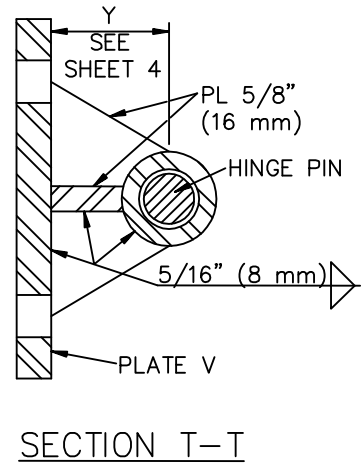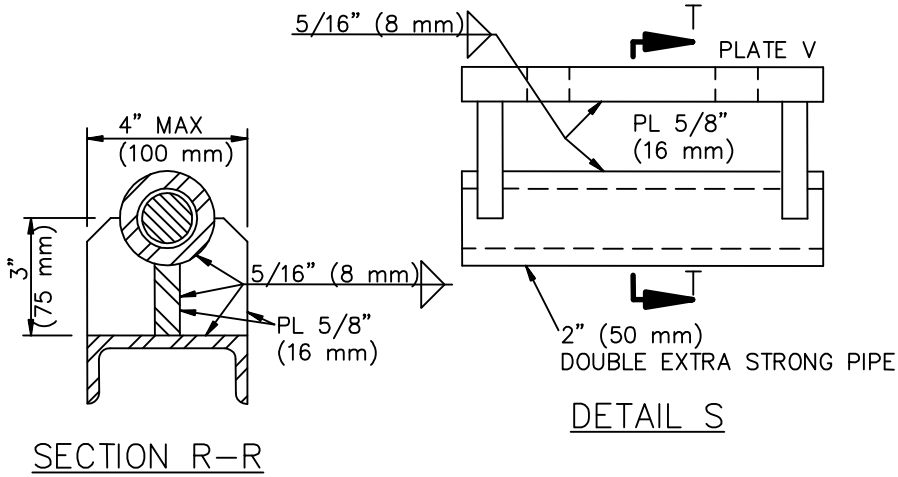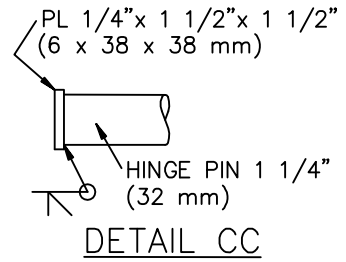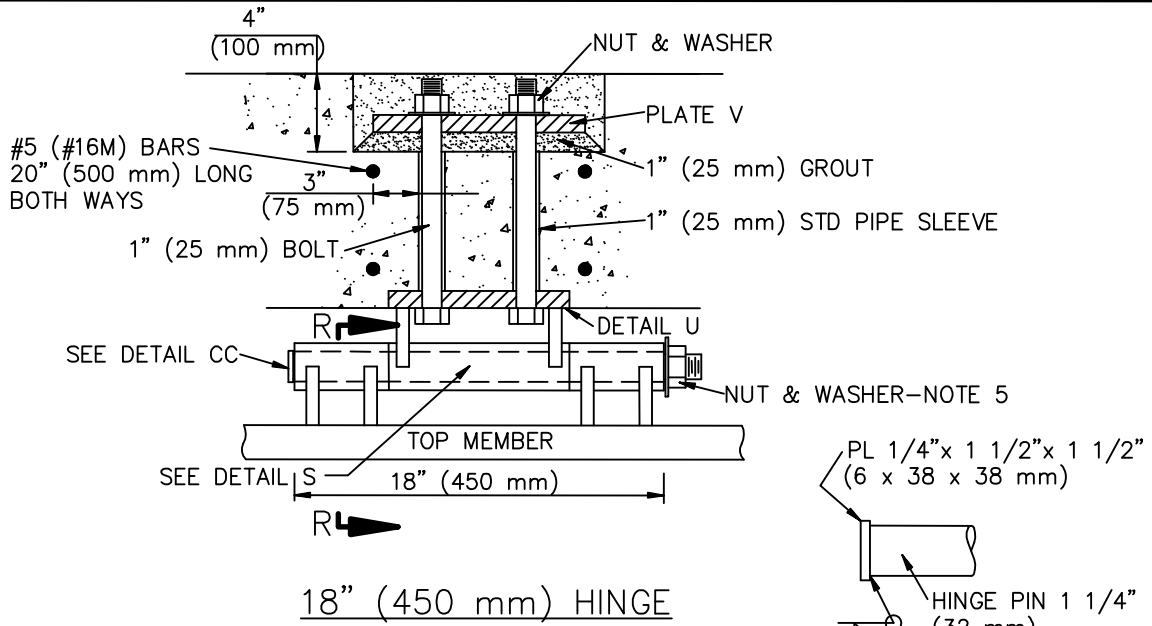

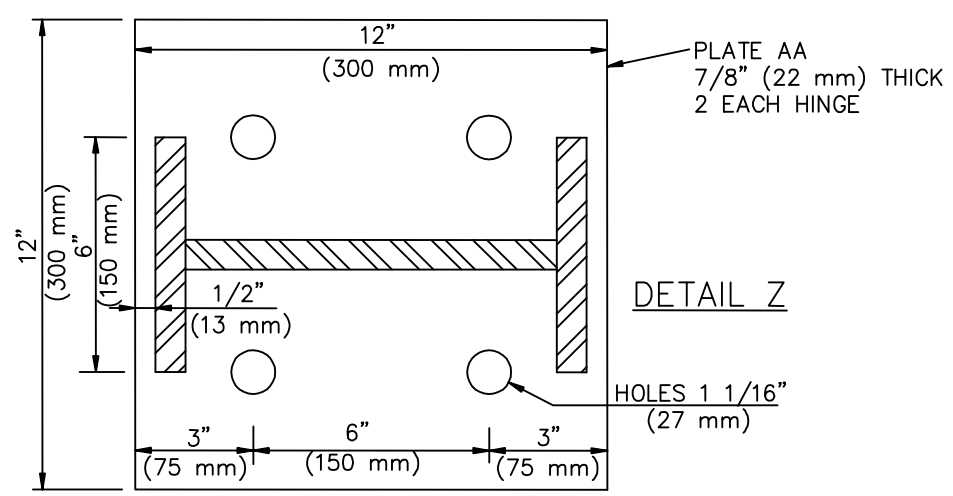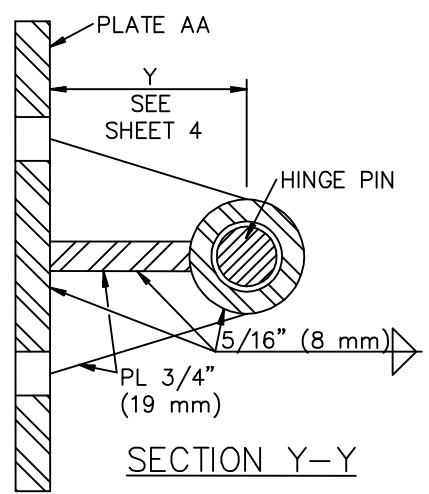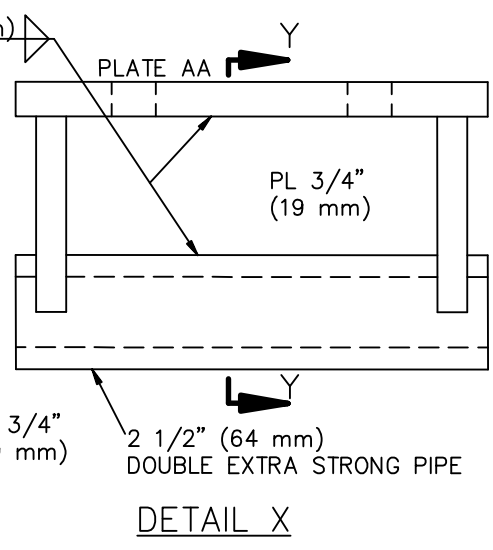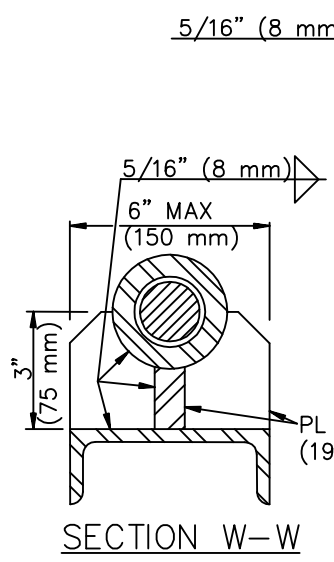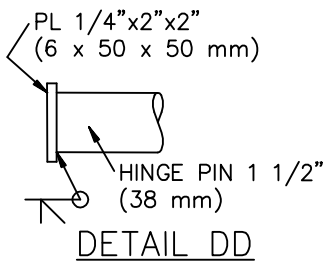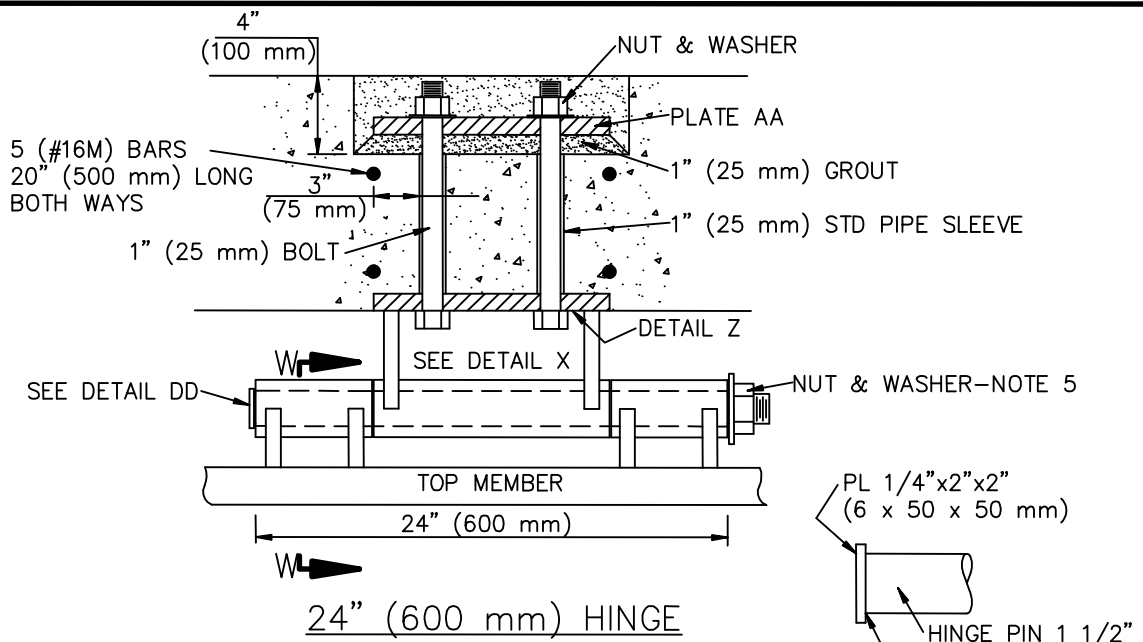

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

SLOPED PROTECTION BARRIER


STANDARD PLAN

360-2

SHEET 7 OF 8


NOTES:

1. SUBMIT FABRICATION ("SHOP") DRAWINGS FOR APPROVAL PER SSPWC 2-5.3.3.
2. WHENEVER THE REINFORCED CONCRETE BOX SIZE FALLS BETWEEN SIZES SHOWN IN THE TABLES, USE THE HINGE AND MEMBER SIZING FOR THE LARGER BOX SIZE SHOWN.
3. FRAME MEMBERS SHALL BE ASTM A 36 STEEL OR BETTER.
4. HINGE ASSEMBLIES AND BEARING PADS SHALL BE STAINLESS STEEL.
5. MAKE NECESSARY MODIFICATIONS TO ALLOW THE SIMPLE REMOVAL OR INSERTION OF HINGE PINS FOR INSTALLATION OR REMOVAL OF THE PROTECTION BARRIER. THREAD THE END OF HINGE PINS SO THAT NUTS AND LOCK WASHERS ARE FLUSH WITH THE HINGE SLEEVE PIPE. DAMAGE THE THREADS BEYOND THE NUT FACE TO PREVENT LOOSENING. SEE ALSO ALTERNATE DETAIL BELOW.
6. GALVANIZE FRAME MEMBERS AFTER FABRICATION.
7. MINIMIZE OR ELIMINATE WELDING AFTER GALVANIZING. REPAIR POST-FABRICATION WELDS IN ACCORDANCE WITH SSPWC 210-3.5.
8. INSTALL A MID SUPPORT FOR BARRIERS WITH THREE HINGES.
9. INSTALL SAND PLATES AT OCEAN OUTLETS.
10. DESIGN LOADS:
 - A. INLET/OUTLET BARRIER: BULKED EQUIVALENT FLUID DENSITY = 85 PCF
 - B. OCEAN OUTLET:
 1. 1,800 PSF (86 kPa) OVER SAND PLATE AREA
 2. 600 PSF (29 kPa) OVER LOWER OPEN AREA

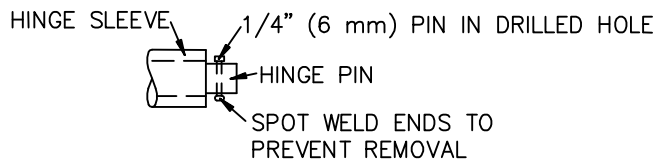

ALTERNATE HINGE PIN ATTACHMENT

USE ONLY WHERE APPROVED

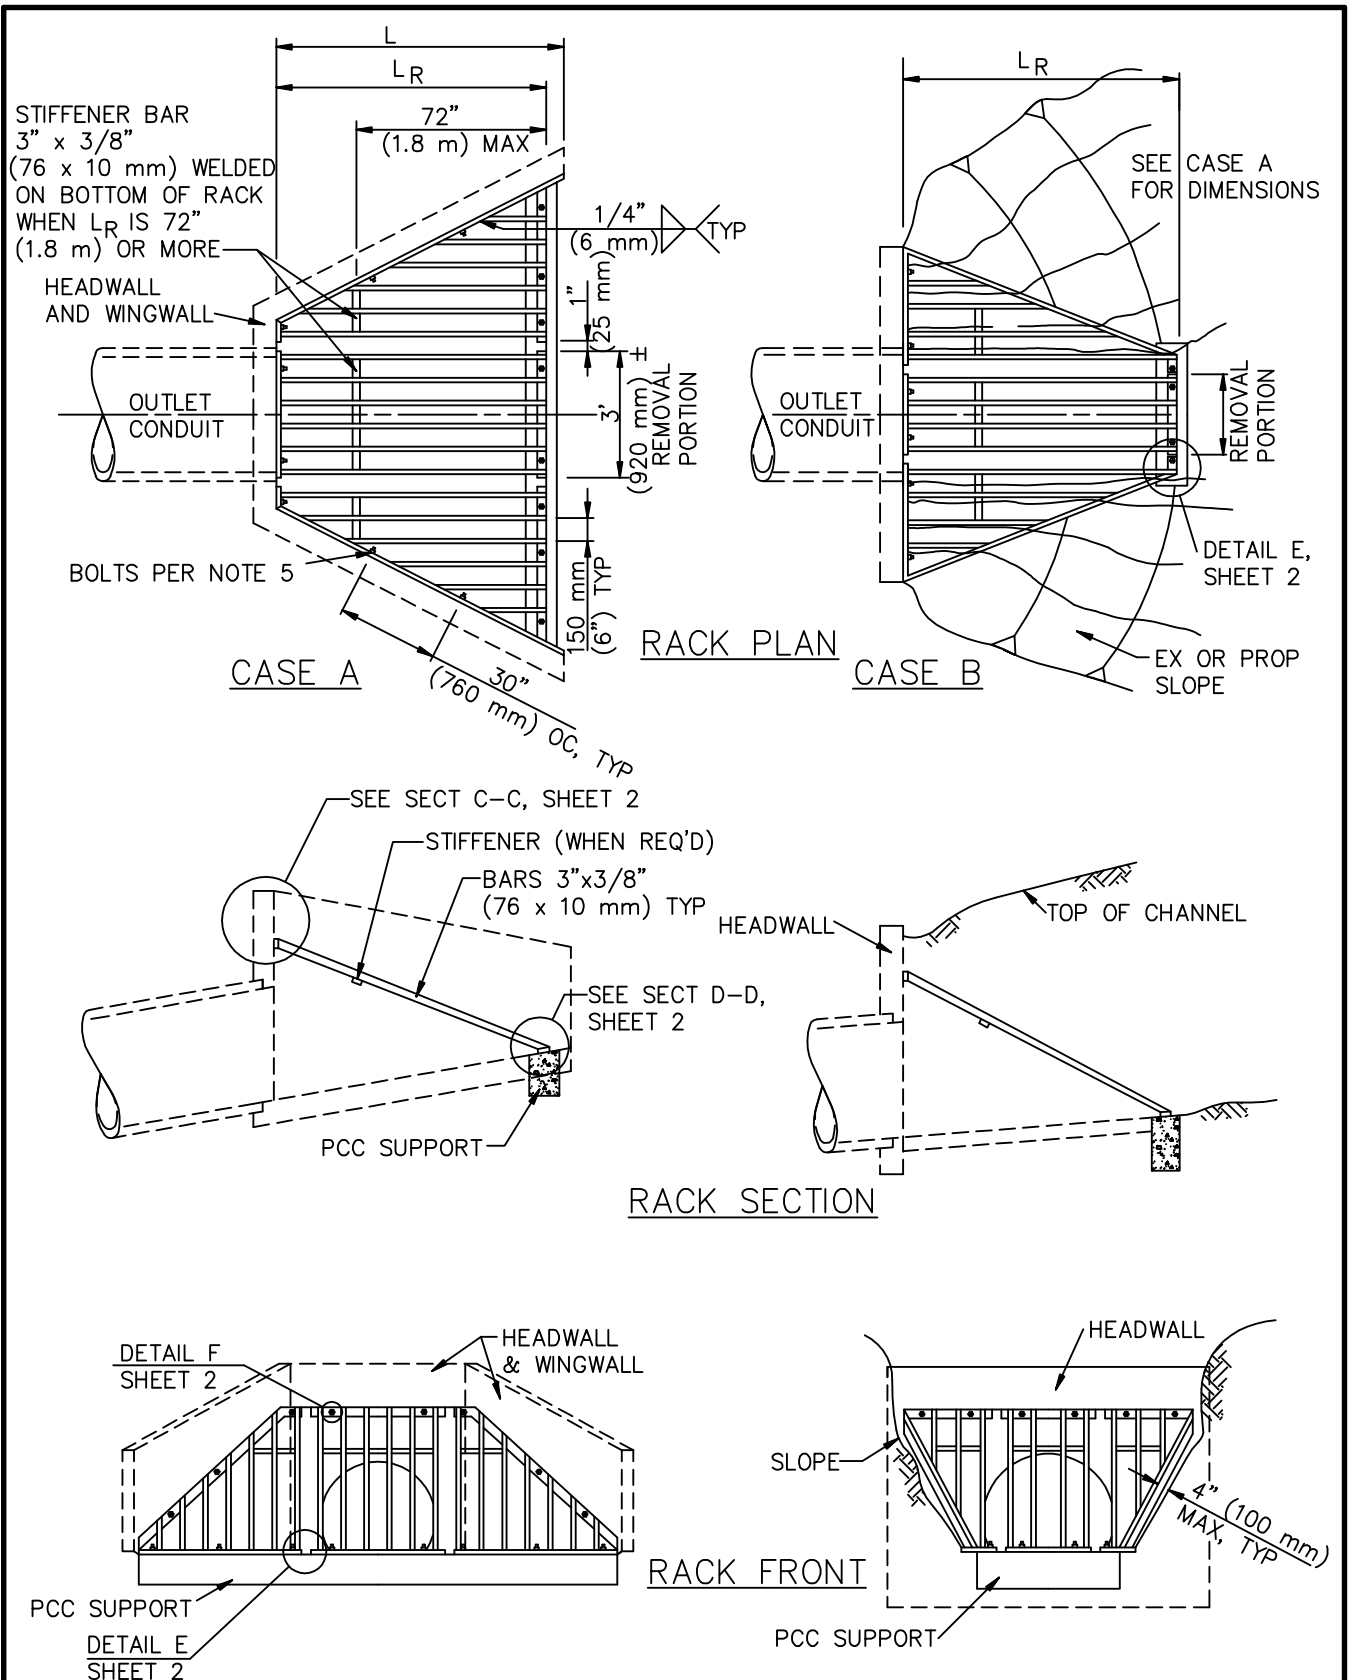

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 2005, 2009





TRASH RACK (INCLINED)

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION



STANDARD PLAN

361-2

SHEET 1 OF 2

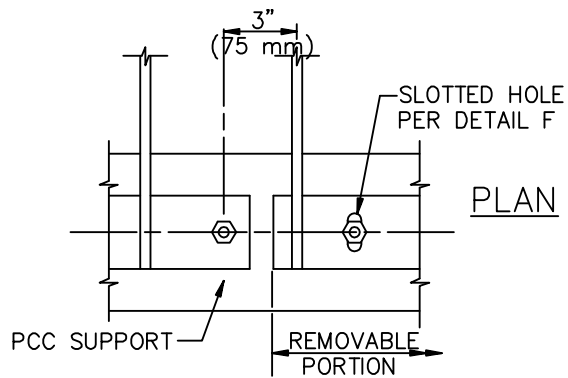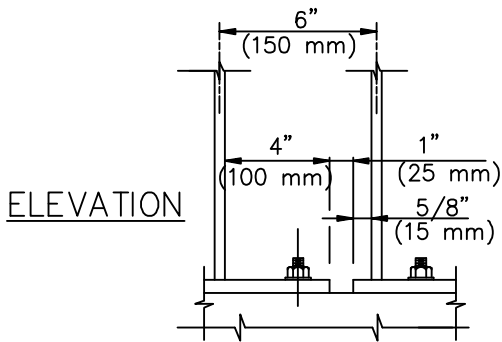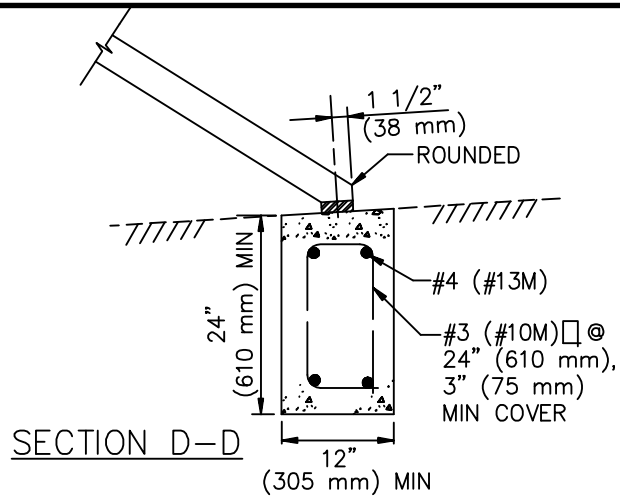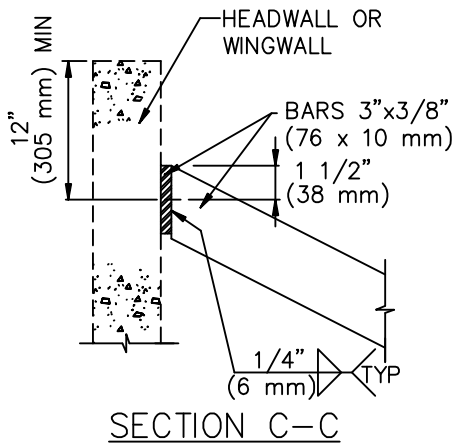

DETAIL E

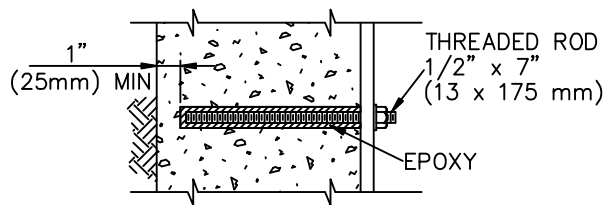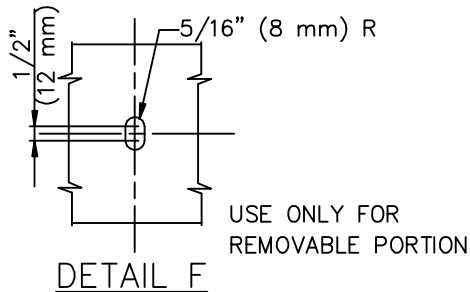

NOTES

1. MAXIMUM SIZE OF OUTLET FOR THIS RACK IS 48" (1200 mm) PIPE OR 48" (1.2 m) WIDE RCB. MAXIMUM LENGTH OF RACK L_R IS 10'-0" (3 m).
2. ADJUST L_R SO THAT THE SLOPE OF THE RACK IS APPROXIMATELY 2 HORIZONTAL TO 1 VERTICAL.
3. THE PCC SUPPORT IS NOT NEEDED IF THE INLET STRUCTURE HAS A SUITABLE CUTOFF WALL. THE PCC SUPPORT SHALL NOT REPLACE THE CUTOFF WALL.
4. GALVANIZE RACK AFTER FABRICATION.
5. BOLTS SHALL BE 1/2"x7" (13 x 175 mm). BOLTS FOR REMOVABLE PORTION SHALL BE STAINLESS STEEL. PROVIDE WASHERS AT EACH BOLT.
6. SUBMIT SHOP DRAWINGS PER SSPWC 2-5.3.3. FOR RETROFIT WORK, INCLUDE DETAILS FOR ATTACHMENT TO EXISTING STRUCTURE.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


TRASH RACK (INCLINED)

361-2

SHEET 2 OF 2

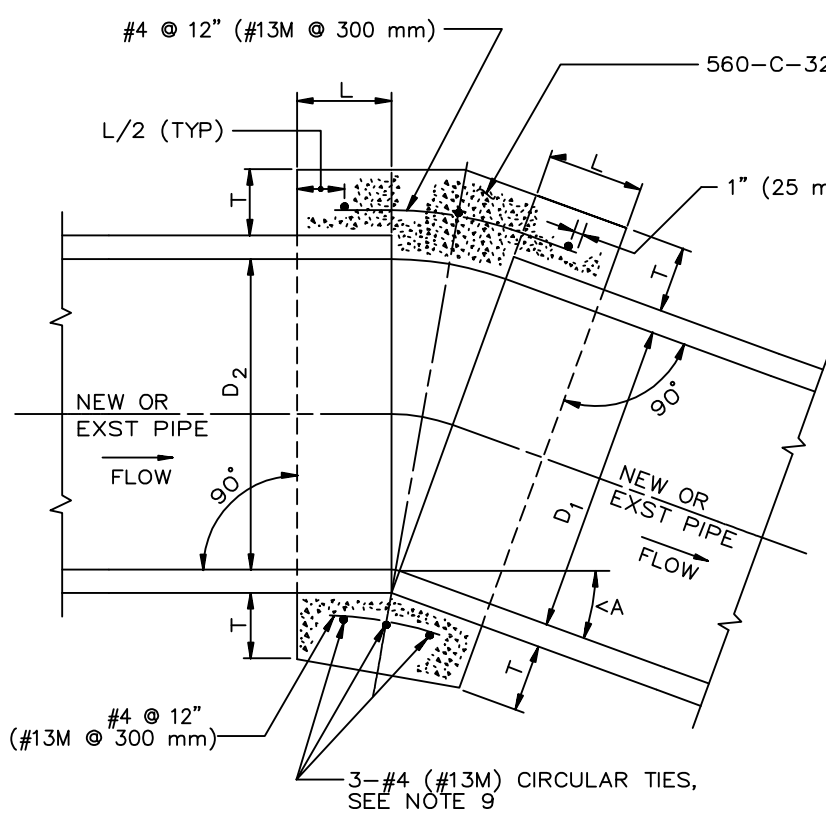


D	L	T
12" (300 mm)	12" (300 mm)	4" (100 mm)
18" (450 mm)	12" (300 mm)	5" (125 mm)
24" (600 mm)	12" (300 mm)	6" (150 mm)
30" (750 mm)	18" (450 mm)	7" (175 mm)
36" (900 mm)	18" (450 mm)	9" (225 mm)
42" (1050 mm)	18" (450 mm)	9" (225 mm)
48" (1200 mm)	18" (450 mm)	10" (250 mm)
57" (1425 mm)	18" (450 mm)	10" (250 mm)
60" (1500 mm)	21" (525 mm)	11" (275 mm)
66" (1650 mm)	21" (525 mm)	11" (275 mm)
72" (1800 mm)	24" (600 mm)	12" (300 mm)

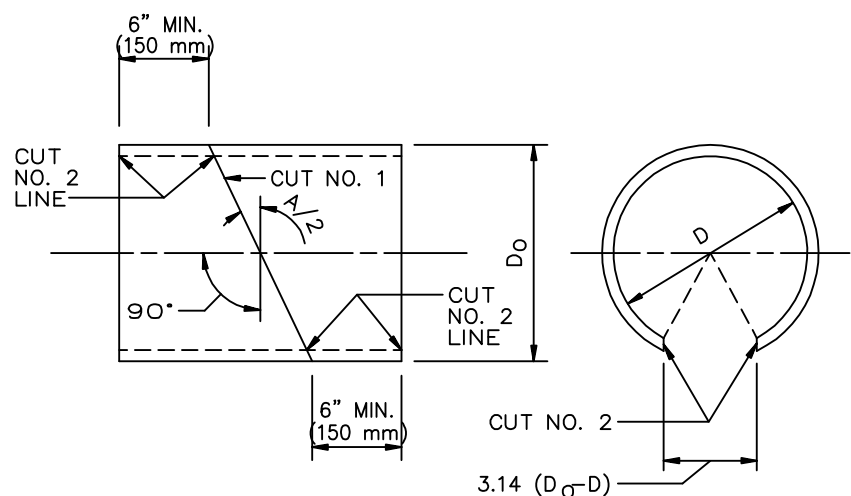

DETAIL "A" (SEE NOTE 10)
SONO-TUBE, OR EQUAL, INTERIOR FORM

CUT NO. 1: SAW THE TUBE AT AN ANGLE OF $A/2$ WITH THE TRANSVERSE PLANE. REVERSE ONE SECTION AND TAPE BOTH SECTIONS TOGETHER FORMING THE DEFLECTION ANGLE A.
CUT NO. 2: SAW THE TUBE LONGITUDINALLY REMOVING A STRIP $3.14 (D_0 - D)$ WIDE ON THE SIDE OPPOSITE THE OPEN JOINT. BEND THE ENDS OF THE CUT TOGETHER AND INSERT THE TUBE IN THE PIPE.

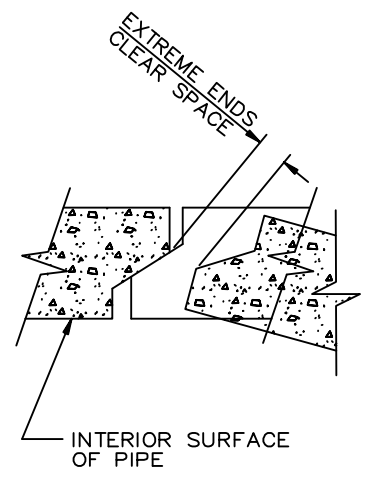

DETAIL "B"
TYPICAL JOINT FOR
REINFORCED CONCRETE PIPE

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1992
REV. 1996, 1997, 1999, 2009

12" (300 mm) THROUGH 72" (1800 mm)
CONCRETE COLLAR FOR RCP
USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
380-4
SHEET 1 OF 2

NOTES


1. A CONCRETE COLLAR IS REQUIRED WHERE THE CHANGE IN GRADE EXCEEDS 10%.
2. FOR CURVE JOINTS (SEE DETAIL B, SHEET 1)
 IF THE EXTREME ENDS OF THE PIPE LEAVE A CLEAR SPACE THAT IS GREATER THAN 1" (25 mm), BUT IS LESS THAN 3" (75 mm) A CONCRETE COVER IS REQUIRED IN ACCORDANCE WITH SSPWC 306-1.2.4.
 IF THE EXTREME ENDS OF THE PIPE LEAVE A CLEAR SPACE THAT IS EQUAL TO OR GREATER THAN 3" (75 mm), BUT LESS THAN 6" (150 mm), A CONCRETE COLLAR IS REQUIRED. IF THE CLEAR SPACE IS 6" (150 mm) OR GREATER, A TRANSITION STRUCTURE IS REQUIRED.
3. CONCRETE COLLAR SHALL NOT BE USED FOR A SIZE CHANGE ON THE MAIN LINE.
4. CONNECTOR PIPES
 - A. WHERE PIPES OF DIFFERENT DIAMETERS ARE JOINED WITH A CONCRETE COLLAR, L AND T SHALL BE THOSE OF THE LARGER PIPE. $D=D_1$ OR D_2 , WHICHEVER IS GREATER.
 - B. WHEN D_1 IS EQUAL TO OR LESS THAN D_2 , JOIN INVERTS AND WHEN D_1 IS GREATER THAN D_2 , JOIN SOFFITS.
5. FOR PIPE LARGER THAN 72" (1800 mm) SPECIAL COLLAR DETAILS ARE REQUIRED.
6. FOR PIPE SIZE NOT LISTED USE NEXT SIZE LARGER.
7. REINFORCEMENT SHALL CONFORM TO ASTM A 615 (A 615 M) GRADE 40 (300).
8. WHERE REINFORCING IS REQUIRED THE DIAMETER OF THE CIRCULAR TIES SHALL BE $D+(2X \text{ WALL THICKNESS}) + T$.
9. REINFORCING SHALL BE USED WHERE THE PIPE DIAMETER IS GREATER THAN 21" (525 mm) AND ON ALL PIPES WHERE THE SPACES BETWEEN THE EXTREME OUTER ENDS IS 3" (75 mm) OR LARGER.

CIRCULAR TIES:


PIPE DIAMETER	NO. OF CIRCULAR TIES
21" (525 mm) OR LESS	3
24" (600 mm) TO 30" (750 mm)	3
33" (825 mm) TO 57" (1425 mm)	4
60" (1500 mm) TO 72" (1800 mm)	5

WHERE THE SPACE BETWEEN PIPE ENDS EXCEEDS 3" (75 mm), THE NUMBER OF CIRCULAR TIES SHALL BE INCREASED TO MAINTAIN AN APPROXIMATE SPACING OF 6" (150 mm) O.C.


10. WHERE THE PIPE IS 21" (525 mm) OR LESS IN DIAMETER AN INTERIOR FORM OF UNSEALED SONO-TUBE OR EQUAL SHALL BE USED TO PROVIDE A SMOOTH INTERIOR JOINT. THE PAPER FORM MAY BE LEFT IN PLACE (SEE DETAIL A). WHEN THE PIPE IS 24" (600 mm) OR LARGER A REMOVABLE INTERIOR FORM SHALL BE USED OR THE INTERIOR JOINT SHALL BE COMPLETELY FILLED WITH MORTAR AND NEATLY POINTED.

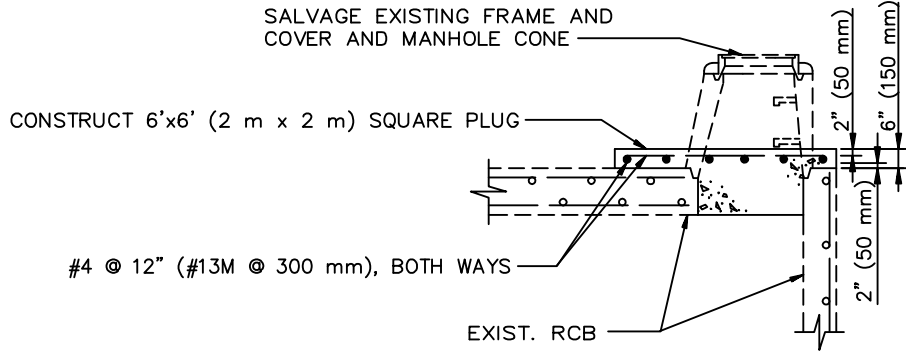


MANHOLE ABANDONMENT SEAL FOR RCB

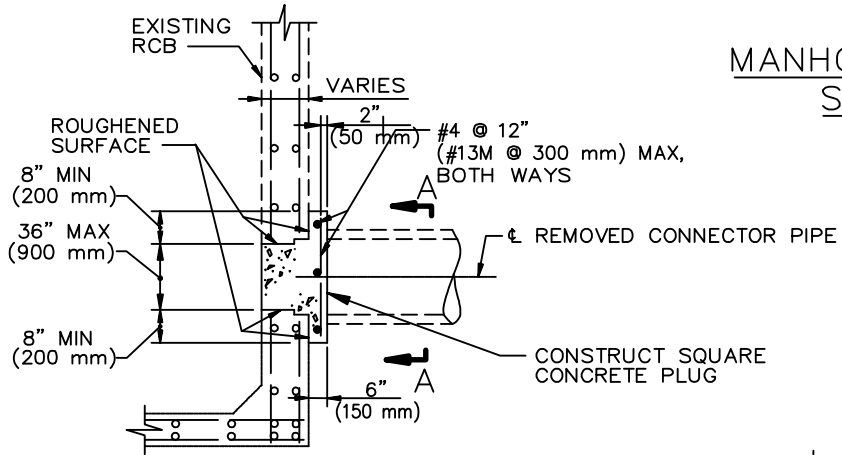

ABANDONMENT SEAL FOR RCB INLET

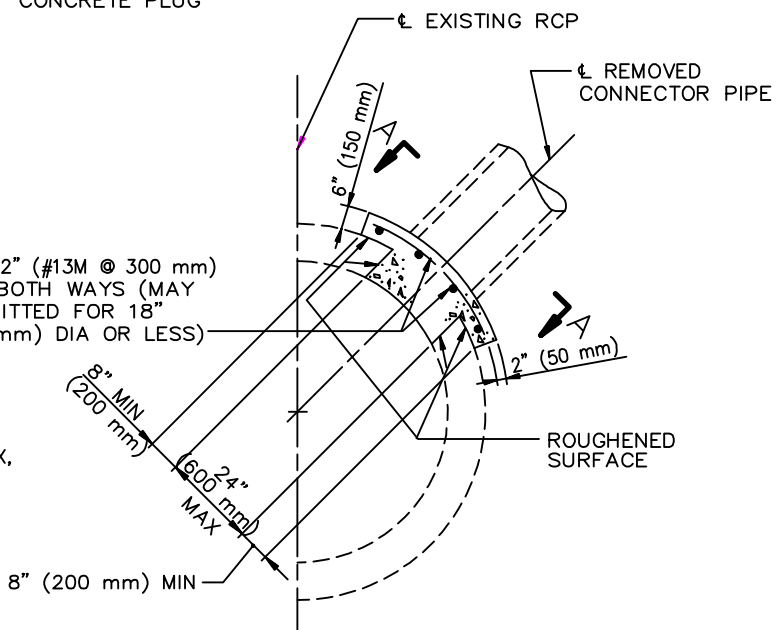

ABANDONMENT SEAL FOR RCP INLET

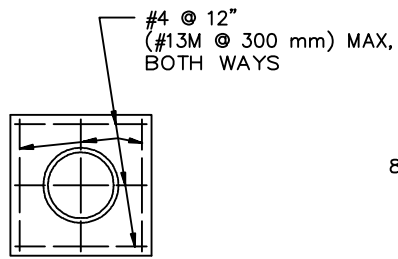

SECTION A-A


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009


**ABANDONMENT SEALS
FOR MANHOLES AND INLETS**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
381-2
SHEET 1 OF 1

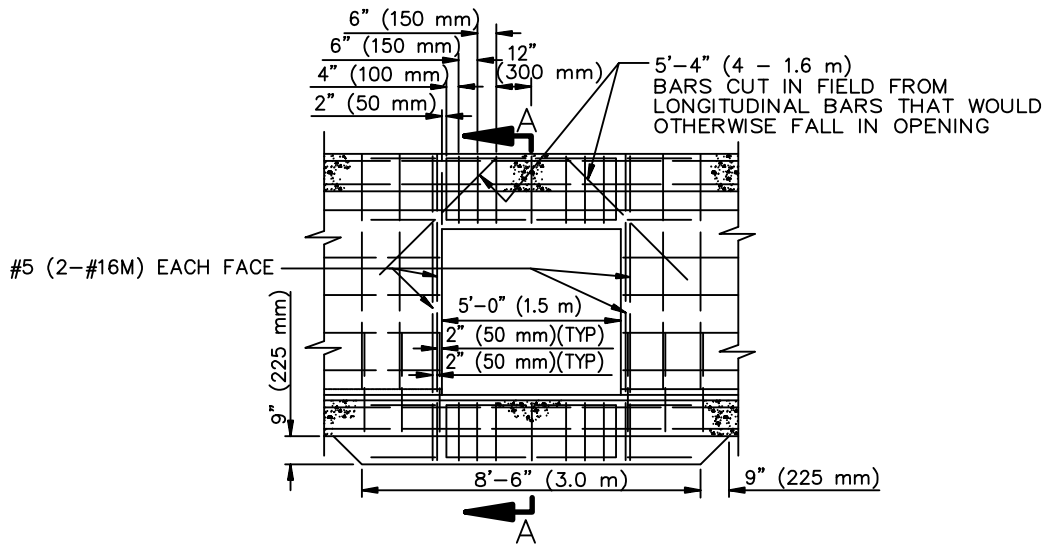

ELEVATION

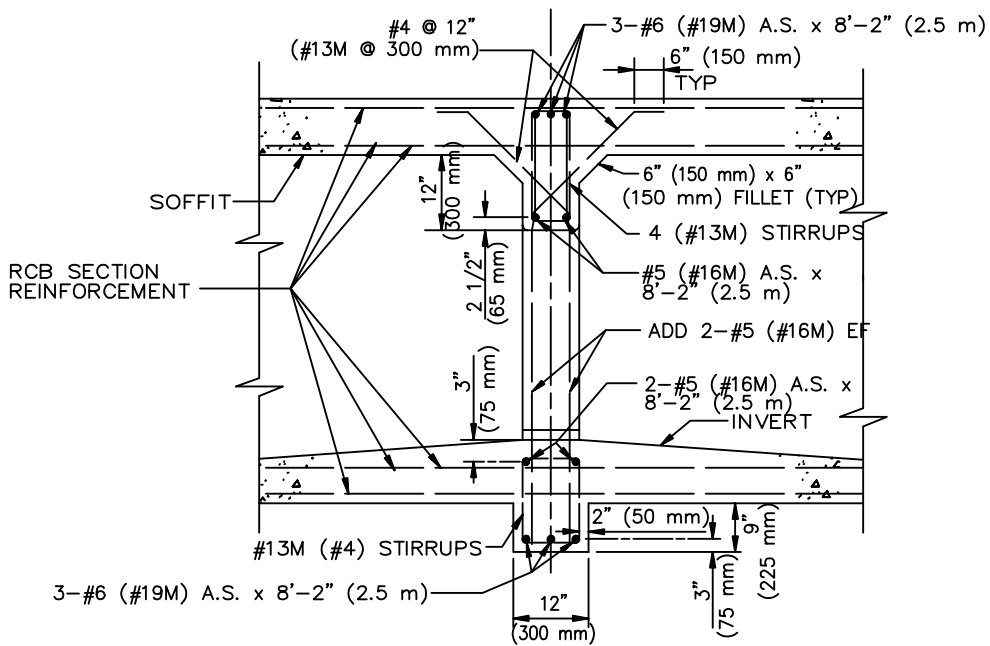

SECTION A-A

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

WINDOW DETAILS FOR
MULTIPLE RCB STRUCTURES

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

382-2

SHEET 1 OF 2

NOTES

1. THIS STRUCTURE MAY BE USED WHERE:
 - a. DEPTH OF COVER DOES NOT EXCEED 10' (3.0 m).
 - b. CLEAR SPAN OF ONE BARREL DOES NOT EXCEED 12' (3.6 m).
WHEN THESE LIMITS ARE EXCEEDED, WINDOW OPENING DETAILS SHALL BE AS SHOWN ON PLANS.
2. LONGITUDINAL BARS SHALL BE CUT IN THE FIELD 2" (50 mm) FROM OPENING.
3. ROUND ALL EDGES TO 2" (50 mm) RADIUS.
4. NO TRANSVERSE CONSTRUCTION JOINT SHALL BE PLACED WITHIN 5'-0" (1.5 m) OF WINDOW.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**WINDOW DETAILS FOR
MULTIPLE RCB STRUCTURES**


382-2

SHEET 2 OF 2

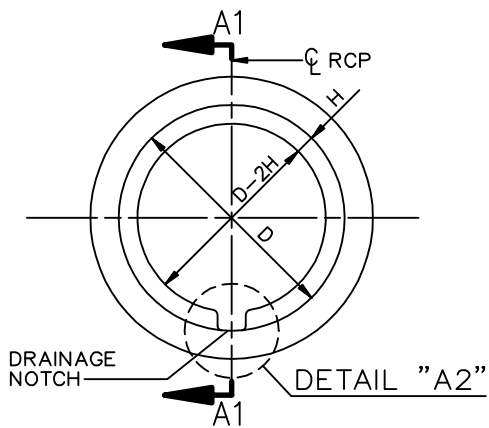


NOTE:
PLATE AND ANCHOR BOLTS NOT SHOWN.

PRECAST RCP SECTION
LOOKING UPSTREAM

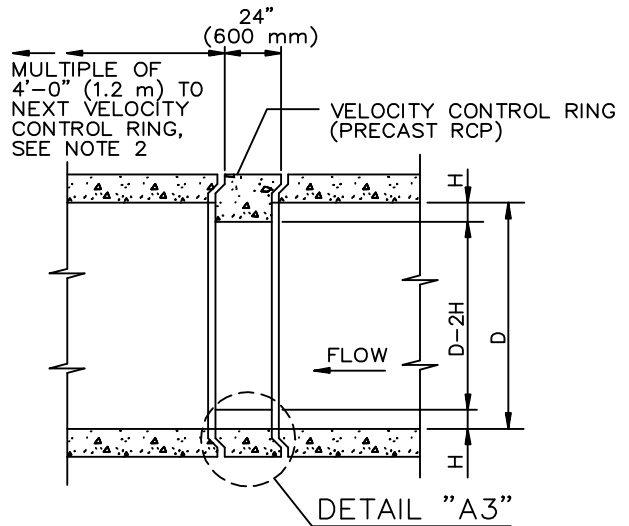


SECTION A1-A1

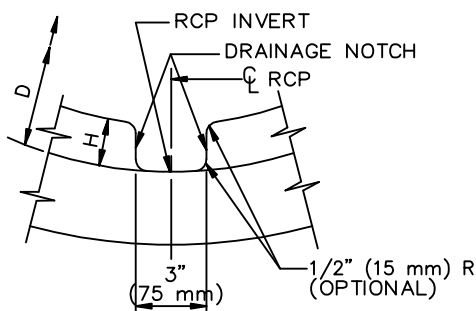

DETAIL "A2"

NOTE:
PLATE AND ANCHOR BOLTS NOT SHOWN.

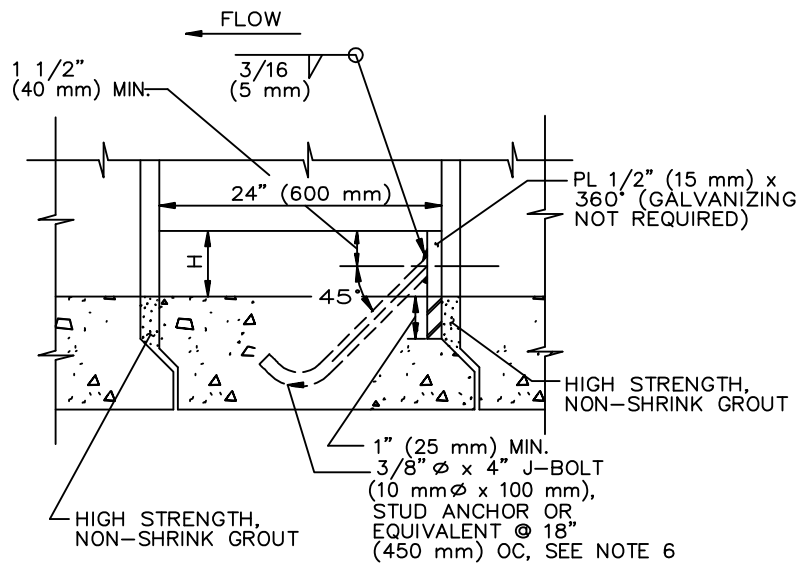

DETAIL "A3"

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1995, 2009

**VELOCITY CONTROL RING
PRECAST RCP SECTION**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

383-2

SHEET 1 OF 2

NOTES

1. DRAINAGE NOTCH OF VELOCITY CONTROL PRECAST SECTIONS SHALL BE PLACED ON THE RCP INVERT AND CENTERED ON THE RCP CENTERLINE.
2. THE LOCATION AND SPACING OF THE VELOCITY CONTROL RINGS ARE SHOWN ON THE PLANS. THE SPACING BETWEEN THE RINGS UPSTREAM TO DOWNSTREAM SHALL BE A MULTIPLE OF 4'-0" (1.2 m).
3. PRECAST RCP VELOCITY CONTROL RINGS SHALL BE MANUFACTURED PER SSPWC 207-2. REINFORCING STEEL CAGES SHALL BE THE SAME AS THAT OF THE ADJACENT RCP EXCEPT THAT AN ADDITIONAL CAGE MAY BE ADDED. THE RING NEED NOT BE D-LOAD TESTED.
4. VALUES D AND H ARE SHOWN ON THE PLANS. THE VALUE H SHALL BE A MULTIPLE OF 1 1/2" (37.5 mm).
5. THE MINIMUM INSIDE DIAMETER (D-2H) SHALL BE 36" (900 mm).
6. #3 (#10M) REINFORCING STEEL BARS 12" (300 mm) LONG WELDED TO THE REINFORCING CAGES MAY BE USED IN PLACE OF THE J BOLTS OR STUD ANCHORS.
7. CONCRETE STRENGTH FOR VELOCITY RINGS SHALL BE 5,000 PSI (35 MPa) AT 28 DAYS.



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**VELOCITY CONTROL RING
PRECAST RCP SECTION**

383-2

SHEET 2 OF 2

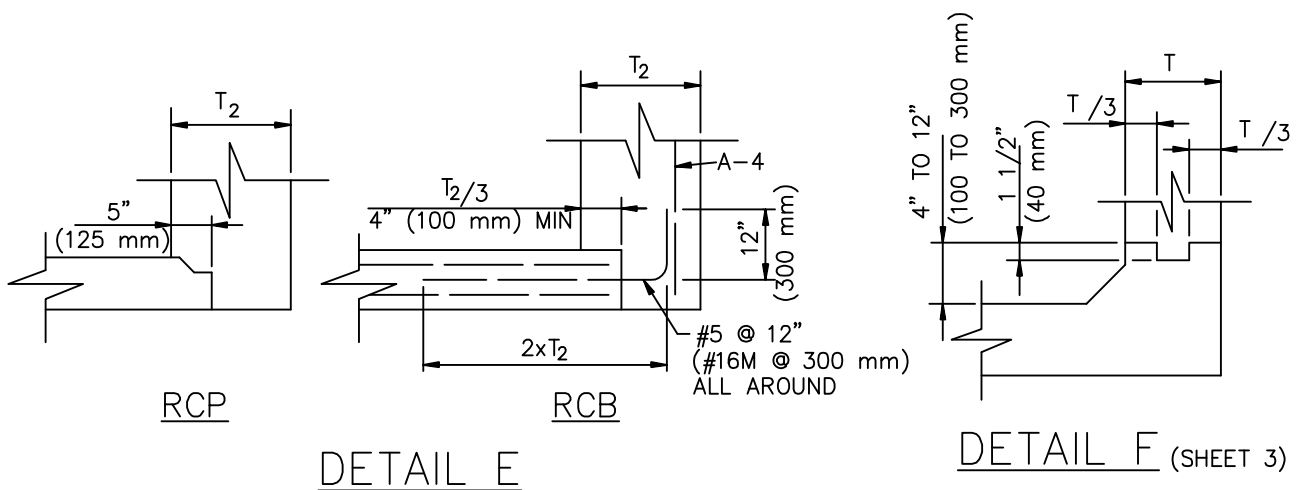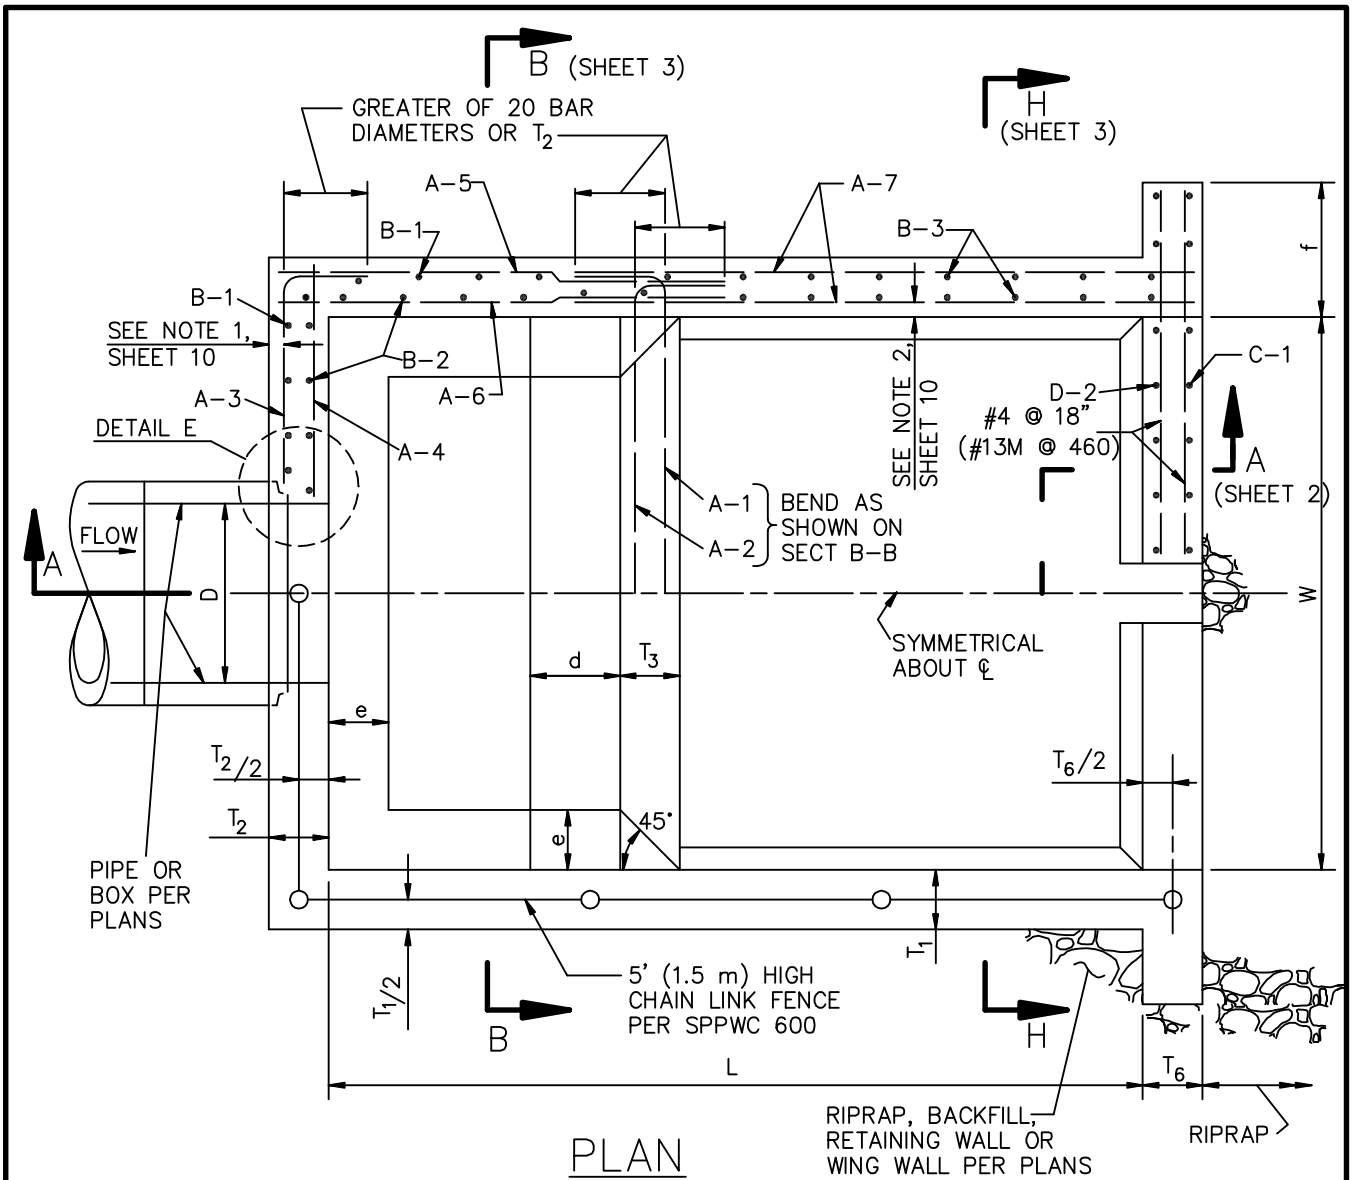

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 2005, 2009


**ENERGY DISSIPATOR - IMPACT BASIN
WITH VERTICAL BAFFLE WALL**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

384-3


SHEET 1 OF 10

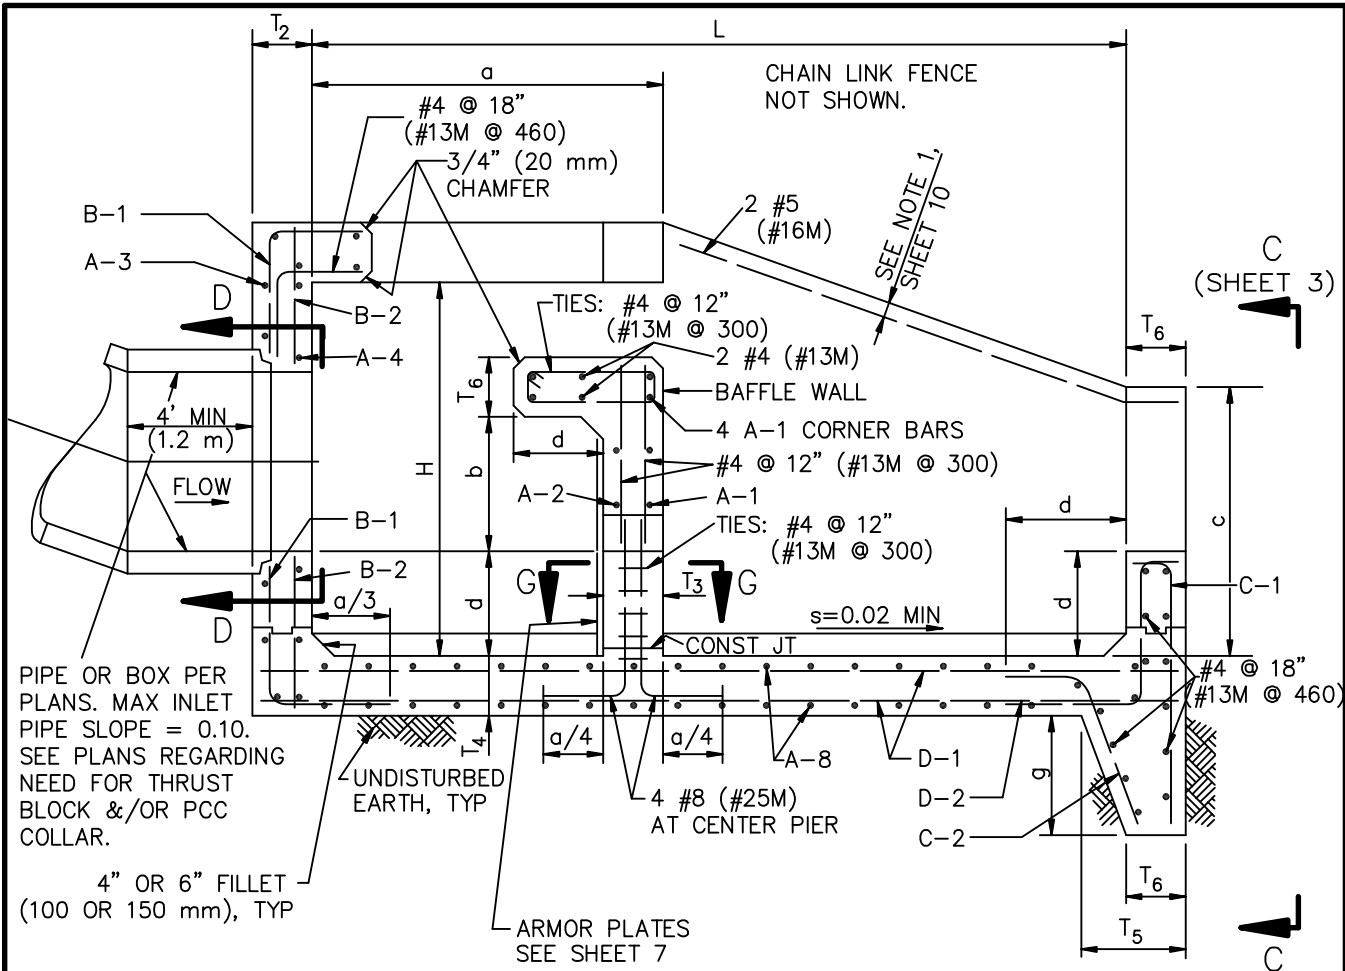

SECTION A-A



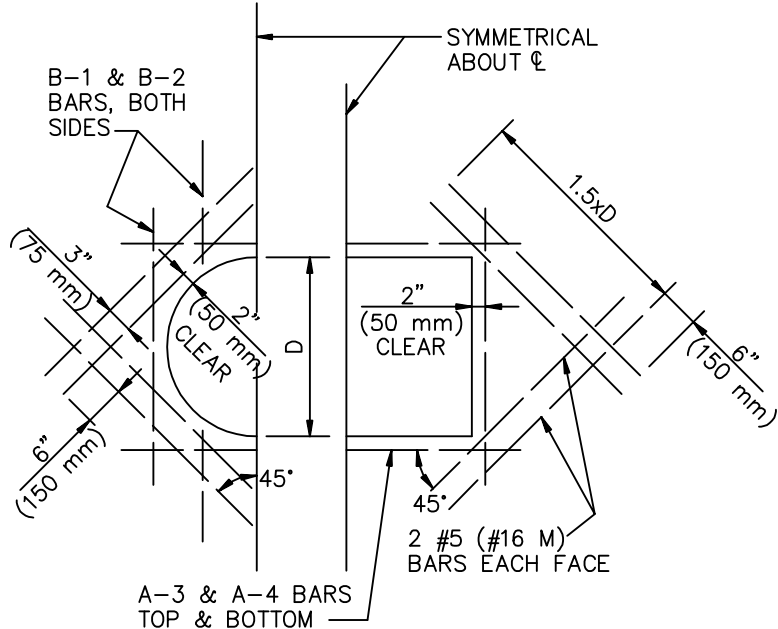


SECTION D-D

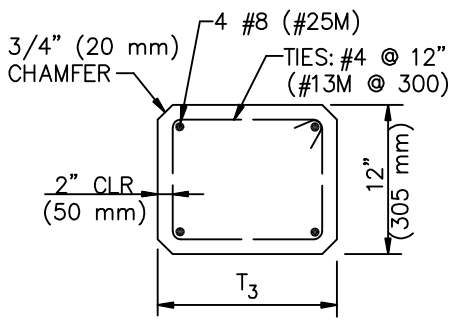

NOTE: ARMOR PLATE NOT SHOWN.

SECTION G-G

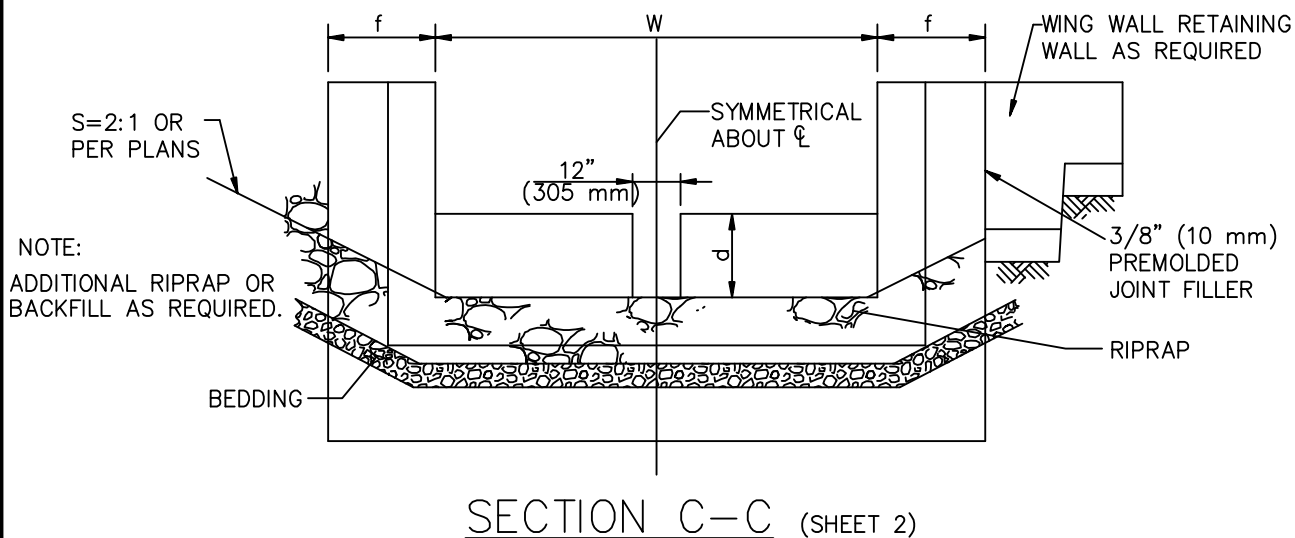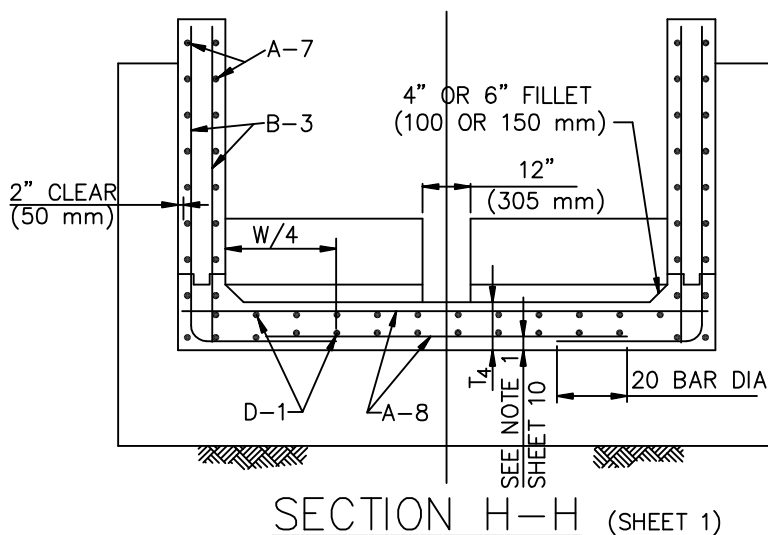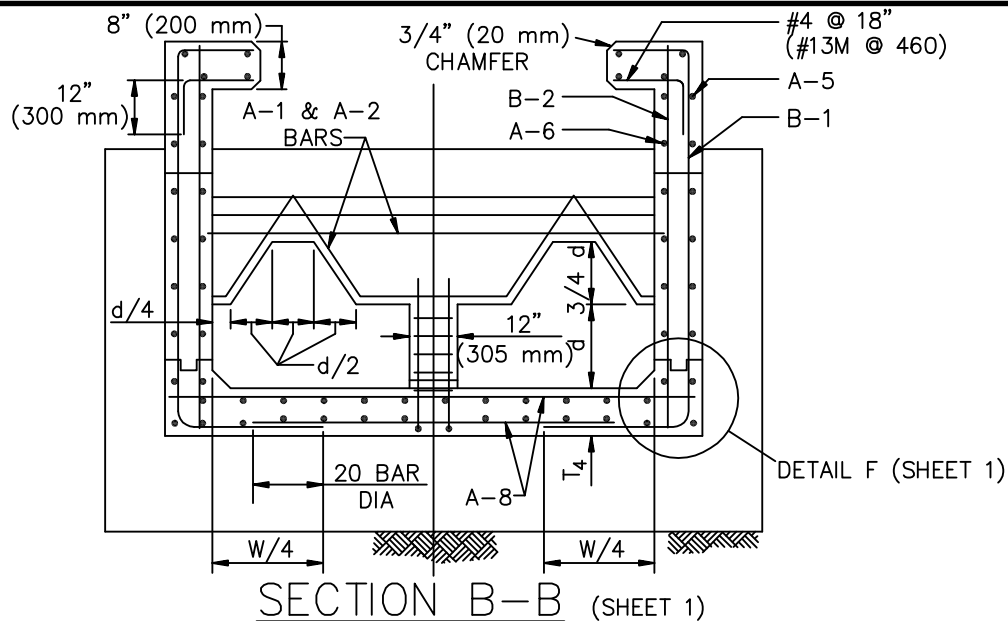

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

**ENERGY DISSIPATOR – IMPACT BASIN
WITH VERTICAL BAFFLE WALL**

STANDARD PLAN

384-3

SHEET 3 OF 10

*SEE NOTES, SHEET 10

DIMENSIONS	WIDTH	(4'-0")	(1220)	6'-0"	(1830)	8'-0"	(2440)	
	H	(3'-0")	(910)	4'-6"	(1370)	6'-0"	(1830)	
	L	(5'-6")	(1680)	8'-0"	(2440)	11'-0"	(3510)	
	a	(2'-0")	(610)	3'-0"	(910)	4'-0"	(1220)	
	b	(1'-6")	(460)	2'-3"	(690)	3'-0"	(910)	
	c	(2'-0")	(610)	3'-0"	(910)	4'-0"	(1220)	
	d	(0'-8")	(200)	1'-0"	(300)	1'-4"	(410)	
	e	(0'-4")	(100)	0'-6"	(150)	0'-8"	(200)	
	f	(2'-0")	(610)	2'-0"	(610)	2'-0"	(610)	
	g	(3'-0")	(910)	3'-0"	(910)	3'-0"	(910)	
BAR DESIGNATION	T1*	(8")	(200)	8"	(200)	8"	(200)	
	T2	(8")	(200)	8"	(200)	8"	(200)	
	T3	(8")	(200)	8"	(200)	8"	(200)	
	T4*	(8")	(200)	8"	(200)	8"	(200)	
	T5	(9")	(230)	9"	(230)	9"	(230)	
	T6	(9")	(230)	9"	(230)	9"	(230)	
	WORKING STRESS DESIGN							
	A-1	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#5 @ 12"	(#16M @ 300)	
	A-2	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#5 @ 12"	(#16M @ 300)	
	A-3	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	
A-4	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
A-5	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
A-6	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#5 @ 12"	(#16M @ 300)		
A-7	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
A-8	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
B-1	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
B-2	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
B-3	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
C-1	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
C-2	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
D-1	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
D-2	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
STRENGTH DESIGN								
A-1	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
A-2	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
A-3	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
A-4	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
A-5	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
A-6	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
A-7	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
A-8	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
B-1	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
B-2	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
B-3	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
C-1	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
C-2	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
D-1	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)	#4 @ 12"	(#13M @ 300)		
D-2	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)	#4 @ 18"	(#13M @ 460)		
DESIGN LOAD, IMPACT	225 PSF	(10.8 kPa)	300 PSF	(14.4 kPa)	375 PSF	(18.0 kPa)		

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**ENERGY DISSIPATOR – IMPACT BASIN
WITH VERTICAL BAFFLE WALL**

384-3

SHEET 4 OF 10

*SEE NOTES, SHEET 10

DIMENSIONS	WIDTH	10'-0" (3050)	12'-0" (3660)	14'-0" (4270)	
	H	7'-6" (2290)	9'-0" (2740)	10'-6" (3200)	
	L	13'-6" (4110)	16'-0" (4880)	18'-6" (5640)	
	a	5'-0" (1520)	6'-0" (1830)	7'-0" (2130)	
	b	3'-9" (1140)	4'-6" (1370)	5'-3" (1600)	
	c	5'-0" (1520)	6'-0" (1830)	7'-0" (2130)	
	d	1'-8" (510)	2'-0" (610)	2'-4" (710)	
	e	0'-10" (250)	1'-0" (300)	1'-2" (360)	
	f	2'-0" (610)	2'-6" (760)	3'-0" (910)	
	g	4'-0" (1220)	5'-0" (1520)	5'-6" (1680)	
BAR DESIGNATION	T1*	9" (230)	9" (230)	10" (250)	
	T2	8" (200)	8" (200)	10" (250)	
	T3	8" (200)	10" (250)	12" (300)	
	T4*	8" (200)	8.5" (220)	8.5" (220)	
	T5	9" (230)	9" (230)	9" (230)	
	T6	9" (230)	9" (2300)	9" (230)	
	WORKING STRESS DESIGN				
	A-1	#6 @ 12" (#19M @ 300)	#9 @ 18" (#29M @ 460)	#8 @ 12" (#25M @ 300)	
	A-2	#7 @ 12" (#22M @ 300)	#9 @ 18" (#29M @ 460)	#8 @ 12" (#25M @ 300)	
	A-3	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 12" (#13M @ 300)	
A-4	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)		
A-5	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 12" (#13M @ 300)		
A-6	#7 @ 12" (#22M @ 300)	#8 @ 12" (#25M @ 300)	#9 @ 12" (#29M @ 300)		
A-7	#5 @ 14" (#16M @ 360)	#5 @ 12" (#16M @ 300)	#5 @ 10" (#16M @ 250)		
A-8	#5 @ 11" (#16M @ 275)	#7 @ 12" (#22M @ 300)	#8 @ 12" (#25M @ 300)		
B-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
B-2	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
B-3	#6 @ 18" (#19M @ 460)	#5 @ 12" (#16M @ 300)	#6 @ 15" (#19M @ 380)		
C-1	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)		
C-2	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)		
D-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
D-2	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)		
STRENGTH DESIGN					
A-1	#5 @ 12" (#16M @ 300)	#6 @ 12" (#19M @ 300)	#8 @ 18" (#25M @ 460)		
A-2	#6 @ 12" (#19M @ 300)	#6 @ 12" (#19M @ 300)	#8 @ 18" (#25M @ 460)		
A-3	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)		
A-4	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)		
A-5	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)		
A-6	#6 @ 12" (#19M @ 300)	#7 @ 12" (#22M @ 300)	#8 @ 12" (#25M @ 300)		
A-7	#5 @ 14" (#16M @ 360)	#5 @ 12" (#16M @ 300)	#5 @ 10" (#16M @ 250)		
A-8	#4 @ 12" (#13M @ 300)	#5 @ 12" (#16M @ 300)	#6 @ 11" (#19M @ 275)		
B-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
B-2	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
B-3	#6 @ 18" (#19M @ 460)	#5 @ 12" (#16M @ 300)	#6 @ 15" (#19M @ 380)		
C-1	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)		
C-2	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)		
D-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
D-2	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)		
DESIGN LOAD, IMPACT	450 PSF (21.5 kPa)	525 PSF (25.1 kPa)	600 PSF (28.7 kPa)		

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**ENERGY DISSIPATOR – IMPACT BASIN
WITH VERTICAL BAFFLE WALL**

384-3

SHEET 5 OF 10

*SEE NOTES, SHEET 10

DIMENSIONS	WIDTH	16'-0" (4880)	18'-0" (5490)	20'-0" (6100)	
	H	12'-0" (3660)	13'-6" (4110)	15'-0" (4570)	
	L	21'-6" (6550)	24'-0" (7320)	26'-6" (8080)	
	a	8'-0" (2440)	9'-0" (2740)	10'-0" (3050)	
	b	6'-0" (1830)	6'-9" (2060)	7'-6" (2290)	
	c	8'-0" (2440)	9'-0" (2740)	10'-0" (3050)	
	d	2'-8" (810)	3'-0" (910)	3'-4" (1020)	
	e	1'-4" (410)	1'-6" (460)	1'-8" (510)	
	f	3'-6" (1070)	3'-6" (1070)	3'-6" (1070)	
	g	6'-0" (1830)	7'-0" (2130)	7'-6" (2290)	
BAR DESIGNATION	T1*	12" (300)	13" (330)	14" (360)	
	T2	10" (250)	12" (300)	12" (300)	
	T3	13" (330)	14" (360)	16" (410)	
	T4*	9.5" (240)	10.5" (270)	(11.5") 290	
	T5	10" (250)	11" (280)	(13") 330	
	T6	9" (230)	9" (230)	(9") 230	
	WORKING STRESS DESIGN				
	A-1	#9 @ 12" (#29M @ 300)	#8 @ 6" (#32M @ 300)	#10 @ 12" (#25M @ 150)	
	A-2	#9 @ 12" (#29M @ 300)	#7 @ 6" (#22M @ 150)	#7 @ 6" (#22M @ 150)	
	A-3	#5 @ 12" (#16M @ 300)	#4 @ 6" (#16M @ 300)	#5 @ 12" (#13M @ 150)	
A-4	#4 @ 18" (#13M @ 460)	#4 @ 12" (#13M @ 460)	#4 @ 18" (#13M @ 300)		
A-5	#5 @ 12" (#16M @ 300)	#5 @ 12" (#16M @ 300)	#5 @ 12" (#16M @ 300)		
A-6	#9 @ 12" (#29M @ 300)	#9 @ 6" (#25M @ 150)	#8 @ 6" (#29M @ 150)		
A-7	#6 @ 12" (#19M @ 300)	#7 @ 14" (#16M @ 200)	#5 @ 8" (#22M @ 360)		
A-8	#9 @ 12" (#29M @ 300)	#8 @ 7" (#25M @ 200)	#8 @ 8" (#25M @ 175)		
B-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
B-2	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
B-3	#6 @ 12" (#19M @ 300)	#7 @ 14" (#22M @ 410)	#7 @ 16" (#22M @ 360)		
C-1	#4 @ 15" (#13M @ 380)	#4 @ 13" (#13M @ 330)	#4 @ 13" (#13M @ 330)		
C-2	#4 @ 15" (#13M @ 380)	#4 @ 13" (#13M @ 330)	#4 @ 13" (#13M @ 330)		
D-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
D-2	#4 @ 18" (#13M @ 460)	#6 @ 13" (#13M @ 300)	#4 @ 12" (#19M @ 330)		
STRENGTH DESIGN					
A-1	#8 @ 12" (#25M @ 300)	#9 @ 12" (#29M @ 300)	#8 @ 8" (#25M @ 200)		
A-2	#8 @ 12" (#25M @ 300)	#6 @ 6" (#19M @ 150)	#7 @ 8" (#22M @ 200)		
A-3	#4 @ 12" (#13M @ 300)	#5 @ 12" (#16M @ 300)	#4 @ 8" (#13M @ 200)		
A-4	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#4 @ 16" (#13M @ 410)		
A-5	#4 @ 12" (#13M @ 300)	#5 @ 12" (#16M @ 300)	#4 @ 8" (#13M @ 200)		
A-6	#6 @ 6" (#19M @ 150)	#9 @ 12" (#29M @ 300)	#6 @ 4" (#19M @ 100)		
A-7	#6 @ 12" (#19M @ 300)	#5 @ 8" (#16M @ 200)	#7 @ 14" (#22M @ 360)		
A-8	#7 @ 12" (#22M @ 300)	#8 @ 14" (#25M @ 360)	#8 @ 12" (#25M @ 300)		
B-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
B-2	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
B-3	#6 @ 12" (#19M @ 300)	#7 @ 16" (#22M @ 410)	#7 @ 14" (#22M @ 360)		
C-1	#4 @ 15" (#13M @ 380)	#4 @ 13" (#13M @ 330)	#4 @ 13" (#13M @ 330)		
C-2	#4 @ 15" (#13M @ 380)	#4 @ 13" (#13M @ 330)	#4 @ 13" (#13M @ 330)		
D-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
D-2	#4 @ 18" (#13M @ 460)	#4 @ 18" (#13M @ 460)	#5 @ 14" (#16M @ 360)		
DESIGN LOAD, IMPACT	675 PSF (32.3 kPa)	750 PSF (35.9 kPa)	825 PSF (39.5 kPa)		

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**ENERGY DISSIPATOR – IMPACT BASIN
WITH VERTICAL BAFFLE WALL**

384-3

SHEET 6 OF 10

*SEE NOTES, SHEET 10

DIMENSIONS	WIDTH	22'-0" (6710)	24'-0" (7320)	26'-0" (7920)	
	H	16'-6" (5030)	18'-0" (5490)	19'-6" (5940)	
	L	29'-6" (8990)	32'-0" (9750)	35'-0" (10670)	
	a	11'-0" (3350)	12'-0" (3660)	13'-0" (3960)	
	b	8'-3" (2510)	9'-0" (2740)	9'-9" (2790)	
	c	11'-0" (3350)	12'-0" (3660)	13'-0" (3960)	
	d	3'-8" (1120)	4'-0" (1220)	4'-4" (1320)	
	e	1'-10" (560)	2'-0" (610)	2'-2" (660)	
	f	4'-0" (1220)	4'-6" (1370)	4'-6" (1370)	
	g	8'-0" (2440)	8'-6" (2590)	9'-6" (2900)	
BAR DESIGNATION	T1*	15" (380)	17" (430)	18" (460)	
	T2	13" (330)	13" (330)	13" (330)	
	T3	17" (430)	18" (460)	21" (530)	
	T4*	13" (330)	14" (360)	15" (380)	
	T5	15" (380)	17" (430)	19" (480)	
	T6	9" (230)	9" (230)	9" (230)	
	WORKING STRESS DESIGN				
	A-1	#9 @ 6" (#29M @ 150)	#9 @ 6" (#29M @ 150)	#8 @ 4" (#25M @ 100)	
	A-2	#8 @ 6" (#25M @ 150)	#9 @ 6" (#29M @ 150)	#9 @ 6" (#29M @ 150)	
	A-3	#4 @ 6" (#13M @ 150)	#5 @ 6" (#16M @ 150)	#6 @ 8" (#19M @ 200)	
A-4	#4 @ 12" (#13M @ 300)	#5 @ 12" (#16M @ 300)	#6 @ 16" (#19M @ 410)		
A-5	#5 @ 12" (#16M @ 300)	#4 @ 6" (#13M @ 150)	#8 @ 16" (#25M @ 410)		
A-6	#9 @ 6" (#29M @ 150)	#10 @ 6" (#32M @ 150)	#9 @ 4" (#29M @ 100)		
A-7	#8 @ 16" (#25M @ 410)	#7 @ 12" (#22M @ 300)	#6 @ 8" (#19M @ 200)		
A-8	#9 @ 8" (#29M @ 200)	#9 @ 7" (#29M @ 175)	#9 @ 6" (#29M @ 150)		
B-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
B-2	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
B-3	#8 @ 18" (#25M @ 460)	#7 @ 12" (#22M @ 300)	#7 @ 12" (#22M @ 300)		
C-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#5 @ 16" (#16M @ 410)		
C-2	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#5 @ 16" (#16M @ 410)		
D-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)		
D-2	#8 @ 18" (#25M @ 460)	#9 @ 18" (#29M @ 460)	#8 @ 14" (#25M @ 360)		
STRENGTH DESIGN					
A-1	#9 @ 8" (#29M @ 200)	(#10 @ 9") (#29M @ 200)	#9 @ 8" #32M @ 225		
A-2	#8 @ 8" (#25M @ 200)	(#9 @ 8") (#29M @ 200)	#9 @ 8" #29M @ 200		
A-3	#4 @ 8" (#13M @ 200)	(#8 @ 16") (#16M @ 200)	#5 @ 8" #25M @ 410		
A-4	#4 @ 16" (#13M @ 410)	(#5 @ 16") (#13M @ 410)	#4 @ 16" #16M @ 410		
A-5	#5 @ 8" (#16M @ 200)	(#5 @ 8") (#16M @ 200)	#5 @ 8" #16M @ 200		
A-6	#9 @ 8" (#29M @ 200)	(#8 @ 4") (#29M @ 150)	#9 @ 6" #25M @ 100		
A-7	#8 @ 16" (#25M @ 410)	(#6 @ 8") (#22M @ 300)	#7 @ 12" #19M @ 200		
A-8	#8 @ 11" (#25M @ 275)	(#8 @ 8") (#29M @ 300)	#9 @ 12" #25M @ 200		
B-1	#4 @ 12" (#13M @ 300)	(#4 @ 12") (#13M @ 300)	#4 @ 12" #13M @ 300		
B-2	#4 @ 12" (#13M @ 300)	(#4 @ 12") (#13M @ 300)	#4 @ 12" #13M @ 300		
B-3	#8 @ 18" (#25M @ 460)	(#7 @ 12") (#22M @ 300)	#7 @ 12" #22M @ 300		
C-1	#4 @ 12" (#13M @ 300)	(#5 @ 16") (#13M @ 300)	#4 @ 12" #16M @ 410		
C-2	#4 @ 12" (#13M @ 300)	(#5 @ 16") (#13M @ 300)	#4 @ 12" #16M @ 410		
D-1	#4 @ 12" (#13M @ 300)	(#4 @ 12") (#13M @ 300)	#4 @ 12" #13M @ 300		
D-2	#6 @ 14" (#19M @ 360)	(#8 @ 15") (#22M @ 360)	#7 @ 14" #25M @ 380		
DESIGN LOAD, IMPACT	900 PSF (43.1 kPa)	950 PSF (45.5 kPa)	1000 PSF (47.9 kPa)		

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**ENERGY DISSIPATOR – IMPACT BASIN
WITH VERTICAL BAFFLE WALL**

384-3

SHEET 7 OF 10

*SEE NOTES, SHEET 10

DIMENSIONS	WIDTH	28'-0" (8530)	30'-0" (9140)	32'-0" (9750)	
	H	21'-0" (6400)	22'-6" (6860)	24'-0" (7320)	
	L	37'-6" (11430)	40'-0" (12190)	42'-6" (12950)	
	a	14'-0" (4270)	15'-0" (4570)	16'-0" (4880)	
	b	10'-6" (3200)	11'-3" (3430)	12'-0" (3660)	
	c	14'-0" (4270)	15'-0" (4570)	16'-0" (4880)	
	d	4'-8" (1420)	5'-0" (1520)	5'-4" (1630)	
	e	2'-4" (710)	2'-6" (760)	2'-8" (810)	
	f	5'-0" (1520)	5'-6" (1680)	6'-0" (1830)	
	g	10'-0" (3050)	10'-6" (3200)	11'-0" (3350)	
BAR DESIGNATION	T1*	20" (510)	22" (560)	25" (640)	
	T2	14" (360)	14" (360)	14" (360)	
	T3	23" (580)	24" (610)	26" (660)	
	T4*	17" (430)	18.5" (470)	20" (510)	
	T5	21" (530)	24" (610)	26" (660)	
	T6	9" (230)	10" (250)	11" (280)	
	WORKING STRESS DESIGN				
	A-1	#9 @ 4" (#29M @ 100)	#10 @ 4" (#32M @ 100)	(#10 @ 4")	#32M @ 100
	A-2	#8 @ 4" (#25M @ 100)	#9 @ 4" (#29M @ 100)	(#9 @ 4")	#29M @ 100
	A-3	#6 @ 8" (#19M @ 200)	#5 @ 4" (#16M @ 100)	(#5 @ 4")	#16M @ 100
A-4	#6 @ 12" (#19M @ 300)	#7 @ 12" (#22M @ 300)	(#6 @ 8")	#19M @ 200	
A-5	#7 @ 12" (#22M @ 300)	#7 @ 12" (#22M @ 300)	(#8 @ 12")	#25M @ 300	
A-6	#9 @ 4" (#29M @ 100)	#9 @ 4" (#29M @ 100)	(#10 @ 4")	#32M @ 100	
A-7	#8 @ 13" (#25M @ 330)	#8 @ 12" (#25M @ 300)	(#8 @ 10")	#25M @ 250	
A-8	#8 @ 4" (#25M @ 100)	#9 @ 5" (#29M @ 125)	(#9 @ 4")	#29M @ 100	
B-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	(#4 @ 10")	#13M @ 250	
B-2	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	(#4 @ 10")	#13M @ 250	
B-3	#8 @ 14" (#25M @ 360)	#8 @ 12" (#25M @ 300)	(#8 @ 11")	#25M @ 275	
C-1	#5 @ 15" (#16M @ 380)	#5 @ 12" (#16M @ 300)	(#5 @ 12")	#16M @ 300	
C-2	#5 @ 15" (#16M @ 380)	#5 @ 12" (#16M @ 300)	(#5 @ 12")	#16M @ 300	
D-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	(#4 @ 12")	#13M @ 300	
D-2	#8 @ 11" (#25M @ 275)	#9 @ 13" (#29M @ 330)	(#8 @ 10")	#25M @ 250	
STRENGTH DESIGN					
A-1	#9 @ 6" (#29M @ 150)	#8 @ 4" (#25M @ 100)	#9 @ 5" (#29M @ 125)	(#29M @ 125)	
A-2	#9 @ 8" (#29M @ 200)	#10 @ 8" (#32M @ 200)	#8 @ 5" (#25M @ 125)	(#25M @ 125)	
A-3	#9 @ 12" (#29M @ 300)	#7 @ 8" (#22M @ 200)	#8 @ 10" (#25M @ 250)	(#25M @ 250)	
A-4	#8 @ 12" (#25M @ 300)	#5 @ 8" (#16M @ 200)	#4 @ 5" (#13M @ 125)	(#13M @ 125)	
A-5	#7 @ 12" (#22M @ 300)	#4 @ 4" (#13M @ 100)	#5 @ 5" (#16M @ 125)	(#16M @ 125)	
A-6	#8 @ 4" (#25M @ 100)	#8 @ 4" (#25M @ 100)	#10 @ 5" (#32M @ 125)	(#32M @ 125)	
A-7	#8 @ 13" (#25M @ 330)	#8 @ 12" (#25M @ 300)	#8 @ 10" (#25M @ 250)	(#25M @ 250)	
A-8	#8 @ 7" (#25M @ 175)	#9 @ 8" (#29M @ 200)	#8 @ 6" (#25M @ 150)	(#25M @ 150)	
B-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 10" (#13M @ 250)	(#13M @ 250)	
B-2	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 10" (#13M @ 250)	(#13M @ 250)	
B-3	#8 @ 14" (#25M @ 360)	#8 @ 12" (#25M @ 300)	#8 @ 11" (#25M @ 275)	(#25M @ 275)	
C-1	#5 @ 15" (#16M @ 380)	#5 @ 12" (#16M @ 300)	#5 @ 12" (#16M @ 300)	(#16M @ 300)	
C-2	#5 @ 15" (#16M @ 380)	#5 @ 12" (#16M @ 300)	#5 @ 12" (#16M @ 300)	(#16M @ 300)	
D-1	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	#4 @ 12" (#13M @ 300)	(#13M @ 300)	
D-2	#8 @ 15" (#25M @ 380)	#8 @ 15" (#25M @ 380)	#9 @ 18" (#29M @ 460)	(#29M @ 460)	
DESIGN LOAD, IMPACT	1100 PSF (52.7 kPa)	1200 PSF (57.5 kPa)	1300 PSF (62.2 kPa)		


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**ENERGY DISSIPATOR – IMPACT BASIN
WITH VERTICAL BAFFLE WALL**


384-3

SHEET 8 OF 10

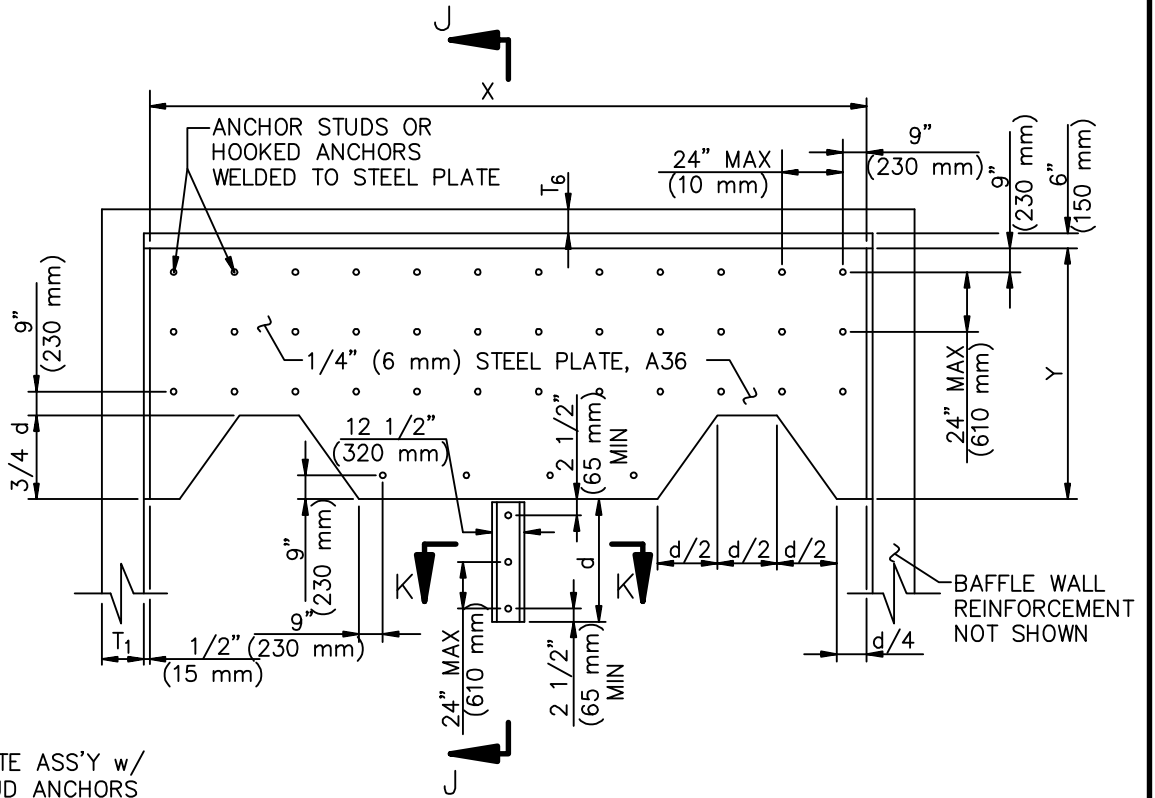

NOTE:
 ARMOR PLATE ASS'Y w/
 WELDED STUD ANCHORS
 SHALL BE EMBEDDED
 INTO WET CONCRETE.

ARMOR PLATE DETAIL (SHT 2)

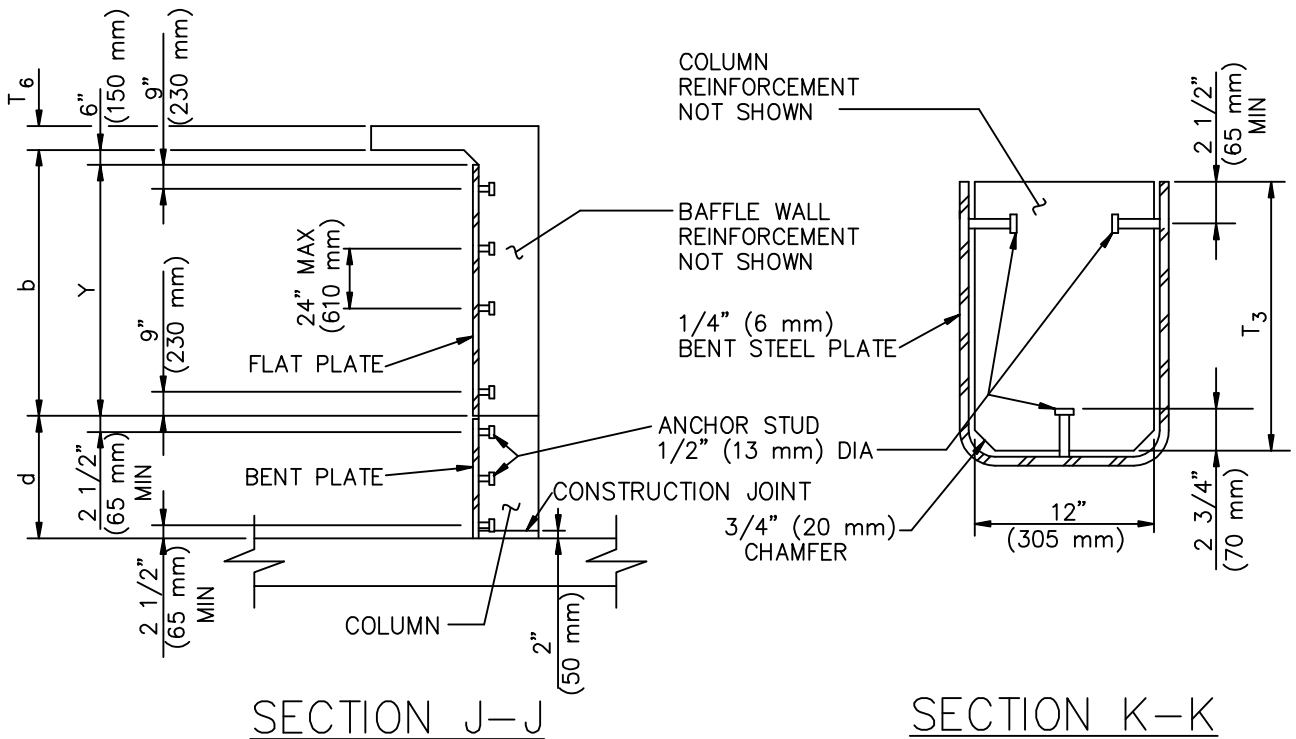


ARMOR PLATE ANCHORS


WIDTH, (mm)	TOTAL BENT PLATE ANCHORS	FLAT PLATE ANCHORS							X, (mm)	Y, (mm)
		ROW 1	ROW 2	ROW 3	ROW 4	ROW 5	ROW 6	ROW 7		
4'-0" (1220)	6	3	3						3'-11" (1190)	1'-0" (310)
6'-0" (1830)	6	4	4						5'-11" (1800)	1'-9" (540)
8'-0" (2440)	6	7	5	2					7'-11" (2410)	2'-6" (760)
10'-0" (3050)	6	9	6	3					9'-11" (3020)	3'-3" (990)
12'-0" (3660)	6	12	7	2	3				11'-11" (3630)	4'-0" (1220)
14'-0" (4270)	6	14	8	2	4				13'-11" (4240)	4'-9" (1450)
16'-0" (4880)	9	15	9	2	4				15'-11" (4850)	5'-6" (1680)
18'-0" (5490)	9	18	10	2	2	4			17'-11" (5460)	6'-3" (1910)
20'-0" (6100)	9	20	11	2	2	5			19'-11" (6070)	7'-0" (2140)
22'-0" (6710)	9	23	12	2	2	2	5		21'-11" (6680)	7'-9" (2360)
24'-0" (7320)	9	25	13	2	2	2	6		23'-11" (7290)	8'-6" (2590)
26'-0" (7920)	9	26	14	2	2	2	6		25'-11" (7890)	9'-3" (2820)
28'-0" (8530)	12	29	15	2	2	2	2	6	27'-11" (8500)	10'-0" (3050)
30'-0" (9140)	12	31	16	2	2	2	2	7	29'-11" (9130)	10'-9" (3280)
32'-0" (9750)	12	32	17	2	2	2	2	7	31'-11" (9720)	11'-6" (3510)

NOTES:

1. PCC COVER FOR RE-BAR SHALL BE 2" (50 mm), EXCEPT AS OTHERWISE NOTED. WHEN PCC WILL BE POURED AGAINST BARE EARTH, HOWEVER, INCREASE WALL THICKNESS SHOWN IN TABLES BY 1" (25 mm) AND INCREASE PCC COVER TO 3" (75 mm).
2. PCC COVER FOR RE-BAR WITHIN IMPACT CHAMBER SHALL BE 2-1/2" (65 mm).
3. TABULATED METRIC REINFORCING BAR SPACING IS IN MILLIMETERS.

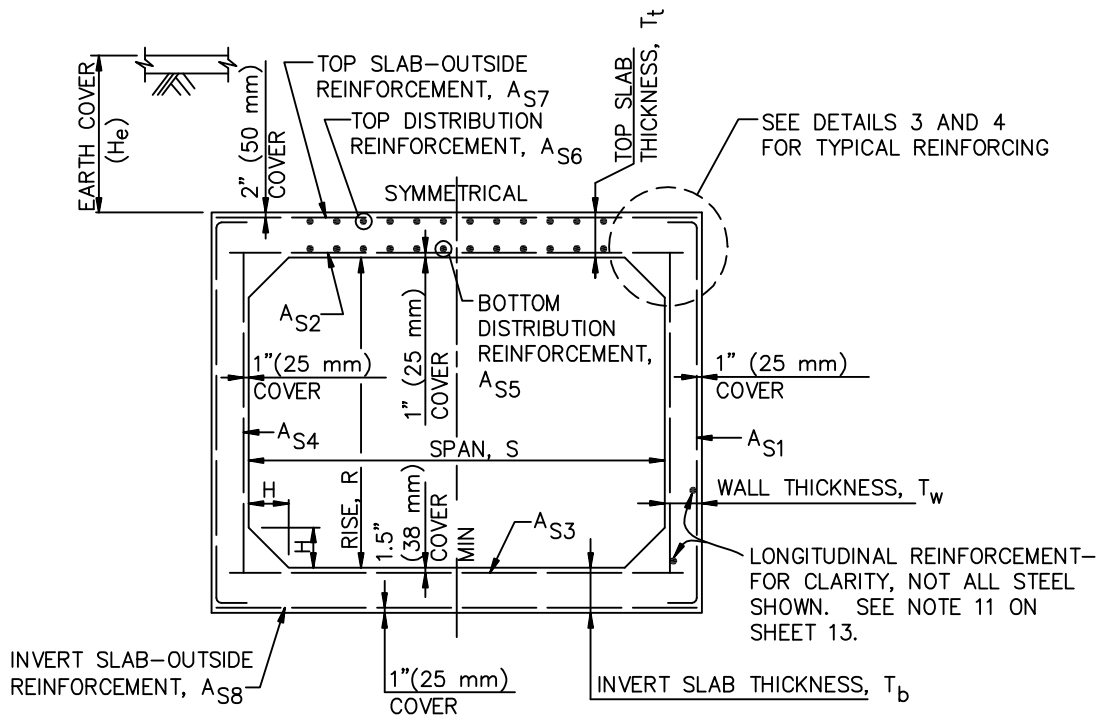

EARTH COVER LESS THAN 24" (600 mm)

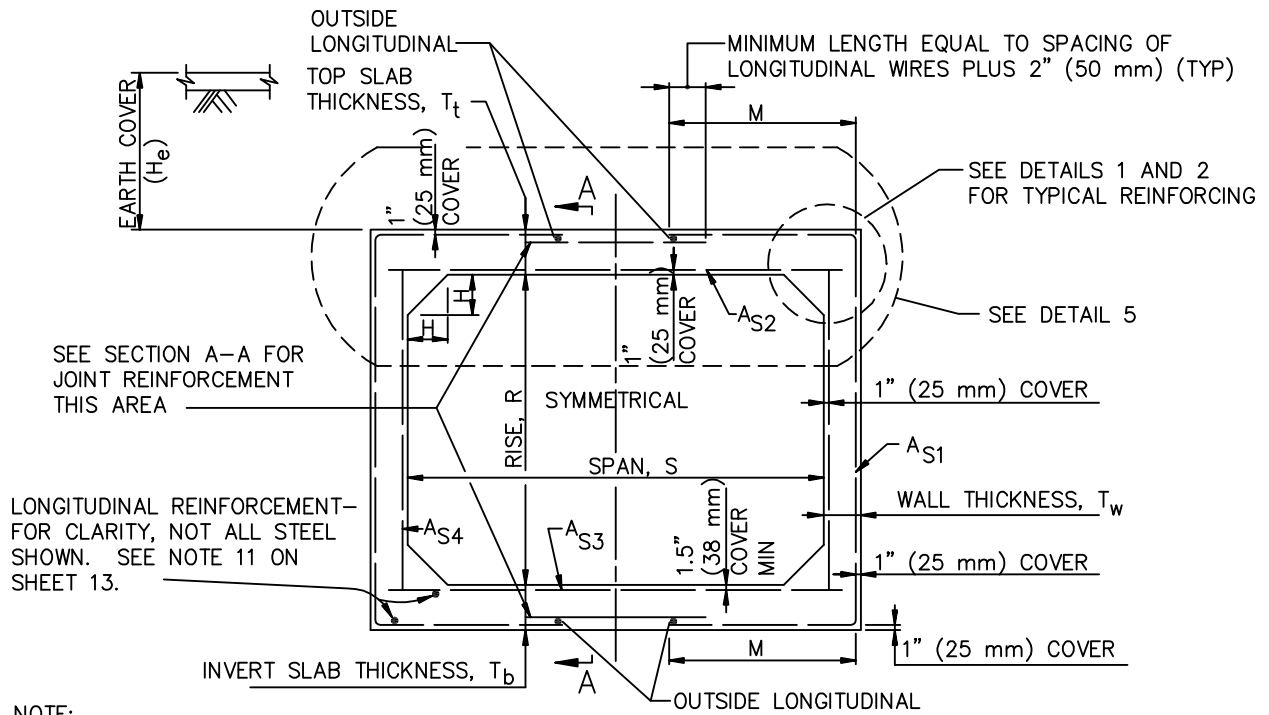

EARTH COVER 24" (610 mm) AND GREATER

TYPICAL BOX SECTIONS

NOTE:
HAUNCH, H =
WALL THICKNESS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
ADOPTED 2008


PRECAST REINFORCED CONCRETE BOX

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

390-0


SHEET 1 OF 42

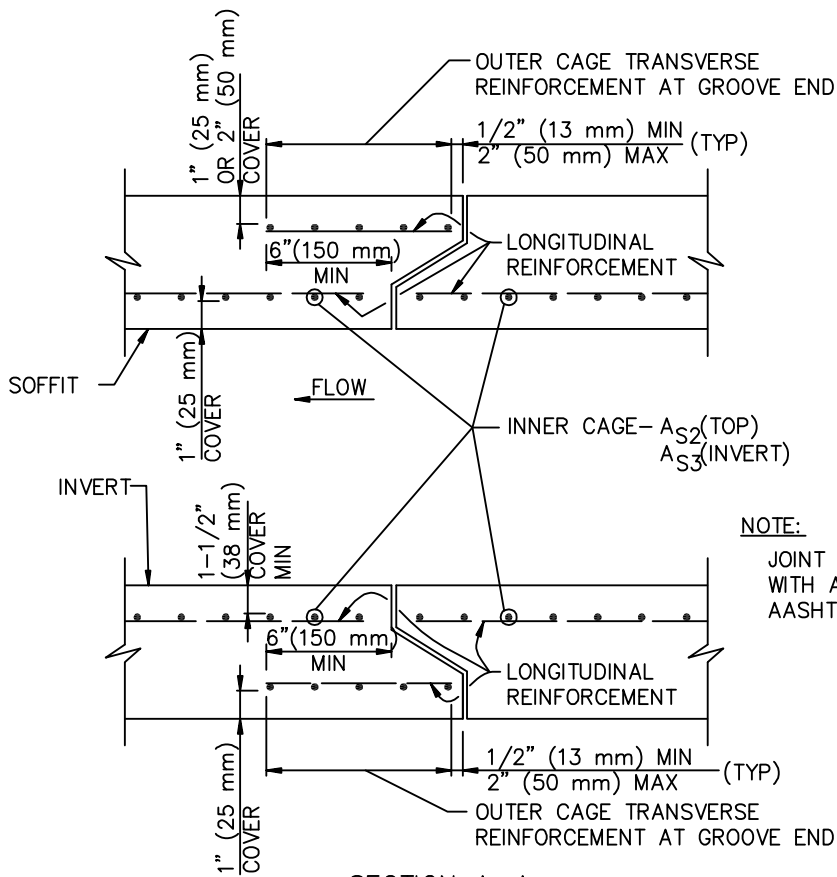


SECTION A-A
TOP AND INVERT SLAB JOINT REINFORCEMENT

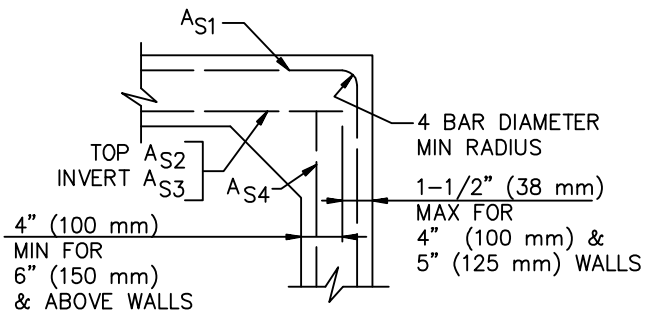


DETAIL 1
INNER REINFORCEMENT

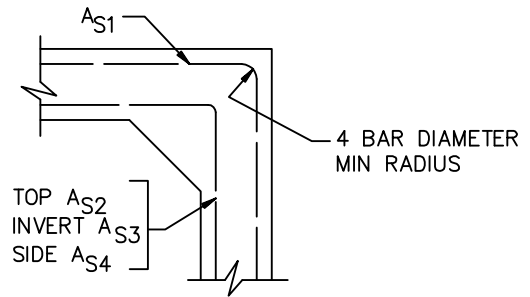


DETAIL 2
OPTION

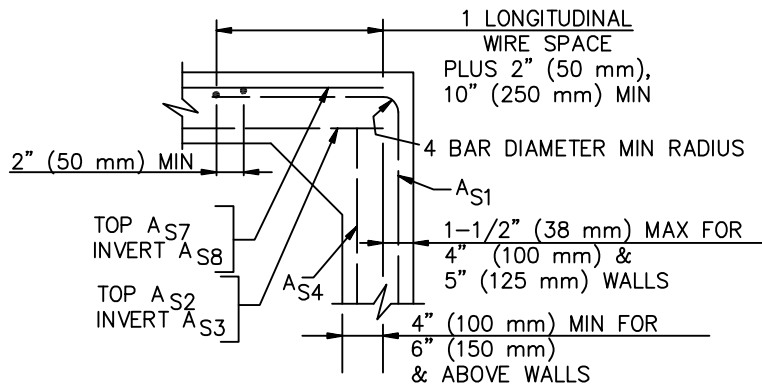

DETAIL 3
REINFORCEMENT ARRANGEMENT

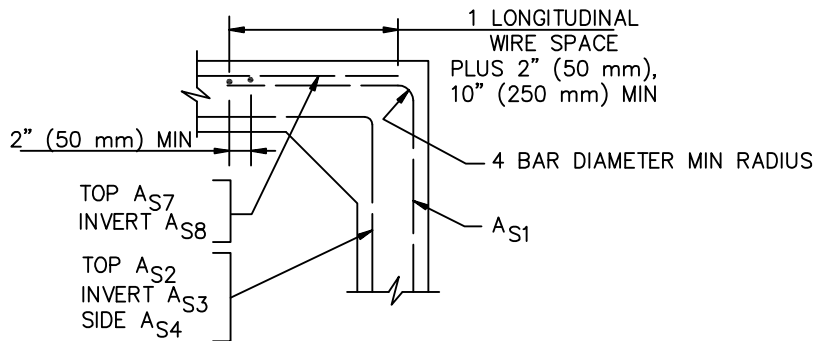


DETAIL 4
OPTION

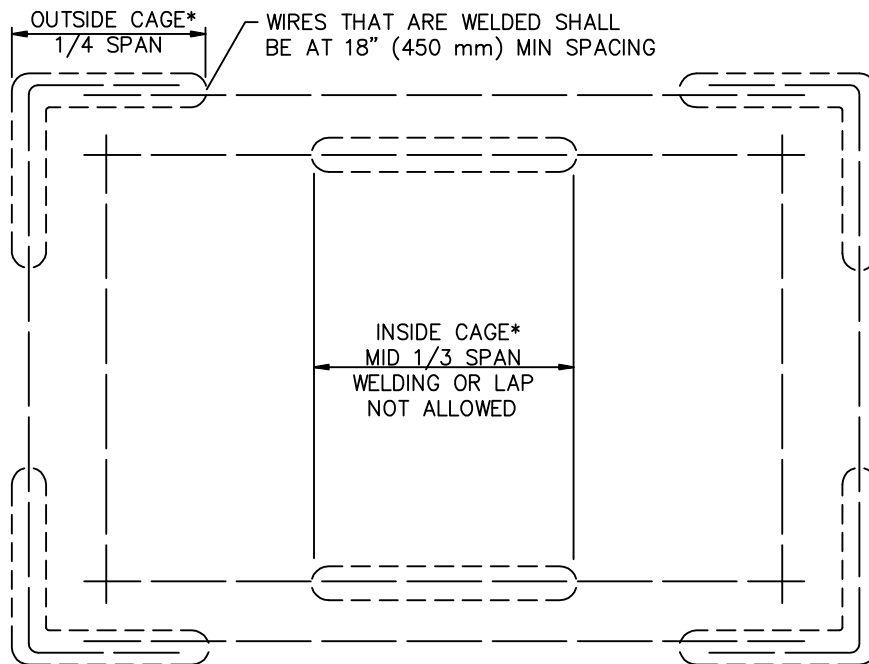


CRITICAL ZONES OF HIGH STRESS
WHERE WELDING IS RESTRICTED

*INDICATES NO-SPLICE ZONES

MINIMUM LENGTH EQUAL TO
SPACING OF LONGITUDINAL
WIRES PLUS 2" (50 mm) (TYP)

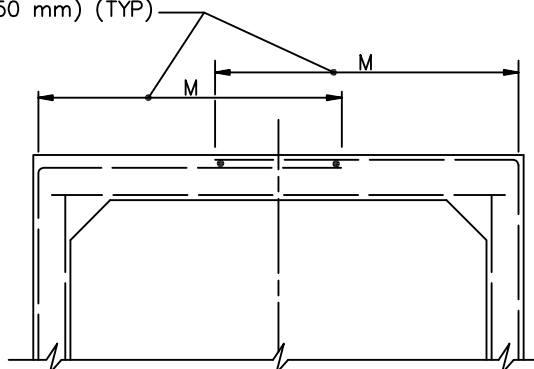

DETAIL 5
OPTION

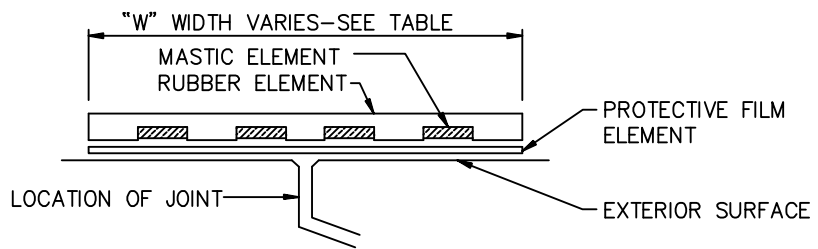



EXTERNAL SEALING BAND SCHEMATIC

TABLE			
SPAN, S		"W" EXTERNAL SEALING BAND WIDTH	
FT	(mm)	INCHES	(mm)
4-6	1200-1800	9	225
7-8	2100-2400	11	275
10-12	3000-3600	14	350

NOTES:


1. THE INSIDE SURFACE OF THE PRCB SOFFIT SHALL BE MARKED "TOP".
2. "W" MINIMUM SHALL EQUAL THE WALL THICKNESS. "W" MAXIMUM SHALL BE 8" (200 mm) FOR SPANS THROUGH 8' (2400 mm) AND 14" (350 mm) FOR SPANS OVER 8' (2500 mm).
3. FOR EXTERNAL SEALING BAND APPLICATIONS SEE BELOW.

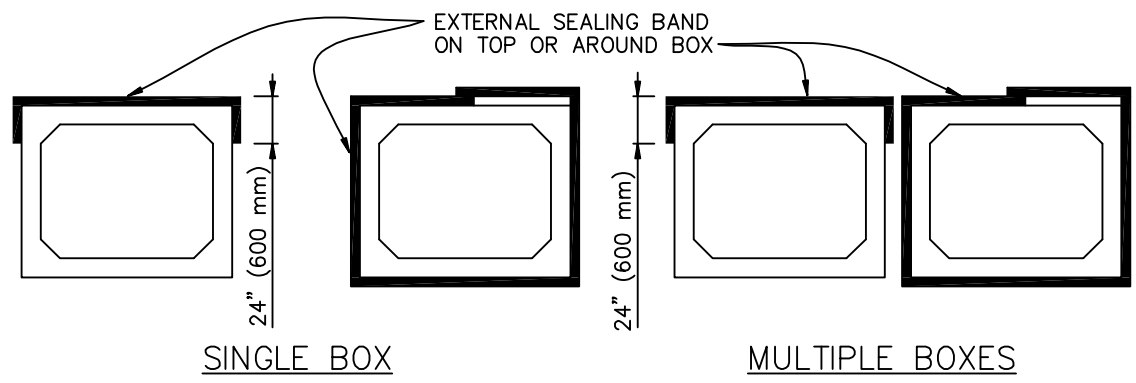

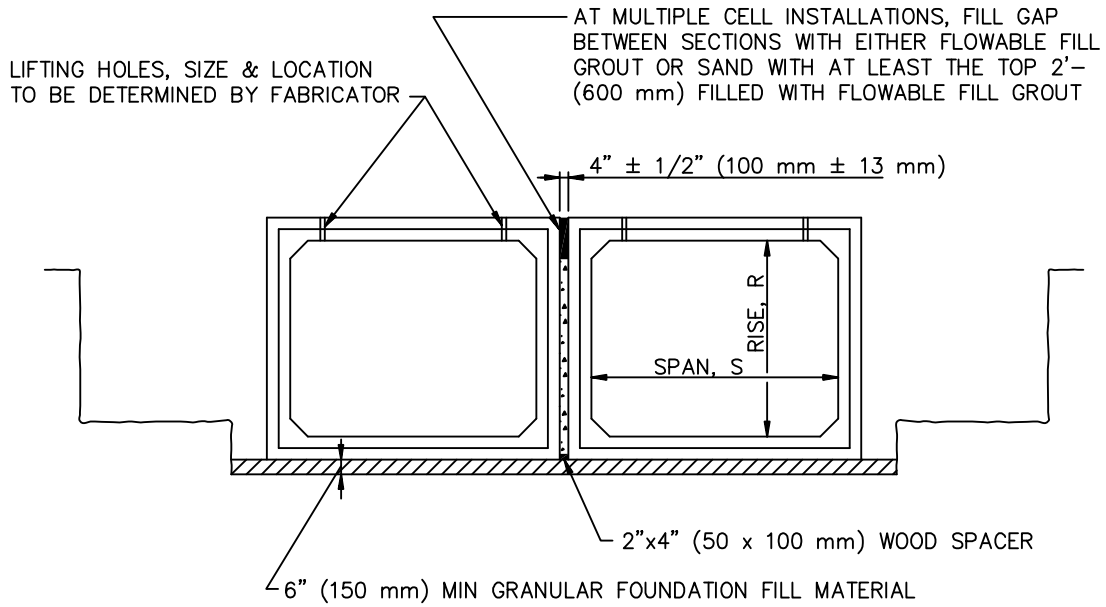









TYPICAL SECTION

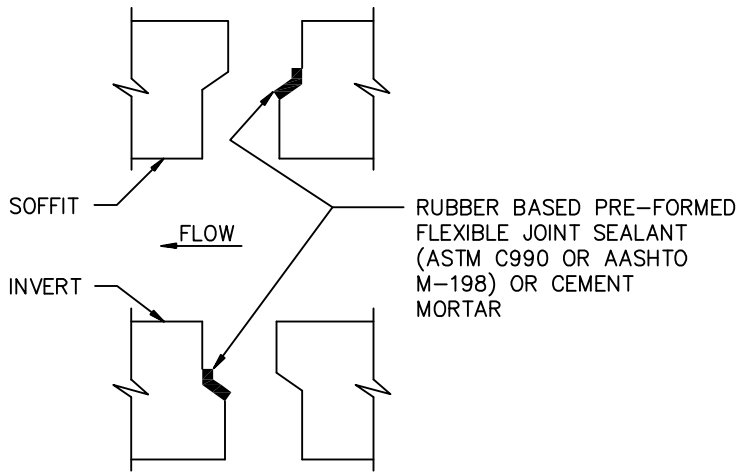SHOWS INSTALLATION OF MULTI-CELL LOCATIONS.
SINGLE CELL INSTALLATION IS SIMILAR.



TYPICAL JOINT DETAIL


LEGEND

	STRUCTURE EXCAVATION		LEVELING BED MATERIAL
	STRUCTURE BACKFILL 95% RELATIVE COMPACTION		ROADWAY STRUCTURAL SECTION
	ROADWAY EMBANKMENT		ORIGINAL GROUND
	SLURRY CEMENT BACKFILL		FLOWABLE FILL GROUT (SEE TYPICAL SECTION ON SHEET 6)

TYPICAL NOTES:

1. SLOPE OR SHORE EXCAVATION SIDES AS DETERMINED BY THE ENGINEER
2. DIMENSIONS SHOWN ARE MINIMUM.
3. CONSTRUCTION OF ROADWAY STRUCTURAL SECTION SHALL NOT DISTURB THE SEALING BAND INSTALLATION.

OG = ORIGINAL GROUND GP = GROUND PROFILE

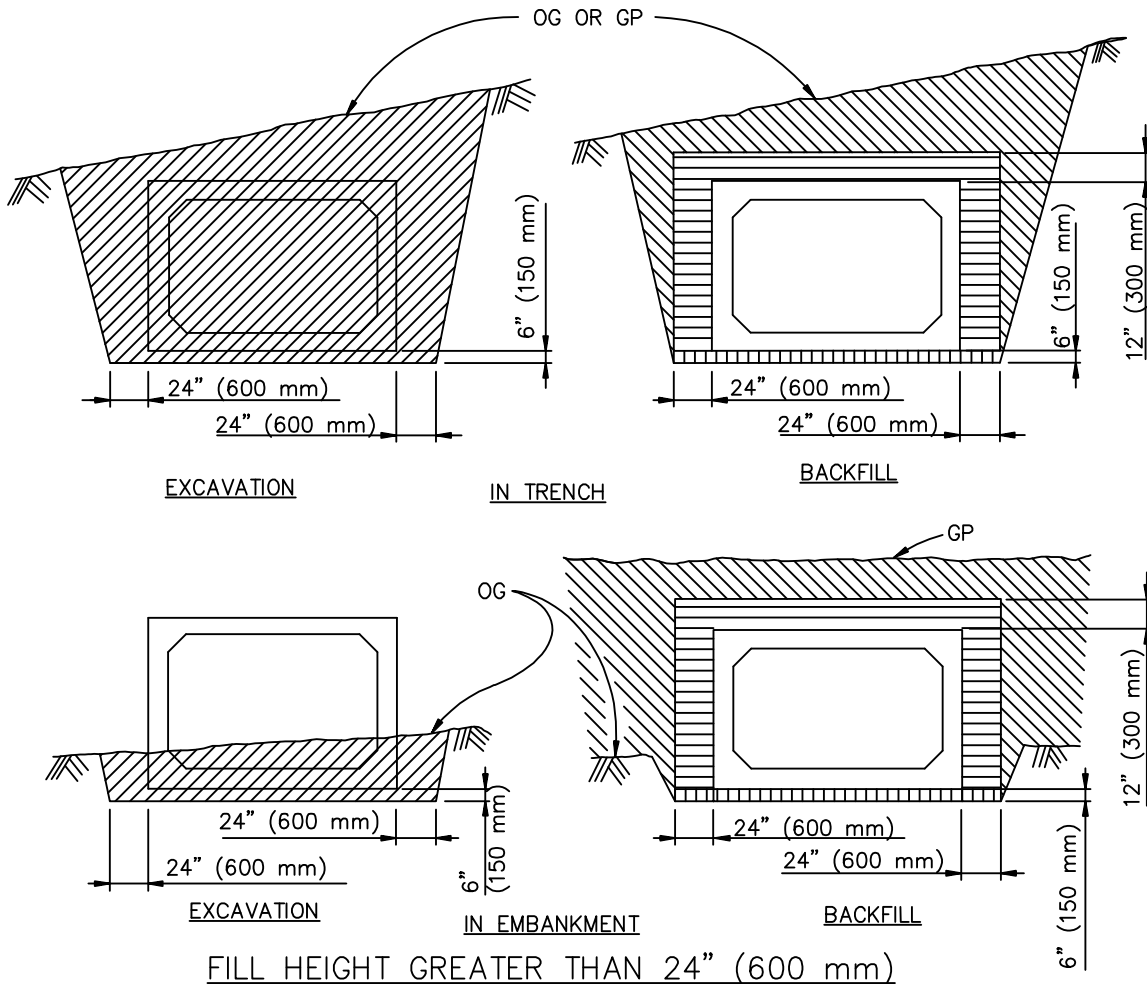

FILL HEIGHT GREATER THAN 24" (600 mm)

EXCAVATION AND BACKFILL DETAILS 1



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0


SHEET 7 OF 42

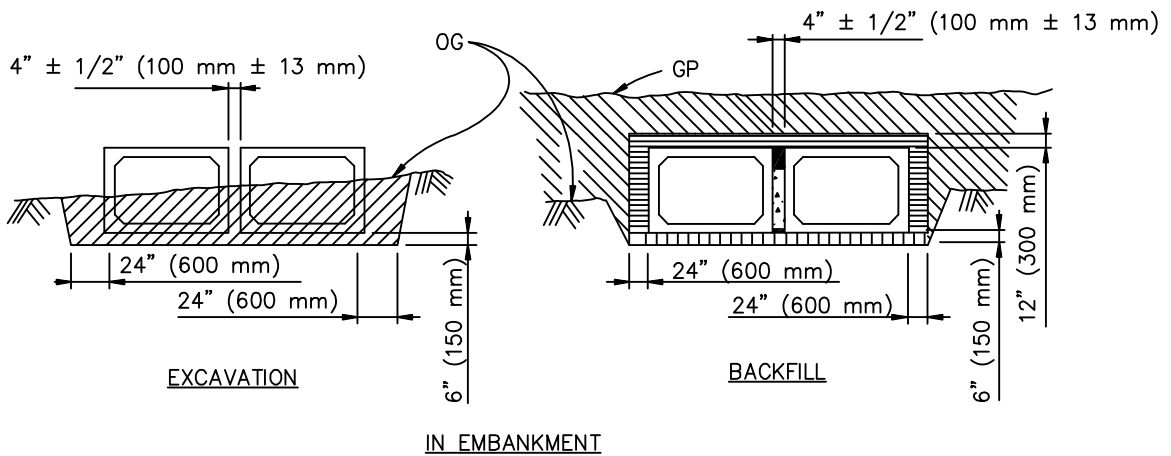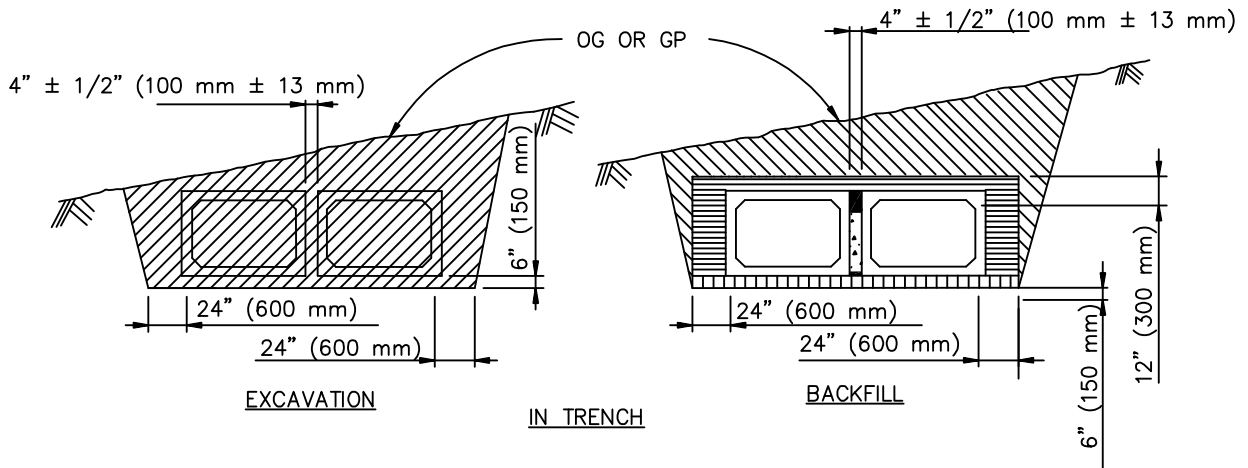

FILL HEIGHT GREATER THAN 24" (600 mm)

EXCAVATION AND BACKFILL DETAILS 2

NOTE: SEE LEGEND AND TYPICAL NOTES ON SHEET 7

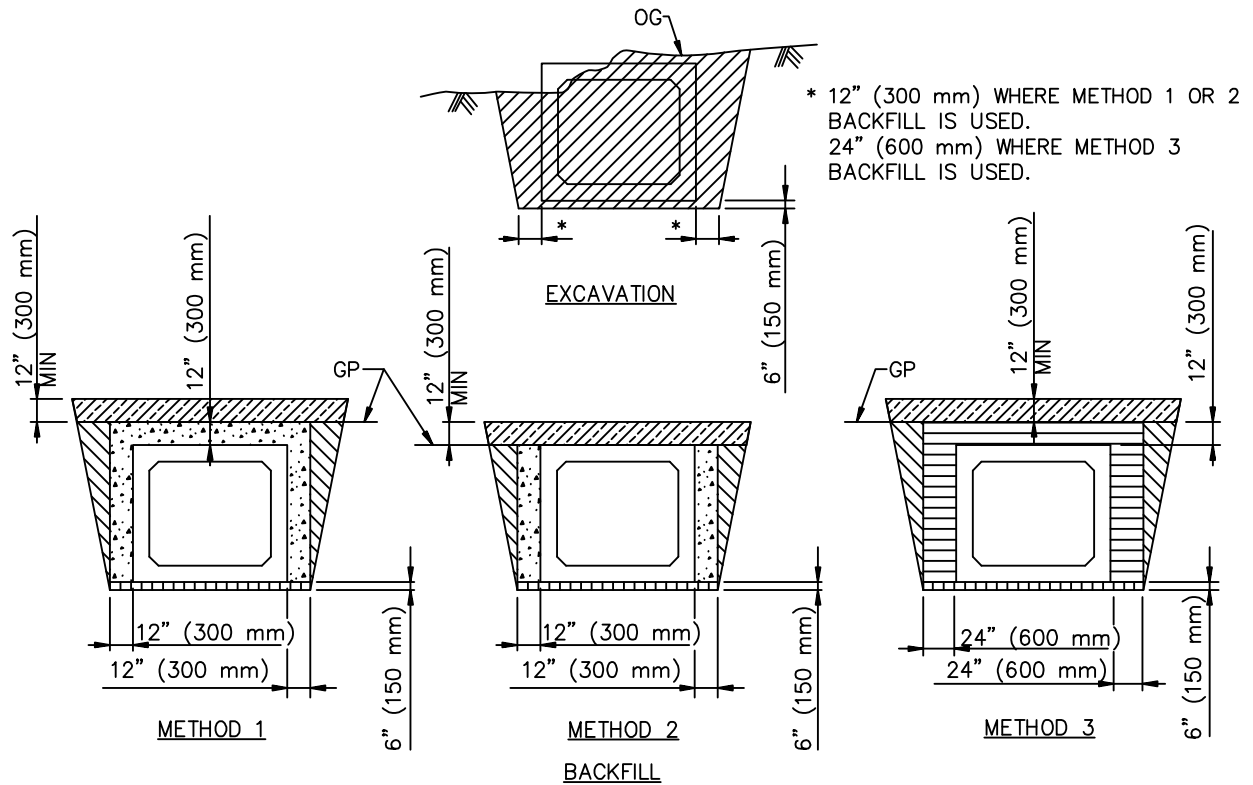

FILL HEIGHT 24" (600 mm) OR LESS
EXCAVATION AND BACKFILL DETAILS 3

NOTE: SEE LEGEND AND TYPICAL NOTES ON SHEET 7


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 9 OF 42

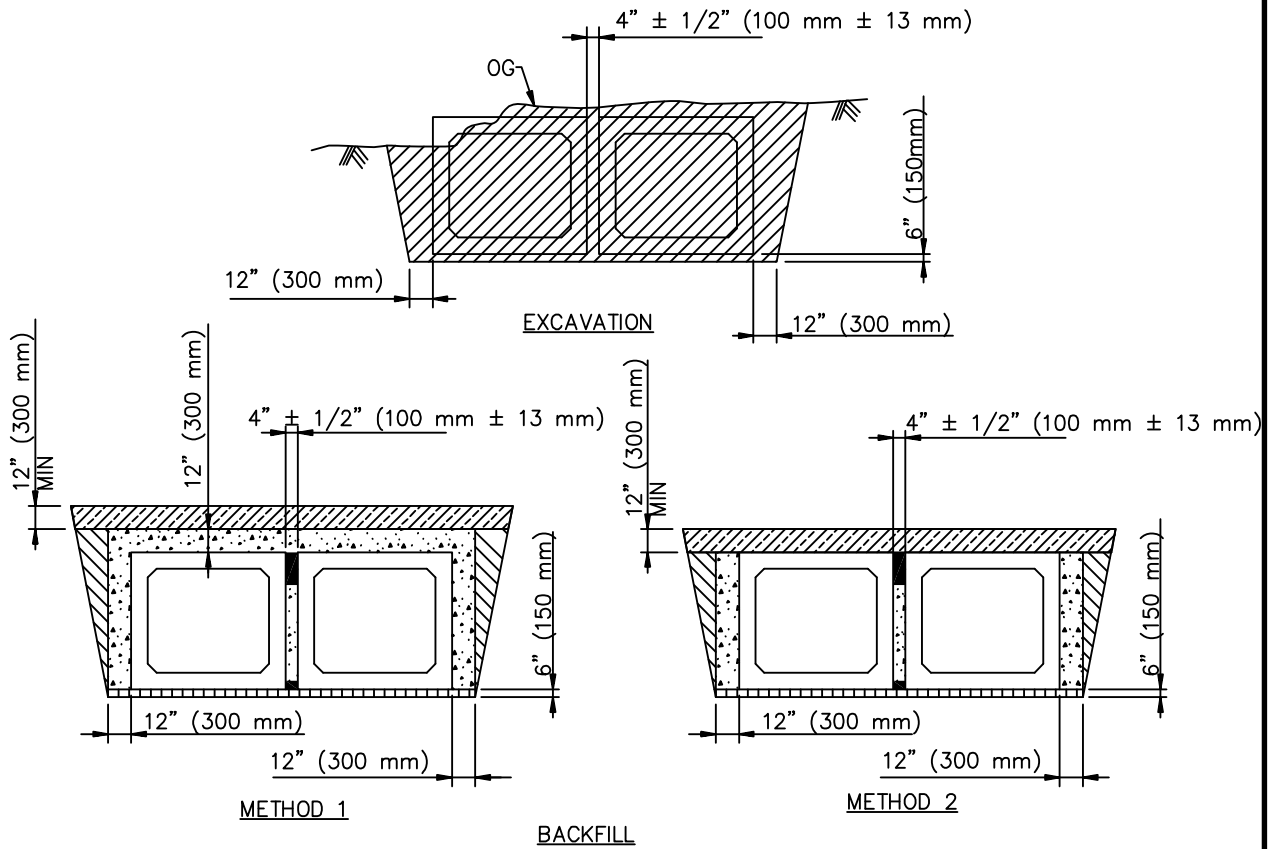

FILL HEIGHT 24" (600 mm) OR LESS
EXCAVATION AND BACKFILL DETAILS 4

NOTE: SEE LEGEND AND TYPICAL NOTES ON SHEET 7


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 10 OF 42

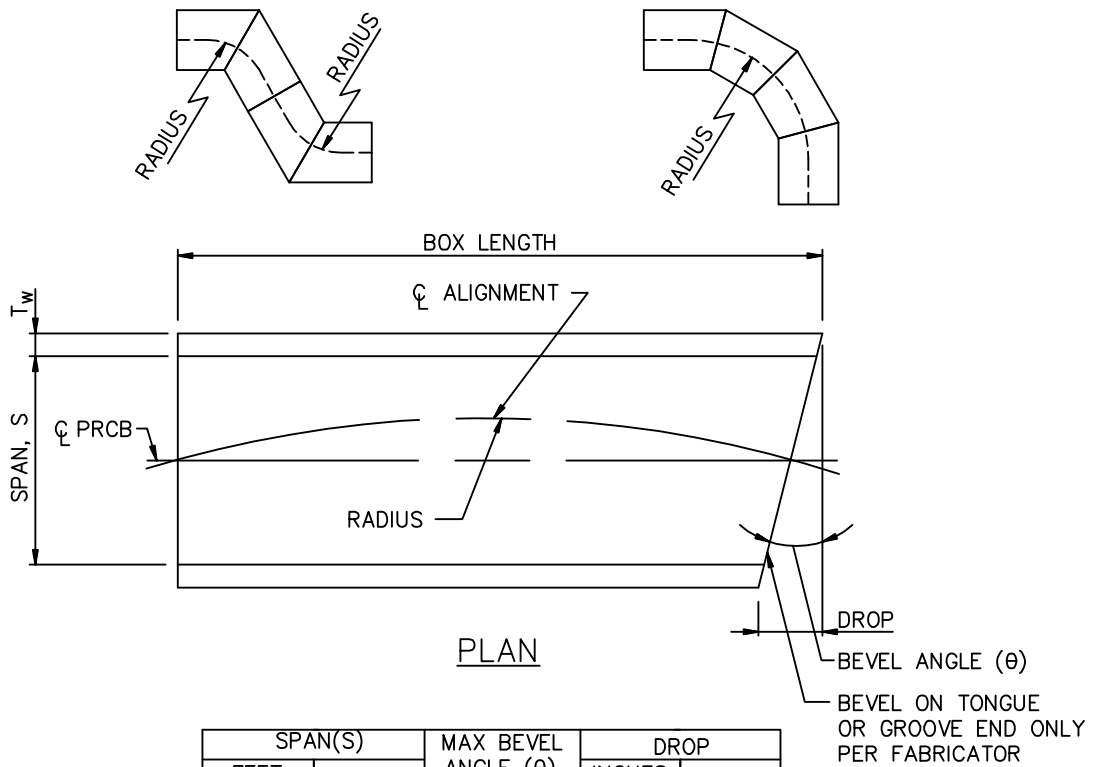

SPAN(S)		MAX BEVEL ANGLE (θ)	DROP	
FEET	mm		INCHES	mm
3	900	5	3.85	97
4	1200	5	5.07	125
5	1500	5	6.30	158
6	1800	5	7.52	188
7	2100	3	5.20	130
8	2400	3	5.87	147
9	2700	3	6.60	165
10	3000	3	7.33	183
11	3300	3	8.07	200
12	3600	3	8.80	220

SPAN(S)		BOX LENGTH		MIN RADIUS	
FEET	mm	FEET	mm	FEET	m
3 THROUGH 6	900 THROUGH 1800	4	1200	45	14
		6	1800	67.5	20.6
		8	2400	90	27
7 THROUGH 12	214 THROUGH 3600	4	1200	75	23
		6	1800	112.5	34.3
		8	2400	150	46

PRECAST REINFORCED CONCRETE BOX BEVELS



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 11 OF 42

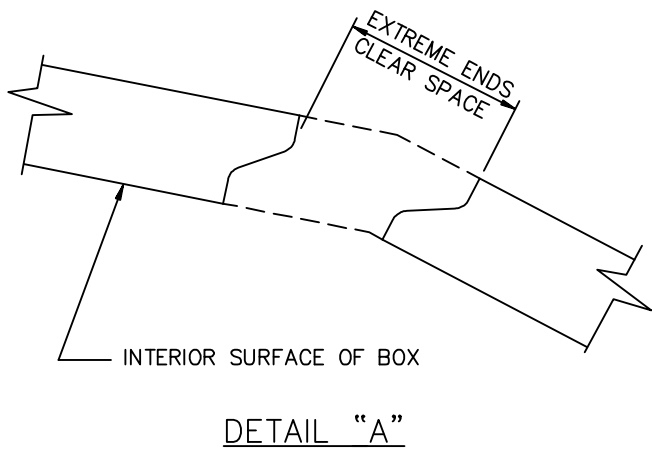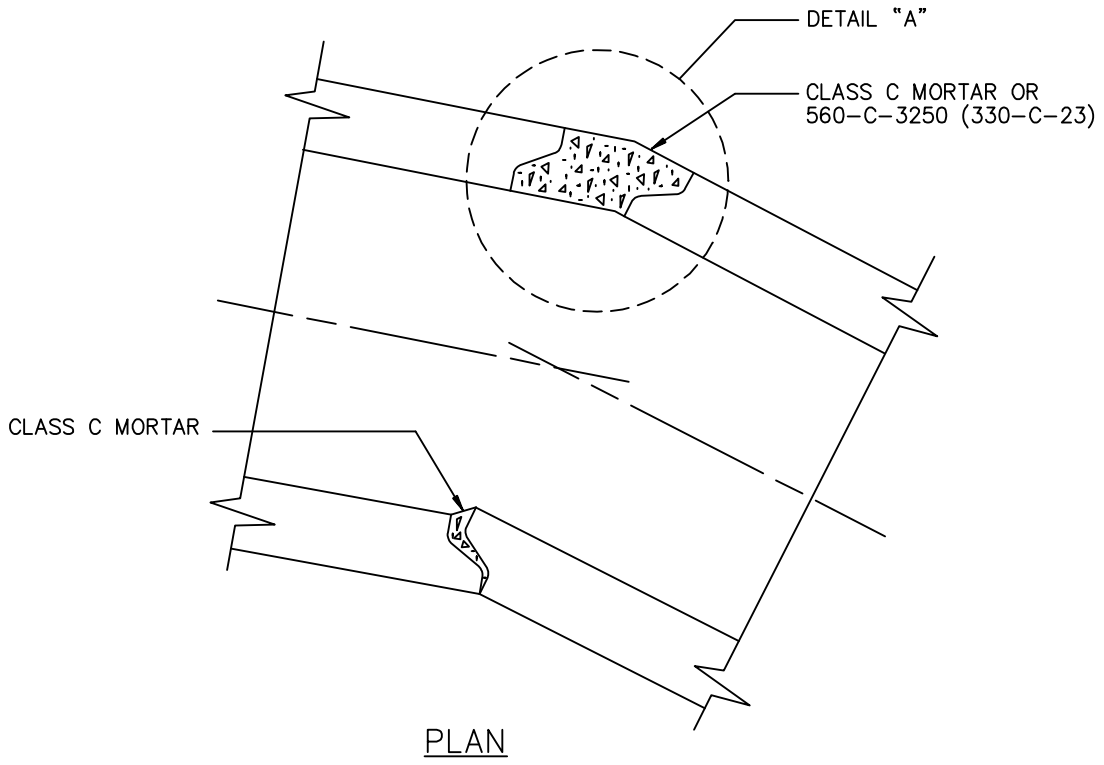

PRECAST REINFORCED CONCRETE BOX PULLED

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION	STANDARD PLAN
PRECAST REINFORCED CONCRETE BOX	390-0 SHEET 12 OF 42

NOTES:

1. STEEL COVER SHALL BE FROM THE FACE OF THE BAR OR WIRE TO THE FACE OF THE CONCRETE.
2. STEEL COVER FROM THE TOP OF INVERT SLAB SHALL BE IN ACCORDANCE WITH THE FOLLOWING:

VELOCITY		STEEL COVER		MINIMUM 28-DAY	
FPS	(m/s)	INCHES	(mm)	CONCRETE STRENGTH	
< 5	(< 1.5)	1.5	(38)	5,000 PSI	(35 MPa)
5 TO 20	(1.5 TO 6)	2.0	(50)	5,000 PSI	(35 MPa)
> 20 TO 40	(> 6 TO 12)	2.5	(63)	5,000 PSI	(35 MPa)
> 40	(> 12)	NOT ALLOWED		NOT ALLOWED	

FPS: FEET PER SECOND
m/s: METERS PER SECOND

3. STEEL COVER FROM THE TOP OF INVERT SLAB MAY BE INCREASED FOR PRCB SUBJECT TO THE ACTION OF SEAWATER, HARMFUL GROUNDWATER, OR APPRECIABLE DEBRIS FLOWS.
4. STEEL COVER GREATER THAN 2.5" (63 mm) MAY RESULT IN DELAMINATION OF CONCRETE. SEE THE PLANS FOR SACRIFICIAL STEEL TO PREVENT SLABBING WHEN THE STEEL COVER EXCEEDS 2.5" (63 mm).
5. PRCB SHALL NOT BE PERMITTED WHEN THE MAXIMUM GROUND WATER TABLE IS LOCATED 1' (300 mm) BELOW THE BOTTOM OF INVERT OR HIGHER, OR THE HYDRAULIC GRADE LINE IS MORE THAN 4' (1200 mm) ABOVE THE SOFFIT.
6. PRCB WITH RISE LARGER THAN 12' (3600 mm) AND SPAN GREATER THAN 12' (3600 mm) SPAN TO 24' (7200 mm), MUST HAVE A SPECIAL DESIGN SUBMITTED FOR REVIEW AND ARE SUBJECT TO APPROVAL BY THE ENGINEER.
7. THE DESIGN TABLES IN THIS STANDARD PLAN DO NOT ACCOUNT FOR TEMPERATURE VARIATIONS, UNBALANCED LATERAL LOADS, RAILROAD LOADING OR LOADING DUE TO OTHER TEMPORARY OR PERMANENT STRUCTURES. SPECIAL DESIGN FOR THESE LOADS, IF APPLICABLE, MUST BE SUBMITTED FOR REVIEW AND ARE SUBJECT TO APPROVAL BY THE ENGINEER.
8. DESIGN CRITERIA: AASHTO SPECIFICATIONS FOR HIGHWAY BRIDGES, CURRENT LFD EDITION, EXCEPT THE LOAD FACTOR FOR DEAD LOAD (β_D) AND EARTH PRESSURE (β_E) = 1.4
9. IF STEEL BARS GRADE 60 (GRADE 420) ARE USED IN LIEU OF WELDED WIRE REINFORCEMENT, THE STEEL AREAS PRESENTED SHALL BE INCREASED TO ACCOUNT FOR THE DIFFERENCES IN STEEL YIELD STRENGTH, STEEL SPACING, CONCRETE COVER, AND CRACK CONTROL.
10. THE JOINTS OF THE SECTIONS SHALL BE OF SUCH DESIGN THAT THEY WILL WITHSTAND THE FORCES CAUSED BY THE COMPRESSION OF THE SEALANT WHEN JOINED, WITHOUT CRACKING OR FRACTURING WHEN TESTED.
11. LONGITUDINAL STEEL SHALL HAVE AN AREA OF AT LEAST 40 PERCENT OF THE TRANSVERSE STEEL AND 8" (200 mm) MAXIMUM SPACING.
12. THE INSIDE TRANSVERSE REINFORCEMENT SHALL EXTEND INTO THE TONGUE PORTION OF THE JOINT AND THE OUTSIDE TRANSVERSE REINFORCEMENT SHALL EXTEND INTO THE GROOVE PORTION OF THE JOINT.
13. THE CLEAR DISTANCE OF THE END TRANVERSE WIRES SHALL BE NOT LESS THAN 1/2" (12 mm) NOR MORE THAN 2 INCHES (50 mm) FROM THE ENDS OF THE PRCB SECTION.
14. REINFORCEMENT MAY BE ASSEMBLED USING ANY COMBINATION OF SINGLE OR MULTIPLE LAYERS OF WELDED-WIRE REINFORCEMENT.
15. A COMMON REINFORCEMENT UNIT MAY BE USED FOR BOTH A_{S2} (OR A_{S3}) AND A_{S4} , AND ALSO FOR BOTH A_{S7} (OR A_{S8}) AND A_{S1} , WITH THE LARGEST AREA REQUIREMENT GOVERNING, BENDING THE REINFORCEMENT 90° AT THE CORNERS AND WAIVING THE EXTENSION REQUIREMENTS SHOWN IN DETAILS 1 THROUGH 4.
16. WHEN A SINGLE CAGE OF MULTIPLE TRANSVERSE STEEL IS USED FOR A_{S2} (OR A_{S3}) AND A_{S4} REINFORCEMENT, THE SLAB OR WALL REQUIRING THE LARGER STEEL AREA SHALL HAVE THIS ADDITIONAL TRANSVERSE STEEL EXTENDING THE FULL LENGTH OF THE SLAB OR WALL.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 13 OF 42

17. WELDED WIRE REINFORCEMENT SHALL BE COMPOSED OF TRANSVERSE AND LONGITUDINAL WIRES WITH SUFFICIENT LONGITUDINAL WIRES EXTENDING THROUGH THE PRCB SECTION TO MAINTAIN THE SHAPE AND POSITION OF REINFORCEMENT.
18. THE ENDS OF THE LONGITUDINAL DISTRIBUTION REINFORCEMENT SHALL NOT BE MORE THAN 2" (50 mm) FROM THE ENDS OF THE PRCB SECTION.
19. THE ENDS OF THE LONGITUDINALS, STIRRUPS, AND SPACERS USED TO POSITION THE REINFORCEMENT MAY BE EXPOSED TO CONTACT WITH FORMS.
20. THE OVERLAP MEASURED BETWEEN THE OUTERMOST LONGITUDINAL WIRES OF EACH WELDED WIRE REINFORCEMENT SHEET SHALL NOT BE LESS THAN THE SPACING OF THE LONGITUDINAL WIRES PLUS 2" (50 mm) NOR LESS THAN 10" (250 mm).
21. IF A_{S1} IS EXTENDED TO THE MIDDLE OF EITHER SLAB AND CONNECTED, WELDED SPLICES ARE ALLOWED IN THE CONNECTION.
22. WHEN USED, A_{S7} AND A_{S8} SHALL BE LAPPED WITH A_{S1} AS SHOWN ON DETAILS 3 AND 4.
23. SPLICES IN THE TRANSVERSE REINFORCEMENT SHALL BE MADE BY LAPPING. IF WELDS ARE MADE TO TRANSVERSE REINFORCEMENT, THEY SHALL BE MADE ONLY TO SELECTED TRANSVERSE WIRES THAT ARE NOT LESS THAN 18" (460 mm) APART ALONG THE LONGITUDINAL AXIS OF THE PRCB SECTION. ALSO, WHEN SPACERS ARE WELDED TO TRANSVERSE WIRES, THEY SHALL BE WELDED ONLY TO THE SELECTED TRANSVERSE WIRES.
24. THERE SHALL BE NO WELDING TO OTHER TRANSVERSE WIRES, EXCEPT A_{S4} MAY BE LAPPED AND WELDED AT ANY LOCATION OR CONNECTED BY WELDING AT THE CORNERS TO A_{S2} AND A_{S3} .
25. NO WELDS OR LAPS SHALL BE MADE TO A_{S2} OR A_{S3} TRANSVERSE WIRES IN THE MIDDLE THIRD OF THE SPAN.
26. WHEN DISTRIBUTION REINFORCEMENT IS TO BE FASTENED TO A CAGE BY WELDING, IT SHALL BE WELDED ONLY TO LONGITUDINAL WIRES AND ONLY NEAR THE ENDS OF THE PRCB SECTION.
27. THE SPACING CENTER TO CENTER OF THE TRANSVERSE WIRES SHALL BE NOT LESS THAN 2" (50 mm) NOR MORE THAN 4" (100 mm).
28. THE SPACING CENTER TO CENTER OF THE LONGITUDINAL WIRES SHALL BE NOT MORE THAN 8" (200 mm).
29. OUTER CAGE TRANSVERSE REINFORCEMENT AS SHOWN SHALL BE PLACED IN THE TOP AND BOTTOM SLABS AT THE GROOVE PORTION OF THE JOINT WHEN A_{S1} IS NOT CONTINUOUS OVER THE SPAN.
30. IF STEEL BARS (GRADE 60) ARE USED IN LIEU OF WELDED WIRE REINFORCEMENT, THE STEEL AREAS SHALL BE INCREASED TO ACCOUNT FOR THE DIFFERENCE IN STEEL YIELD STRENGTH, STEEL SPACING, CONCRETE COVER, AND CRACK CONTROL BETWEEN THE WELDED WIRE REINFORCEMENT AND STEEL BARS.
31. IN LIEU OF PERFORMING A SPECIAL DESIGN FOR THE SPECIFIC CASE WHERE THE ACTUAL HAUNCH DIMENSIONS ARE LARGER THAN THE STANDARD DIMENSIONS AND VERTICAL AND HORIZONTAL HAUNCH DIMENSIONS ARE EQUAL, THE A_{S1} STEEL AREA SHALL BE INCREASED 1 PERCENT FOR EVERY 5 PERCENT INCREASE IN THE HAUNCH DIMENSION OVER THAT SPECIFIED, AND A_{S2} AND A_{S3} SHALL BE REDUCED BY AN EQUAL PERCENTAGE.

NOTE:

SHEETS 16 TO 24 HAVE 1.5" (38 mm) OF STEEL COVER AT THE TOP OF INVERT SLAB.
 SHEETS 25 TO 33 HAVE 2.0" (50 mm) OF STEEL COVER AT THE TOP OF INVERT SLAB.
 SHEETS 34 TO 42 HAVE 2.5" (63 mm) OF STEEL COVER AT THE TOP OF INVERT SLAB.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 14 OF 42

SPECIFIC CRITERIA USED FOR TABLES

MATERIAL PROPERTIES:

WELDED WIRE REINFORCEMENT,----- 65,000 PSI (450 MPa)
 MINIMUM SPECIFIED YIELD STRESS

DEFORMED BARS,----- 60,000 PSI (420 MPa)
 MINIMUM SPECIFIED YIELD STRESS

CONCRETE,----- 5,000 PSI (35 MPa)
 MINIMUM SPECIFIED COMPRESSIVE STRENGTH

SOIL DATA:

UNIT WEIGHT----- 120 lbf/ft³ (20 kN/m³)

RATIO OF LATERAL TO VERTICAL PRESSURE----- 0.50 MAX TO 0.25 MIN
 FROM WEIGHT TO EARTH

ADDITIONAL LATERAL PRESSURE FROM----- 700/H_e, lbf/ft² (10/H_e, kN/m²) OR
 APPROACHING TRUCK WHEELS----- 800 lbf/ft² (39 kN/m²)
 WHEN H_e < 1 FEET (300 mm), WHERE H_e = EARTH
 COVER, FEET (mm)

EXTERNAL WATER TABLE----- BELOW BOX SECTION INVERT

SOIL STRUCTURE INTERACTION FACTOR----- 1.15

CAPACITY REDUCTION FACTORS (FROM AASHTO BRIDGE SPECIFICATIONS):

SHEAR ----- 0.90

AXIAL COMPRESSION COMBINED WITH BENDING----- 0.95

LOADING DATA:

LOAD FACTOR = $\delta(\beta_D + \beta_L)$ ----- $\delta = 1.3$
 $\beta_D = 1.40$ FOR DEAD LOADS
 $\beta_L = 1.67$ FOR LIVE LOADS

TRUCK AXLE LOAD:

HS20 (MS18)----- 32,000 lbf (142 kN)

IMPACT (VARIABLE WITH DEPTH)----- 0 TO 30% (FROM AASHTO BRIDGE SPECIFICATIONS):

UNIFORM INTERNAL PRESSURE----- 0.0

DEPTH OF WATER IN BOX SECTION----- EQUAL TO INSIDE HEIGHT

EXTERNAL GROUND WATER PRESSURE----- 0.0

STRUCTURAL ARRANGEMENT:

CONCRETE COVER OVER STEEL----- 1.0 INCH (25 mm)
 TOP SLAB----- 1.0 INCH (25 mm) FOR FILL HEIGHT 2 FEET
 (600 mm) AND GREATER, 2.0 INCHES (50 mm)
 FOR FILL HEIGHTS UNDER 2 FEET (600 mm)

SLAB THICKNESS----- FOR FILL HEIGHTS GREATER THAN 2 FEET
 (600 mm), 1/12 TIMES INSIDE SPAN PLUS 1.0
 INCH (25 mm) UP TO 7-FOOT (2100 mm) SPAN,
 1/12 INSIDE SPAN ABOVE 7-FOOT (2100 mm)
 SPAN

SIDE WALL THICKNESS----- 1/12 TIMES INSIDE SPAN PLUS 1.0 INCH
 (25 mm) UP TO 7-FOOT (2100 mm) SPAN,
 1/12 INSIDE SPAN ABOVE 7-FOOT SPAN
 (2100 mm)

MINIMUM HAUNCH DIMENSIONS----- VERTICAL AND HORIZONTAL DIMENSIONS BOTH
 EQUAL TO WALL THICKNESS

TRANSVERSE WIRE SPACING----- 4.0 INCHES (100 mm) MAX

MINIMUM REINFORCING INSIDE FACE SLABS
 AND SIDE WALLS, OUTSIDE FACE SIDE WALLS
 AND CORNERS OF SLABS----- 0.002 x GROSS AREA

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 15 OF 42

SPAN, S FEET (mm)	RISE, R FEET (mm)	T _t TOP INCHES (mm)	T _b BOTTOM INCHES (mm)	T _w SIDE INCHES (mm)	H HAUNCH INCHES (mm)	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)							
						A _{S1}	A _{S2}	A _{S3}	A _{S4}	A _{S5}	A _{S6}	A _{S7}	A _{S8}
3 (900)	2 (600)	7 (175)	6 (150)	4 (100)	4 (100)	0.38 (804)	0.23 (487)	0.10 (212)	0.22 (466)	0.17 (360)	0.17 (360)	0.17 (360)	0.14 (296)
3 (900)	3 (900)	7 (175)	6 (150)	4 (100)	4 (100)	0.40 (847)	0.25 (529)	0.10 (212)	0.23 (487)	0.17 (360)	0.17 (360)	0.17 (360)	0.14 (296)
4 (1200)	2 (600)	7.5 (190)	6 (150)	5 (125)	5 (125)	0.40 (847)	0.22 (466)	0.12 (254)	0.21 (445)	0.18 (381)	0.18 (381)	0.18 (381)	0.14 (296)
4 (1200)	3 (900)	7.5 (190)	6 (150)	5 (125)	5 (125)	0.45 (953)	0.26 (550)	0.12 (254)	0.23 (487)	0.18 (381)	0.18 (381)	0.18 (381)	0.14 (296)
4 (1200)	4 (1200)	7.5 (190)	6 (150)	5 (125)	5 (125)	0.47 (995)	0.28 (593)	0.12 (254)	0.25 (529)	0.18 (381)	0.18 (381)	0.18 (381)	0.14 (296)
5 (1500)	3 (900)	8 (200)	7 (175)	6 (150)	6 (150)	0.44 (931)	0.24 (508)	0.14 (296)	0.22 (466)	0.19 (402)	0.19 (402)	0.17 (360)	0.17 (360)
5 (1500)	4 (1200)	8 (200)	7 (175)	6 (150)	6 (150)	0.48 (1016)	0.27 (572)	0.14 (296)	0.24 (508)	0.19 (402)	0.19 (402)	0.17 (360)	0.17 (360)
5 (1500)	5 (1500)	8 (200)	7 (175)	6 (150)	6 (150)	0.50 (1059)	0.29 (614)	0.14 (296)	0.25 (529)	0.19 (402)	0.19 (402)	0.17 (360)	0.17 (360)
6 (1800)	3 (900)	8 (200)	7 (175)	7 (175)	7 (175)	0.45 (953)	0.22 (466)	0.17 (360)	0.22 (466)	0.19 (402)	0.19 (402)	0.17 (360)	0.17 (360)
6 (1800)	4 (1200)	8 (200)	7 (175)	7 (175)	7 (175)	0.49 (1037)	0.25 (529)	0.17 (360)	0.23 (487)	0.19 (402)	0.19 (402)	0.17 (360)	0.17 (360)
6 (1800)	5 (1500)	8 (200)	7 (175)	7 (175)	7 (175)	0.52 (1101)	0.28 (593)	0.17 (360)	0.25 (529)	0.19 (402)	0.19 (402)	0.17 (360)	0.17 (360)
6 (1800)	6 (1800)	8 (200)	7 (175)	7 (175)	7 (175)	0.54 (1143)	0.30 (635)	0.17 (360)	0.26 (550)	0.19 (402)	0.19 (402)	0.17 (360)	0.17 (360)
7 (2100)	4 (1200)	8 (200)	8 (200)	8 (200)	8 (200)	0.49 (1037)	0.25 (529)	0.19 (402)	0.23 (487)	0.19 (402)	0.19 (402)	0.19 (402)	0.19 (402)
7 (2100)	5 (1500)	8 (200)	8 (200)	8 (200)	8 (200)	0.52 (1101)	0.31 (656)	0.19 (402)	0.24 (508)	0.19 (402)	0.19 (402)	0.19 (402)	0.19 (402)
7 (2100)	6 (1800)	8 (200)	8 (200)	8 (200)	8 (200)	0.54 (1143)	0.33 (699)	0.19 (402)	0.26 (550)	0.19 (402)	0.19 (402)	0.19 (402)	0.19 (402)
7 (2100)	7 (2100)	8 (200)	8 (200)	8 (200)	8 (200)	0.56 (1186)	0.36 (762)	0.19 (402)	0.27 (572)	0.19 (402)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	4 (1200)	8 (200)	8 (200)	8 (200)	8 (200)	0.53 (1122)	0.32 (677)	0.19 (402)	0.25 (529)	0.19 (402)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	5 (1500)	8 (200)	8 (200)	8 (200)	8 (200)	0.57 (1207)	0.35 (741)	0.19 (402)	0.26 (550)	0.19 (402)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	6 (1800)	8 (200)	8 (200)	8 (200)	8 (200)	0.59 (1249)	0.37 (783)	0.19 (402)	0.28 (593)	0.22 (466)	0.22 (466)	0.19 (402)	0.19 (402)
8 (2400)	7 (2100)	8 (200)	8 (200)	8 (200)	8 (200)	0.62 (1313)	0.40 (847)	0.20 (423)	0.29 (614)	0.19 (402)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	8 (2400)	8 (200)	8 (200)	8 (200)	8 (200)	0.64 (1335)	0.42 (889)	0.24 (508)	0.30 (635)	0.19 (402)	0.19 (402)	0.19 (402)	0.19 (402)
9 (2700)	5 (1500)	9 (225)	9 (225)	9 (225)	9 (225)	0.53 (1122)	0.33 (699)	0.22 (466)	0.25 (529)	0.22 (466)	0.22 (466)	0.22 (466)	0.22 (466)
9 (2700)	6 (1800)	9 (225)	9 (225)	9 (225)	9 (225)	0.56 (1186)	0.35 (741)	0.22 (466)	0.26 (550)	0.22 (466)	0.22 (466)	0.22 (466)	0.22 (466)
9 (2700)	7 (2100)	9 (225)	9 (225)	9 (225)	9 (225)	0.58 (1228)	0.38 (804)	0.22 (466)	0.27 (572)	0.22 (466)	0.22 (466)	0.22 (466)	0.22 (466)

SHALLOW COVER BOXES – COVER 0' TO 2' (0 TO 600 mm)
STEEL COVER 1.5" (38 mm) AT TOP OF INVERT SLAB

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 16 OF 42

SPAN, S FEET (mm)	RISE, R FEET (mm)	T ₊ TOP INCHES (mm)	T _B BOTTOM INCHES (mm)	T _W SIDE INCHES (mm)	H HAUNCH INCHES (mm)	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)								
						AS1	AS2	AS3	AS4	AS5	AS6	AS7	AS8	
9 (2700)	8 (2400)	9 (225)	9 (225)	9 (225)	9 (225)	0.23 (487)	0.60 (1270)	0.41 (868)	0.22 (466)	0.28 (593)	0.22 (466)	0.22 (466)	0.22 (466)	0.22 (466)
9 (2700)	9 (2700)	9 (225)	9 (225)	9 (225)	9 (225)	0.24 (508)	0.62 (1313)	0.44 (931)	0.27 (572)	0.28 (593)	0.22 (466)	0.22 (466)	0.22 (466)	0.22 (466)
10 (3000)	5 (1500)	10 (250)	10 (250)	10 (250)	10 (250)	0.29 (614)	0.51 (1080)	0.34 (720)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	6 (1800)	10 (250)	10 (250)	10 (250)	10 (250)	0.27 (572)	0.53 (1122)	0.37 (783)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	7 (2100)	10 (250)	10 (250)	10 (250)	10 (250)	0.25 (529)	0.55 (1164)	0.40 (847)	0.24 (508)	0.25 (529)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	8 (2400)	10 (250)	10 (250)	10 (250)	10 (250)	0.24 (508)	0.57 (1207)	0.43 (910)	0.24 (508)	0.26 (550)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	9 (2700)	10 (250)	10 (250)	10 (250)	10 (250)	0.24 (508)	0.59 (1249)	0.46 (974)	0.25 (529)	0.27 (572)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	10 (3000)	10 (250)	10 (250)	10 (250)	10 (250)	0.26 (550)	0.60 (1270)	0.49 (1037)	0.30 (635)	0.28 (593)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
12 (3600)	4 (1200)	12 (300)	12 (300)	12 (300)	12 (300)	0.37 (783)	0.44 (931)	0.33 (699)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	5 (1500)	12 (300)	12 (300)	12 (300)	12 (300)	0.35 (741)	0.46 (974)	0.36 (762)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	6 (1800)	12 (300)	12 (300)	12 (300)	12 (300)	0.33 (699)	0.49 (1037)	0.39 (826)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	7 (2100)	12 (300)	12 (300)	12 (300)	12 (300)	0.31 (656)	0.51 (1080)	0.43 (910)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	8 (2400)	12 (300)	12 (300)	12 (300)	12 (300)	0.30 (635)	0.52 (1101)	0.46 (974)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	9 (2700)	12 (300)	12 (300)	12 (300)	12 (300)	0.29 (614)	0.54 (1143)	0.49 (1037)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	10 (3000)	12 (300)	12 (300)	12 (300)	12 (300)	0.29 (614)	0.55 (1164)	0.52 (1101)	0.29 (614)	0.30 (635)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	11 (3300)	12 (300)	12 (300)	12 (300)	12 (300)	0.29 (614)	0.57 (1207)	0.55 (1164)	0.30 (635)	0.31 (656)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	12 (3600)	12 (300)	12 (300)	12 (300)	12 (300)	0.31 (656)	0.58 (1228)	0.58 (1228)	0.38 (804)	0.32 (677)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)

SHALLOW COVER BOXES – COVER 0' TO 2' (0 TO 610 mm)
STEEL COVER 1.5" (38 mm) AT TOP OF INVERT SLAB

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 17 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR
HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 1.5" (38 mm) AT TOP OF INVERT SLAB

H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	
	AS1	AS2	AS3			AS4	AS1	AS2		AS3
3' x 2' x 4" (900 x 600 x 100 mm)										
3 (915)	0.13 (275)	0.21 (445)	0.26 (550)	0.10 (217)	3 (915) *	0.17 (360)	0.25 (529)	0.28 (593)	0.12 (254)	38 (950)
5 (1525)	0.10 (217)	0.10 (217)	0.11 (233)	0.10 (217)	5 (1525) *	0.12 (254)	0.12 (254)	0.15 (318)	0.12 (254)	38 (950)
10 (3000) *	0.10 (217)	0.11 (233)	0.14 (296)	0.10 (217)	10 (3000) *	0.12 (254)	0.15 (318)	0.19 (402)	0.12 (254)	38 (950)
15 (4500) *	0.10 (217)	0.16 (339)	0.20 (423)	0.10 (217)	15 (4500) *	0.12 (254)	0.23 (489)	0.27 (572)	0.12 (254)	38 (950)
20 (6000) *	0.12 (254)	0.22 (466)	0.25 (529)	0.10 (217)	20 (6000) *	0.16 (339)	0.30 (635)	0.36 (762)	0.12 (254)	38 (950)
25 (7500) *	0.16 (339)	0.28 (593)	0.35 (741)	0.10 (217)	25 (7500) *	0.20 (423)	0.38 (804)	0.46 (974)	0.12 (254)	38 (950)
3' x 3' x 4" (900 x 900 x 100 mm)										
3 (915)	0.10 (217)	0.25 (529)	0.31 (656)	0.10 (217)	3 (915) *	0.14 (296)	0.31 (656)	0.32 (677)	0.12 (254)	38 (950)
5 (1525)	0.10 (217)	0.11 (233)	0.12 (254)	0.10 (217)	5 (1525) *	0.12 (254)	0.17 (360)	0.15 (318)	0.12 (254)	38 (950)
10 (3000) *	0.10 (217)	0.11 (233)	0.14 (296)	0.10 (217)	10 (3000) *	0.12 (254)	0.15 (318)	0.19 (402)	0.12 (254)	38 (950)
15 (4500) *	0.10 (217)	0.16 (339)	0.21 (445)	0.10 (217)	15 (4500) *	0.12 (254)	0.22 (466)	0.27 (572)	0.12 (254)	38 (950)
20 (6000) *	0.10 (217)	0.22 (466)	0.28 (593)	0.10 (217)	20 (6000) *	0.13 (275)	0.30 (635)	0.36 (762)	0.12 (254)	38 (950)
25 (7500) *	0.11 (233)	0.28 (593)	0.36 (762)	0.10 (217)	25 (7500) *	0.16 (339)	0.38 (804)	0.46 (974)	0.12 (254)	38 (950)
4' x 2' x 5" (1200 x 600 x 125 mm)										
3 (915)	0.21 (445)	0.23 (489)	0.23 (489)	0.12 (254)	3 (915)	0.21 (445)	0.29 (614)	0.25 (529)	0.14 (296)	45 (1125)
5 (1525)	0.12 (254)	0.12 (254)	0.13 (275)	0.12 (254)	5 (1525)	0.14 (296)	0.15 (318)	0.17 (360)	0.14 (296)	36 (900)
10 (3000) *	0.12 (254)	0.14 (296)	0.16 (339)	0.12 (254)	10 (3000)	0.14 (296)	0.18 (381)	0.22 (466)	0.14 (296)	36 (900)
15 (4500) *	0.16 (339)	0.20 (423)	0.24 (508)	0.12 (254)	15 (4500)	0.18 (381)	0.27 (572)	0.32 (677)	0.14 (296)	35 (875)
20 (6000) *	0.22 (466)	0.27 (572)	0.32 (677)	0.12 (254)	20 (6000)	0.25 (529)	0.36 (762)	0.42 (889)	0.14 (296)	35 (875)
25 (7500) *	0.28 (593)	0.34 (720)	0.40 (847)	0.12 (254)	25 (7500) *	0.32 (677)	0.46 (974)	0.53 (1122)	0.14 (296)	35 (875)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 18 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm) STEEL COVER 1.5" (38 mm) AT TOP OF INVERT SLAB

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)			
	AS1	AS2	AS3			AS4	AS1	AS2		AS3	AS4	
5' x 4' x 6" (1500 x 1200 x 150 mm)												
3	0.18 (381)	0.33 (699)	0.28 (593)	0.14 (296)	45 (1125)	3	(915)	0.22 (466)	0.33 (699)	0.27 (572)	0.17 (360)	43 (1075)
5	0.14 (296)	0.16 (339)	0.19 (402)	0.14 (296)	45 (1125)	5	(1525)	0.17 (360)	0.18 (381)	0.21 (445)	0.17 (360)	40 (1000)
10	0.14 (296)	0.20 (423)	0.24 (508)	0.14 (296)	36 (900)	10	(3000)	0.17 (360)	0.22 (466)	0.27 (572)	0.17 (360)	39 (975)
15	0.15 (318)	0.29 (614)	0.34 (720)	0.14 (296)	35 (875)	15	(4500)	0.21 (445)	0.33 (699)	0.39 (826)	0.17 (360)	38 (950)
20	0.20 (423)	0.39 (826)	0.45 (953)	0.14 (296)	35 (875)	20	(6000)	0.28 (593)	0.44 (931)	0.50 (1059)	0.17 (360)	38 (950)
25	0.25 (529)	0.49 (1037)	0.57 (1207)	0.14 (296)	35 (875)	25	(7500) *	0.35 (741)	0.56 (1186)	0.64 (1335)	0.17 (360)	38 (950)
5' x 5' x 6" (1500 x 1500 x 150 mm)												
3	0.16 (339)	0.35 (741)	0.31 (656)	0.14 (296)	45 (1125)	3	(915)	0.19 (402)	0.36 (762)	0.30 (635)	0.17 (360)	52 (1300)
5	0.14 (296)	0.17 (360)	0.20 (423)	0.14 (296)	45 (1125)	5	(1525)	0.17 (360)	0.20 (423)	0.23 (487)	0.17 (360)	43 (1075)
10	0.14 (296)	0.20 (423)	0.25 (529)	0.14 (296)	45 (1125)	10	(3000)	0.17 (360)	0.24 (508)	0.29 (614)	0.17 (360)	39 (975)
15	0.14 (296)	0.29 (614)	0.35 (741)	0.14 (296)	36 (900)	15	(4500)	0.18 (381)	0.35 (741)	0.42 (889)	0.17 (360)	38 (950)
20	0.17 (360)	0.39 (826)	0.46 (974)	0.14 (296)	35 (875)	20	(6000)	0.24 (508)	0.47 (995)	0.54 (1143)	0.17 (360)	38 (950)
25	0.21 (445)	0.49 (1037)	0.58 (1228)	0.14 (296)	35 (875)	25	(7500) *	0.30 (635)	0.59 (1249)	0.68 (1439)	0.17 (360)	38 (950)
6' x 3' x 7" (1800 x 900 x 175 mm)												
3	0.24 (508)	0.29 (614)	0.24 (508)	0.17 (360)	43 (1075)	3	(915)	0.17 (360)	0.38 (804)	0.32 (677)	0.17 (360)	52 (1300)
5	0.17 (360)	0.17 (360)	0.16 (339)	0.17 (360)	40 (1000)	5	(1525)	0.17 (360)	0.20 (423)	0.24 (508)	0.17 (360)	52 (1300)
10	0.17 (360)	0.21 (445)	0.25 (529)	0.17 (360)	39 (975)	10	(3000)	0.17 (360)	0.23 (487)	0.29 (614)	0.17 (360)	43 (1075)
15	0.25 (529)	0.31 (656)	0.36 (762)	0.17 (360)	38 (950)	15	(4500)	0.17 (360)	0.34 (720)	0.41 (868)	0.17 (360)	39 (975)
20	0.34 (720)	0.41 (868)	0.47 (995)	0.17 (360)	38 (950)	20	(6000)	0.21 (445)	0.46 (974)	0.54 (1143)	0.17 (360)	38 (950)
25	0.44 (931)	0.52 (1101)	0.58 (1228)	0.17 (360)	38 (950)	25	(7500) *	0.27 (572)	0.58 (1228)	0.67 (1418)	0.17 (360)	38 (950)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 19 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR
HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 1.5" (38 mm) AT TOP OF INVERT SLAB

H _g EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	H _g EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)
	AS1	AS2	AS3	AS4			AS1	AS2	AS3	AS4	
7' x 4' x 8" (2100 x 1200 x 200 mm)											
3 (915)	0.24 (508)	0.33 (699)	0.33 (699)	0.19 (402)	47 (1175)	3 (915)	0.19 (402)	0.41 (868)	0.41 (868)	0.19 (402)	59 (1475)
5 (1525)	0.19 (402)	0.21 (445)	0.24 (508)	0.19 (402)	43 (1075)	5 (1525)	0.19 (402)	0.25 (529)	0.30 (635)	0.19 (402)	59 (1475)
10 (3000)	0.19 (402)	0.26 (550)	0.31 (656)	0.19 (402)	43 (1075)	10 (3000)	0.19 (402)	0.29 (614)	0.36 (762)	0.19 (402)	47 (1175)
15 (4500)	0.28 (593)	0.38 (804)	0.44 (931)	0.19 (402)	41 (1025)	15 (4500)	0.20 (423)	0.42 (889)	0.50 (1058)	0.19 (402)	43 (1075)
20 (6000)	0.37 (783)	0.51 (1080)	0.57 (1207)	0.19 (402)	41 (1025)	20 (6000)	0.26 (550)	0.56 (1185)	0.65 (1376)	0.19 (402)	41 (1025)
25 (7500) *	0.47 (995)	0.64 (1355)	0.71 (1503)	0.19 (402)	41 (1025)	25 (7500) *	0.32 (677)	0.70 (1482)	0.80 (1693)	0.19 (402)	41 (1025)
7' x 5' x 8" (2100 x 1500 x 200 mm)											
3 (915)	0.22 (466)	0.36 (762)	0.36 (762)	0.19 (402)	59 (1475)	3 (915)	0.32 (677)	0.39 (826)	0.38 (804)	0.19 (402)	50 (1250)
5 (1525)	0.19 (402)	0.23 (489)	0.26 (550)	0.19 (402)	43 (1075)	5 (1525)	0.22 (466)	0.26 (550)	0.29 (614)	0.19 (402)	45 (1125)
10 (3000)	0.19 (402)	0.28 (593)	0.33 (699)	0.19 (402)	43 (1075)	10 (3000)	0.28 (593)	0.33 (699)	0.39 (826)	0.19 (402)	45 (1125)
15 (4500)	0.24 (508)	0.41 (868)	0.48 (1016)	0.19 (402)	41 (1025)	15 (4500)	0.42 (889)	0.49 (1037)	0.56 (1185)	0.19 (402)	41 (1025)
20 (6000)	0.32 (677)	0.54 (1143)	0.62 (1312)	0.19 (402)	41 (1025)	20 (6000) *	0.57 (1207)	0.65 (1376)	0.73 (1545)	0.19 (402)	41 (1025)
25 (7500) *	0.40 (847)	0.68 (1438)	0.76 (1609)	0.19 (402)	41 (1025)	25 (7500) *	0.73 (1545)	0.83 (1757)	0.92 (1947)	0.19 (402)	41 (1025)
7' x 6' x 8" (2100 x 1200 x 200 mm)											
3 (915)	0.20 (423)	0.39 (826)	0.39 (826)	0.19 (402)	59 (1475)	3 (915)	0.28 (593)	0.42 (889)	0.42 (889)	0.19 (402)	50 (1250)
5 (1525)	0.19 (402)	0.24 (508)	0.28 (593)	0.19 (402)	47 (1175)	5 (1525)	0.20 (423)	0.28 (593)	0.33 (699)	0.19 (402)	50 (1250)
10 (3000)	0.19 (402)	0.29 (614)	0.35 (741)	0.19 (402)	43 (1075)	10 (3000)	0.25 (529)	0.35 (741)	0.42 (889)	0.19 (402)	45 (1125)
15 (4500)	0.21 (445)	0.42 (889)	0.50 (1058)	0.19 (402)	41 (1025)	15 (4500)	0.37 (783)	0.52 (1101)	0.60 (1270)	0.19 (402)	41 (1025)
20 (6000)	0.28 (593)	0.55 (1164)	0.64 (1355)	0.19 (402)	41 (1025)	20 (6000) *	0.49 (1037)	0.70 (1482)	0.79 (1672)	0.19 (402)	41 (1025)
25 (7500) *	0.35 (741)	0.70 (1482)	0.79 (1672)	0.19 (402)	41 (1025)	25 (7500) *	0.63 (1334)	0.89 (1884)	1.00 (2117)	0.19 (402)	41 (1025)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 20 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR
HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 1.5" (38 mm) AT TOP OF INVERT SLAB

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)		
	A _{S1}	A _{S2}	A _{S3}			A _{S4}	A _{S1}	A _{S2}		A _{S3}	A _{S4}
8' x 6' x 8" (2400 x 1800 x 200 mm)											
3	0.25 (529)	0.45 (953)	0.45 (953)	0.19 (402)	55 (1375)	3	0.34 (720)	0.44 (931)	0.58 (1228)	0.22 (466)	54 (1350)
5	0.19 (402)	0.30 (635)	0.35 (741)	0.19 (402)	50 (1250)	5	0.24 (508)	0.30 (635)	0.35 (741)	0.22 (466)	49 (1225)
10	0.23 (489)	0.37 (783)	0.45 (953)	0.19 (402)	45 (1125)	10	0.30 (635)	0.38 (804)	0.46 (974)	0.22 (466)	49 (1225)
15	0.33 (699)	0.55 (1164)	0.63 (1334)	0.19 (402)	41 (1025)	15	0.44 (931)	0.56 (1185)	0.62 (1312)	0.22 (466)	44 (1100)
20	0.44 (931)	0.73 (1545)	0.83 (1757)	0.19 (402)	41 (1025)	20	0.59 (1249)	0.75 (1588)	0.85 (1799)	0.22 (466)	44 (1100)
25	0.56 (1185)	0.93 (1969)	1.05 (2223)	0.19 (402)	41 (1025)	25	0.76 (1609)	0.95 (2011)	1.05 (2223)	0.22 (466)	44 (1100)
8' x 7' x 8" (2400 x 2100 x 200 mm)											
3	0.23 (489)	0.47 (995)	0.49 (1037)	0.19 (402)	66 (1650)	3	0.37 (783)	0.47 (995)	0.52 (1101)	0.22 (466)	59 (1475)
5	0.19 (402)	0.31 (656)	0.37 (783)	0.19 (402)	55 (1375)	5	0.22 (466)	0.32 (677)	0.37 (783)	0.22 (466)	54 (1350)
10	0.21 (445)	0.38 (804)	0.46 (974)	0.19 (402)	45 (1125)	10	0.24 (508)	0.40 (847)	0.49 (1037)	0.22 (466)	49 (1225)
15	0.30 (635)	0.56 (1185)	0.65 (1376)	0.19 (402)	41 (1025)	15	0.40 (847)	0.59 (1249)	0.69 (1461)	0.22 (466)	44 (1100)
20	0.40 (847)	0.75 (1588)	0.86 (1821)	0.19 (402)	41 (1025)	20	0.53 (1122)	0.79 (1672)	0.89 (1884)	0.22 (466)	44 (1100)
25	0.51 (1080)	0.95 (2011)	1.08 (2286)	0.19 (402)	41 (1025)	25	0.68 (1438)	1.00 (2117)	1.12 (2371)	0.22 (466)	44 (1100)
8' x 8' x 8" (2400 x 2400 x 200 mm)											
3	0.22 (466)	0.49 (1037)	0.52 (1101)	0.19 (402)	65 (1625)	3	0.28 (593)	0.49 (1037)	0.53 (1122)	0.22 (466)	59 (1475)
5	0.19 (402)	0.33 (699)	0.39 (826)	0.19 (402)	65 (1625)	5	0.22 (466)	0.34 (720)	0.40 (847)	0.22 (466)	54 (1350)
10	0.20 (423)	0.39 (826)	0.48 (1016)	0.19 (402)	50 (1250)	10	0.25 (529)	0.42 (889)	0.51 (1080)	0.22 (466)	49 (1225)
15	0.29 (614)	0.56 (1185)	0.66 (1397)	0.19 (402)	45 (1125)	15	0.36 (762)	0.61 (1291)	0.72 (1524)	0.22 (466)	44 (1100)
20	0.38 (804)	0.75 (1588)	0.87 (1482)	0.19 (402)	45 (1125)	20	0.48 (1016)	0.82 (1736)	0.93 (1969)	0.22 (466)	44 (1100)
25	0.48 (1016)	0.95 (2011)	1.09 (2308)	0.19 (402)	45 (1125)	25	0.61 (1291)	1.04 (2202)	1.17 (2477)	0.22 (466)	44 (1100)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 21 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR
HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 1.5" (38 mm) AT TOP OF INVERT SLAB

H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)
	A S1	A S2	A S3	A S4			A S1	A S2	A S3	A S4	
9' x 8' x 9" (2700 x 2400 x 225 mm)											
3 (915)	0.26 (550)	0.51 (1080)	0.57 (1207)	0.22 (466)	72 (1800)	3 (915)	0.35 (741)	0.49 (1037)	0.52 (1101)	0.24 (508)	58 (1450)
5 (1525)	0.22 (466)	0.35 (741)	0.42 (889)	0.22 (466)	59 (1475)	5 (1525)	0.26 (550)	0.34 (720)	0.40 (868)	0.24 (508)	52 (1300)
10 (3000)	0.24 (508)	0.43 (910)	0.53 (1122)	0.22 (466)	54 (1350)	10 (3000)	0.32 (677)	0.44 (931)	0.52 (1101)	0.24 (508)	52 (1300)
15 (4500)	0.34 (720)	0.63 (1334)	0.74 (1566)	0.22 (466)	44 (1100)	15 (4500)	0.47 (995)	0.64 (1355)	0.74 (1566)	0.24 (508)	47 (1175)
20 (6000) *	0.45 (953)	0.83 (1757)	0.95 (2011)	0.22 (466)	44 (1100)	20 (6000) *	0.63 (1334)	0.85 (1799)	0.96 (2032)	0.24 (508)	47 (1175)
25 (7500) *	0.57 (1207)	1.05 (2223)	1.19 (2519)	0.22 (466)	44 (1100)	25 (7500) *	0.80 (1693)	1.07 (2265)	1.18 (2498)	0.24 (508)	47 (1175)
9' x 9' x 9" (2700 x 2700 x 225 mm)											
3 (915)	0.25 (529)	0.53 (1122)	0.60 (1270)	0.22 (466)	72 (1800)	3 (915)	0.32 (677)	0.51 (1080)	0.56 (1185)	0.24 (508)	64 (1600)
5 (1525)	0.22 (466)	0.37 (783)	0.44 (931)	0.22 (466)	72 (1800)	5 (1525)	0.24 (508)	0.36 (762)	0.43 (910)	0.24 (508)	58 (1450)
10 (3000)	0.23 (487)	0.43 (910)	0.54 (1143)	0.22 (466)	59 (1475)	10 (3000)	0.30 (635)	0.46 (974)	0.55 (1164)	0.24 (508)	52 (1300)
15 (4500)	0.32 (677)	0.63 (1334)	0.75 (1588)	0.22 (466)	49 (1225)	15 (4500)	0.43 (910)	0.67 (1418)	0.78 (1651)	0.24 (508)	47 (1175)
20 (6000) *	0.43 (910)	0.84 (1778)	0.96 (2032)	0.22 (466)	49 (1225)	20 (6000) *	0.57 (1207)	0.89 (1884)	1.01 (2138)	0.24 (508)	47 (1175)
25 (7500) *	0.54 (1143)	1.05 (2223)	1.20 (2540)	0.22 (466)	44 (1100)	25 (7500) *	0.73 (1545)	1.12 (2371)	1.24 (2625)	0.24 (508)	47 (1175)
10' x 5' x 10" (3000 x 1500 x 250 mm)											
3 (915)	0.38 (804)	0.46 (974)	0.48 (1016)	0.24 (508)	58 (1450)	3 (915)	0.30 (635)	0.54 (1143)	0.60 (1270)	0.24 (508)	64 (1600)
5 (1525)	0.28 (593)	0.32 (677)	0.37 (783)	0.24 (508)	52 (1300)	5 (1525)	0.21 (445)	0.38 (804)	0.46 (974)	0.24 (508)	58 (1450)
10 (3000)	0.35 (741)	0.41 (868)	0.49 (1037)	0.24 (508)	52 (1300)	10 (3000)	0.28 (593)	0.47 (995)	0.58 (1228)	0.24 (508)	52 (1300)
15 (4500)	0.52 (1101)	0.60 (1270)	0.70 (1482)	0.24 (508)	47 (1175)	15 (4500)	0.40 (868)	0.68 (1439)	0.81 (1715)	0.24 (508)	47 (1175)
20 (6000) *	0.70 (1482)	0.80 (1693)	0.91 (1926)	0.24 (508)	47 (1175)	20 (6000) *	0.53 (1122)	0.91 (1926)	1.04 (2201)	0.24 (508)	47 (1175)
25 (7500) *	0.90 (1905)	1.01 (2138)	1.11 (2350)	0.24 (508)	47 (1175)	25 (7500) *	0.67 (1418)	1.15 (2434)	1.28 (2709)	0.24 (508)	47 (1175)
10' x 6' x 10" (3300 x 1800 x 250 mm)											
3 (915)	0.26 (550)	0.51 (1080)	0.57 (1207)	0.22 (466)	72 (1800)	3 (915)	0.35 (741)	0.49 (1037)	0.52 (1101)	0.24 (508)	58 (1450)
5 (1525)	0.22 (466)	0.35 (741)	0.42 (889)	0.22 (466)	59 (1475)	5 (1525)	0.26 (550)	0.34 (720)	0.40 (868)	0.24 (508)	52 (1300)
10 (3000)	0.24 (508)	0.43 (910)	0.53 (1122)	0.22 (466)	54 (1350)	10 (3000)	0.32 (677)	0.44 (931)	0.52 (1101)	0.24 (508)	52 (1300)
15 (4500)	0.34 (720)	0.63 (1334)	0.74 (1566)	0.22 (466)	44 (1100)	15 (4500)	0.47 (995)	0.64 (1355)	0.74 (1566)	0.24 (508)	47 (1175)
20 (6000) *	0.45 (953)	0.83 (1757)	0.95 (2011)	0.22 (466)	44 (1100)	20 (6000) *	0.63 (1334)	0.85 (1799)	0.96 (2032)	0.24 (508)	47 (1175)
25 (7500) *	0.57 (1207)	1.05 (2223)	1.19 (2519)	0.22 (466)	44 (1100)	25 (7500) *	0.80 (1693)	1.07 (2265)	1.18 (2498)	0.24 (508)	47 (1175)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 22 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm) STEEL COVER 1.5" (38 mm) AT TOP OF INVERT SLAB

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	
	A _{S1}	A _{S2}	A _{S3}	A _{S4}			A _{S1}	A _{S2}	A _{S3}	A _{S4}		
10' x 9' x 10" (3000 x 2700 x 250 mm)												
3 (915)	0.28 (593)	0.56 (1185)	0.64 (1355)	0.24 (508)	79 (1975)	3 (915)	0.47 (995)	0.48 (1016)	0.50 (1059)	0.29 (614)	73 (1825)	
5 (1525)	0.24 (508)	0.39 (826)	0.48 (1016)	0.24 (508)	64 (1600)	5 (1525)	0.37 (783)	0.36 (762)	0.42 (889)	0.29 (614)	66 (1650)	
10 (3000)	0.27 (572)	0.48 (1016)	0.60 (1270)	0.24 (508)	58 (1450)	10 (3000)	0.47 (995)	0.46 (974)	0.56 (1186)	0.29 (614)	59 (1475)	
15 (4500)	0.38 (804)	0.69 (1461)	0.83 (1757)	0.24 (508)	47 (1175)	15 (4500)	0.69 (1461)	0.67 (1418)	0.79 (1672)	0.29 (614)	59 (1475)	
20 (6000) *	0.50 (1058)	0.92 (1947)	1.06 (2244)	0.24 (508)	47 (1175)	20 (6000)	0.92 (1947)	0.89 (1884)	1.02 (2159)	0.29 (614)	59 (1475)	
25 (7500) *	0.63 (1334)	1.16 (2455)	1.31 (2773)	0.24 (508)	47 (1175)	25 (7500) *	1.18 (2498)	1.12 (2371)	1.25 (2646)	0.29 (614)	59 (1475)	
10' x 10' x 10" (3000 x 3000 x 250 mm)												
3 (915)	0.27 (572)	0.57 (1207)	0.68 (1439)	0.24 (508)	79 (1975)	3 (915)	0.44 (931)	0.52 (1101)	0.54 (1143)	0.29 (614)	66 (1650)	
5 (1525)	0.24 (508)	0.41 (868)	0.50 (1058)	0.24 (508)	70 (1750)	5 (1525)	0.34 (720)	0.39 (826)	0.46 (974)	0.29 (614)	59 (1475)	
10 (3000)	0.26 (550)	0.48 (1016)	0.61 (1291)	0.24 (508)	64 (1600)	10 (3000)	0.43 (910)	0.49 (1037)	0.60 (1270)	0.29 (614)	59 (1475)	
15 (4500)	0.36 (762)	0.70 (1482)	0.84 (1778)	0.24 (508)	52 (1300)	15 (4500)	0.63 (1334)	0.72 (1524)	0.85 (1799)	0.29 (614)	53 (1325)	
20 (6000) *	0.48 (1016)	0.92 (1947)	1.07 (2265)	0.24 (508)	52 (1300)	20 (6000) *	0.84 (1778)	0.95 (2011)	1.09 (2307)	0.29 (614)	53 (1325)	
25 (7500) *	0.60 (1270)	1.16 (2455)	1.32 (2794)	0.24 (508)	47 (1175)	25 (7500) *	1.07 (2265)	1.20 (2540)	1.34 (2836)	0.29 (614)	53 (1325)	
12' x 4' x 12" (3600 x 1200 x 300 mm)												
3 (915)	0.50 (1058)	0.44 (931)	0.45 (953)	0.29 (614)	73 (1825)	3 (915)	0.41 (868)	0.55 (1164)	0.59 (1249)	0.29 (614)	66 (1650)	
5 (1525)	0.40 (847)	0.33 (699)	0.38 (804)	0.29 (614)	66 (1650)	5 (1525)	0.32 (677)	0.41 (868)	0.49 (1037)	0.29 (614)	59 (1475)	
10 (3000)	0.51 (1080)	0.42 (889)	0.51 (1080)	0.29 (614)	59 (1475)	10 (3000)	0.40 (847)	0.52 (1101)	0.64 (1355)	0.29 (614)	59 (1475)	
15 (4500)	0.76 (1609)	0.61 (1291)	0.72 (1524)	0.29 (614)	59 (1475)	15 (4500)	0.58 (1228)	0.76 (1609)	0.89 (1884)	0.29 (614)	53 (1325)	
20 (6000)	1.03 (2180)	0.81 (1715)	0.94 (1990)	0.29 (614)	59 (1475)	20 (6000) *	0.77 (1630)	1.00 (2117)	1.15 (2434)	0.29 (614)	53 (1325)	
25 (7500) *	1.32 (2794)	1.02 (2159)	1.15 (2434)	0.29 (614)	59 (1475)	25 (7500) *	0.97 (2053)	1.26 (2667)	1.41 (2985)	0.29 (614)	53 (1325)	

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 23 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR
HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 1.5" (38 mm) AT TOP OF INVERT SLAB

H _g EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	H _g EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)
	A _{S1}	A _{S2}	A _{S3}	A _{S4}			A _{S1}	A _{S2}	A _{S3}	A _{S4}	
12' x 8' x 12" (3600 x 2400 x 300 mm)											
3 (915)	0.39 (826)	0.58 (1228)	0.63 (1334)	0.29 (614)	66 (1650)	3 (915)	0.35 (741)	0.66 (1397)	0.75 (1588)	0.29 (614)	93 (2325)
5 (1525)	0.30 (635)	0.43 (910)	0.52 (1101)	0.29 (614)	59 (1475)	5 (1525)	0.29 (614)	0.48 (1016)	0.61 (1291)	0.29 (614)	80 (2000)
10 (3000)	0.38 (804)	0.54 (1143)	0.67 (1418)	0.29 (614)	59 (1475)	10 (3000)	0.33 (699)	0.58 (1228)	0.74 (1566)	0.29 (614)	73 (1825)
15 (4500)	0.54 (1143)	0.79 (1672)	0.93 (1969)	0.29 (614)	53 (1325)	15 (4500)	0.46 (974)	0.84 (779)	1.02 (2159)	0.29 (614)	59 (1475)
20 (6000) *	0.71 (1503)	1.04 (2201)	1.20 (2540)	0.29 (614)	53 (1325)	20 (6000) *	0.60 (1270)	1.10 (2328)	1.29 (2731)	0.29 (614)	59 (1475)
25 (7500) *	0.90 (1905)	1.31 (2773)	1.47 (3112)	0.29 (614)	53 (1325)	25 (7500) *	0.75 (1588)	1.38 (2921)	1.56 (3302)	0.29 (614)	59 (1475)
12' x 9' x 12" (3600 x 2700 x 300 mm)											
3 (915)	0.37 (783)	0.61 (1291)	0.67 (1418)	0.29 (614)	80 (2000)	3 (915)	0.31 (656)	0.69 (1461)	0.79 (1672)	0.29 (614)	93 (2325)
5 (1525)	0.29 (614)	0.45 (953)	0.55 (1164)	0.29 (614)	66 (1650)	5 (1525)	0.29 (614)	0.50 (1058)	0.63 (1334)	0.29 (614)	80 (2000)
10 (3000)	0.36 (762)	0.56 (1185)	0.70 (1482)	0.29 (614)	59 (1475)	10 (3000)	0.32 (677)	0.59 (1249)	0.76 (1609)	0.29 (614)	73 (1825)
15 (4500)	0.50 (1058)	0.81 (1715)	0.97 (2053)	0.29 (614)	53 (1325)	15 (4500)	0.45 (953)	0.84 (1778)	1.03 (2180)	0.29 (614)	59 (1475)
20 (6000) *	0.66 (1397)	1.07 (2265)	1.24 (2625)	0.29 (614)	53 (1325)	20 (6000) *	0.58 (1228)	1.11 (2350)	1.30 (2752)	0.29 (614)	59 (1475)
25 (7500) *	0.84 (1778)	1.35 (2858)	1.51 (3196)	0.29 (614)	53 (1325)	25 (7500) *	0.73 (1545)	1.38 (2921)	1.58 (3344)	0.29 (614)	59 (1475)
12' x 10' x 12" (3600 x 3000 x 300 mm)											
3 (915)	0.34 (720)	0.64 (1355)	0.71 (1503)	0.29 (614)	80 (2000)	3 (915)	0.34 (720)	0.64 (1355)	0.71 (1503)	0.29 (614)	80 (2000)
5 (1525)	0.29 (614)	0.47 (995)	0.58 (1228)	0.29 (614)	66 (1650)	5 (1525)	0.29 (614)	0.47 (995)	0.58 (1228)	0.29 (614)	66 (1650)
10 (3000)	0.34 (720)	0.57 (1207)	0.72 (1524)	0.29 (614)	59 (1475)	10 (3000)	0.34 (720)	0.57 (1207)	0.72 (1524)	0.29 (614)	59 (1475)
15 (4500)	0.48 (1016)	0.83 (1757)	1.00 (2117)	0.29 (614)	53 (1325)	15 (4500)	0.48 (1016)	0.83 (1757)	1.00 (2117)	0.29 (614)	53 (1325)
20 (6000) *	0.63 (1334)	1.09 (2307)	1.27 (2688)	0.29 (614)	53 (1325)	20 (6000) *	0.63 (1334)	1.09 (2307)	1.27 (2688)	0.29 (614)	53 (1325)
25 (7500) *	0.79 (1672)	1.37 (2900)	1.54 (3260)	0.29 (614)	53 (1325)	25 (7500) *	0.79 (1672)	1.37 (2900)	1.54 (3260)	0.29 (614)	53 (1325)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 24 OF 42

SPAN, S FEET (mm)	RISE, R FEET (mm)	T ₊ TOP INCHES (mm)	T _B BOTTOM INCHES (mm)	T _W SIDE INCHES (mm)	H HAUNCH INCHES (mm)	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)							
						AS1	AS2	AS3	AS4	AS5	AS6	AS7	AS8
3 (900)	2 (600)	7 (175)	6 (150)	4 (100)	4 (100)	0.17 (360)	0.37 (783)	0.26 (550)	0.10 (212)	0.22 (466)	0.17 (360)	0.17 (360)	0.14 (296)
3 (900)	3 (900)	7 (175)	6 (150)	4 (100)	4 (100)	0.17 (360)	0.40 (847)	0.28 (593)	0.10 (212)	0.23 (487)	0.17 (360)	0.17 (360)	0.14 (296)
4 (1200)	2 (600)	7.5 (190)	6 (150)	5 (125)	5 (125)	0.18 (381)	0.40 (847)	0.25 (529)	0.12 (254)	0.21 (445)	0.18 (381)	0.18 (381)	0.14 (296)
4 (1200)	3 (900)	7.5 (190)	6 (150)	5 (125)	5 (125)	0.18 (381)	0.44 (931)	0.29 (614)	0.12 (254)	0.23 (487)	0.18 (381)	0.18 (381)	0.14 (296)
4 (1200)	4 (1200)	7.5 (190)	6 (150)	5 (125)	5 (125)	0.18 (381)	0.46 (974)	0.32 (677)	0.12 (254)	0.25 (529)	0.18 (381)	0.18 (381)	0.14 (296)
5 (1500)	3 (900)	8 (200)	7 (175)	6 (150)	6 (150)	0.19 (402)	0.44 (931)	0.26 (550)	0.14 (296)	0.22 (466)	0.19 (402)	0.19 (402)	0.17 (360)
5 (1500)	4 (1200)	8 (200)	7 (175)	6 (150)	6 (150)	0.19 (402)	0.47 (995)	0.29 (614)	0.14 (296)	0.24 (508)	0.19 (402)	0.19 (402)	0.17 (360)
5 (1500)	5 (1500)	8 (200)	7 (175)	6 (150)	6 (150)	0.19 (402)	0.50 (1059)	0.32 (677)	0.14 (296)	0.25 (529)	0.19 (402)	0.19 (402)	0.17 (360)
6 (1800)	3 (900)	8 (200)	7 (175)	7 (175)	7 (175)	0.23 (487)	0.45 (953)	0.24 (508)	0.17 (360)	0.19 (402)	0.19 (402)	0.19 (402)	0.17 (360)
6 (1800)	4 (1200)	8 (200)	7 (175)	7 (175)	7 (175)	0.19 (402)	0.49 (1037)	0.31 (656)	0.17 (360)	0.24 (508)	0.19 (402)	0.19 (402)	0.17 (360)
6 (1800)	5 (1500)	8 (200)	7 (175)	7 (175)	7 (175)	0.19 (402)	0.52 (1101)	0.34 (720)	0.17 (360)	0.25 (529)	0.19 (402)	0.19 (402)	0.17 (360)
6 (1800)	6 (1800)	8 (200)	7 (175)	7 (175)	7 (175)	0.19 (402)	0.54 (1143)	0.36 (762)	0.17 (360)	0.26 (550)	0.19 (402)	0.19 (402)	0.17 (360)
7 (2100)	4 (1200)	8 (200)	8 (200)	8 (200)	8 (200)	0.26 (550)	0.49 (1037)	0.25 (529)	0.19 (402)	0.23 (487)	0.19 (402)	0.19 (402)	0.19 (402)
7 (2100)	5 (1500)	8 (200)	8 (200)	8 (200)	8 (200)	0.23 (487)	0.52 (1101)	0.34 (720)	0.19 (402)	0.24 (508)	0.19 (402)	0.19 (402)	0.19 (402)
7 (2100)	6 (1800)	8 (200)	8 (200)	8 (200)	8 (200)	0.21 (445)	0.54 (1143)	0.37 (783)	0.19 (402)	0.26 (550)	0.19 (402)	0.19 (402)	0.19 (402)
7 (2100)	7 (2100)	8 (200)	8 (200)	8 (200)	8 (200)	0.19 (402)	0.56 (1186)	0.39 (826)	0.19 (402)	0.27 (572)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	4 (1200)	8 (200)	8 (200)	8 (200)	8 (200)	0.31 (656)	0.53 (1122)	0.35 (741)	0.19 (402)	0.25 (529)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	5 (1500)	8 (200)	8 (200)	8 (200)	8 (200)	0.28 (593)	0.57 (1207)	0.39 (826)	0.19 (402)	0.26 (550)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	6 (1800)	8 (200)	8 (200)	8 (200)	8 (200)	0.26 (550)	0.59 (1249)	0.42 (889)	0.19 (402)	0.28 (593)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	7 (2100)	8 (200)	8 (200)	8 (200)	8 (200)	0.24 (508)	0.62 (1313)	0.45 (953)	0.19 (402)	0.29 (614)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	8 (2400)	8 (200)	8 (200)	8 (200)	8 (200)	0.22 (466)	0.64 (1335)	0.49 (1037)	0.19 (402)	0.30 (635)	0.19 (402)	0.19 (402)	0.19 (402)
9 (2700)	5 (1500)	9 (225)	9 (225)	9 (225)	9 (225)	0.29 (614)	0.53 (1122)	0.40 (847)	0.22 (466)	0.25 (529)	0.22 (466)	0.22 (466)	0.22 (466)
9 (2700)	6 (1800)	9 (225)	9 (225)	9 (225)	9 (225)	0.27 (572)	0.56 (1186)	0.42 (889)	0.22 (466)	0.26 (550)	0.22 (466)	0.22 (466)	0.22 (466)
9 (2700)	7 (2100)	9 (225)	9 (225)	9 (225)	9 (225)	0.25 (529)	0.58 (1228)	0.45 (953)	0.22 (466)	0.27 (572)	0.22 (466)	0.22 (466)	0.22 (466)

SHALLOW COVER BOXES – COVER 0' TO 2' (0 TO 600 mm)
STEEL COVER 2.0" (50 mm) AT TOP OF INVERT SLAB

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 25 OF 42

SPAN, S FEET (mm)	RISE, R FEET (mm)	T _t TOP INCHES (mm)	T _b BOTTOM INCHES (mm)	T _w SIDE INCHES (mm)	H HAUNCH INCHES (mm)	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)								
						A _{S1}	A _{S2}	A _{S3}	A _{S4}	A _{S5}	A _{S6}	A _{S7}	A _{S8}	
9 (2700)	8 (2400)	9 (225)	9 (225)	9 (225)	9 (225)	0.23 (487)	0.60 (1270)	0.48 (1016)	0.22 (466)	0.28 (593)	0.22 (466)	0.22 (466)	0.22 (466)	0.22 (466)
9 (2700)	9 (2700)	9 (225)	9 (225)	9 (225)	9 (225)	0.25 (529)	0.62 (1313)	0.54 (1143)	0.27 (572)	0.28 (593)	0.22 (466)	0.22 (466)	0.22 (466)	0.22 (466)
10 (3000)	5 (1500)	10 (250)	10 (250)	10 (250)	10 (250)	0.29 (614)	0.51 (1080)	0.38 (804)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	6 (1800)	10 (250)	10 (250)	10 (250)	10 (250)	0.27 (572)	0.53 (1122)	0.42 (889)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	7 (2100)	10 (250)	10 (250)	10 (250)	10 (250)	0.25 (529)	0.55 (1164)	0.45 (953)	0.24 (508)	0.25 (529)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	8 (2400)	10 (250)	10 (250)	10 (250)	10 (250)	0.24 (508)	0.57 (1207)	0.48 (1016)	0.24 (508)	0.26 (550)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	9 (2700)	10 (250)	10 (250)	10 (250)	10 (250)	0.24 (508)	0.59 (1249)	0.57 (1207)	0.24 (508)	0.27 (572)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	10 (3000)	10 (250)	10 (250)	10 (250)	10 (250)	0.26 (550)	0.60 (1270)	0.60 (1270)	0.30 (635)	0.28 (593)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
12 (3600)	4 (1200)	12 (300)	12 (300)	12 (300)	12 (300)	0.40 (847)	0.44 (931)	0.40 (847)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	5 (1500)	12 (300)	12 (300)	12 (300)	12 (300)	0.35 (741)	0.46 (974)	0.44 (931)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	6 (1800)	12 (300)	12 (300)	12 (300)	12 (300)	0.33 (699)	0.49 (1037)	0.49 (1037)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	7 (2100)	12 (300)	12 (300)	12 (300)	12 (300)	0.31 (656)	0.51 (1080)	0.53 (1122)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	8 (2400)	12 (300)	12 (300)	12 (300)	12 (300)	0.30 (635)	0.52 (1101)	0.57 (1207)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	9 (2700)	12 (300)	12 (300)	12 (300)	12 (300)	0.29 (614)	0.54 (1143)	0.60 (1270)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	10 (3000)	12 (300)	12 (300)	12 (300)	12 (300)	0.29 (614)	0.55 (1164)	0.64 (1355)	0.29 (614)	0.30 (635)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	11 (3300)	12 (300)	12 (300)	12 (300)	12 (300)	0.29 (614)	0.57 (1207)	0.68 (1439)	0.29 (614)	0.31 (656)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	12 (3600)	12 (300)	12 (300)	12 (300)	12 (300)	0.31 (656)	0.58 (1228)	0.72 (1524)	0.29 (614)	0.32 (677)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)

SHALLOW COVER BOXES – COVER 0' TO 2' (0 TO 610 mm)
STEEL COVER 2.0" (50 mm) AT TOP OF INVERT SLAB

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 26 OF 42

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 2.0 INCHES (50 mm) AT TOP OF INVERT SLAB

DIMENSIONS SHOWN ARE SPAN x RISE x
HAUNCH, WALL AND SLAB THICKNESS

* WHERE NOTED, SUBMIT DETAILS FOR
TOP SLAB SHEAR REINFORCEMENT

H _a EARTH COVER FT. (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	H _a EARTH COVER FT. (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)
	AS1	AS2	AS3	AS4			AS1	AS2	AS3	AS4	
3' x 2' x 4" (900 x 600 x 100 mm)											
3 (915)	0.12 (254)	0.21 (445)	0.33 (699)	0.10 (217)	31 (775)	3 (915)	0.16 (339)	0.28 (593)	0.33 (699)	0.12 (254)	38 (950)
5 (1525)	0.10 (217)	0.10 (217)	0.17 (360)	0.10 (217)	31 (775)	5 (1525)	0.12 (254)	0.15 (318)	0.23 (487)	0.12 (254)	38 (950)
10 (3000)	0.10 (217)	0.12 (254)	0.24 (508)	0.10 (217)	31 (775)	10 (3000)	0.12 (254)	0.17 (360)	0.28 (593)	0.12 (254)	38 (950)
15 (4500)	0.10 (217)	0.18 (381)	0.33 (699)	0.10 (217)	31 (775)	15 (4500)	0.12 (254)	0.24 (508)	0.40 (847)	0.12 (254)	38 (950)
20 (6000) *	0.13 (275)	0.23 (487)	0.43 (910)	0.10 (217)	31 (775)	20 (6000)	0.16 (339)	0.31 (656)	0.51 (1080)	0.12 (254)	38 (950)
3' x 3' x 4" (900 x 900 x 100 mm)											
3 (915)	0.10 (217)	0.25 (529)	0.39 (826)	0.10 (217)	31 (775)	3 (915)	0.13 (275)	0.31 (656)	0.37 (783)	0.12 (254)	38 (950)
5 (1525)	0.10 (217)	0.12 (254)	0.21 (445)	0.10 (217)	31 (775)	5 (1525)	0.12 (254)	0.16 (339)	0.16 (339)	0.12 (254)	38 (950)
10 (3000)	0.10 (217)	0.13 (275)	0.24 (508)	0.10 (217)	31 (775)	10 (3000)	0.12 (254)	0.17 (360)	0.30 (635)	0.12 (254)	38 (950)
15 (4500)	0.10 (217)	0.18 (381)	0.34 (720)	0.10 (217)	31 (775)	15 (4500)	0.12 (254)	0.24 (508)	0.41 (868)	0.12 (254)	38 (950)
20 (6000) *	0.10 (217)	0.24 (508)	0.43 (910)	0.10 (217)	31 (775)	20 (6000)	0.13 (275)	0.32 (677)	0.52 (1101)	0.12 (254)	38 (950)
4' x 3' x 5" (1200 x 900 x 125 mm)											
3 (915)	0.12 (254)	0.21 (445)	0.33 (699)	0.10 (217)	31 (775)	3 (915)	0.16 (339)	0.28 (593)	0.33 (699)	0.12 (254)	38 (950)
5 (1525)	0.10 (217)	0.10 (217)	0.17 (360)	0.10 (217)	31 (775)	5 (1525)	0.12 (254)	0.15 (318)	0.23 (487)	0.12 (254)	38 (950)
10 (3000)	0.10 (217)	0.12 (254)	0.24 (508)	0.10 (217)	31 (775)	10 (3000)	0.12 (254)	0.17 (360)	0.28 (593)	0.12 (254)	38 (950)
15 (4500)	0.10 (217)	0.18 (381)	0.33 (699)	0.10 (217)	31 (775)	15 (4500)	0.12 (254)	0.24 (508)	0.40 (847)	0.12 (254)	38 (950)
20 (6000) *	0.13 (275)	0.23 (487)	0.43 (910)	0.10 (217)	31 (775)	20 (6000)	0.16 (339)	0.31 (656)	0.51 (1080)	0.12 (254)	38 (950)
4' x 4' x 5" (1200 x 1200 x 125 mm)											
3 (915)	0.10 (217)	0.25 (529)	0.39 (826)	0.10 (217)	31 (775)	3 (915)	0.13 (275)	0.31 (656)	0.37 (783)	0.12 (254)	38 (950)
5 (1525)	0.10 (217)	0.12 (254)	0.21 (445)	0.10 (217)	31 (775)	5 (1525)	0.12 (254)	0.16 (339)	0.16 (339)	0.12 (254)	38 (950)
10 (3000)	0.10 (217)	0.13 (275)	0.24 (508)	0.10 (217)	31 (775)	10 (3000)	0.12 (254)	0.17 (360)	0.30 (635)	0.12 (254)	38 (950)
15 (4500)	0.10 (217)	0.18 (381)	0.34 (720)	0.10 (217)	31 (775)	15 (4500)	0.12 (254)	0.24 (508)	0.41 (868)	0.12 (254)	38 (950)
20 (6000) *	0.10 (217)	0.24 (508)	0.43 (910)	0.10 (217)	31 (775)	20 (6000)	0.13 (275)	0.32 (677)	0.52 (1101)	0.12 (254)	38 (950)
5' x 3' x 6" (1500 x 900 x 150 mm)											
3 (915)	0.21 (445)	0.23 (489)	0.27 (572)	0.12 (254)	38 (950)	3 (915)	0.21 (445)	0.29 (614)	0.30 (635)	0.14 (296)	45 (1125)
5 (1525)	0.12 (254)	0.13 (275)	0.19 (402)	0.12 (254)	38 (950)	5 (1525)	0.14 (296)	0.17 (360)	0.25 (529)	0.14 (296)	36 (900)
10 (3000)	0.12 (254)	0.15 (318)	0.25 (529)	0.12 (254)	38 (950)	10 (3000)	0.14 (296)	0.20 (423)	0.32 (677)	0.14 (296)	36 (900)
15 (4500)	0.17 (360)	0.21 (445)	0.35 (741)	0.12 (254)	38 (950)	15 (4500)	0.19 (402)	0.29 (614)	0.44 (931)	0.12 (254)	35 (875)
20 (6000)	0.23 (487)	0.28 (593)	0.45 (953)	0.12 (254)	38 (950)	20 (6000)	0.25 (529)	0.37 (783)	0.57 (1207)	0.12 (254)	35 (875)
25 (7500) *	0.29 (614)	0.35 (741)	0.56 (1185)	0.12 (254)	38 (950)	25 (7500)	0.32 (677)	0.47 (995)	0.70 (1482)	0.12 (254)	35 (875)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN
390-0
SHEET 27 OF 42

EARTH COVER MORE THAN 2' (610 mm) AT TOP OF INVERT SLAB
 STEEL COVER 2.0 INCHES (50 mm) AT TOP OF INVERT SLAB
 DIMENSIONS SHOWN ARE SPAN x RISE x HAUNCH, WALL AND SLAB THICKNESS
 * WHERE NOTED, SUBMIT DETAILS FOR TOP SLAB SHEAR REINFORCEMENT

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)
	AS1	AS2	AS3	AS4			AS1	AS2	AS3	AS4	
5' x 4' x 6" (1500 x 1200 x 150 mm)											
3 (915)	0.18 (381)	0.33 (699)	0.34 (720)	0.14 (296)	45 (1125)	3 (915)	0.22 (466)	0.33 (699)	0.33 (699)	0.17 (360)	43 (1075)
5 (1525)	0.14 (296)	0.19 (402)	0.29 (614)	0.14 (296)	45 (1125)	5 (1525)	0.17 (360)	0.22 (466)	0.31 (656)	0.17 (360)	40 (1000)
10 (3000)	0.14 (296)	0.22 (466)	0.35 (741)	0.14 (296)	36 (900)	10 (3000)	0.17 (360)	0.25 (529)	0.39 (826)	0.17 (360)	39 (975)
15 (4500)	0.15 (318)	0.31 (656)	0.48 (1016)	0.14 (296)	35 (875)	15 (4500)	0.22 (466)	0.32 (677)	0.54 (1143)	0.17 (360)	39 (975)
20 (6000) *	0.20 (423)	0.40 (847)	0.62 (1312)	0.12 (254)	35 (875)	20 (6000) *	0.29 (614)	0.47 (995)	0.69 (1461)	0.17 (360)	38 (850)
25 (7500) *	0.25 (529)	0.50 (1058)	0.75 (1588)	0.12 (254)	35 (875)	25 (7500) *	0.36 (762)	0.58 (1228)	0.85 (1799)	0.17 (360)	38 (850)
5' x 5' x 6" (1500 x 1500 x 150 mm)											
3 (915)	0.16 (339)	0.35 (741)	0.37 (783)	0.14 (296)	45 (1125)	3 (915)	0.19 (402)	0.36 (762)	0.36 (762)	0.17 (360)	52 (1300)
5 (1525)	0.14 (296)	0.21 (445)	0.31 (656)	0.14 (296)	45 (1125)	5 (1525)	0.17 (360)	0.24 (508)	0.35 (741)	0.17 (360)	43 (1075)
10 (3000)	0.14 (296)	0.22 (466)	0.36 (762)	0.14 (296)	36 (900)	10 (3000)	0.17 (360)	0.37 (783)	0.42 (889)	0.17 (360)	39 (975)
15 (4500)	0.14 (296)	0.31 (656)	0.49 (1037)	0.14 (296)	35 (875)	15 (4500)	0.19 (402)	0.37 (783)	0.59 (1249)	0.17 (360)	38 (950)
20 (6000) *	0.17 (360)	0.40 (847)	0.63 (1334)	0.14 (296)	35 (875)	20 (6000) *	0.24 (508)	0.49 (1037)	0.73 (1545)	0.17 (360)	38 (950)
25 (7500) *	0.22 (466)	0.50 (1058)	0.76 (1609)	0.14 (296)	35 (875)	25 (7500) *	0.31 (656)	0.60 (1270)	0.89 (1884)	0.17 (360)	38 (950)
6' x 3' x 7" (1800 x 900 x 175 mm)											
3 (915)	0.24 (508)	0.29 (614)	0.29 (614)	0.17 (360)	43 (1075)	3 (915)	0.17 (360)	0.38 (804)	0.40 (847)	0.17 (360)	52 (1300)
5 (1525)	0.17 (360)	0.19 (402)	0.27 (572)	0.17 (360)	40 (1000)	5 (1525)	0.17 (360)	0.25 (529)	0.37 (783)	0.17 (360)	52 (1300)
10 (3000)	0.19 (402)	0.23 (489)	0.35 (741)	0.17 (360)	39 (975)	10 (3000)	0.17 (360)	0.27 (572)	0.43 (910)	0.17 (360)	43 (1075)
15 (4500)	0.27 (572)	0.32 (677)	0.49 (1037)	0.17 (360)	38 (950)	15 (4500)	0.17 (360)	0.38 (804)	0.58 (1228)	0.17 (360)	39 (975)
20 (6000) *	0.36 (762)	0.42 (889)	0.63 (1334)	0.17 (360)	38 (950)	20 (6000) *	0.22 (466)	0.49 (1037)	0.74 (1567)	0.17 (360)	38 (950)
25 (7500) *	0.45 (953)	0.53 (1122)	0.78 (1651)	0.17 (360)	38 (950)	25 (7500) *	0.27 (572)	0.61 (1291)	0.89 (1884)	0.17 (360)	38 (950)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION
PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN
390-0
 SHEET 28 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm) STEEL COVER 2.0 INCHES (50 mm) AT TOP OF INVERT SLAB

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)
	A _{S1}	A _{S2}	A _{S3}	A _{S4}			A _{S1}	A _{S2}	A _{S3}	A _{S4}	
7' x 4' x 8" (2100 x 1200 x 200 mm)											
3	0.24 (508)	0.33 (699)	0.38 (804)	0.19 (402)	47 (1175)	3	0.19 (402)	0.41 (868)	0.50 (1058)	0.19 (402)	59 (1475)
5	0.19 (402)	0.24 (508)	0.24 (508)	0.19 (402)	43 (1075)	5	0.19 (402)	0.27 (572)	0.44 (931)	0.19 (402)	59 (1475)
10	0.21 (445)	0.28 (593)	0.43 (910)	0.19 (402)	43 (1075)	10	0.19 (402)	0.32 (677)	0.50 (1058)	0.19 (402)	47 (1175)
15	0.38 (804)	0.52 (1101)	0.76 (1609)	0.19 (402)	41 (1025)	15	0.20 (423)	0.44 (931)	0.68 (1439)	0.19 (402)	43 (1075)
20	0.39 (826)	0.52 (1101)	0.76 (1609)	0.19 (402)	41 (1025)	20	0.26 (550)	0.58 (1228)	0.86 (1820)	0.19 (402)	41 (1025)
25	0.49 (1037)	0.65 (1376)	0.94 (1990)	0.19 (402)	41 (1025)	25	0.33 (699)	0.71 (1503)	1.03 (2180)	0.19 (402)	41 (1025)
7' x 5' x 8" (2100 x 1500 x 200 mm)											
3	0.22 (466)	0.36 (762)	0.42 (889)	0.19 (402)	59 (1475)	3	0.31 (656)	0.39 (826)	0.45 (953)	0.19 (402)	50 (1250)
5	0.19 (402)	0.27 (572)	0.38 (804)	0.19 (402)	43 (1075)	5	0.25 (529)	0.31 (656)	0.42 (889)	0.19 (402)	45 (1125)
10	0.19 (402)	0.30 (635)	0.40 (847)	0.19 (402)	43 (1075)	10	0.31 (656)	0.36 (762)	0.54 (1143)	0.19 (402)	45 (1125)
15	0.25 (529)	0.43 (910)	0.64 (1355)	0.19 (402)	41 (1025)	15	0.44 (931)	0.51 (1080)	0.75 (1588)	0.19 (402)	41 (1025)
20	0.33 (699)	0.56 (1185)	0.82 (1736)	0.19 (402)	41 (1025)	20	0.58 (1228)	0.67 (1418)	0.97 (2053)	0.19 (402)	41 (1025)
25	0.41 (868)	0.69 (1461)	0.99 (2096)	0.19 (402)	41 (1025)	25	0.75 (1588)	0.84 (1778)	1.18 (2498)	0.19 (402)	41 (1025)
8' x 4' x 8" (2400 x 1200 x 200 mm)											
8' x 5' x 8" (2400 x 1500 x 200 mm)											
3	0.20 (423)	0.39 (826)	0.46 (974)	0.19 (402)	59 (1475)	3	0.27 (572)	0.72 (1524)	0.50 (1058)	0.19 (402)	50 (1250)
5	0.19 (402)	0.28 (593)	0.41 (868)	0.19 (402)	47 (1175)	5	0.23 (487)	0.33 (699)	0.46 (974)	0.19 (402)	50 (1250)
10	0.19 (402)	0.32 (677)	0.49 (1037)	0.19 (402)	43 (1075)	10	0.27 (572)	0.39 (826)	0.59 (1249)	0.19 (402)	45 (1125)
15	0.22 (466)	0.44 (931)	0.66 (1397)	0.19 (402)	41 (1025)	15	0.38 (804)	0.55 (1164)	0.81 (1715)	0.19 (402)	41 (1025)
20	0.29 (614)	0.57 (1207)	0.84 (1778)	0.19 (402)	41 (1025)	20	0.51 (1080)	0.72 (1524)	1.04 (2201)	0.19 (402)	41 (1025)
25	0.36 (762)	0.71 (1503)	1.03 (2180)	0.19 (402)	41 (1025)	25	0.65 (1376)	0.91 (1926)	1.27 (2688)	0.19 (402)	41 (1025)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 29 OF 42

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 2.0 INCHES (50 mm) AT TOP OF INVERT SLAB

H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			INCHES (mm)	H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)		
	AS1	AS2	AS3			AS4	AS1	AS2		AS3	AS4
8' x 6' x 8" (2400 x 1800 x 200 mm)											
3 (915)	0.25 (529)	0.45 (953)	0.54 (1122)	0.19 (402)	55 (1375)	3 (915)	0.34 (720)	0.44 (931)	0.54 (1143)	0.22 (466)	54 (1350)
5 (1525)	0.21 (445)	0.36 (762)	0.50 (1058)	0.19 (402)	50 (1250)	5 (1525)	0.28 (593)	0.35 (741)	0.29 (614)	0.22 (466)	49 (1225)
10 (3000)	0.25 (529)	0.41 (868)	0.62 (1312)	0.19 (402)	45 (1125)	10 (3000)	0.33 (699)	0.42 (889)	0.62 (1312)	0.22 (466)	49 (1225)
15 (4500)	0.35 (741)	0.58 (1228)	0.85 (1799)	0.19 (402)	41 (1025)	15 (4500)	0.46 (974)	0.59 (1249)	0.86 (1820)	0.22 (466)	44 (1100)
20 (6000) *	0.45 (953)	0.76 (1609)	1.08 (2286)	0.19 (402)	41 (1025)	20 (6000) *	0.61 (1291)	0.78 (1651)	1.10 (2328)	0.22 (466)	44 (1100)
25 (7500) *	0.57 (1207)	0.95 (2011)	1.32 (2794)	0.19 (402)	41 (1025)	25 (7500) *	0.78 (1651)	0.97 (2053)	1.34 (2836)	0.22 (466)	44 (1100)
8' x 7' x 8" (2400 x 2100 x 200 mm)											
3 (915)	0.23 (489)	0.47 (995)	0.58 (1228)	0.19 (402)	65 (1376)	3 (915)	0.30 (635)	0.47 (995)	0.58 (1228)	0.22 (466)	59 (1475)
5 (1525)	0.19 (402)	0.38 (804)	0.54 (1143)	0.19 (402)	55 (1375)	5 (1525)	0.25 (529)	0.38 (804)	0.53 (1122)	0.22 (466)	54 (1350)
10 (3000)	0.23 (487)	0.42 (889)	0.65 (1376)	0.19 (402)	45 (1125)	10 (3000)	0.30 (635)	0.44 (931)	0.66 (1397)	0.22 (466)	49 (1225)
15 (4500)	0.32 (677)	0.59 (1249)	0.88 (1863)	0.19 (402)	41 (1025)	15 (4500)	0.42 (889)	0.62 (1312)	0.91 (1926)	0.22 (466)	44 (1100)
20 (6000) *	0.42 (889)	0.77 (1630)	1.11 (2350)	0.19 (402)	41 (1025)	20 (6000) *	0.55 (1164)	0.82 (1736)	1.16 (2455)	0.22 (466)	44 (1100)
25 (7500) *	0.52 (1101)	0.97 (2053)	1.35 (2858)	0.19 (402)	41 (1025)	25 (7500) *	0.69 (1461)	1.02 (2159)	1.42 (3006)	0.22 (466)	44 (1100)
8' x 8' x 8" (2400 x 2400 x 200 mm)											
3 (915)	0.22 (466)	0.49 (1037)	0.62 (1312)	0.19 (402)	65 (1625)	3 (915)	0.28 (593)	0.49 (1037)	0.63 (1334)	0.22 (466)	59 (1475)
5 (1525)	0.19 (402)	0.40 (847)	0.57 (1207)	0.19 (402)	65 (1625)	5 (1525)	0.23 (487)	0.41 (868)	0.57 (1207)	0.22 (466)	54 (1350)
10 (3000)	0.22 (466)	0.43 (910)	0.66 (1397)	0.19 (402)	50 (1250)	10 (3000)	0.27 (572)	0.46 (974)	0.70 (1482)	0.22 (466)	49 (1225)
15 (4500)	0.30 (635)	0.59 (1249)	0.89 (1884)	0.19 (402)	45 (1125)	15 (4500)	0.38 (804)	0.65 (1376)	0.95 (2011)	0.22 (466)	44 (1100)
20 (6000) *	0.39 (826)	0.77 (1630)	1.12 (2371)	0.19 (402)	45 (1125)	20 (6000) *	0.50 (1058)	0.85 (1799)	1.21 (2561)	0.22 (466)	44 (1100)
25 (7500) *	0.49 (1037)	0.97 (2053)	1.36 (2879)	0.19 (402)	45 (1125)	25 (7500) *	0.63 (1334)	1.06 (2244)	1.46 (3090)	0.22 (466)	44 (1100)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 30 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x
HAUNCH, WALL AND SLAB THICKNESS

* WHERE NOTED, SUBMIT DETAILS FOR
TOP SLAB SHEAR REINFORCEMENT

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm) STEEL COVER 2.0" (50 mm) AT TOP OF INVERT SLAB

H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)			
	A _{S1}	A _{S2}	A _{S3}			A _{S4}	A _{S1}	A _{S2}		A _{S3}	A _{S4}	
9' x 8' x 9" (2700 x 2400 x 225 mm)												
3	0.26 (550)	0.51 (1080)	0.67 (1418)	0.22 (466)	72 (1800)	3	(915)	0.34 (720)	0.49 (1037)	0.63 (1334)	0.24 (508)	58 (1450)
5	0.22 (466)	0.43 (910)	0.61 (1291)	0.22 (466)	59 (1475)	5	(1525)	0.30 (635)	0.41 (868)	0.56 (1185)	0.24 (508)	52 (1300)
10	0.26 (550)	0.47 (995)	0.72 (1524)	0.22 (466)	54 (1350)	10	(3000)	0.35 (741)	0.48 (1016)	0.71 (1503)	0.24 (508)	52 (1300)
15	0.36 (762)	0.66 (1397)	0.98 (2074)	0.22 (466)	44 (1100)	15	(4500)	0.49 (1037)	0.67 (1418)	0.97 (2053)	0.24 (508)	47 (1175)
20	0.46 (974)	0.86 (1820)	1.23 (2604)	0.22 (466)	44 (1100)	20	(6000) *	0.65 (1376)	0.88 (1863)	1.24 (2625)	0.24 (508)	47 (1175)
25	0.58 (1228)	1.07 (2265)	1.49 (3154)	0.22 (466)	44 (1100)	25	(7500) *	0.82 (1736)	1.09 (2307)	1.51 (3196)	0.24 (508)	47 (1175)
9' x 9' x 9" (2700 x 2700 x 225 mm)												
3	0.25 (529)	0.53 (1122)	0.71 (1503)	0.22 (466)	72 (1800)	3	(915)	0.32 (677)	0.51 (1080)	0.67 (1417)	0.24 (508)	64 (1600)
5	0.22 (466)	0.44 (931)	0.64 (1355)	0.22 (466)	72 (1800)	5	(1525)	0.28 (593)	0.43 (910)	0.60 (1270)	0.24 (508)	58 (1450)
10	0.25 (529)	0.48 (1016)	0.74 (1567)	0.22 (466)	59 (1475)	10	(3000)	0.32 (677)	0.50 (1058)	0.75 (1588)	0.24 (508)	52 (1300)
15	0.34 (720)	0.66 (1397)	0.99 (2096)	0.22 (466)	49 (1225)	15	(4500)	0.45 (953)	0.70 (1482)	1.02 (2059)	0.24 (508)	47 (1175)
20	0.44 (931)	0.86 (1820)	1.25 (2646)	0.22 (466)	49 (1225)	20	(6000) *	0.59 (1249)	0.91 (1926)	1.29 (2731)	0.24 (508)	47 (1175)
25	0.55 (1164)	1.08 (2286)	1.50 (3175)	0.22 (466)	44 (1100)	25	(7500) *	0.74 (1567)	1.14 (2413)	1.57 (3323)	0.24 (508)	47 (1175)
10' x 5' x 10" (3000 x 1500 x 250 mm)												
3	0.38 (804)	0.46 (974)	0.57 (1207)	0.24 (508)	58 (1450)	3	(915)	0.30 (635)	0.54 (1143)	0.72 (1270)	0.24 (508)	64 (1600)
5	0.32 (677)	0.38 (804)	0.52 (1101)	0.24 (508)	52 (1300)	5	(1525)	0.26 (550)	0.46 (974)	0.64 (974)	0.24 (508)	58 (1450)
10	0.39 (826)	0.45 (953)	0.66 (1397)	0.24 (508)	52 (1300)	10	(3000)	0.30 (635)	0.52 (1101)	0.78 (1228)	0.24 (508)	52 (1300)
15	0.54 (1143)	0.63 (1334)	0.91 (1926)	0.24 (508)	47 (1175)	15	(4500)	0.42 (889)	0.72 (1524)	1.05 (2223)	0.24 (508)	47 (1175)
20	0.72 (1524)	0.82 (1736)	1.17 (2477)	0.24 (508)	47 (1175)	20	(6000) *	0.54 (1143)	0.94 (1990)	1.33 (2815)	0.24 (508)	47 (1175)
25	0.91 (1926)	1.03 (2180)	1.42 (3006)	0.24 (508)	47 (1175)	25	(7500) *	0.68 (1439)	1.17 (2477)	1.62 (3429)	0.24 (508)	47 (1175)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 31 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR
HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 2.0" (50 mm) AT TOP OF INVERT SLAB

H ₀ EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	H ₀ EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)		
	AS1	AS2	AS3			AS4	AS1	AS2		AS3	AS4
10' x 9' x 10" (3000 x 2700 x 250 mm)											
3 (915)	0.28 (593)	0.56 (1185)	0.76 (1609)	0.24 (508)	79 (1975)	3 (915)	0.47 (995)	0.48 (1016)	0.61 (1291)	0.29 (614)	73 (1825)
5 (1525)	0.24 (508)	0.47 (995)	0.68 (1439)	0.24 (508)	64 (1600)	5 (1525)	0.42 (889)	0.52 (1101)	0.57 (1207)	0.29 (614)	66 (1650)
10 (3000)	0.29 (614)	0.53 (1122)	0.81 (1715)	0.24 (508)	58 (1450)	10 (3000)	0.51 (1080)	0.50 (1058)	0.71 (1503)	0.29 (614)	59 (1475)
15 (4500)	0.39 (826)	0.73 (1545)	1.08 (2286)	0.24 (508)	47 (1175)	15 (4500)	0.72 (1524)	0.70 (1482)	1.01 (2138)	0.29 (614)	59 (1475)
20 (6000) *	0.51 (1080)	0.95 (2011)	1.36 (2879)	0.24 (508)	47 (1175)	20 (6000) *	0.95 (2011)	0.91 (1926)	1.29 (2731)	0.29 (614)	59 (1475)
25 (7500) *	0.64 (1355)	1.18 (2498)	1.64 (3471)	0.24 (508)	47 (1175)	25 (7500) *	1.21 (2561)	1.14 (2413)	1.57 (3323)	0.29 (614)	59 (1475)
10' x 10' x 10" (3000 x 3000 x 250 mm)											
3 (915)	0.26 (550)	0.57 (1207)	0.80 (1693)	0.24 (508)	79 (1975)	3 (915)	0.44 (931)	0.52 (1101)	0.66 (1397)	0.29 (614)	66 (1650)
5 (1525)	0.24 (508)	0.50 (1058)	0.72 (1524)	0.24 (508)	70 (1750)	5 (1525)	0.39 (826)	0.45 (953)	0.62 (1312)	0.29 (614)	59 (1475)
10 (3000)	0.28 (593)	0.54 (1143)	0.83 (1757)	0.24 (508)	64 (1600)	10 (3000)	0.47 (995)	0.54 (1143)	0.79 (1672)	0.29 (614)	59 (1475)
15 (4500)	0.38 (804)	0.74 (1567)	1.19 (2519)	0.24 (508)	52 (1300)	15 (4500)	0.66 (1397)	0.75 (1588)	1.08 (2286)	0.29 (614)	53 (1325)
20 (6000) *	0.49 (1037)	0.95 (2011)	1.38 (2921)	0.24 (508)	52 (1300)	20 (6000) *	0.86 (1820)	0.98 (2074)	1.38 (2921)	0.29 (614)	53 (1325)
25 (7500) *	0.61 (1291)	1.19 (2519)	1.65 (3493)	0.24 (508)	47 (1175)	25 (7500) *	1.09 (2307)	1.22 (2582)	1.68 (3556)	0.29 (614)	53 (1325)
12' x 4' x 12" (3600 x 1200 x 300 mm)											
3 (915)	0.31 (656)	0.69 (1461)	0.95 (2011)	0.29 (614)	73 (1825)	3 (915)	0.41 (868)	0.55 (1164)	0.77 (1630)	0.29 (614)	66 (1650)
5 (1525)	0.46 (974)	0.53 (1122)	0.80 (1693)	0.29 (614)	66 (1650)	5 (1525)	0.37 (783)	0.49 (1037)	0.67 (1418)	0.29 (614)	59 (1475)
10 (3000)	0.56 (1185)	0.46 (974)	0.67 (1418)	0.29 (614)	59 (1475)	10 (3000)	0.44 (931)	0.57 (1207)	0.84 (1778)	0.29 (614)	59 (1475)
15 (4500)	0.80 (1693)	0.64 (1355)	0.92 (1947)	0.29 (614)	59 (1475)	15 (4500)	0.60 (1270)	0.79 (1672)	1.15 (2434)	0.29 (614)	53 (1325)
20 (6000)	1.06 (2244)	0.83 (1757)	1.18 (2498)	0.29 (614)	59 (1475)	20 (6000) *	0.79 (1672)	1.03 (2180)	1.46 (3090)	0.29 (614)	53 (1325)
25 (7500) *	1.35 (2858)	1.03 (2180)	1.44 (2434)	0.29 (614)	59 (1475)	25 (7500) *	0.99 (2096)	1.28 (2731)	1.77 (3747)	0.29 (614)	53 (1325)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 32 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 2.0" (50 mm) AT TOP OF INVERT SLAB

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)		
	A _{S1}	A _{S2}	A _{S3}			A _{S4}	A _{S1}	A _{S2}		A _{S3}	A _{S4}
12' x 8' x 12" (3600 x 2400 x 300 mm)											
3 (915)	0.38 (804)	0.58 (1228)	0.76 (1609)	0.29 (614)	66 (1650)	3 (915)	0.32 (677)	0.66 (1397)	0.90 (1905)	0.29 (614)	93 (2325)
5 (1525)	0.35 (741)	0.51 (1080)	0.72 (1524)	0.29 (614)	59 (1475)	5 (1525)	0.31 (656)	0.58 (1228)	0.84 (1778)	0.29 (614)	80 (2000)
10 (3000)	0.41 (868)	0.59 (1249)	0.89 (1884)	0.29 (614)	59 (1475)	10 (3000)	0.35 (741)	0.64 (1355)	0.99 (2096)	0.29 (614)	73 (1825)
15 (4500)	0.56 (1186)	0.83 (1757)	1.20 (2540)	0.29 (614)	53 (1325)	15 (4500)	0.48 (1016)	0.88 (1863)	1.31 (2773)	0.29 (614)	59 (1475)
20 (6000) *	0.73 (1545)	1.07 (2265)	1.52 (3217)	0.29 (614)	53 (1325)	20 (6000) *	0.62 (1312)	1.14 (2413)	1.63 (3450)	0.29 (614)	59 (1475)
25 (7500) *	0.92 (1947)	1.34 (2836)	1.84 (3895)	0.29 (614)	53 (1325)	25 (7500) *	0.77 (1630)	1.41 (2985)	1.96 (4159)	0.29 (614)	59 (1475)
12' x 9' x 12" (3600 x 2700 x 300 mm)											
3 (915)	0.36 (762)	0.61 (1291)	0.81 (1715)	0.29 (614)	80 (2000)	3 (915)	0.31 (656)	0.65 (1376)	0.95 (2011)	0.29 (614)	93 (2325)
5 (1525)	0.33 (699)	0.54 (1143)	0.76 (1609)	0.29 (614)	66 (1650)	5 (1525)	0.29 (614)	0.60 (1270)	0.88 (1863)	0.29 (614)	80 (2000)
10 (3000)	0.39 (826)	0.61 (1291)	0.92 (1947)	0.29 (614)	59 (1475)	10 (3000)	0.34 (720)	0.65 (1376)	1.01 (2138)	0.29 (614)	73 (1825)
15 (4500)	0.53 (1122)	0.85 (1799)	1.24 (2625)	0.29 (614)	53 (1325)	15 (4500)	0.46 (974)	0.89 (1884)	1.33 (2815)	0.29 (614)	59 (1475)
20 (6000) *	0.68 (1439)	1.10 (2328)	1.57 (3323)	0.29 (614)	53 (1325)	20 (6000) *	0.60 (1270)	1.14 (2413)	1.65 (3493)	0.29 (614)	59 (1475)
25 (7500) *	0.85 (1799)	1.37 (2900)	1.90 (4022)	0.29 (614)	53 (1325)	25 (7500) *	0.74 (1567)	1.41 (2985)	1.96 (4159)	0.29 (614)	59 (1475)
12' x 10' x 12" (3600 x 3000 x 300 mm)											
3 (915)	0.34 (720)	0.63 (1334)	0.75 (1588)	0.29 (614)	80 (2000)	3 (915)	0.31 (656)	0.65 (1376)	0.95 (2011)	0.29 (614)	93 (2325)
5 (1525)	0.31 (656)	0.56 (1185)	0.80 (1693)	0.29 (614)	66 (1650)	5 (1525)	0.29 (614)	0.60 (1270)	0.88 (1863)	0.29 (614)	80 (2000)
10 (3000)	0.37 (783)	0.63 (1334)	0.96 (2032)	0.29 (614)	59 (1475)	10 (3000)	0.34 (720)	0.65 (1376)	1.01 (2138)	0.29 (614)	73 (1825)
15 (4500)	0.50 (1058)	0.87 (1842)	1.27 (2688)	0.29 (614)	53 (1325)	15 (4500)	0.46 (974)	0.89 (1884)	1.33 (2815)	0.29 (614)	59 (1475)
20 (6000) *	0.64 (1355)	1.13 (2307)	1.60 (3387)	0.29 (614)	53 (1325)	20 (6000) *	0.60 (1270)	1.14 (2413)	1.65 (3493)	0.29 (614)	59 (1475)
25 (7500) *	0.80 (1693)	1.40 (2963)	1.94 (4106)	0.29 (614)	53 (1325)	25 (7500) *	0.74 (1567)	1.41 (2985)	1.96 (4159)	0.29 (614)	59 (1475)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 33 OF 42

SPAN, S		RISE, R		T _t TOP	T _b BOTTOM	T _w SIDE	H HAUNCH	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)							
FEET (mm)	FEET (mm)	INCHES (mm)	INCHES (mm)	INCHES (mm)	INCHES (mm)	INCHES (mm)	INCHES (mm)	A _{S1}	A _{S2}	A _{S3}	A _{S4}	A _{S5}	A _{S6}	A _{S7}	A _{S8}
3 (900)	2 (600)	7 (175)	6 (150)	4 (100)	4 (100)	4 (100)	4 (100)	0.17 (360)	0.38 (804)	0.30 (635)	0.10 (212)	0.22 (466)	0.17 (360)	0.17 (360)	0.14 (296)
3 (900)	3 (900)	7 (175)	6 (150)	4 (100)	6 (150)	4 (100)	4 (100)	0.17 (360)	0.40 (847)	0.32 (677)	0.10 (212)	0.23 (487)	0.17 (360)	0.17 (360)	0.14 (296)
4 (1200)	2 (600)	7.5 (190)	6 (150)	5 (125)	6 (150)	5 (125)	5 (125)	0.18 (381)	0.40 (847)	0.29 (614)	0.12 (254)	0.21 (445)	0.18 (381)	0.18 (381)	0.14 (296)
4 (1200)	3 (900)	7.5 (190)	6 (150)	5 (125)	6 (150)	5 (125)	5 (125)	0.18 (381)	0.45 (953)	0.34 (720)	0.12 (254)	0.23 (487)	0.18 (381)	0.18 (381)	0.14 (296)
4 (1200)	4 (1200)	7.5 (190)	6 (150)	5 (125)	6 (150)	5 (125)	5 (125)	0.18 (381)	0.47 (995)	0.36 (762)	0.12 (254)	0.25 (529)	0.18 (381)	0.18 (381)	0.14 (296)
5 (1500)	3 (900)	8 (200)	7 (175)	6 (150)	7 (175)	6 (150)	6 (150)	0.19 (402)	0.44 (931)	0.30 (635)	0.14 (296)	0.22 (466)	0.19 (402)	0.19 (402)	0.17 (360)
5 (1500)	4 (1200)	8 (200)	7 (175)	6 (150)	7 (175)	6 (150)	6 (150)	0.19 (402)	0.48 (1016)	0.33 (699)	0.14 (296)	0.24 (508)	0.19 (402)	0.19 (402)	0.17 (360)
5 (1500)	5 (1500)	8 (200)	7 (175)	6 (150)	7 (175)	6 (150)	6 (150)	0.19 (402)	0.50 (1059)	0.35 (741)	0.14 (296)	0.25 (529)	0.19 (402)	0.19 (402)	0.17 (360)
6 (1800)	3 (900)	8 (200)	7 (175)	7 (175)	7 (175)	7 (175)	7 (175)	0.23 (487)	0.45 (953)	0.30 (635)	0.17 (360)	0.22 (466)	0.19 (402)	0.19 (402)	0.17 (360)
6 (1800)	4 (1200)	8 (200)	7 (175)	7 (175)	7 (175)	7 (175)	7 (175)	0.19 (402)	0.49 (1037)	0.33 (699)	0.17 (360)	0.23 (487)	0.19 (402)	0.19 (402)	0.17 (360)
6 (1800)	5 (1500)	8 (200)	7 (175)	7 (175)	7 (175)	7 (175)	7 (175)	0.19 (402)	0.52 (1101)	0.37 (783)	0.17 (360)	0.25 (529)	0.19 (402)	0.19 (402)	0.17 (360)
6 (1800)	6 (1800)	8 (200)	7 (175)	7 (175)	7 (175)	7 (175)	7 (175)	0.19 (402)	0.54 (1143)	0.39 (826)	0.17 (360)	0.26 (550)	0.19 (402)	0.19 (402)	0.17 (360)
7 (2100)	4 (1200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	0.26 (550)	0.49 (1037)	0.34 (720)	0.19 (402)	0.23 (487)	0.19 (402)	0.19 (402)	0.19 (402)
7 (2100)	5 (1500)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	0.23 (487)	0.52 (1101)	0.38 (804)	0.19 (402)	0.24 (508)	0.19 (402)	0.19 (402)	0.19 (402)
7 (2100)	6 (1800)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	0.21 (445)	0.54 (1143)	0.41 (868)	0.19 (402)	0.26 (550)	0.19 (402)	0.19 (402)	0.19 (402)
7 (2100)	7 (2100)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	0.19 (402)	0.56 (1186)	0.44 (931)	0.19 (402)	0.27 (572)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	4 (1200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	0.31 (656)	0.53 (1122)	0.38 (804)	0.19 (402)	0.25 (529)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	5 (1500)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	0.28 (593)	0.57 (1207)	0.43 (910)	0.19 (402)	0.26 (550)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	6 (1800)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	0.26 (550)	0.59 (1249)	0.46 (974)	0.19 (402)	0.28 (593)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	7 (2100)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	0.24 (508)	0.62 (1313)	0.51 (1080)	0.20 (423)	0.29 (614)	0.19 (402)	0.19 (402)	0.19 (402)
8 (2400)	8 (2400)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	8 (200)	0.22 (466)	0.64 (1335)	0.55 (1164)	0.24 (508)	0.30 (635)	0.19 (402)	0.19 (402)	0.19 (402)
9 (2700)	5 (1500)	9 (225)	9 (225)	9 (225)	9 (225)	9 (225)	9 (225)	0.29 (614)	0.53 (1122)	0.43 (910)	0.22 (466)	0.25 (529)	0.22 (466)	0.22 (466)	0.22 (466)
9 (2700)	6 (1800)	9 (225)	9 (225)	9 (225)	9 (225)	9 (225)	9 (225)	0.27 (572)	0.56 (1186)	0.47 (995)	0.22 (466)	0.26 (550)	0.22 (466)	0.22 (466)	0.22 (466)
9 (2700)	7 (2100)	9 (225)	9 (225)	9 (225)	9 (225)	9 (225)	9 (225)	0.25 (529)	0.58 (1228)	0.51 (1080)	0.22 (466)	0.27 (572)	0.22 (466)	0.22 (466)	0.22 (466)

SHALLOW COVER BOXES – COVER 0' TO 2' (0 TO 600 mm)
STEEL COVER 2.5" (63 mm) AT TOP OF INVERT SLAB

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 34 OF 42

SPAN, S FEET (mm)	RISE, R FEET (mm)	T ₊ TOP INCHES (mm)	T _B BOTTOM INCHES (mm)	T _W SIDE INCHES (mm)	H HAUNCH INCHES (mm)	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)								
						A _{S1}	A _{S2}	A _{S3}	A _{S4}	A _{S5}	A _{S6}	A _{S7}	A _{S8}	
9 (2700)	8 (2400)	9 (225)	9 (225)	9 (225)	9 (225)	0.23 (487)	0.60 (1270)	0.54 (1143)	0.22 (466)	0.28 (593)	0.22 (466)	0.22 (466)	0.22 (466)	0.22 (466)
9 (2700)	9 (2700)	9 (225)	9 (225)	9 (225)	9 (225)	0.24 (508)	0.62 (1313)	0.58 (1228)	0.27 (572)	0.28 (593)	0.22 (466)	0.22 (466)	0.22 (466)	0.22 (466)
10 (3000)	5 (1500)	10 (250)	10 (250)	10 (250)	10 (250)	0.29 (614)	0.51 (1080)	0.45 (953)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	6 (1800)	10 (250)	10 (250)	10 (250)	10 (250)	0.27 (572)	0.53 (1122)	0.49 (1037)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	7 (2100)	10 (250)	10 (250)	10 (250)	10 (250)	0.25 (529)	0.55 (1164)	0.52 (1101)	0.24 (508)	0.25 (529)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	8 (2400)	10 (250)	10 (250)	10 (250)	10 (250)	0.24 (508)	0.57 (1207)	0.57 (1207)	0.24 (508)	0.26 (550)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	9 (2700)	10 (250)	10 (250)	10 (250)	10 (250)	0.24 (508)	0.59 (1249)	0.60 (1270)	0.25 (529)	0.27 (572)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
10 (3000)	10 (3000)	10 (250)	10 (250)	10 (250)	10 (250)	0.26 (550)	0.60 (1270)	0.64 (1355)	0.30 (635)	0.28 (593)	0.24 (508)	0.24 (508)	0.24 (508)	0.24 (508)
12 (3600)	4 (1200)	12 (300)	12 (300)	12 (300)	12 (300)	0.37 (783)	0.44 (931)	0.42 (889)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	5 (1500)	12 (300)	12 (300)	12 (300)	12 (300)	0.35 (741)	0.46 (974)	0.47 (995)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	6 (1800)	12 (300)	12 (300)	12 (300)	12 (300)	0.33 (699)	0.49 (1037)	0.51 (1080)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	7 (2100)	12 (300)	12 (300)	12 (300)	12 (300)	0.31 (656)	0.51 (1080)	0.55 (1164)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	8 (2400)	12 (300)	12 (300)	12 (300)	12 (300)	0.30 (635)	0.52 (1101)	0.60 (1270)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	9 (2700)	12 (300)	12 (300)	12 (300)	12 (300)	0.29 (614)	0.54 (1143)	0.64 (1355)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	10 (3000)	12 (300)	12 (300)	12 (300)	12 (300)	0.29 (614)	0.55 (1164)	0.68 (1439)	0.29 (614)	0.30 (635)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	11 (3300)	12 (300)	12 (300)	12 (300)	12 (300)	0.29 (614)	0.57 (1207)	0.72 (1524)	0.30 (635)	0.31 (656)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)
12 (3600)	12 (3600)	12 (300)	12 (300)	12 (300)	12 (300)	0.31 (656)	0.58 (1228)	0.76 (1609)	0.38 (804)	0.32 (677)	0.29 (614)	0.29 (614)	0.29 (614)	0.29 (614)

SHALLOW COVER BOXES – COVER 0' TO 2' (0 TO 610 mm)
STEEL COVER 2.5" (63 mm) AT TOP OF INVERT SLAB

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 35 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR
HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 2.5" (63 mm) AT TOP OF INVERT SLAB

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)		
	AS1	AS2	AS3			AS4	AS1	AS2		AS3	AS4
3' x 2' x 4" (900 x 600 x 100 mm)											
3	0.13 (275)	0.21 (445)	0.25 (529)	0.10 (217)	31 (775)	3	0.17 (360)	0.28 (593)	0.41 (868)	0.12 (254)	38 (950)
5	0.10 (217)	0.10 (217)	0.22 (466)	0.10 (217)	31 (775)	5	0.12 (254)	0.12 (254)	0.25 (529)	0.12 (254)	38 (950)
10	0.10 (217)	0.11 (233)	0.28 (593)	0.10 (217)	31 (775)	10	0.12 (254)	0.15 (318)	0.32 (677)	0.12 (254)	38 (950)
						15	0.12 (254)	0.23 (489)	0.46 (974)	0.12 (254)	38 (950)
3' x 3' x 4" (900 x 900 x 100 mm)											
3	0.10 (217)	0.25 (529)	0.27 (572)	0.10 (217)	31 (775)	3	0.14 (296)	0.31 (656)	0.45 (953)	0.12 (254)	38 (950)
5	0.10 (217)	0.10 (217)	0.23 (487)	0.10 (217)	31 (775)	5	0.12 (254)	0.14 (296)	0.26 (550)	0.12 (254)	38 (950)
10	0.10 (217)	0.11 (233)	0.29 (614)	0.10 (217)	31 (775)	10	0.12 (254)	0.15 (318)	0.32 (677)	0.12 (254)	38 (950)
						15	0.12 (254)	0.22 (466)	0.46 (974)	0.12 (254)	38 (950)
4' x 2' x 5" (1200 x 600 x 125 mm)											
3	0.19 (402)	0.23 (489)	0.34 (720)	0.12 (254)	38 (950)	3	0.21 (445)	0.29 (614)	0.34 (720)	0.14 (296)	45 (1125)
5	0.12 (254)	0.12 (254)	0.21 (445)	0.12 (254)	38 (950)	5	0.14 (296)	0.15 (318)	0.26 (550)	0.14 (296)	36 (900)
10	0.12 (254)	0.14 (296)	0.28 (593)	0.12 (254)	38 (950)	10	0.14 (296)	0.18 (381)	0.34 (720)	0.14 (296)	36 (900)
15	0.16 (339)	0.20 (423)	0.41 (868)	0.12 (254)	38 (950)	15	0.18 (381)	0.27 (572)	0.49 (1037)	0.14 (296)	35 (875)
20	0.22 (466)	0.27 (572)	0.54 (1143)	0.12 (254)	38 (950)	20	0.25 (529)	0.36 (762)	0.64 (1355)	0.14 (296)	35 (875)
						25	0.32 (677)	0.46 (974)	0.80 (1693)	0.14 (296)	35 (875)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 36 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 2.5" (63 mm) AT TOP OF INVERT SLAB

H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	
	A _{S1}	A _{S2}	A _{S3}	A _{S4}			A _{S1}	A _{S2}	A _{S3}	A _{S4}		
5' x 4' x 6" (1500 x 1200 x 150 mm)												
3 (915)	0.18 (381)	0.33 (699)	0.39 (826)	0.14 (296)	45 (1125)	3 (915)	0.22 (466)	0.33 (699)	0.36 (762)	0.17 (360)	43 (1075)	
5 (1525)	0.14 (296)	0.16 (339)	0.29 (614)	0.14 (296)	45 (1125)	5 (1525)	0.17 (360)	0.18 (381)	0.30 (635)	0.17 (360)	40 (1000)	
10 (3000)	0.14 (296)	0.20 (423)	0.37 (783)	0.14 (296)	36 (900)	10 (3000)	0.17 (360)	0.22 (466)	0.39 (826)	0.17 (360)	39 (975)	
15 (4500)	0.15 (318)	0.29 (614)	0.53 (1122)	0.14 (296)	35 (875)	15 (4500)	0.21 (445)	0.33 (699)	0.57 (1207)	0.17 (360)	38 (850)	
20 (6000) *	0.20 (423)	0.39 (826)	0.69 (1461)	0.14 (296)	35 (875)	20 (6000) *	0.28 (593)	0.44 (931)	0.74 (1567)	0.17 (360)	38 (850)	
5' x 5' x 6" (1500 x 1500 x 150 mm)												
3 (915)	0.16 (339)	0.35 (741)	0.43 (910)	0.14 (296)	45 (1125)	3 (915)	0.19 (402)	0.36 (762)	0.41 (868)	0.17 (360)	52 (1300)	
5 (1525)	0.14 (296)	0.17 (360)	0.31 (656)	0.14 (296)	45 (1125)	5 (1525)	0.17 (360)	0.20 (423)	0.34 (720)	0.17 (360)	43 (1075)	
10 (3000)	0.14 (296)	0.20 (423)	0.38 (804)	0.14 (296)	45 (1125)	10 (3000)	0.17 (360)	0.24 (508)	0.43 (910)	0.17 (360)	39 (975)	
15 (4500)	0.14 (296)	0.29 (614)	0.54 (1143)	0.14 (296)	36 (900)	15 (4500)	0.18 (381)	0.35 (741)	0.61 (1291)	0.17 (360)	38 (950)	
20 (6000) *	0.17 (360)	0.39 (826)	0.70 (1482)	0.14 (296)	35 (875)	20 (6000) *	0.24 (508)	0.47 (995)	0.79 (1672)	0.17 (360)	38 (950)	
6' x 3' x 7" (1800 x 900 x 175 mm)												
3 (915)	0.24 (508)	0.30 (635)	0.32 (677)	0.17 (360)	43 (1075)	3 (915)	0.17 (360)	0.38 (804)	0.43 (910)	0.17 (360)	52 (1300)	
5 (1525)	0.17 (360)	0.17 (360)	0.27 (572)	0.17 (360)	40 (1000)	5 (1525)	0.17 (360)	0.20 (423)	0.35 (741)	0.17 (360)	52 (1300)	
10 (3000)	0.17 (360)	0.21 (445)	0.36 (762)	0.17 (360)	39 (975)	10 (3000)	0.17 (360)	0.24 (508)	0.43 (910)	0.17 (360)	43 (1075)	
15 (4500)	0.25 (529)	0.31 (656)	0.52 (1101)	0.17 (360)	38 (950)	15 (4500)	0.17 (360)	0.34 (720)	0.60 (1270)	0.17 (360)	39 (975)	
20 (6000) *	0.34 (720)	0.41 (868)	0.68 (1439)	0.17 (360)	38 (950)	20 (6000) *	0.21 (445)	0.46 (974)	0.78 (1651)	0.17 (360)	38 (950)	
25 (7500) *	0.44 (931)	0.52 (1101)	0.84 (1778)	0.17 (360)	38 (950)	25 (7500) *	0.25 (529)	0.58 (1228)	0.96 (2032)	0.17 (360)	38 (950)	

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 37 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR
HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 2.5" (63 mm) AT TOP OF INVERT SLAB

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	
	AS1	AS2	AS3			AS4	AS1	AS2		AS3
7' x 4' x 8" (2100 x 1200 x 200 mm)										
3 (915)	0.24 (508)	0.33 (699)	0.41 (868)	0.19 (402)	47 (1175)	3 (915)	0.19 (402)	0.41 (868)	0.54 (1143)	0.19 (402)
5 (1525)	0.19 (402)	0.21 (445)	0.33 (699)	0.19 (402)	43 (1075)	5 (1525)	0.19 (402)	0.25 (529)	0.42 (889)	0.19 (402)
10 (3000)	0.19 (402)	0.26 (550)	0.43 (910)	0.19 (402)	43 (1075)	10 (3000)	0.19 (402)	0.29 (614)	0.51 (1080)	0.19 (402)
15 (4500)	0.28 (593)	0.38 (804)	0.62 (1312)	0.19 (402)	41 (1025)	15 (4500)	0.19 (402)	0.42 (889)	0.71 (1503)	0.19 (402)
20 (6000) *	0.37 (783)	0.51 (1080)	0.81 (1715)	0.19 (402)	41 (1025)	20 (6000) *	0.26 (550)	0.56 (1185)	0.91 (1926)	0.19 (402)
25 (7500) *	0.47 (995)	0.64 (1355)	1.00 (2117)	0.19 (402)	41 (1025)	25 (7500) *	0.32 (677)	0.70 (1482)	1.11 (2350)	0.19 (402)
7' x 5' x 8" (2100 x 1500 x 200 mm)										
3 (915)	0.22 (466)	0.36 (762)	0.46 (974)	0.19 (402)	59 (1475)	3 (915)	0.32 (677)	0.39 (826)	0.49 (1037)	0.19 (402)
5 (1525)	0.19 (402)	0.23 (489)	0.37 (783)	0.19 (402)	43 (1075)	5 (1525)	0.22 (466)	0.26 (550)	0.41 (868)	0.19 (402)
10 (3000)	0.19 (402)	0.28 (593)	0.47 (995)	0.19 (402)	43 (1075)	10 (3000)	0.28 (593)	0.33 (699)	0.55 (1164)	0.19 (402)
15 (4500)	0.24 (508)	0.41 (868)	0.67 (1418)	0.19 (402)	41 (1025)	15 (4500)	0.42 (889)	0.49 (1037)	0.79 (1672)	0.19 (402)
20 (6000) *	0.32 (677)	0.54 (1143)	0.87 (1842)	0.19 (402)	41 (1025)	20 (6000) *	0.57 (1207)	0.65 (1376)	1.03 (2180)	0.19 (402)
25 (7500) *	0.40 (847)	0.68 (1438)	1.07 (2265)	0.19 (402)	41 (1025)	25 (7500) *	0.73 (1545)	0.83 (1757)	1.27 (2688)	0.19 (402)
8' x 4' x 8" (2400 x 1200 x 200 mm)										
3 (915)	0.22 (466)	0.36 (762)	0.46 (974)	0.19 (402)	59 (1475)	3 (915)	0.32 (677)	0.39 (826)	0.49 (1037)	0.19 (402)
5 (1525)	0.19 (402)	0.23 (489)	0.37 (783)	0.19 (402)	43 (1075)	5 (1525)	0.22 (466)	0.26 (550)	0.41 (868)	0.19 (402)
10 (3000)	0.19 (402)	0.28 (593)	0.47 (995)	0.19 (402)	43 (1075)	10 (3000)	0.28 (593)	0.33 (699)	0.55 (1164)	0.19 (402)
15 (4500)	0.24 (508)	0.41 (868)	0.67 (1418)	0.19 (402)	41 (1025)	15 (4500)	0.42 (889)	0.49 (1037)	0.79 (1672)	0.19 (402)
20 (6000) *	0.32 (677)	0.54 (1143)	0.87 (1842)	0.19 (402)	41 (1025)	20 (6000) *	0.57 (1207)	0.65 (1376)	1.03 (2180)	0.19 (402)
25 (7500) *	0.40 (847)	0.68 (1438)	1.07 (2265)	0.19 (402)	41 (1025)	25 (7500) *	0.73 (1545)	0.83 (1757)	1.27 (2688)	0.19 (402)
8' x 5' x 8" (2400 x 1500 x 200 mm)										
3 (915)	0.20 (423)	0.39 (826)	0.50 (1058)	0.19 (402)	59 (1475)	3 (915)	0.28 (593)	0.42 (889)	0.55 (1164)	0.19 (402)
5 (1525)	0.19 (402)	0.24 (508)	0.40 (847)	0.19 (402)	47 (1175)	5 (1525)	0.20 (423)	0.28 (593)	0.46 (974)	0.19 (402)
10 (3000)	0.19 (402)	0.29 (614)	0.49 (1037)	0.19 (402)	43 (1075)	10 (3000)	0.25 (529)	0.35 (741)	0.60 (1270)	0.19 (402)
15 (4500)	0.21 (445)	0.41 (868)	0.70 (1482)	0.19 (402)	41 (1025)	15 (4500)	0.37 (783)	0.52 (1101)	0.85 (1799)	0.19 (402)
20 (6000) *	0.28 (593)	0.55 (1164)	0.90 (1905)	0.19 (402)	41 (1025)	20 (6000) *	0.49 (1037)	0.70 (1482)	1.11 (2350)	0.19 (402)
25 (7500) *	0.33 (699)	0.70 (1482)	1.10 (2328)	0.19 (402)	41 (1025)	25 (7500) *	0.63 (1334)	0.89 (1884)	1.36 (2879)	0.19 (402)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 38 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 2.5" (63 mm) AT TOP OF INVERT SLAB

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)
	A _{S1}	A _{S2}	A _{S3}	A _{S4}			A _{S1}	A _{S2}	A _{S3}	A _{S4}	
8' x 6' x 8" (2400 x 1800 x 200 mm)											
3	0.25 (529)	0.45 (953)	0.59 (1249)	0.19 (402)	55 (1375)	3	0.34 (720)	0.44 (931)	0.58 (1228)	0.22 (466)	54 (1350)
5	0.19 (402)	0.30 (635)	0.50 (1058)	0.19 (402)	50 (1250)	5	0.24 (508)	0.30 (635)	0.48 (1016)	0.22 (466)	49 (1225)
10	0.23 (489)	0.37 (783)	0.63 (1334)	0.19 (402)	45 (1125)	10	0.30 (635)	0.38 (804)	0.63 (1334)	0.22 (466)	49 (1225)
15	0.33 (699)	0.55 (1164)	0.89 (1884)	0.19 (402)	41 (1025)	15	0.44 (931)	0.56 (1185)	0.89 (1884)	0.22 (466)	44 (1100)
20	0.44 (931)	0.73 (1545)	1.16 (2455)	0.19 (402)	41 (1025)	20	0.59 (1249)	0.75 (1588)	1.16 (2455)	0.22 (466)	44 (1100)
8' x 7' x 8" (2400 x 2100 x 200 mm)											
3	0.23 (489)	0.47 (995)	0.64 (1355)	0.19 (402)	65 (1625)	3	0.37 (783)	0.47 (995)	0.71 (1503)	0.22 (466)	59 (1475)
5	0.19 (402)	0.31 (656)	0.53 (1122)	0.19 (402)	55 (1375)	5	0.22 (466)	0.32 (677)	0.51 (1080)	0.22 (466)	54 (1350)
10	0.21 (445)	0.38 (804)	0.65 (1376)	0.19 (402)	45 (1125)	10	0.27 (572)	0.40 (847)	0.67 (1418)	0.22 (466)	49 (1225)
15	0.30 (635)	0.56 (1185)	0.92 (1947)	0.19 (402)	41 (1025)	15	0.40 (847)	0.59 (1249)	0.95 (2011)	0.22 (466)	44 (1100)
20	0.40 (847)	0.75 (1588)	1.19 (2519)	0.19 (402)	41 (1025)	20	0.53 (1122)	0.79 (1672)	1.23 (2604)	0.22 (466)	44 (1100)
8' x 8' x 8" (2400 x 2400 x 200 mm)											
3	0.22 (466)	0.49 (1037)	0.68 (1439)	0.19 (402)	65 (1625)	3	0.28 (593)	0.49 (1037)	0.68 (1439)	0.22 (466)	59 (1475)
5	0.19 (402)	0.33 (699)	0.55 (1164)	0.19 (402)	65 (1625)	5	0.22 (466)	0.34 (720)	0.55 (1164)	0.22 (466)	54 (1350)
10	0.20 (423)	0.39 (826)	0.67 (1418)	0.19 (402)	50 (1250)	10	0.25 (529)	0.42 (889)	0.70 (1482)	0.22 (466)	49 (1225)
15	0.29 (614)	0.56 (1185)	0.94 (1990)	0.19 (402)	45 (1125)	15	0.36 (762)	0.61 (1291)	0.98 (2074)	0.22 (466)	44 (1100)
20	0.38 (804)	0.75 (1588)	1.20 (2540)	0.19 (402)	45 (1125)	20	0.48 (1016)	0.82 (1736)	1.27 (2688)	0.22 (466)	44 (1100)
9' x 5' x 9" (2700 x 1500 x 225 mm)											
9' x 6' x 9" (3300 x 1800 x 225 mm)											
9' x 7' x 9" (2700 x 2100 x 225 mm)											
9' x 8' x 9" (2700 x 2400 x 225 mm)											

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 2.5" (63 mm) AT TOP OF INVERT SLAB

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	
	AS1	AS2	AS3			AS4	AS1	AS2		AS3
9' x 8' x 9" (2700 x 2400 x 225 mm)										
3 (915)	0.26 (550)	0.51 (1080)	0.73 (1545)	0.22 (466)	72 (1800)	3 (915)	0.35 (741)	0.49 (1037)	0.67 (1418)	0.24 (508)
5 (1525)	0.22 (466)	0.35 (741)	0.58 (1228)	0.22 (466)	59 (1475)	5 (1525)	0.26 (550)	0.34 (720)	0.54 (1143)	0.24 (508)
10 (3000)	0.24 (508)	0.43 (910)	0.72 (1524)	0.22 (466)	54 (1350)	10 (3000)	0.32 (677)	0.44 (931)	0.70 (1482)	0.24 (508)
15 (4500)	0.34 (720)	0.63 (1334)	1.01 (2138)	0.22 (466)	44 (1100)	15 (4500)	0.47 (995)	0.63 (1334)	1.00 (2117)	0.24 (508)
20 (6000) *	0.45 (953)	0.83 (1757)	1.30 (2752)	0.22 (466)	44 (1100)	20 (6000) *	0.63 (1334)	0.85 (1799)	1.29 (2731)	0.24 (508)
25 (7500) *	0.57 (1207)	1.05 (2223)	1.59 (3366)	0.22 (466)	44 (1100)	25 (7500) *	0.80 (1693)	1.07 (2265)	1.59 (3366)	0.24 (508)
9' x 9' x 9" (2700 x 2700 x 225 mm)										
3 (915)	0.25 (529)	0.53 (1122)	0.77 (1630)	0.22 (466)	72 (1800)	3 (915)	0.32 (677)	0.51 (1080)	0.71 (1503)	0.24 (508)
5 (1525)	0.22 (466)	0.37 (783)	0.61 (1291)	0.22 (466)	72 (1800)	5 (1525)	0.24 (508)	0.35 (741)	0.56 (1185)	0.24 (508)
10 (3000)	0.23 (487)	0.43 (910)	0.74 (1567)	0.22 (466)	59 (1475)	10 (3000)	0.30 (635)	0.47 (995)	0.75 (1588)	0.24 (508)
15 (4500)	0.32 (677)	0.63 (1334)	1.03 (2180)	0.22 (466)	49 (1225)	15 (4500)	0.42 (889)	0.65 (1376)	1.02 (2159)	0.24 (508)
20 (6000) *	0.43 (910)	0.84 (1778)	1.31 (2773)	0.22 (466)	49 (1225)	20 (6000) *	0.54 (1143)	0.84 (1778)	1.28 (2709)	0.24 (508)
10' x 5' x 10" (3000 x 1500 x 250 mm)										
3 (915)	0.38 (804)	0.46 (974)	0.61 (1291)	0.24 (508)	58 (1450)	3 (915)	0.30 (635)	0.54 (1143)	0.77 (1630)	0.24 (508)
5 (1525)	0.28 (593)	0.32 (677)	0.50 (1058)	0.24 (508)	52 (1300)	5 (1525)	0.24 (508)	0.38 (804)	0.61 (1291)	0.24 (508)
10 (3000)	0.35 (741)	0.41 (868)	0.66 (1397)	0.24 (508)	52 (1300)	10 (3000)	0.28 (593)	0.47 (995)	0.77 (1630)	0.24 (508)
15 (4500)	0.52 (1101)	0.60 (1270)	0.94 (1990)	0.24 (508)	47 (1175)	15 (4500)	0.40 (868)	0.68 (1439)	1.08 (2286)	0.24 (508)
20 (6000) *	0.70 (1482)	0.80 (1693)	1.22 (2582)	0.24 (508)	47 (1175)	20 (6000) *	0.53 (1122)	0.91 (1926)	1.39 (2942)	0.24 (508)
25 (7500) *	0.90 (1905)	1.01 (2138)	1.50 (3175)	0.24 (508)	47 (1175)	25 (7500) *	0.67 (1418)	1.15 (2434)	1.70 (3598)	0.24 (508)
10' x 6' x 10" (3300 x 1800 x 250 mm)										
3 (915)	0.26 (550)	0.51 (1080)	0.73 (1545)	0.22 (466)	72 (1800)	3 (915)	0.35 (741)	0.49 (1037)	0.67 (1418)	0.24 (508)
5 (1525)	0.22 (466)	0.35 (741)	0.58 (1228)	0.22 (466)	59 (1475)	5 (1525)	0.26 (550)	0.34 (720)	0.54 (1143)	0.24 (508)
10 (3000)	0.24 (508)	0.43 (910)	0.72 (1524)	0.22 (466)	54 (1350)	10 (3000)	0.32 (677)	0.44 (931)	0.70 (1482)	0.24 (508)
15 (4500)	0.34 (720)	0.63 (1334)	1.01 (2138)	0.22 (466)	44 (1100)	15 (4500)	0.47 (995)	0.63 (1334)	1.00 (2117)	0.24 (508)
20 (6000) *	0.45 (953)	0.83 (1757)	1.30 (2752)	0.22 (466)	44 (1100)	20 (6000) *	0.63 (1334)	0.85 (1799)	1.29 (2731)	0.24 (508)
25 (7500) *	0.57 (1207)	1.05 (2223)	1.59 (3366)	0.22 (466)	44 (1100)	25 (7500) *	0.80 (1693)	1.07 (2265)	1.59 (3366)	0.24 (508)
10' x 7' x 10" (3000 x 2100 x 250 mm)										
3 (915)	0.25 (529)	0.53 (1122)	0.77 (1630)	0.22 (466)	72 (1800)	3 (915)	0.32 (677)	0.51 (1080)	0.71 (1503)	0.24 (508)
5 (1525)	0.22 (466)	0.37 (783)	0.61 (1291)	0.22 (466)	72 (1800)	5 (1525)	0.24 (508)	0.35 (741)	0.56 (1185)	0.24 (508)
10 (3000)	0.23 (487)	0.43 (910)	0.74 (1567)	0.22 (466)	59 (1475)	10 (3000)	0.30 (635)	0.47 (995)	0.75 (1588)	0.24 (508)
15 (4500)	0.32 (677)	0.63 (1334)	1.03 (2180)	0.22 (466)	49 (1225)	15 (4500)	0.42 (889)	0.65 (1376)	1.02 (2159)	0.24 (508)
20 (6000) *	0.43 (910)	0.84 (1778)	1.31 (2773)	0.22 (466)	49 (1225)	20 (6000) *	0.54 (1143)	0.84 (1778)	1.28 (2709)	0.24 (508)
10' x 8' x 10" (3000 x 2400 x 250 mm)										
3 (915)	0.38 (804)	0.46 (974)	0.61 (1291)	0.24 (508)	58 (1450)	3 (915)	0.30 (635)	0.54 (1143)	0.77 (1630)	0.24 (508)
5 (1525)	0.28 (593)	0.32 (677)	0.50 (1058)	0.24 (508)	52 (1300)	5 (1525)	0.24 (508)	0.38 (804)	0.61 (1291)	0.24 (508)
10 (3000)	0.35 (741)	0.41 (868)	0.66 (1397)	0.24 (508)	52 (1300)	10 (3000)	0.28 (593)	0.47 (995)	0.77 (1630)	0.24 (508)
15 (4500)	0.52 (1101)	0.60 (1270)	0.94 (1990)	0.24 (508)	47 (1175)	15 (4500)	0.40 (868)	0.68 (1439)	1.08 (2286)	0.24 (508)
20 (6000) *	0.70 (1482)	0.80 (1693)	1.22 (2582)	0.24 (508)	47 (1175)	20 (6000) *	0.53 (1122)	0.91 (1926)	1.39 (2942)	0.24 (508)
25 (7500) *	0.90 (1905)	1.01 (2138)	1.50 (3175)	0.24 (508)	47 (1175)	25 (7500) *	0.67 (1418)	1.15 (2434)	1.70 (3598)	0.24 (508)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PRECAST REINFORCED CONCRETE BOX

STANDARD PLAN

390-0

SHEET 40 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm) STEEL COVER 2.5 INCHES (63 mm) AT TOP OF INVERT SLAB

H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	H _E EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)				M INCHES (mm)	
	A _{S1}	A _{S2}	A _{S3}	A _{S4}			A _{S1}	A _{S2}	A _{S3}	A _{S4}		
10' x 9' x 10" (3000 x 2700 x 250 mm)												
3 (915)	0.28 (593)	0.56 (1185)	0.81 (1715)	0.24 (508)	79 (1975)	3 (915)	0.47 (995)	0.48 (1016)	0.64 (1355)	0.29 (614)	73 (1825)	
5 (1525)	0.24 (508)	0.39 (826)	0.64 (1355)	0.24 (508)	64 (1600)	5 (1525)	0.37 (783)	0.36 (762)	0.55 (1164)	0.29 (614)	66 (1650)	
10 (3000)	0.27 (572)	0.48 (1016)	0.80 (1693)	0.24 (508)	58 (1450)	10 (3000)	0.47 (995)	0.46 (974)	0.72 (1524)	0.29 (614)	59 (1475)	
15 (4500)	0.38 (804)	0.63 (1334)	1.11 (2350)	0.24 (508)	47 (1175)	15 (4500)	0.69 (1461)	0.67 (1418)	1.03 (2180)	0.29 (614)	59 (1475)	
20 (6000) *	0.50 (1058)	0.92 (1947)	1.42 (3006)	0.24 (508)	47 (1175)	20 (6000)	0.92 (1947)	0.89 (1884)	1.33 (2815)	0.29 (614)	59 (1475)	
25 (7500) *	0.63 (1334)	1.16 (2455)	1.73 (3662)	0.24 (508)	47 (1175)	25 (7500) *	1.18 (2498)	1.12 (2371)	1.64 (3471)	0.29 (614)	59 (1475)	
10' x 10' x 10" (3000 x 3000 x 250 mm)												
3 (915)	0.27 (572)	0.57 (1207)	0.86 (1820)	0.24 (508)	79 (1975)	3 (915)	0.44 (931)	0.52 (1101)	0.70 (1482)	0.29 (614)	66 (1650)	
5 (1525)	0.24 (508)	0.41 (868)	0.67 (1418)	0.24 (508)	70 (1750)	5 (1525)	0.34 (720)	0.39 (826)	0.60 (1270)	0.29 (614)	59 (1475)	
10 (3000)	0.26 (550)	0.48 (1016)	0.82 (1736)	0.24 (508)	64 (1600)	10 (3000)	0.43 (910)	0.49 (1037)	0.78 (1651)	0.29 (614)	59 (1475)	
15 (4500)	0.36 (762)	0.70 (1482)	1.13 (2392)	0.24 (508)	52 (1300)	15 (4500)	0.63 (1334)	0.72 (1524)	1.10 (2328)	0.29 (614)	53 (1325)	
20 (6000) *	0.48 (1016)	0.92 (1947)	1.46 (3090)	0.24 (508)	52 (1300)	20 (6000) *	0.84 (1778)	0.95 (2011)	1.43 (3027)	0.29 (614)	53 (1325)	
25 (7500) *	0.60 (1270)	1.06 (2244)	1.74 (3683)	0.24 (508)	47 (1175)	25 (7500) *	1.07 (2265)	1.20 (2540)	1.75 (3704)	0.29 (614)	53 (1325)	
12' x 4' x 12" (3600 x 1200 x 300 mm)												
3 (915)	0.50 (1058)	0.44 (931)	0.58 (1228)	0.29 (614)	73 (1825)	3 (915)	0.41 (868)	0.55 (1164)	0.75 (1588)	0.29 (614)	66 (1650)	
5 (1525)	0.40 (847)	0.33 (699)	0.50 (1058)	0.29 (614)	66 (1650)	5 (1525)	0.32 (677)	0.41 (868)	0.64 (1355)	0.29 (614)	59 (1475)	
10 (3000)	0.51 (1080)	0.42 (889)	0.66 (1397)	0.29 (614)	59 (1475)	10 (3000)	0.40 (847)	0.52 (1101)	0.83 (1757)	0.29 (614)	59 (1475)	
15 (4500)	0.76 (1609)	0.61 (1291)	0.94 (1990)	0.29 (614)	59 (1475)	15 (4500)	0.58 (1228)	0.76 (1609)	1.17 (2477)	0.29 (614)	53 (1325)	
20 (6000)	1.03 (2180)	0.81 (1715)	1.22 (2582)	0.29 (614)	59 (1475)	20 (6000) *	0.77 (1630)	1.00 (2117)	1.50 (3175)	0.29 (614)	53 (1325)	
25 (7500) *	1.32 (2794)	1.02 (2159)	1.50 (3175)	0.29 (614)	59 (1475)	25 (7500) *	0.97 (2053)	1.26 (2667)	1.84 (3895)	0.29 (614)	53 (1325)	
12' x 7' x 12" (3600 x 2100 x 300 mm)												

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 41 OF 42

DIMENSIONS SHOWN ARE SPAN x RISE x * WHERE NOTED, SUBMIT DETAILS FOR
HAUNCH, WALL AND SLAB THICKNESS TOP SLAB SHEAR REINFORCEMENT

EARTH COVER MORE THAN 2' (610 mm)
STEEL COVER 2.5" (63 mm) AT TOP OF INVERT SLAB

H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)	H _e EARTH COVER FT (mm) MAXIMUM	TRANSVERSE REINFORCEMENT AREA, IN ² / FT (mm ² / m)			M INCHES (mm)		
	AS1	AS2	AS3			AS4	AS1	AS2		AS3	AS4
12' x 8' x 12" (3600 x 2400 x 300 mm)											
3 (915)	0.39 (826)	0.58 (1228)	0.81 (1715)	0.29 (614)	66 (1650)	3 (915)	0.35 (741)	0.66 (1397)	0.95 (2011)	0.29 (614)	93 (2325)
5 (1525)	0.30 (635)	0.43 (910)	0.68 (1439)	0.29 (614)	59 (1475)	5 (1525)	0.29 (614)	0.48 (1016)	0.79 (1672)	0.29 (614)	80 (2000)
10 (3000)	0.38 (804)	0.54 (1143)	0.87 (1842)	0.29 (614)	59 (1475)	10 (3000)	0.33 (699)	0.58 (1228)	0.97 (2053)	0.29 (614)	73 (1825)
15 (4500)	0.54 (1143)	0.79 (1672)	1.22 (2582)	0.29 (614)	53 (1325)	15 (4500)	0.46 (974)	0.84 (779)	1.33 (2815)	0.29 (614)	59 (1475)
20 (6000) *	0.71 (1503)	1.04 (2201)	1.57 (3323)	0.29 (614)	53 (1325)	20 (6000) *	0.60 (1270)	1.10 (2328)	1.68 (3556)	0.29 (614)	59 (1475)
25 (7500) *	0.90 (1905)	1.31 (2773)	1.91 (4043)	0.29 (614)	53 (1325)	25 (7500) *	0.75 (1588)	1.38 (2921)	2.04 (4318)	0.29 (614)	59 (1475)
12' x 9' x 12" (3600 x 2700 x 300 mm)											
3 (915)	0.37 (783)	0.61 (1291)	0.86 (1820)	0.29 (614)	80 (2000)	3 (915)	0.31 (656)	0.69 (1461)	1.00 (2117)	0.29 (614)	93 (2325)
5 (1525)	0.29 (614)	0.45 (953)	0.72 (1524)	0.29 (614)	66 (1650)	5 (1525)	0.29 (614)	0.50 (1058)	0.83 (1757)	0.29 (614)	80 (2000)
10 (3000)	0.36 (762)	0.56 (1185)	0.91 (1926)	0.29 (614)	59 (1475)	10 (3000)	0.32 (677)	0.59 (1249)	1.00 (2117)	0.29 (614)	73 (1825)
15 (4500)	0.50 (1058)	0.81 (1715)	1.26 (2667)	0.29 (614)	53 (1325)	15 (4500)	0.45 (953)	0.84 (779)	1.35 (2858)	0.29 (614)	59 (1475)
20 (6000) *	0.66 (1397)	1.07 (2265)	1.62 (3429)	0.29 (614)	53 (1325)	20 (6000) *	0.58 (1228)	1.11 (2350)	1.70 (3598)	0.29 (614)	59 (1475)
25 (7500) *	0.84 (1778)	1.35 (2858)	1.97 (4170)	0.29 (614)	53 (1325)	25 (7500) *	0.73 (1545)	1.38 (2921)	2.05 (4339)	0.29 (614)	59 (1475)
12' x 10' x 12" (3600 x 3000 x 300 mm)											
3 (915)	0.34 (720)	0.64 (1355)	0.90 (1905)	0.29 (614)	80 (2000)	3 (915)	0.34 (720)	0.64 (1355)	0.90 (1905)	0.29 (614)	80 (2000)
5 (1525)	0.29 (614)	0.47 (995)	0.76 (1609)	0.29 (614)	66 (1650)	5 (1525)	0.29 (614)	0.47 (995)	0.76 (1609)	0.29 (614)	66 (1650)
10 (3000)	0.34 (720)	0.57 (1207)	0.94 (1990)	0.29 (614)	59 (1475)	10 (3000)	0.34 (720)	0.57 (1207)	0.94 (1990)	0.29 (614)	59 (1475)
15 (4500)	0.48 (1016)	0.83 (1757)	1.30 (2752)	0.29 (614)	53 (1325)	15 (4500)	0.48 (1016)	0.83 (1757)	1.30 (2752)	0.29 (614)	53 (1325)
20 (6000) *	0.63 (1334)	1.09 (2307)	1.65 (3493)	0.29 (614)	53 (1325)	20 (6000) *	0.63 (1334)	1.09 (2307)	1.65 (3493)	0.29 (614)	53 (1325)
25 (7500) *	0.79 (1672)	1.37 (2900)	2.01 (4255)	0.29 (614)	53 (1325)	25 (7500) *	0.79 (1672)	1.37 (2900)	2.01 (4255)	0.29 (614)	53 (1325)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


PRECAST REINFORCED CONCRETE BOX

390-0

SHEET 42 OF 42

SECTION 4

Street Lighting and Traffic Signals

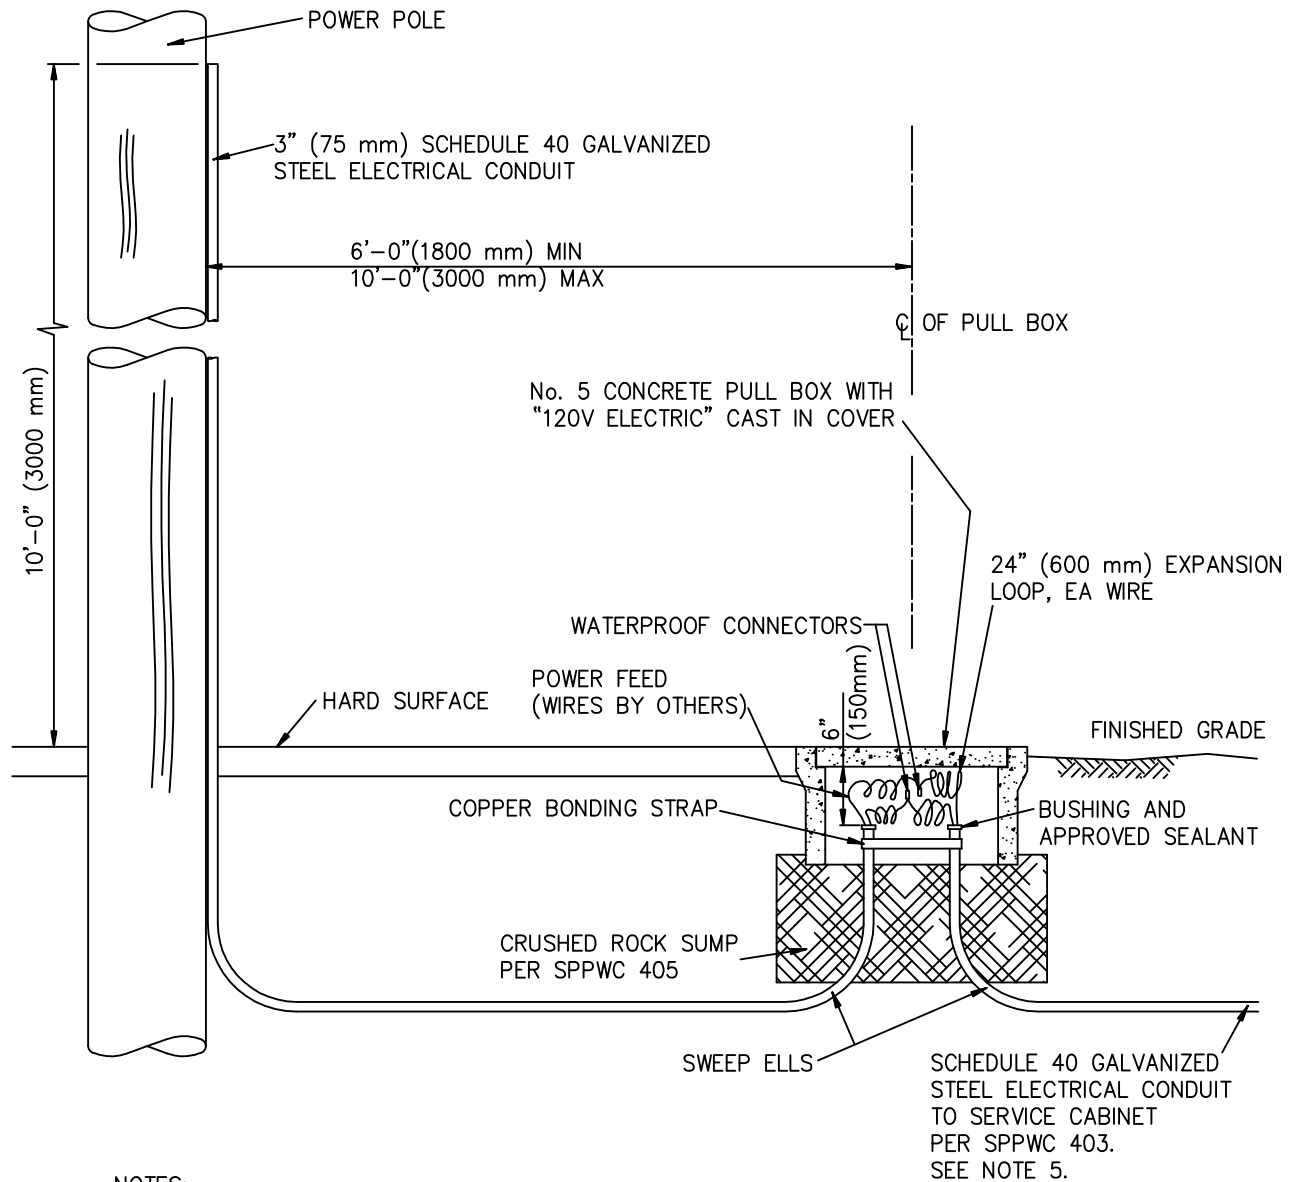

NOTES:

1. AREA AROUND BOX MAY BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF BOX:
 AT GRADE FOR HARD SURFACE
 1/2" (12 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
3. CRUSHED ROCK SHALL COVER ELECTRICAL BOX SIDE OPENINGS TO PREVENT SOIL ENTRY.
4. WATERPROOF CONNECTORS SHALL BE SUBJECT TO ENGINEER'S APPROVAL.
5. IF PLASTIC CONDUIT IS ALLOWED FROM PULL BOX TO SERVICE CABINET, INSTALL 5/8" x 9' (16 x 2700 mm) COPPER GROUND ROD IN PULL BOX.

UNDERGROUND SERVICE

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 2005
 REV. 2009


ELECTRICAL SERVICE

STANDARD PLAN


401-1

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


SHEET 1 OF 2

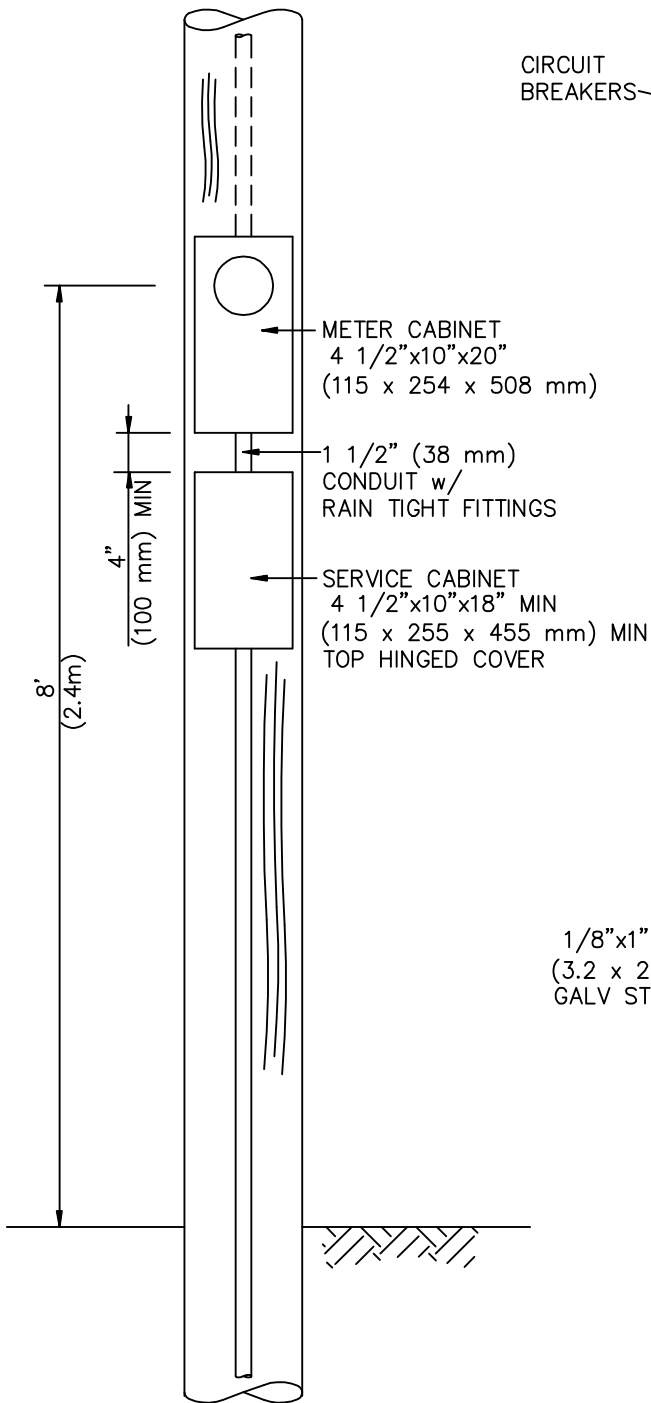


OVERHEAD SERVICE

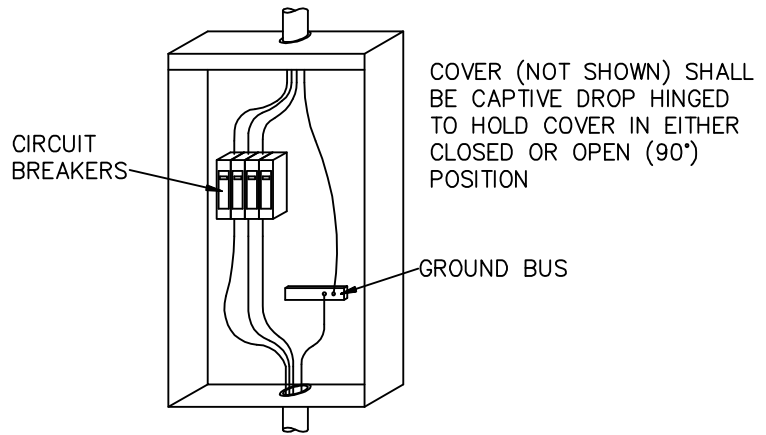

SERVICE CABINET
DETAIL

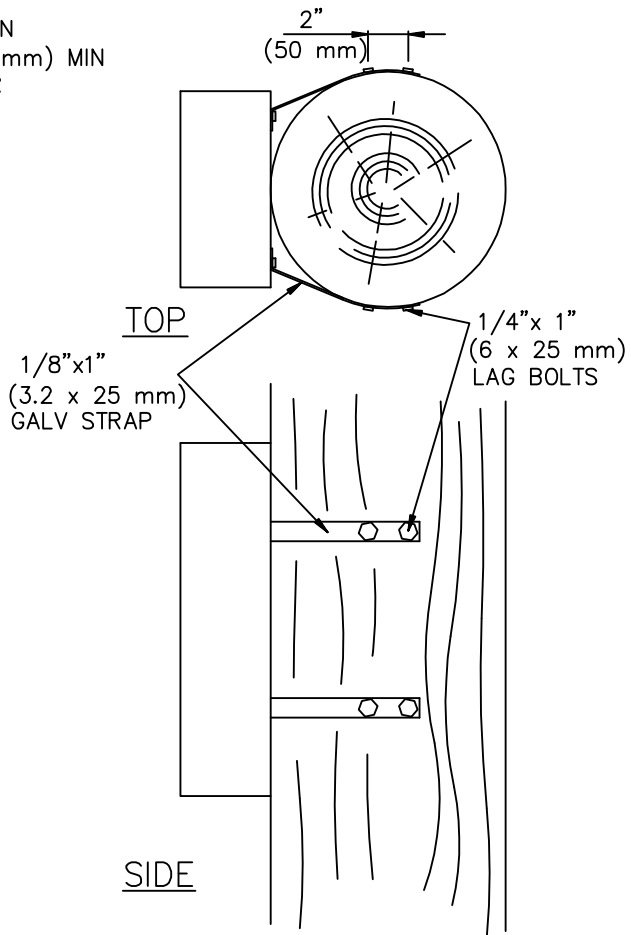

CABINET MOUNTING

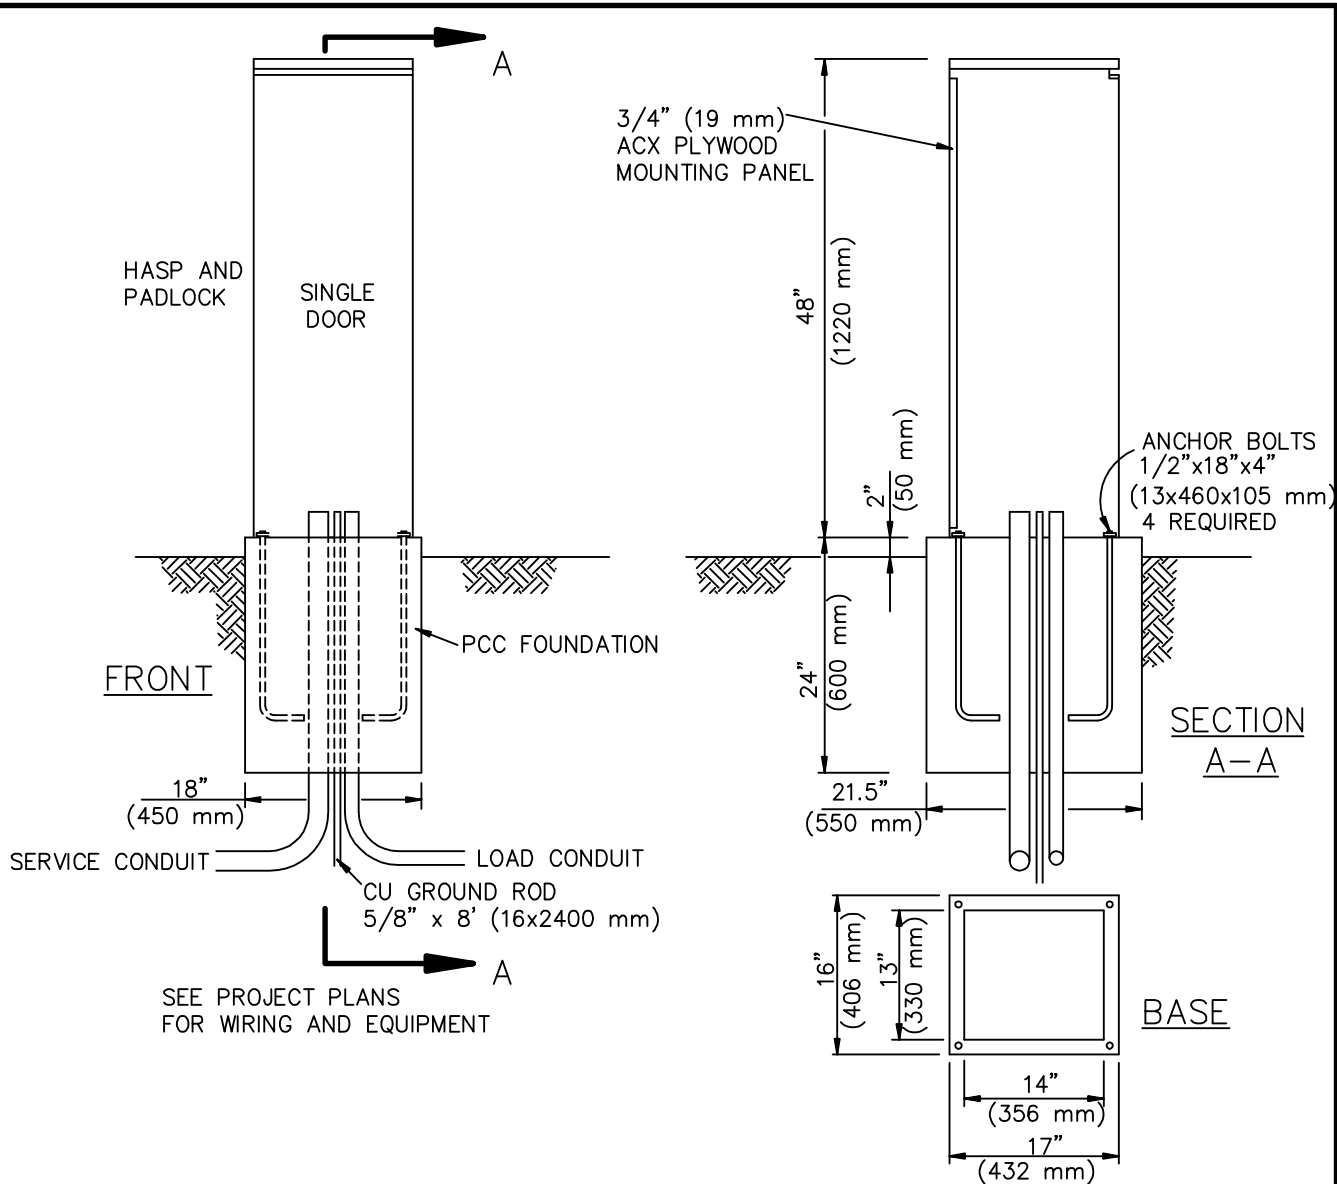

NOTES (ALL TYPES)

1. CABINET SHALL BE FABRICATED FROM 1/8" (3.2 mm) ALUMINUM SHEET, FACTORY WIRED, COMPLYING WITH NEMA 3R AND 12, RAIN AND DUST TIGHT, ELECTRICALLY WELDED AND REINFORCED.
2. NUTS, BOLTS, SCREWS AND HINGES SHALL BE STAINLESS STEEL.
3. NUTS, BOLTS AND SCREWS SHALL NOT BE VISIBLE FROM OUTSIDE ENCLOSURE.
4. PROVIDE PHENOLIC NAMEPLATE AS REQUIRED.
5. MARK CONTROL WIRING AT BOTH ENDS WITH PERMANENT WIRE MARKERS.
6. ATTACH PLASTIC-COVERED WIRING DIAGRAM TO INSIDE OF FRONT DOOR.
7. COATING SYSTEM PREPARATION PROCESS SHALL BE 5 STEP USING DIP TANK:
 - A. ALKALINE CLEANER, 70°C
 - B. CLEAR WATER RINSE
 - C. IRON PHOSPHATE APPLICATION, 65°C.
 - D. CLEAR WATER RINSE
 - E. INHIBITIVE RINSE TO SEAL PHOSPHATED SURFACES, 50°C.
8. FINISH WITH ELECTROSTATICALLY APPLIED DRY POLYESTER POWDER COATING. CURE AT 195°C. COLOR SHALL BE MINT GREEN.

TYPE 1

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009




SERVICE CABINET

STANDARD PLAN

403-1

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION




SHEET 1 OF 6

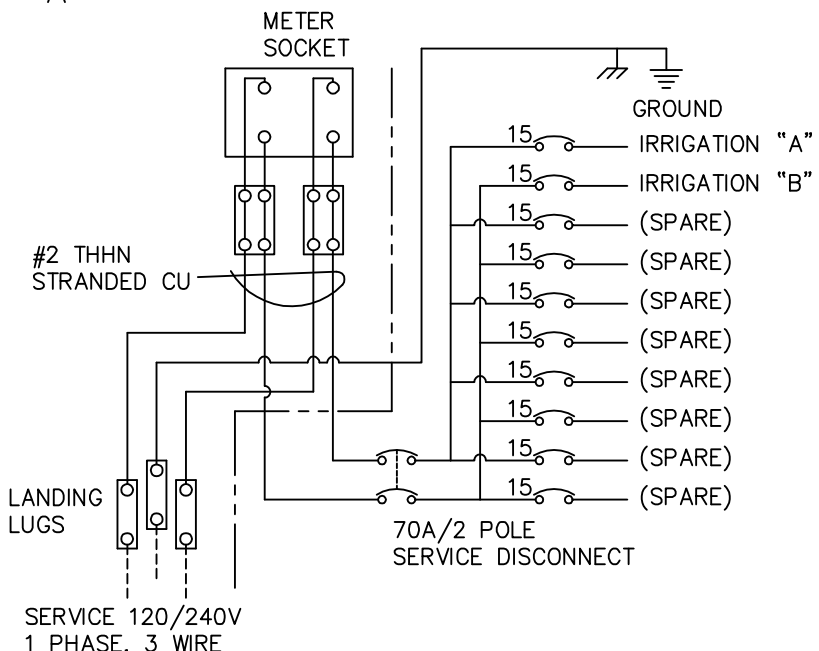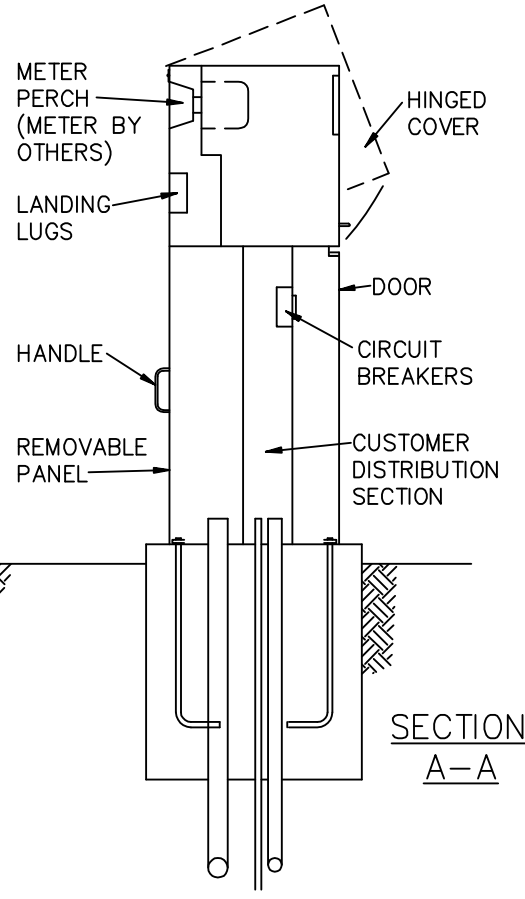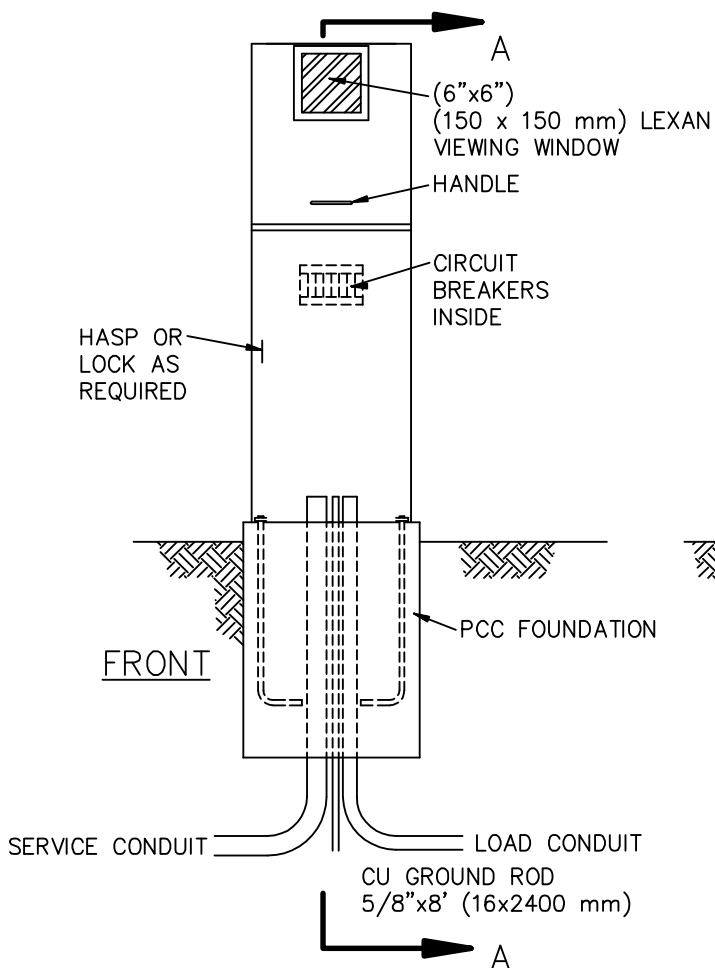




TYPE 2

SEE TYPE 1 FOR
NOTES AND DIMENSIONS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION	STANDARD PLAN
SERVICE CABINET	403-1
	SHEET 2 OF 6

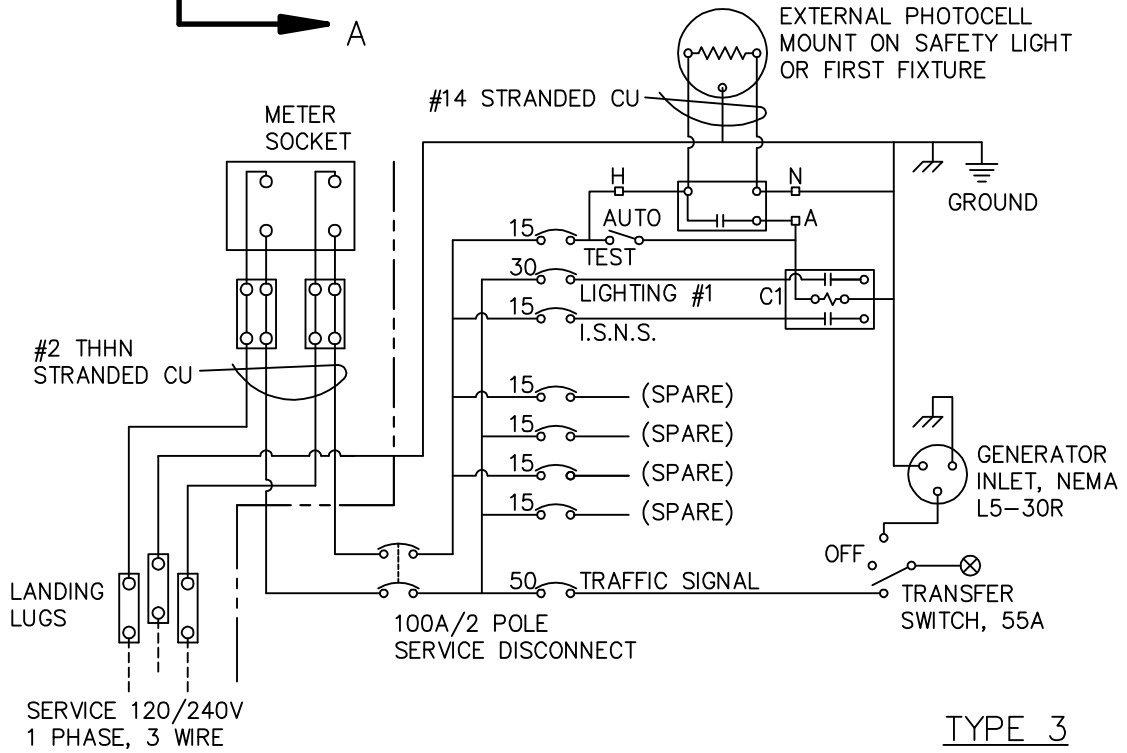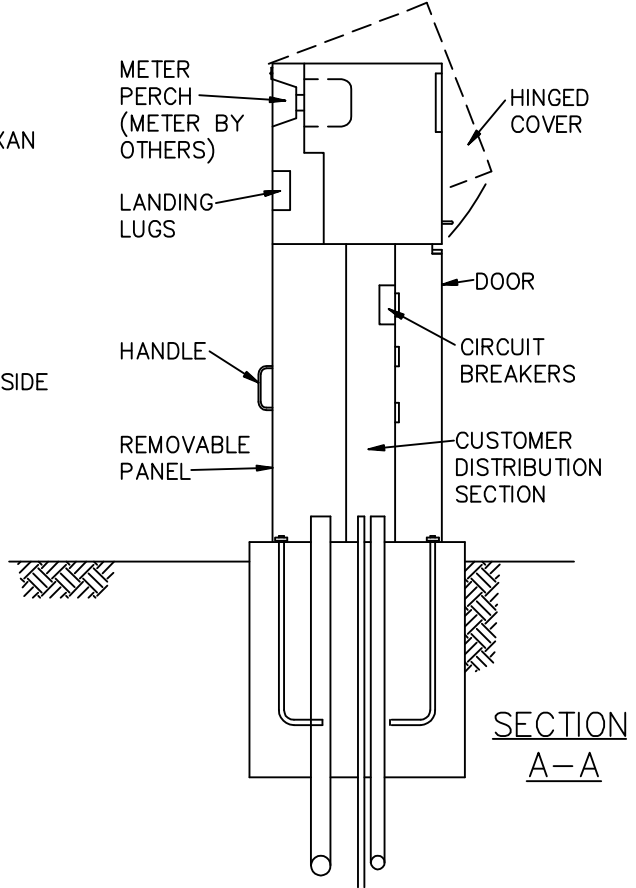
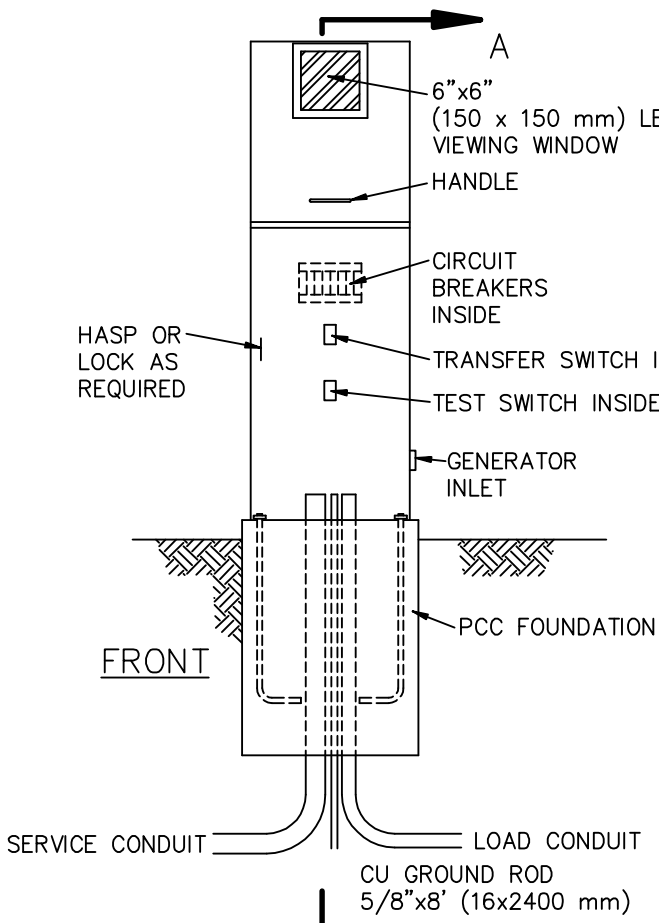


TYPE 3
SEE TYPE 1 FOR
NOTES AND DIMENSIONS

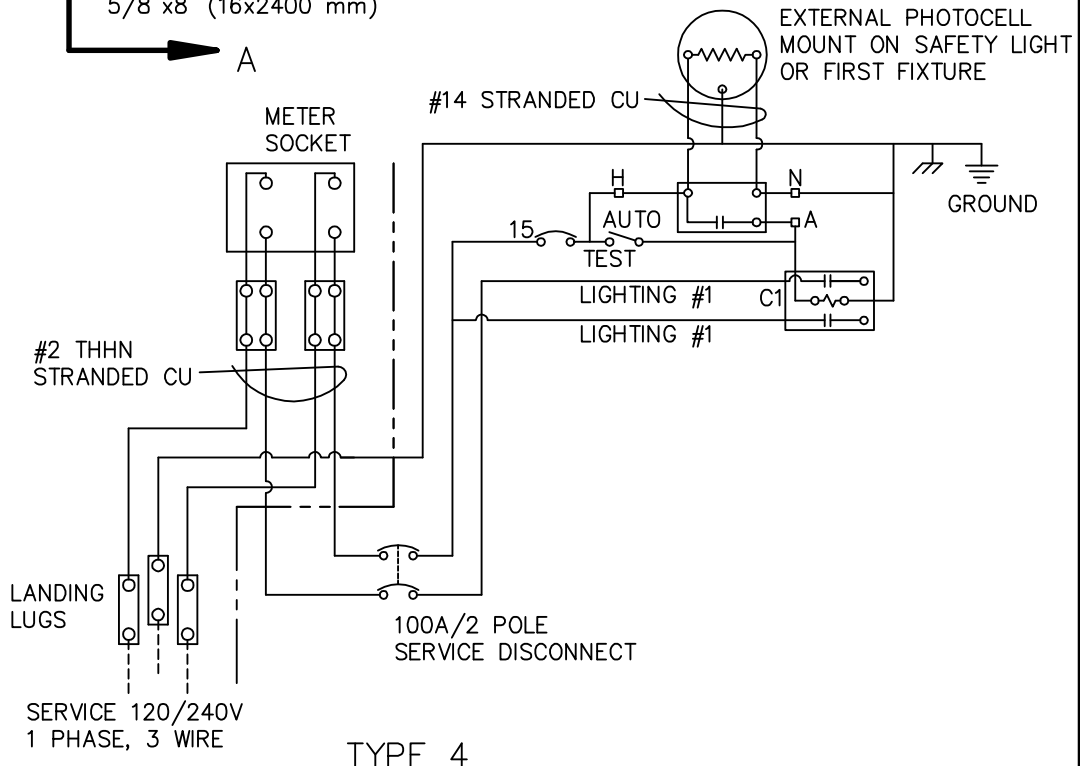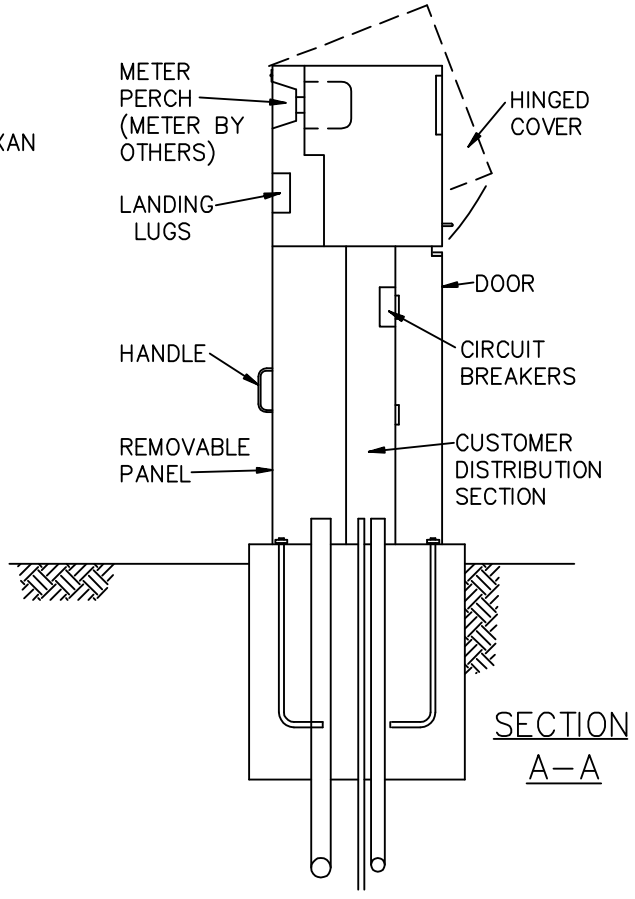
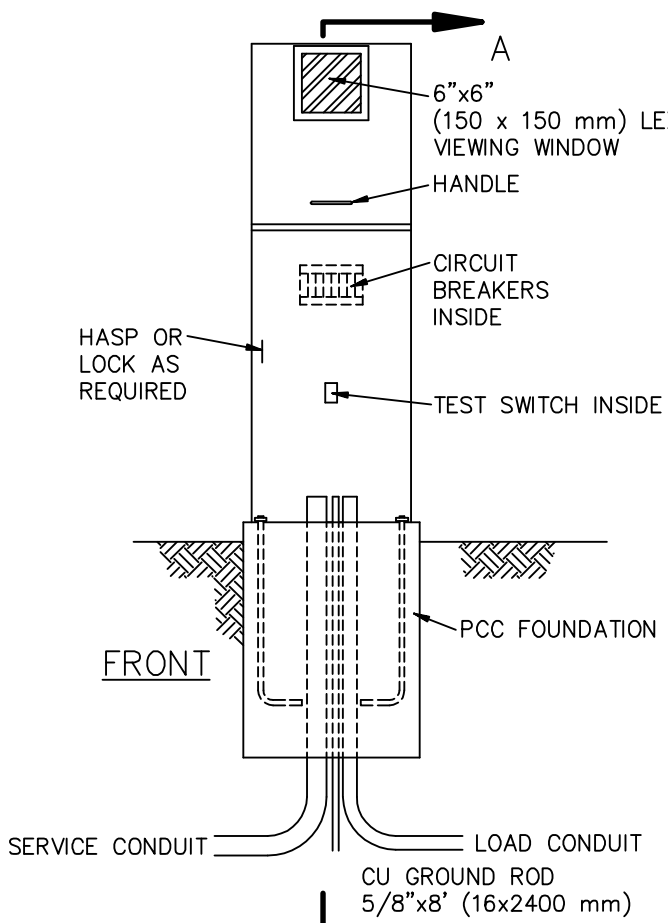


TYPE 4
SEE TYPE 1 FOR NOTES AND DIMENSIONS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION	STANDARD PLAN
SERVICE CABINET	403-1
	SHEET 4 OF 6

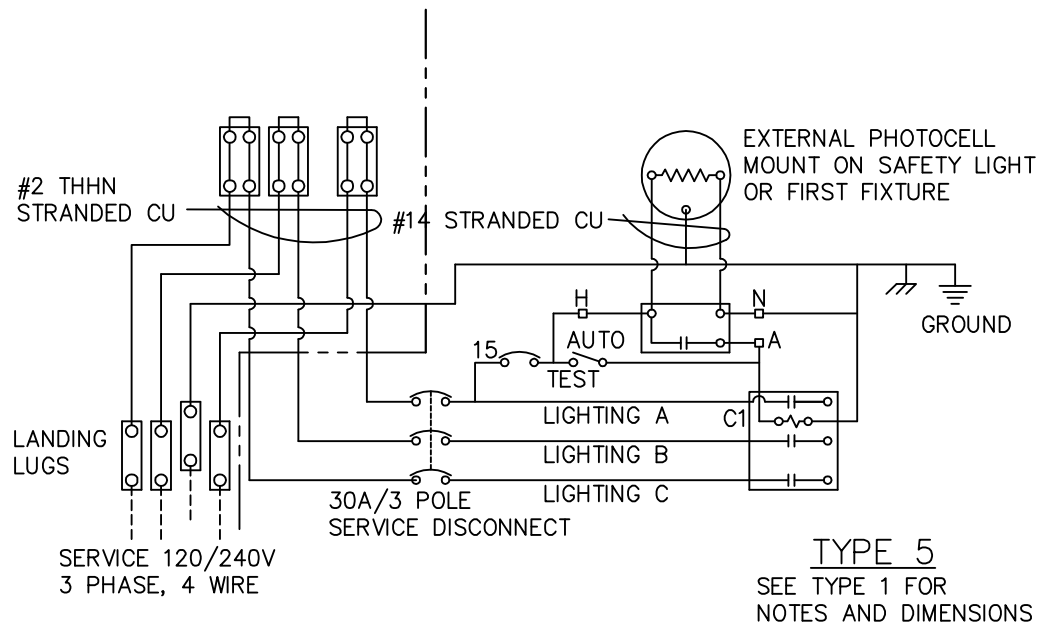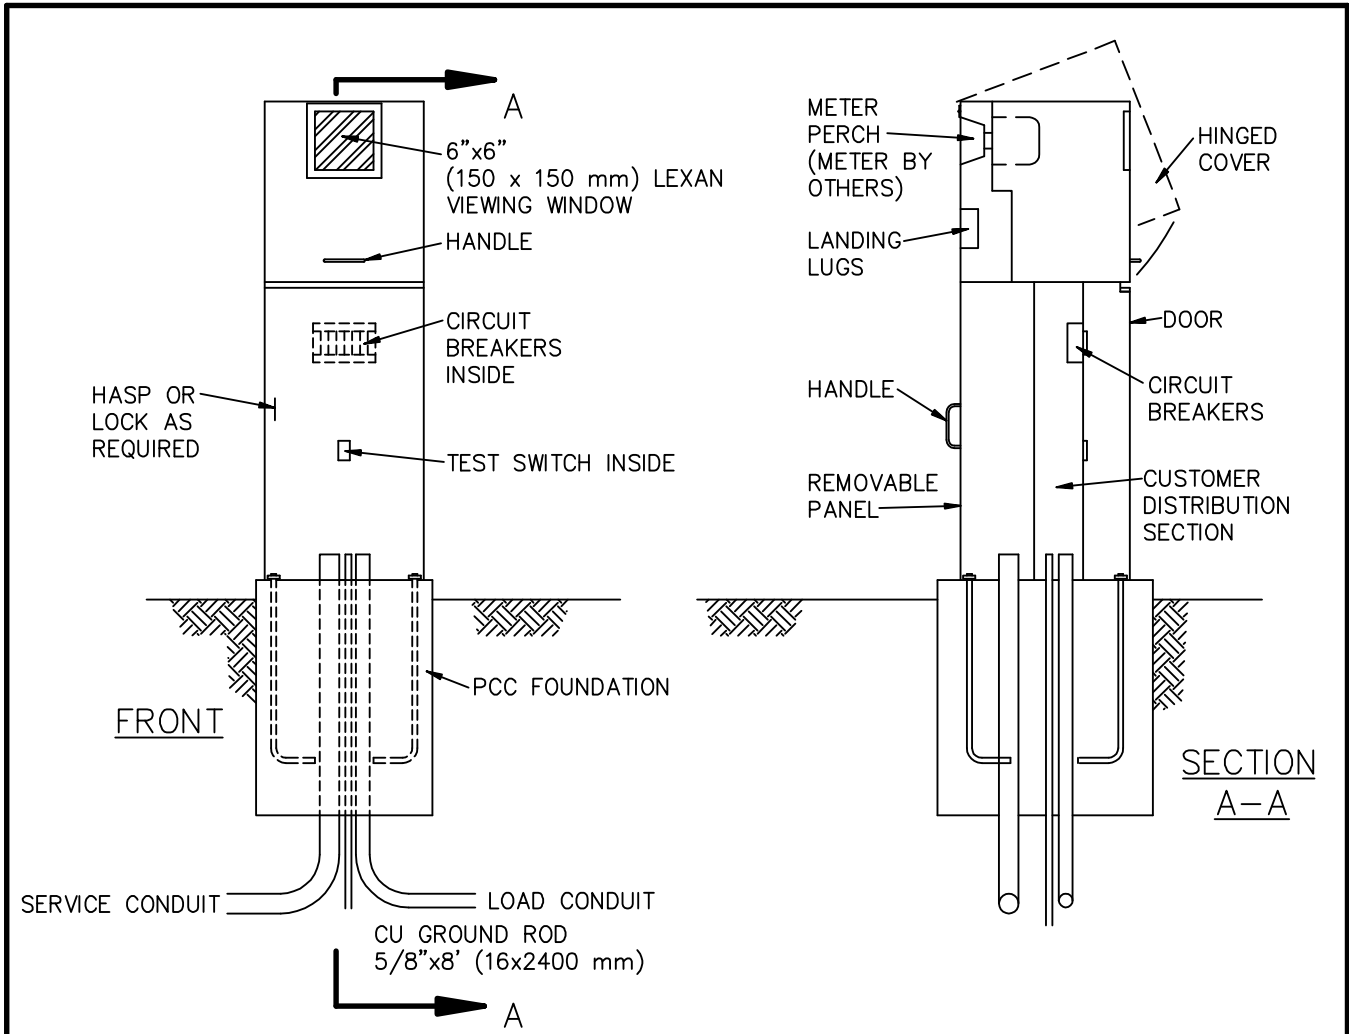


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION		STANDARD PLAN
SERVICE CABINET		403-1
		SHEET 5 OF 6

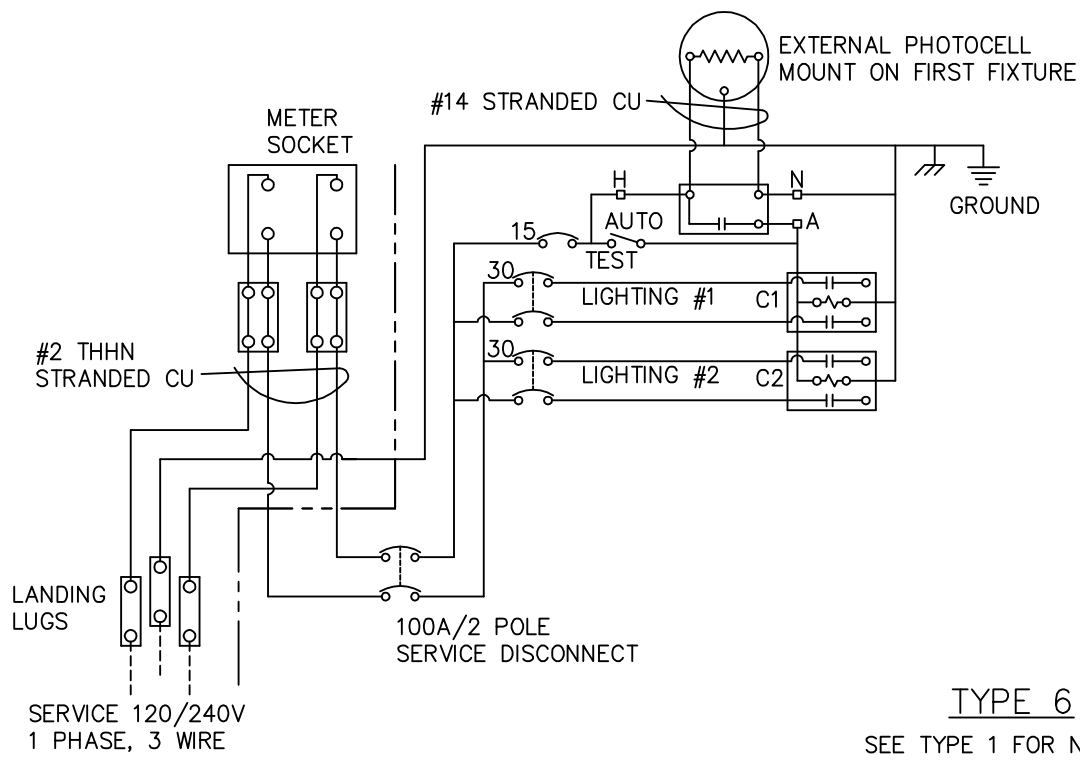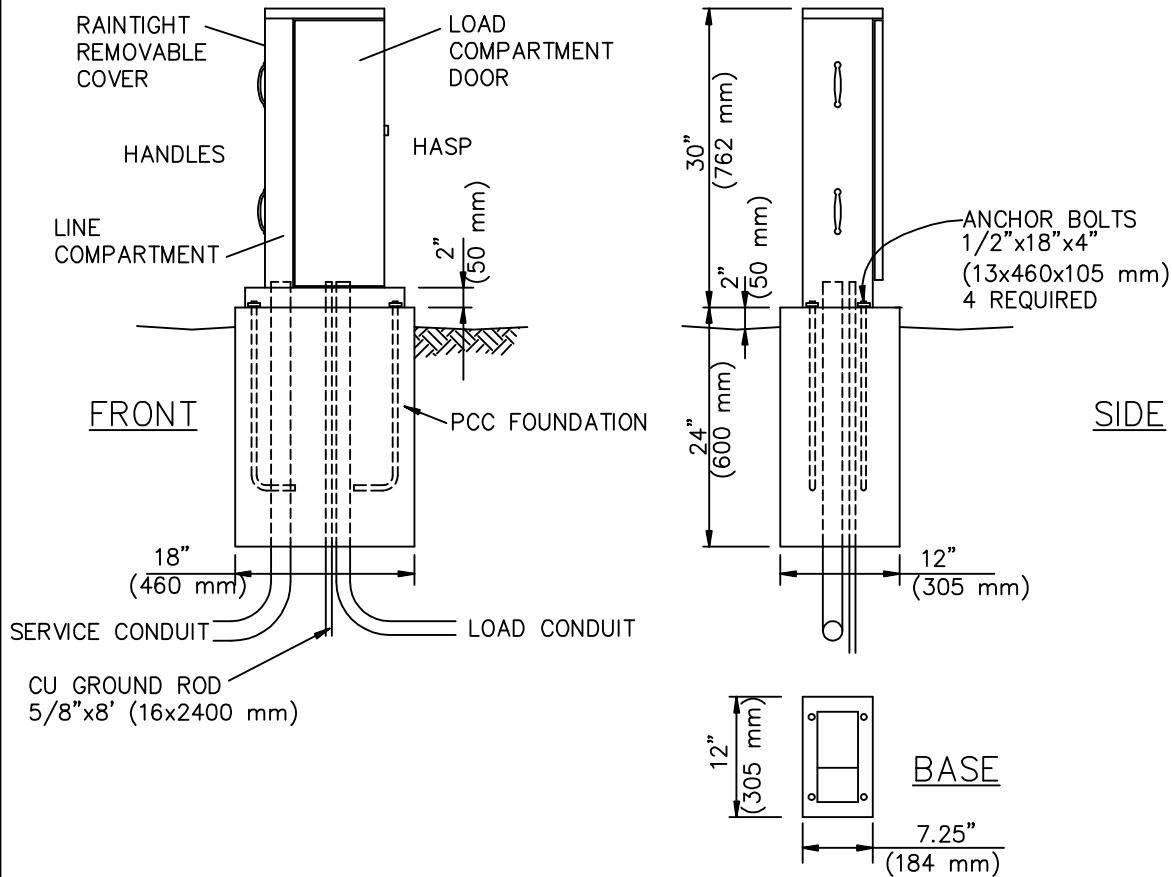

TYPE 6
SEE TYPE 1 FOR NOTES

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION	STANDARD PLAN
SERVICE CABINET	403-1
	SHEET 6 OF 6

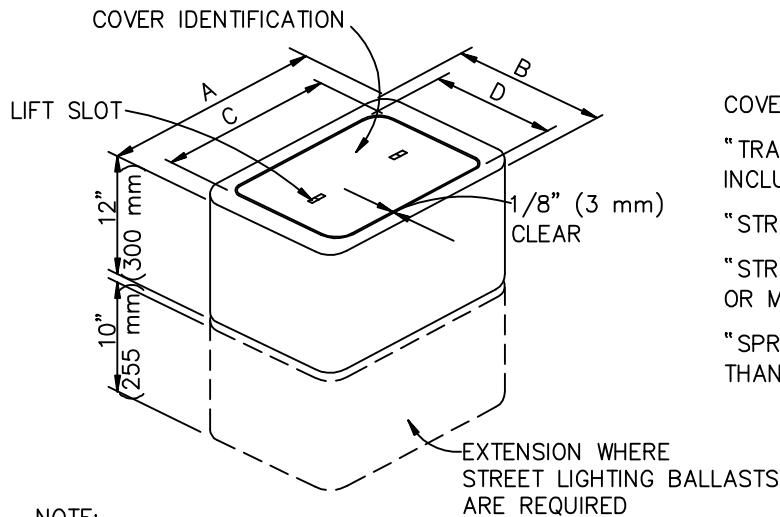

COVER IDENTIFICATION:

"TRAFFIC SIGNAL" – TRAFFIC SIGNAL CIRCUITS, INCLUDING THOSE WITH STREET OR SIGN LIGHTING.

"STREET LIGHTING" – CIRCUITS LESS THAN 600V.

"STREET LIGHTING-HIGH VOLTAGE" – 600V OR MORE.


"SPRINKLER CONTROL" – CIRCUITS LESS THAN 50V.

NOTE:

BOXES SHALL BE PCC AND COVERS SHALL BE NON-BOLTDOWN TYPE UNLESS OTHERWISE NOTED.

PULL BOX NO.	TYPE	DIMENSIONS (mm)			
		OUTSIDE		COVER	
		A	B	C	D
3 1/2	PCC	19" (485)	13" (330)	15" (380)	10" (255)
5	PCC	25" (635)	15" (380)	21 3/4" (550)	11 3/4" (300)
6	PCC	34" (865)	22" (560)	29 3/4" (755)	17 3/4" (450)
3 1/2	PLASTIC	16 3/8" (415)	11" (280)	15 3/8" (390)	10" (255)
5	PLASTIC	24" (610)	14 11/16" (375)	23" (584)	13 11/16" (350)
6	PLASTIC	31 1/2" (800)	18 5/8" (475)	30 1/2" (775)	17 3/4" (450)

PCC APRON, 3" (75 mm) THICK AROUND PULL BOX. OMIT IF PULL BOX CONSTRUCTED WITHIN SIDEWALK

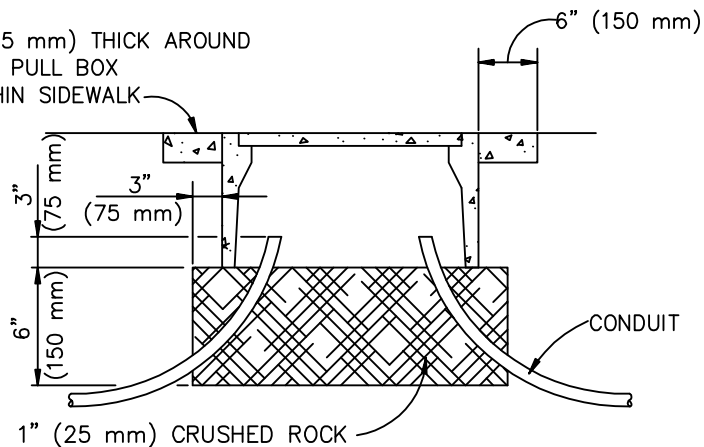

STREET LIGHT PULL BOX INSTALLATION

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009


PULL BOXES

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION



STANDARD PLAN

405-1

SHEET 1 OF 2

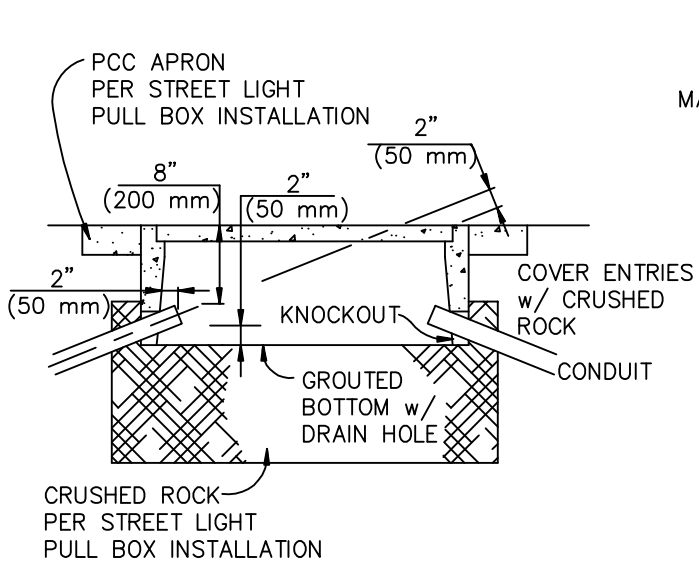


TRAFFIC SIGNAL
PULL BOX INSTALLATION

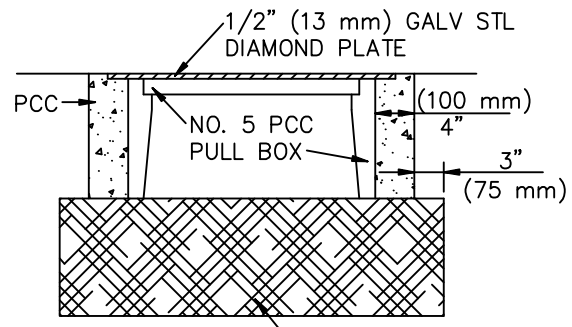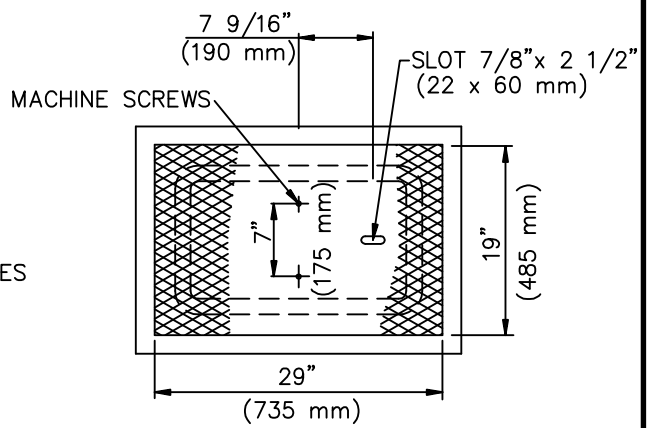


ATTACH STL PLATE TO PCC COVER WITH 2 BRASS MACHINE SCREWS, 1/4" (6 mm) 20 NC-2 FLAT HEAD, IN 1 1/4" (32 mm) HOLES w/ EXPANSION SHIELDS


STEEL COVER INSTALLATION

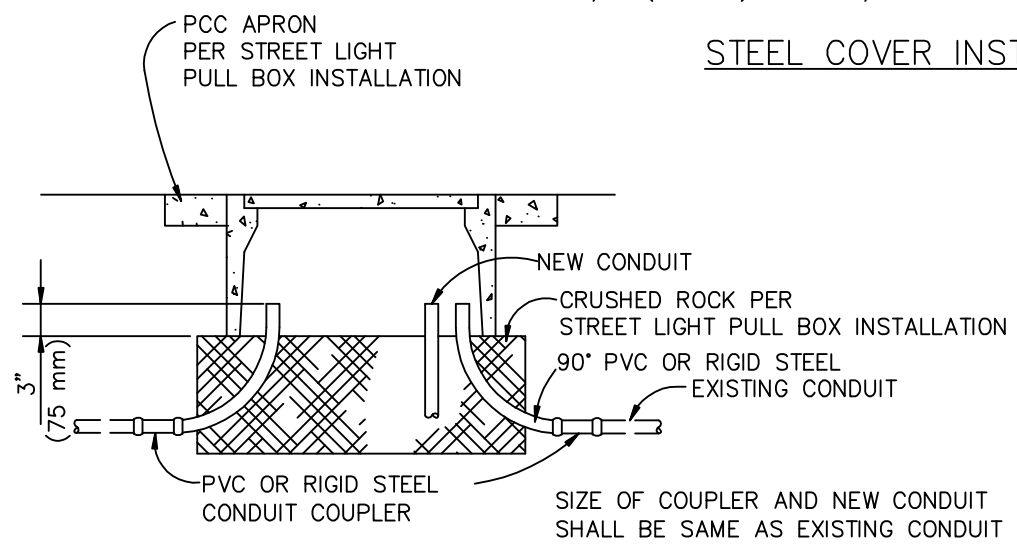

STREET LIGHT CONDUIT INTERCEPT

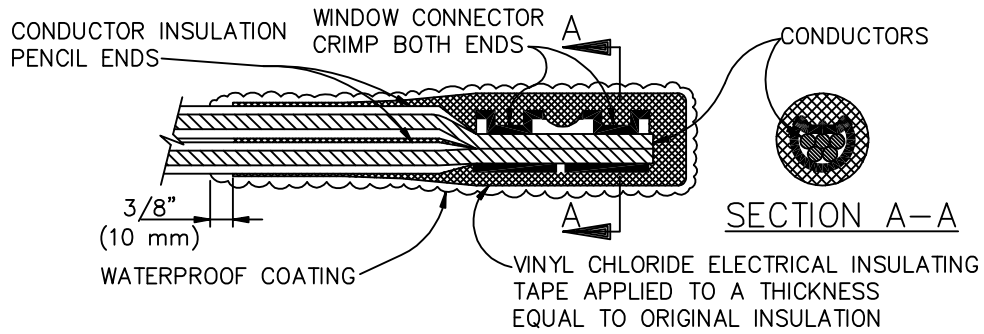

MULTIPLE CONDUCTOR TYPE
(MULTIPLE CIRCUITS)

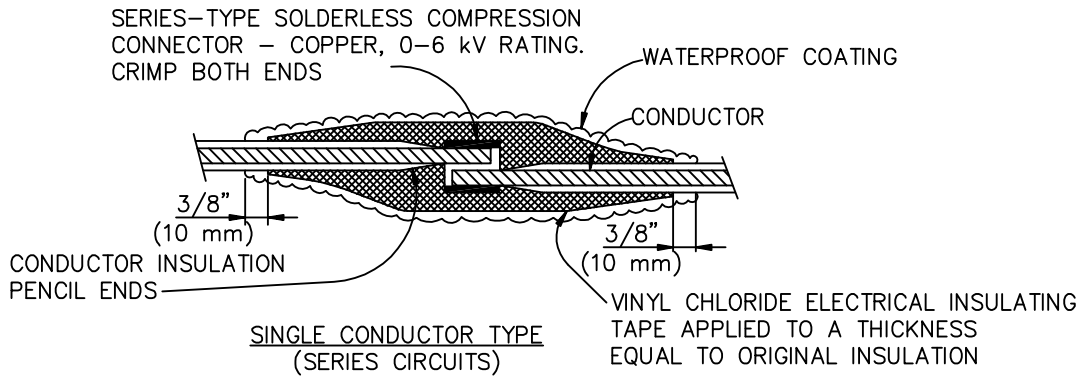


SINGLE CONDUCTOR TYPE
(SERIES CIRCUITS)

STREET LIGHTING WINDOW SPLICE CONNECTORS

NOTES:

1. WATERPROOF COATING SHALL BE SUBJECT TO ENGINEER'S APPROVAL.
2. WIRE NUTS SHALL NOT BE USED FOR STREET LIGHTING SPLICES.

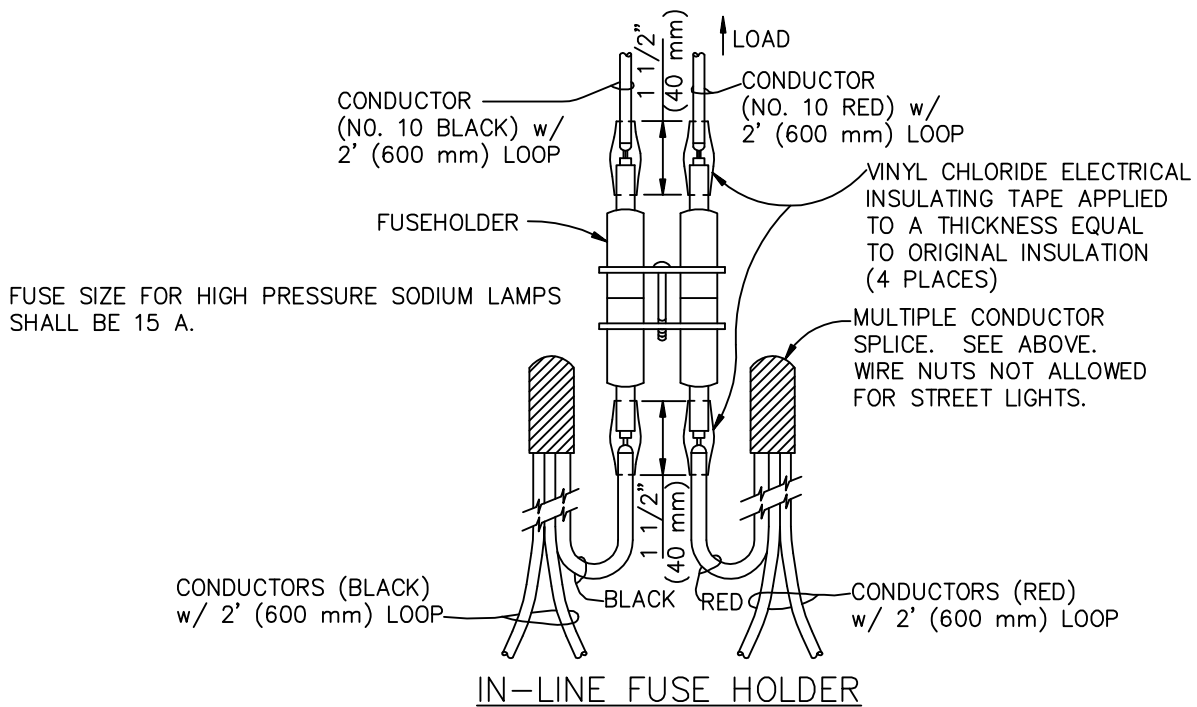

FUSE SIZE FOR HIGH PRESSURE SODIUM LAMPS SHALL BE 15 A.

IN-LINE FUSE HOLDER

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009


WIRING SERVICE DETAILS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION



STANDARD PLAN

408-1

SHEET 1 OF 2

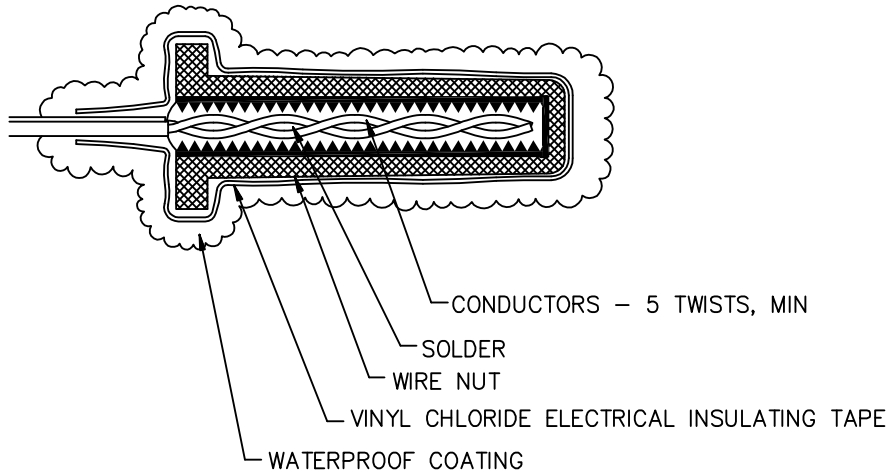

TRAFFIC SIGNAL CONDUCTOR SPLICE

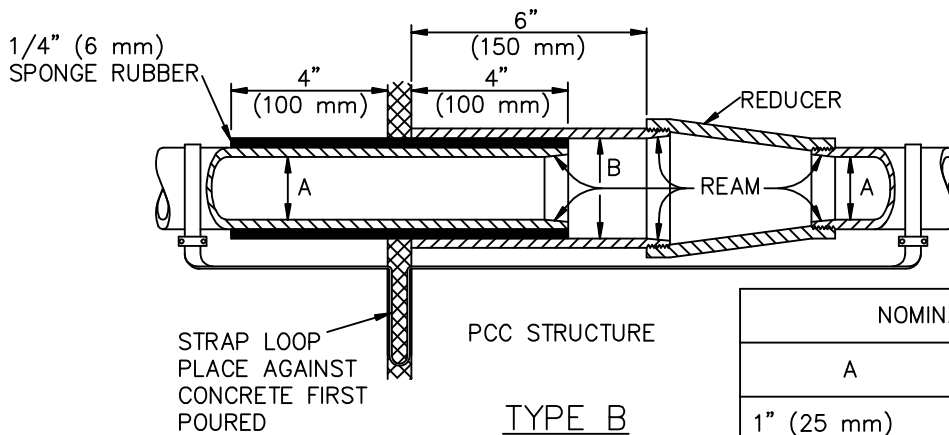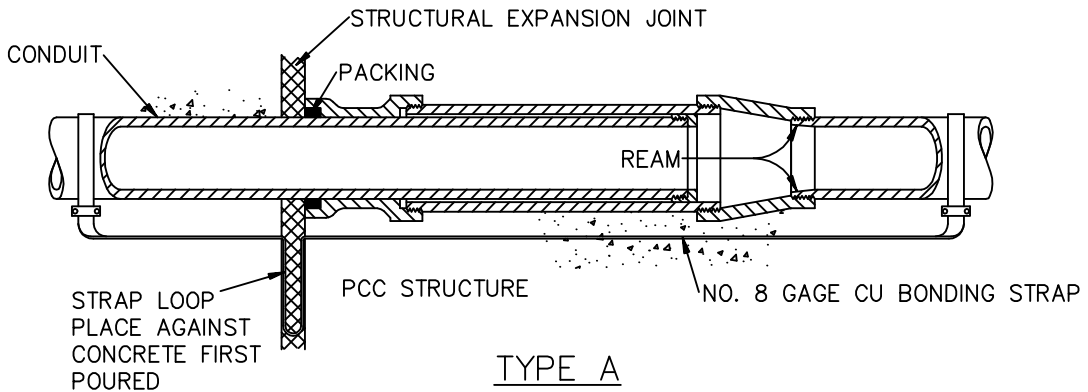

NOMINAL SIZES	
A	B
1" (25 mm)	2" (50 mm)
1 1/2" (40 mm)	2 1/2" (65 mm)
2 1/2" (65 mm)	3 1/2" (90 mm)

CONDUIT EXPANSION ASSEMBLY

SECOND ARM
WHEN SPECIFIED

ARM LENGTH
PER SHEET 2

2.375" (60 mm)
PIPE (O.D.)

RISE
PER SHEET 2

6"
(150 mm)

SIMPLEX ATTACHMENT
w/ 1/2"x3/4"
(13x19 mm) BOLT

11 GA (3.04 mm)
GALV STEEL

SECTION THRU SHAFT

11 1/2" (242 mm)
SQUARE

R=1.5" (38 mm)

1" (25 mm) THICK
STL PLATE

R=11/16" (17 mm)

8 1/8"
(206 mm) SQUARE

9.5" TO 11.5"
(241 TO 292 mm) BOLT CIRCLE

H PER SHEET 2

3/16" (5 mm)

HANDHOLE 4"x6 1/2"
(100 x 165 mm) MIN
SEE NOTE 3

1/8" (3 mm)
3/16" (5 mm)

8" (200 mm)

BOLT COVER

4" (100 mm)
GROUT CAP

2" (50 mm) DRAIN HOLE

GALV STL ANCHOR BOLTS
36" x 4" x 1" DIA
(915 x 100 x 25 mm DIA)

HANDHOLE

36" (915 mm)
SEE NOTE 1

11.5" (292 mm)
UNLESS OTHERWISE SHOWN

32" (815 mm)
SQUARE

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009

STEEL LIGHTING STANDARD
TYPE 10

STANDARD PLAN

429-1

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 2

TYPE	H	SHAFT SIZE	MOUNTING HEIGHT	
			4' (1220 mm) ARM(S)	8' (2440 mm) ARM(S)
10-A	26'-0" (7920 mm)	3.8"x 7.5" (97 x 191 mm)	27'-0" (8200 mm)	28'-6" (8690 mm)
10-B	28'-0" (8530 mm)	3.8"x7.8" (97 x 198 mm)	29'-0" (8800 mm)	30'-6" (9300 mm)
10-C	30'-0" (9140 mm)	3.8"x8.0" (97 x 203 mm)	31'-0" (9400 mm)	32'-6" (9910 mm)

MAST ARM	RADIUS	RISE
4' (1220 mm)	4'8" (1420 mm)	18" (460 mm)
8' (2440 mm)	10'6" (3200 mm)	36" (915 mm)

NOTES:

1. FOR STANDARDS WITH TWO ARMS OR WITH 8' (2440 mm) ARMS, FOUNDATION SHALL BE 4' (1220 mm) DEEP WITH 1 1/8"x 40"x 4" (29 x 1020 x 102 mm) GALVANIZED STEEL ANCHOR BOLTS.
2. BOND ANCHOR BOLTS TO STEEL CONDUIT OR GROUND WIRE AS REQUIRED.
3. FURNISH HANDHOLE WITH ALUMINUM TAMPER-RESISTANT DOOR. INSTALL STANDARD SO THAT DOOR FACES AWAY FROM ONCOMING TRAFFIC.
4. POLE SHAFT SHALL BE CONSTRUCTED TO WITHSTAND LOADING AS SPECIFIED IN THE LATEST EDITION OF AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES, AND TRAFFIC SIGNALS. LOADING FROM LUMINAIRE ARM AND LUMINAIRE SHALL BE INCLUDED.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

**STEEL LIGHTING STANDARD
TYPE 10**

STANDARD PLAN

429-1

SHEET 2 OF 2

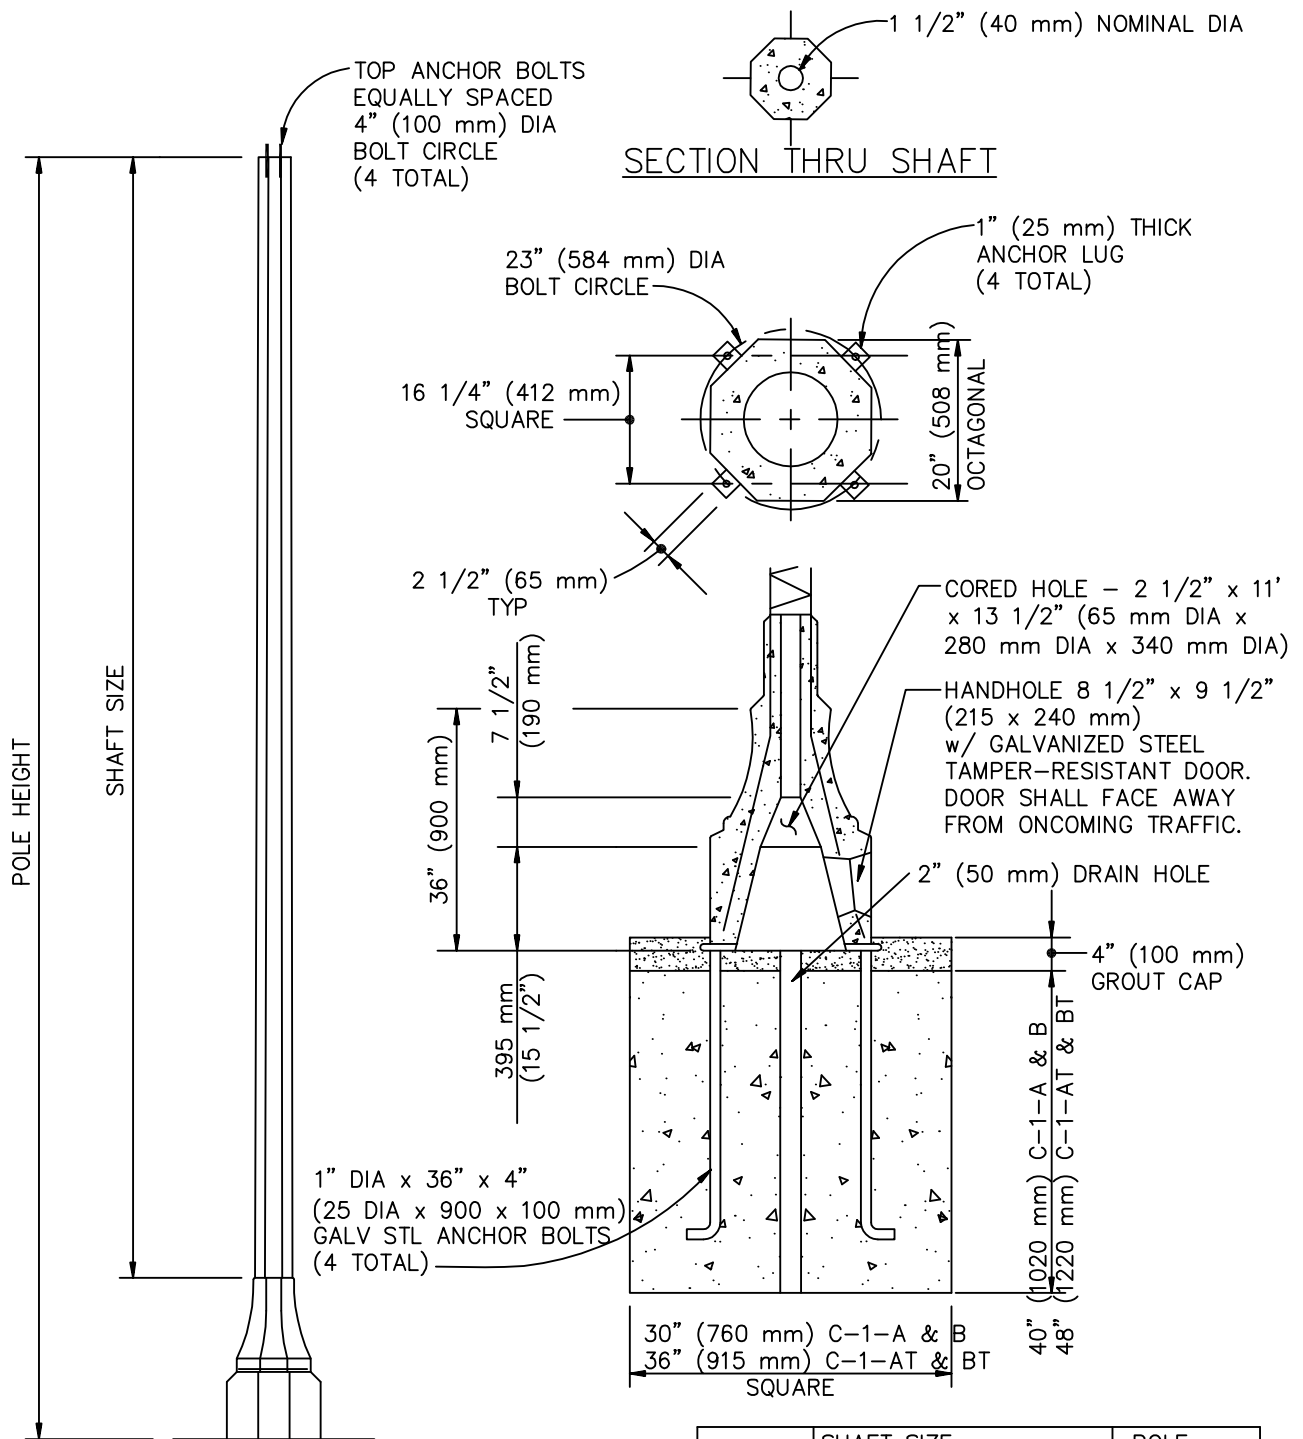

POLE SHAFT SHALL BE CONSTRUCTED TO WITHSTAND LOADING SPECIFIED IN THE LATEST EDITION OF AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES, AND TRAFFIC SIGNALS. LOADING FROM LUMINAIRE ARM AND LUMINAIRE SHALL BE INCLUDED.

TYPE	SHAFT SIZE OCTAGONAL ON FLATS	POLE HEIGHT
C-1-A	8 1/2" x 6" x 23'-3" (215 x 150 x 7,085 mm)	26'-3" (8,000 mm)
C-1-B	9" x 6" x 28'-3" (230 x 150 x 8,610 mm)	31'-3" (9,525 mm)
C-1-AT	SAME AS ABOVE, EXCEPT EQUIPPED	
C-1-BT	w/ TRAFFIC SIGNAL MAST ARM	

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009


**CONCRETE LIGHTING STANDARD
TYPE C-1**

STANDARD PLAN

430-1

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 1

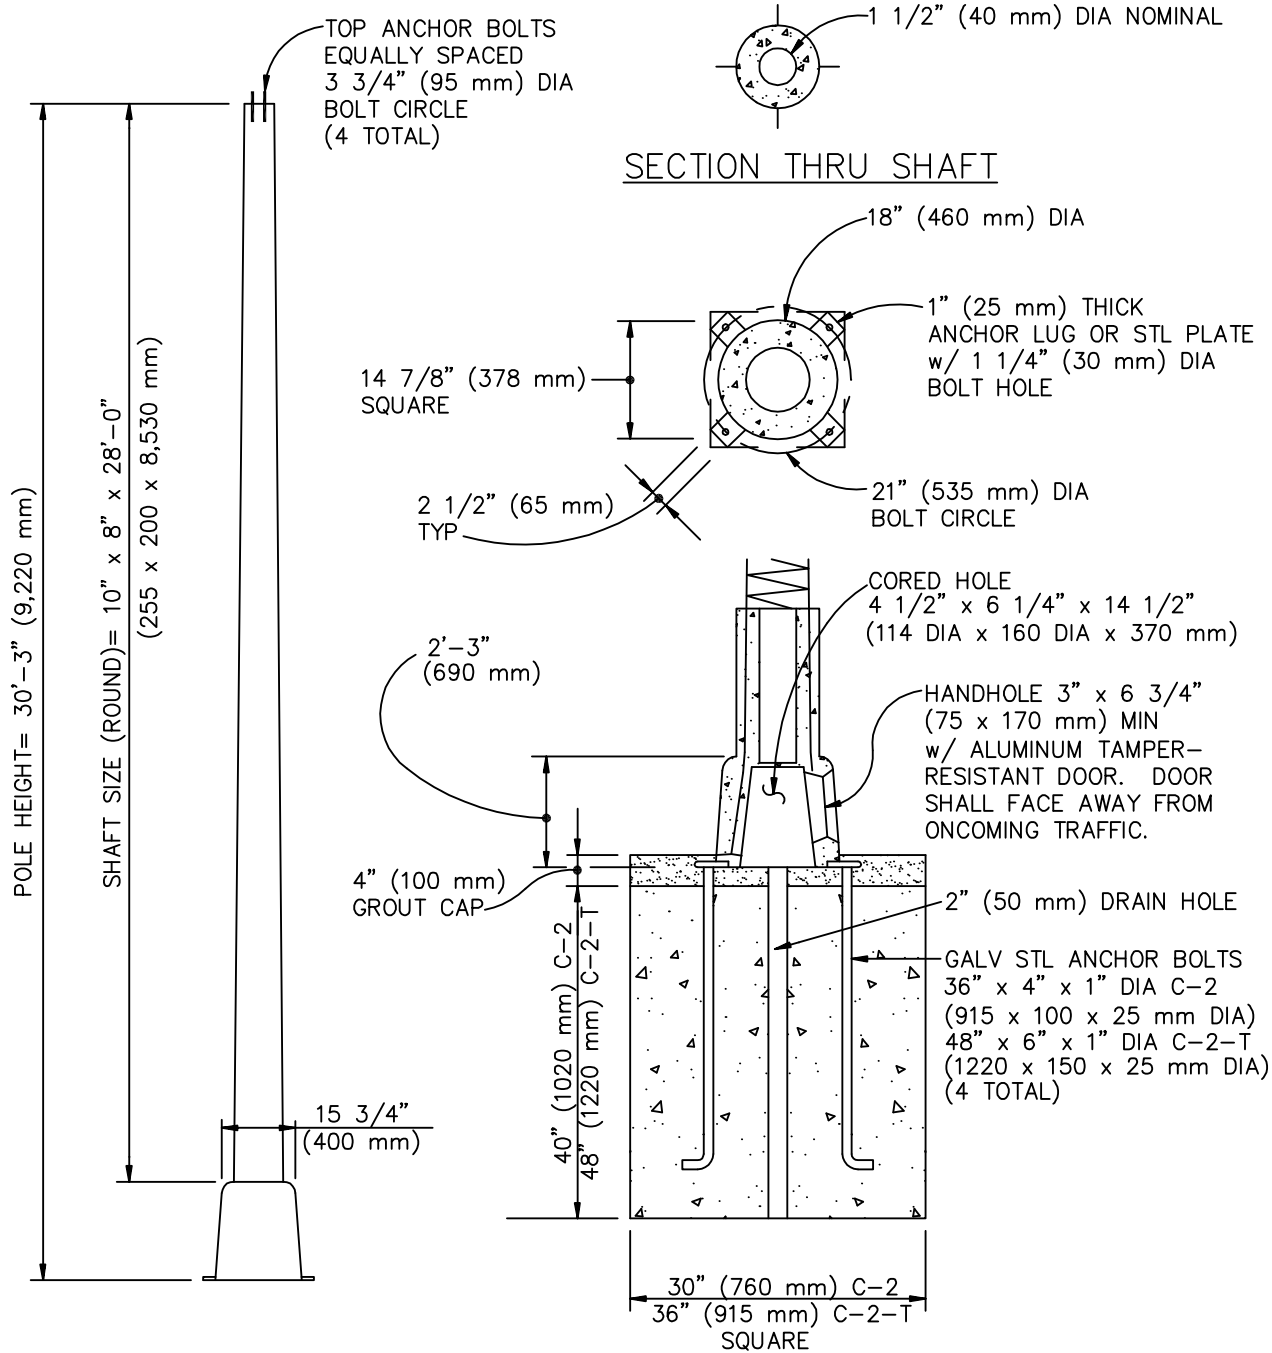

TYPE C-2-T IS THE SAME AS TYPE C-2, EXCEPT EQUIPPED WITH TRAFFIC SIGNAL MAST ARM AND SIGNAL.

POLE SHAFT SHALL BE CONSTRUCTED TO WITHSTAND LOADING AS SPECIFIED IN THE LATEST EDITION OF AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES, AND TRAFFIC SIGNALS. LOADING FROM LUMINAIRE ARM AND LUMINAIRE SHALL BE INCLUDED.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009


**CONCRETE LIGHTING STANDARD
TYPE C-2**

STANDARD PLAN

431-1

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 1

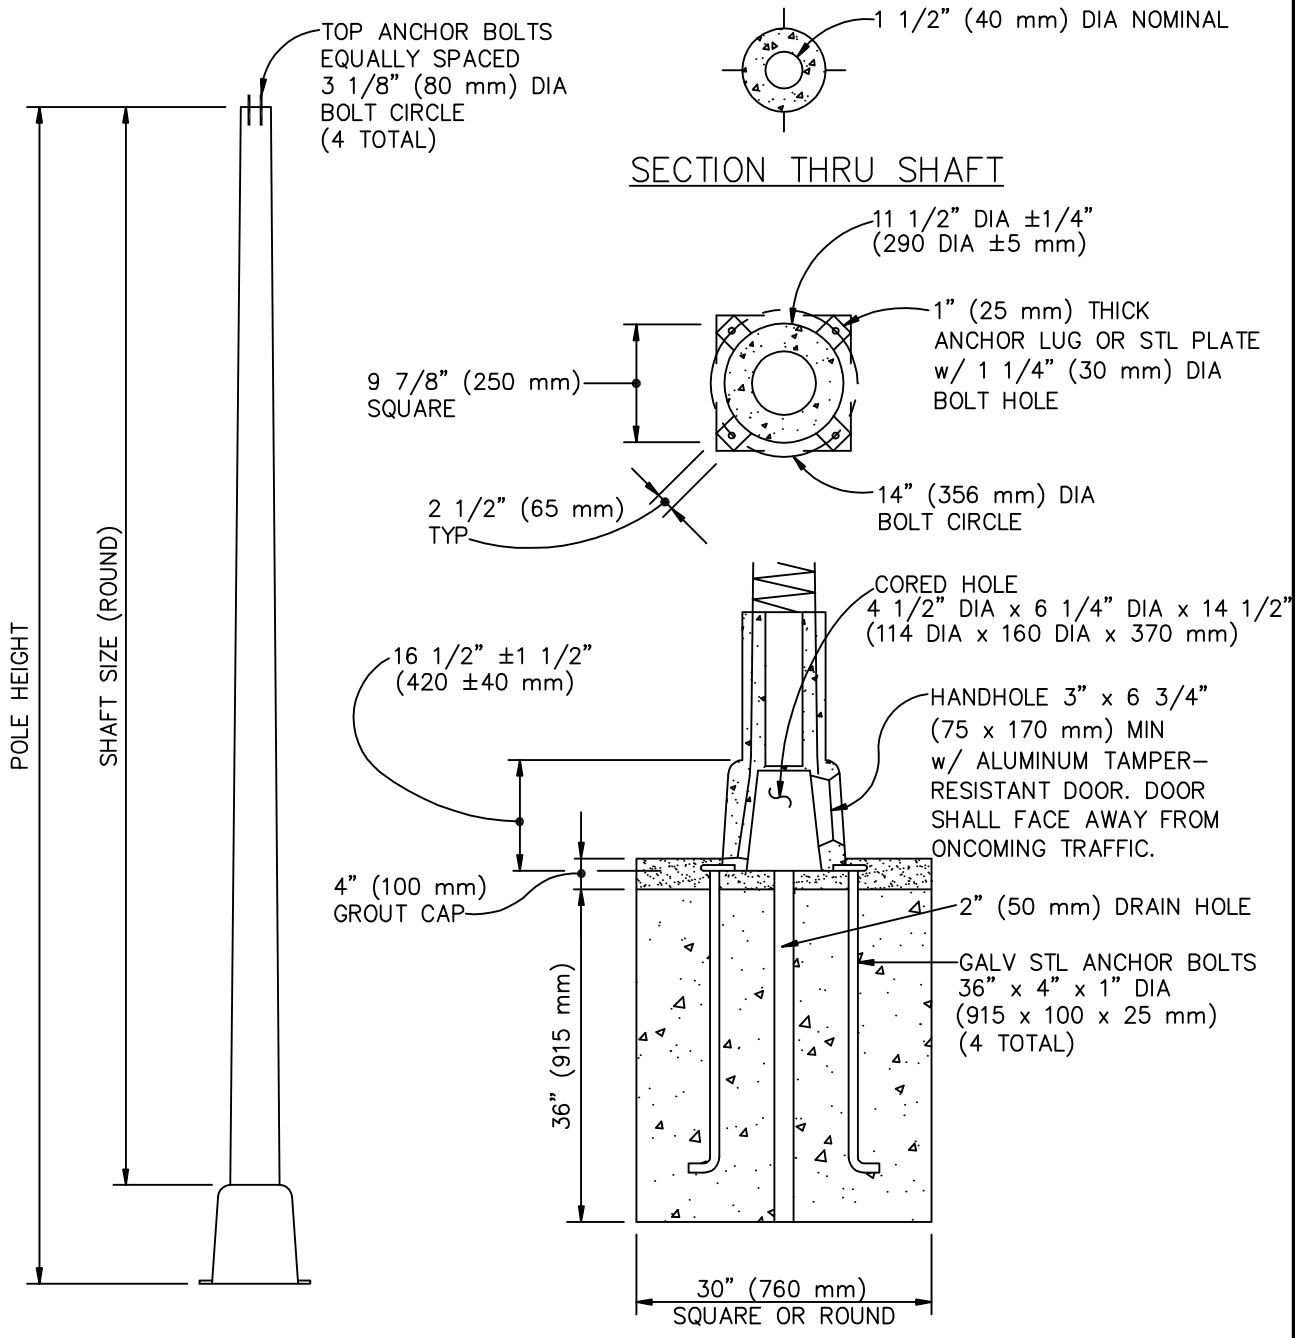

POLE SHAFT SHALL BE CONSTRUCTED TO WITHSTAND LOADING SPECIFIED IN THE LATEST EDITION OF AASHTO STANDARD SPECIFICATION FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS. LOADING FROM LUMINAIRE ARM AND LUMINAIRE SHALL BE INCLUDED.

TYPE	SHAFT SIZE	POLE HEIGHT
C-4-A	8 1/4" x 5" x 23'-1" (210 x 125 x 7,030 mm)	24'-7" (7,490 mm)
C-4-B	8 1/2" x 5" x 25'-1" (220 x 125 x 7,640 mm)	26'-7" (8,100 mm)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009


**CONCRETE LIGHTING STANDARD
TYPE C-4**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

432-1

SHEET 1 OF 1

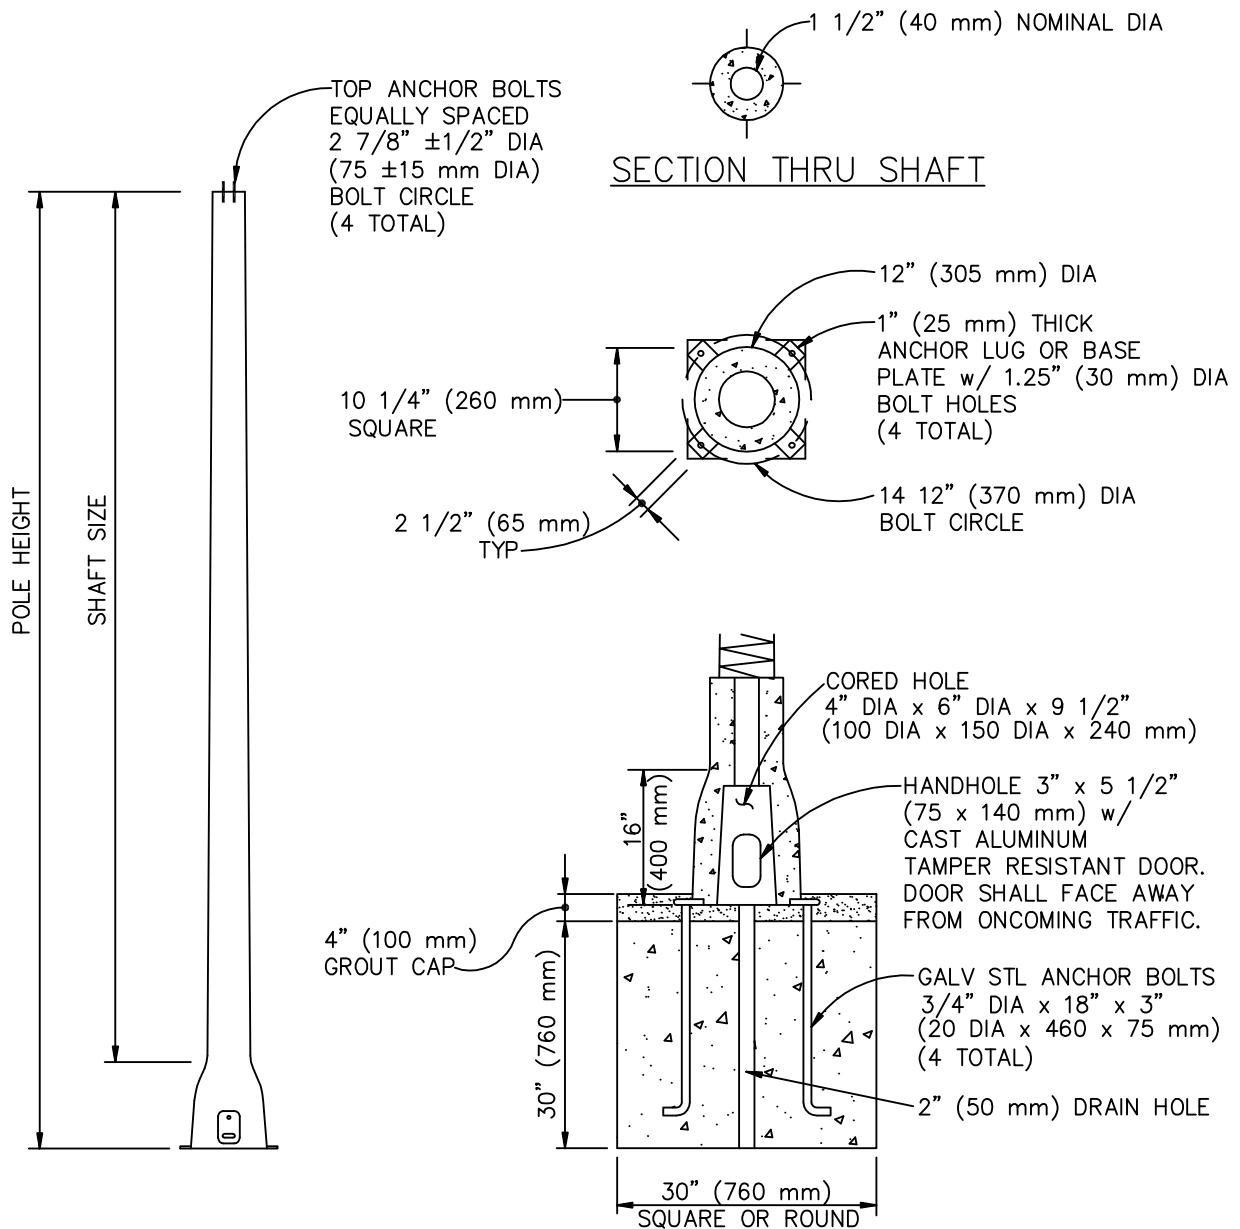

POLE SHAFT SHALL BE CONSTRUCTED TO WITHSTAND LOADING SPECIFIED IN THE LATEST EDITION OF AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES, AND TRAFFIC SIGNALS. LOADING RESULTING FROM LUMINAIRE ARM AND LUMINAIRE SHALL BE INCLUDED.

TYPE	SHAFT SIZE	POLE HEIGHT
C-6-A	6 1/2" x 5 1/4" x 8'-10 1/2" (165 x 135 x 2,710 mm)	10'-2 1/2" (3,110 mm)
C-6-B	6 1/2" x 5" x 10'-10 1/2" (165 x 125 x 3,320 mm)	12'-2 1/2" (3,720 mm)
C-6-C	6 1/2" x 4 5/8" x 13'-1 1/2" (165 x 120 x 4,000 mm)	14'-5 1/2" (4,410 mm)
C-6-D	6 1/2" x 5" x 14'-1 3/8" (165 x 125 x 4,300 mm)	15'-7 7/8" (4,770 mm)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009






**CONCRETE LIGHTING STANDARD
TYPE C-6**

STANDARD PLAN

433-1

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 1

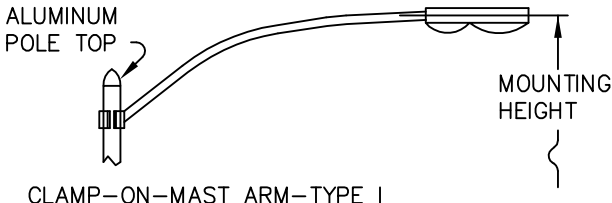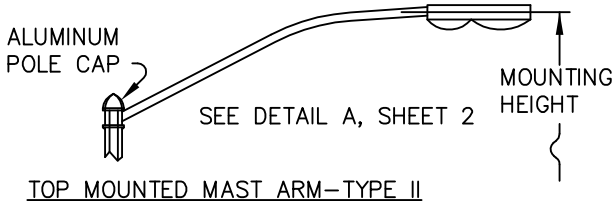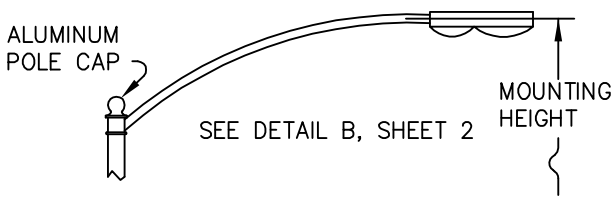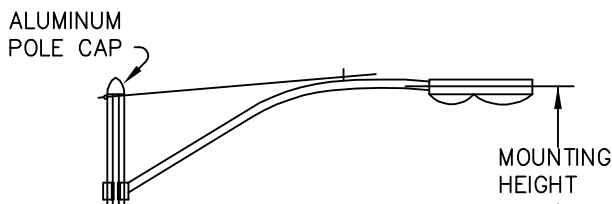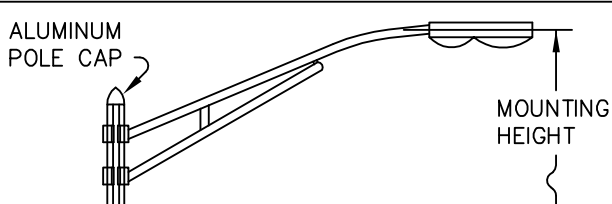MAST ARM TYPE	LIGHT STANDARD	POLE HEIGHT	MAST ARM LENGTH	
			MOUNTING HEIGHT ±6" (±150 mm)	
 <p>ALUMINUM POLE TOP</p> <p>CLAMP-ON-MAST ARM-TYPE I</p>	TYPE A TYPE B, C & D	26'-3" (8,000 mm) 31'-3" (9,525 mm)	6'-0" (1,800 mm)	8'-0" (2,400 mm)
			27'-6" (8,375 mm)	28'-3" (8,600 mm)
 <p>ALUMINUM POLE CAP</p> <p>SEE DETAIL A, SHEET 2</p> <p>TOP MOUNTED MAST ARM-TYPE II</p>	TYPE A TYPE B, C & D	26'-3" (8,000 mm) 31'-3" (9,525 mm)	6'-0" (1,800 mm)	8'-0" (2,400 mm)
			29'-0" (8,850 mm)	29'-9" (9,075 mm)
 <p>ALUMINUM POLE CAP</p> <p>SEE DETAIL B, SHEET 2</p> <p>TOP MOUNTED MAST ARM-TYPE III</p>	TYPE F TYPE H	24'-7" (7,500 mm) 28'-0" (8,535 mm)	4'-0" (1,200 mm)	6'-0" (1,800 mm)
			26'-6" (8,075 mm)	27'-3" (8,300 mm)
 <p>ALUMINUM POLE CAP</p> <p>CLAMP-ON WITH TIE-ROD-TYPE IV</p>	TYPE A TYPE B, C & D	26'-3" (8,000 mm) 31'-3" (9,525 mm)	10'-0" (3,000 mm)	12'-0" (3,600 mm)
			25'-10" 7,875 mm	26'-7" (8,100 mm)
 <p>ALUMINUM POLE CAP</p> <p>CLAMP-ON TRUSS-TYPE V</p>	TYPE C & D	31'-3" (9,525 mm)	10'-0" (3,000 mm)	12'-0" (3,600 mm)
			35'-9" (10,900 mm)	39'-0" (11,875 mm)

NOTE:

ELECTROLIERS SHALL BE DESIGNATED BY LIGHT STANDARD TYPE, MAST ARM TYPE AND MAST ARM LENGTH, I.E. A-II-8.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009


STREET LIGHTING DETAILS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

434-1


SHEET 1 OF 2

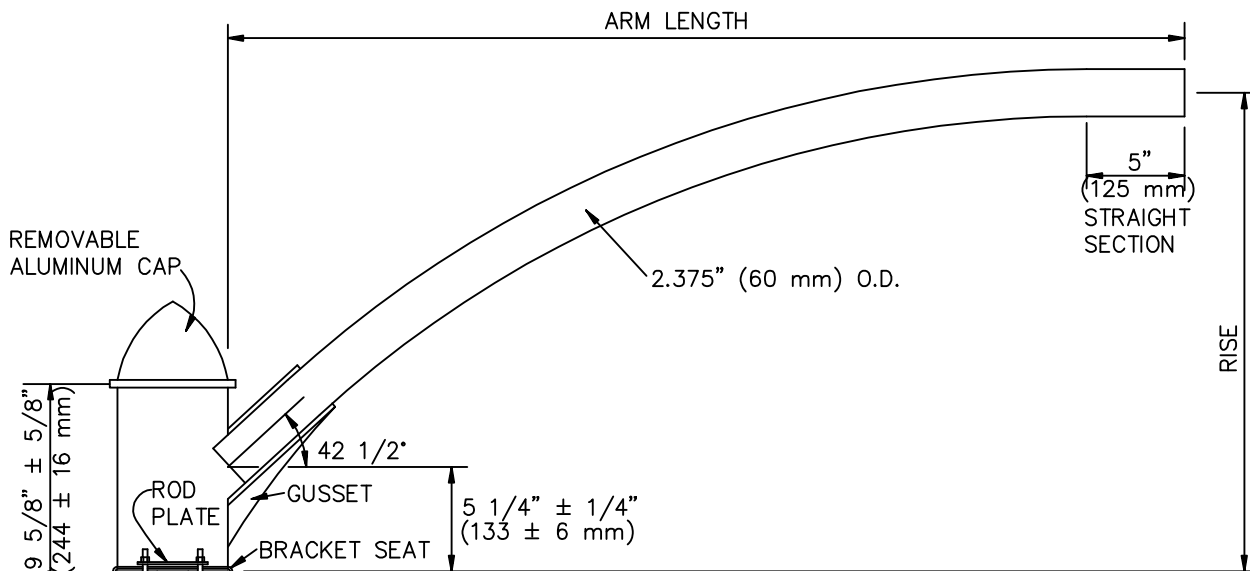

DETAIL A


ARM LENGTH	RISE
4' (1220 mm)	24" (610 mm)
6' (1830 mm)	32" (815 mm)
8' (2440 mm)	42" (1070 mm)

DIMENSIONS SAME FOR
DETAIL A AND B
EXCEPT AS SHOWN

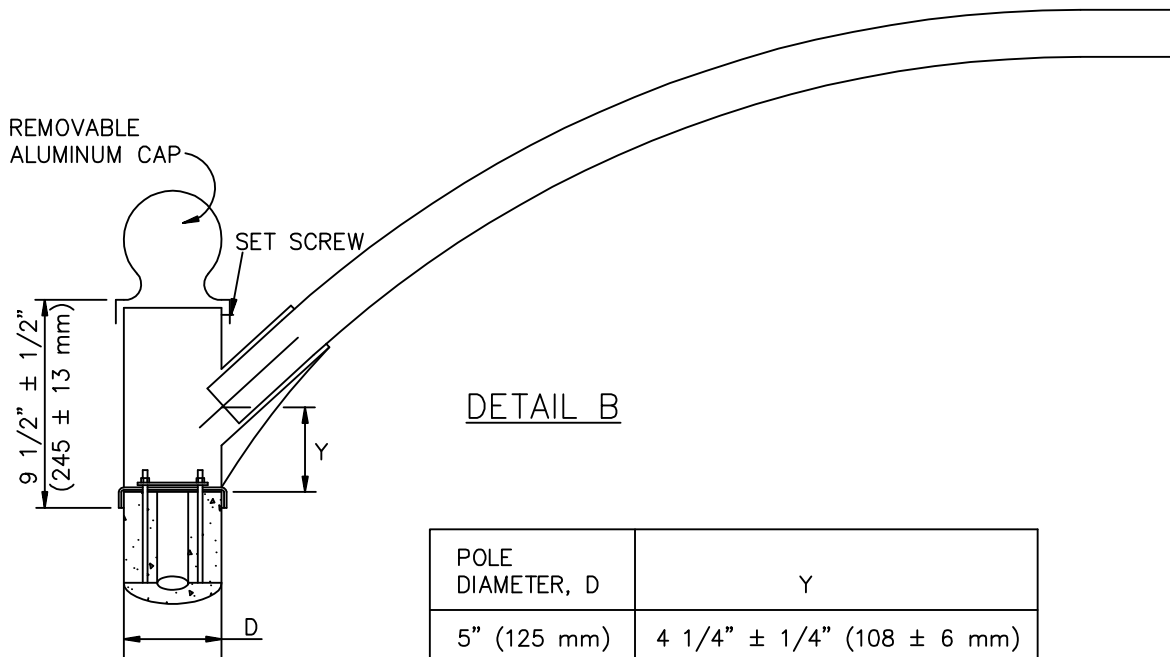


DETAIL B

POLE DIAMETER, D	Y
5" (125 mm)	4 1/4" ± 1/4" (108 ± 6 mm)
6" (150 mm)	6" ± 1/4" (152 ± 6 mm)

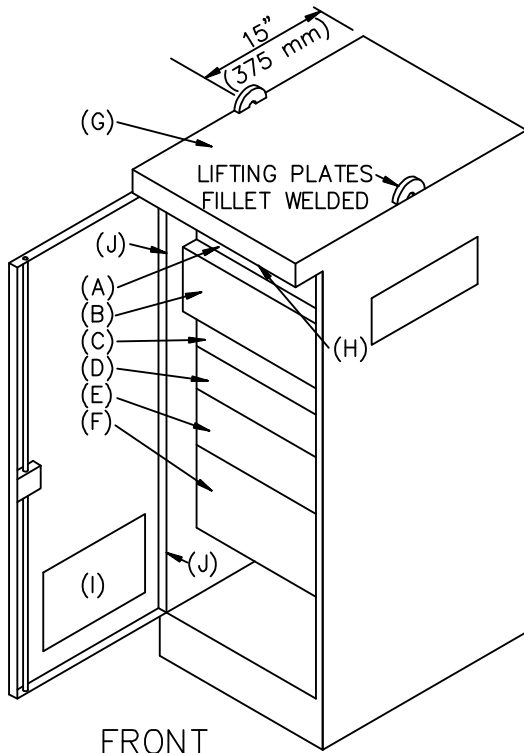





FRONT

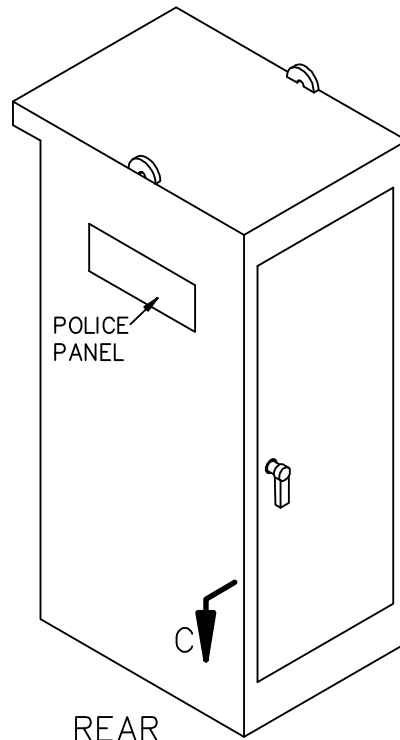

REAR

- (A) POWER SUPPLY
- (B) CONTROLLER UNIT
- (C) INPUT FILE # I
- (D) INPUT FILE # J
- (E) POWER DISTR ASS'Y
- (F) OUTPUT FILE
- (G) FAN AREA
- (H) FAN EXHAUST VENT
- (I) VENT LOUVERS
- (J) HINGES

SEE CABINET NOTES, SHEET 2

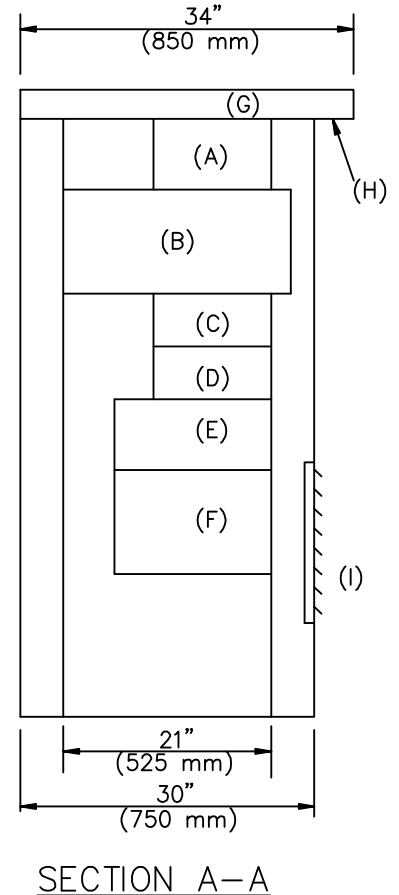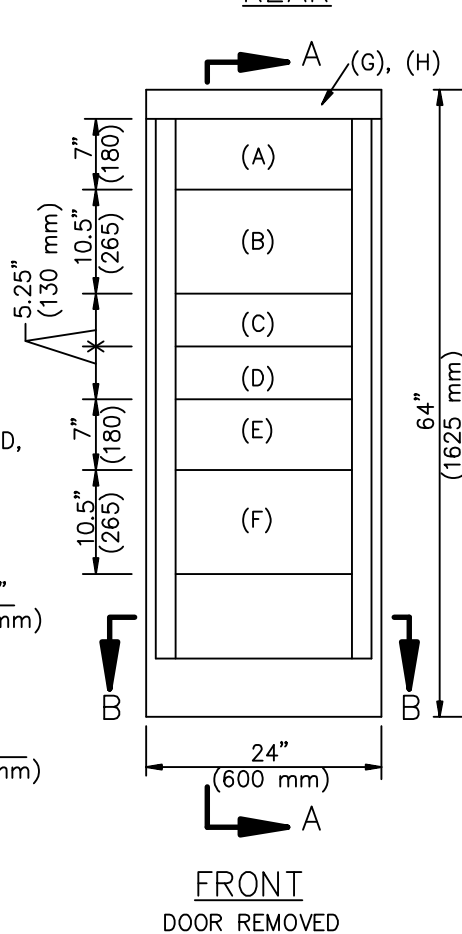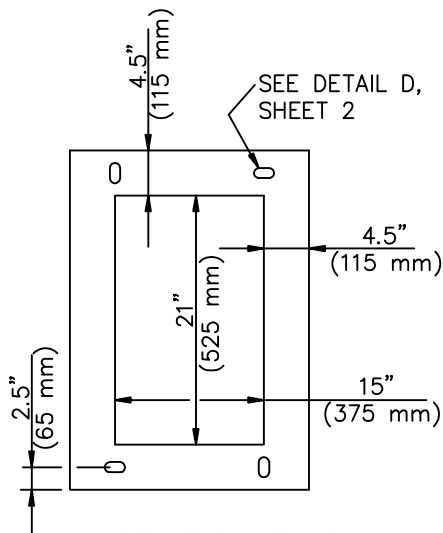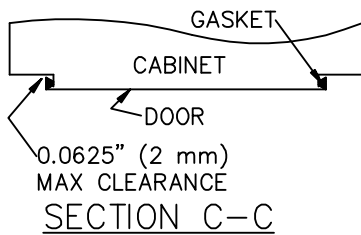

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009


CONTROLLER CABINET TYPE 170

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

452-1


SHEET 1 OF 2




DETAIL D

CABINET NOTES:


1. FAN EXHAUST VENT: SCREENED, VANDAL RESISTANT, 36 SQ IN (0.023 m²) MIN OPENING.
2. VENTILATION LOUVERS SHALL HAVE METAL AIR FILTERS AND 36 SQ IN (0.023 m²) MIN OPENING.
3. HINGES SHALL BE STAINLESS STEEL BUTT-TYPE OR SHALL BE CONTINUOUS.
4. SECTION (A), POWER SUPPLY, MAY BE COMBINED WITH SECTION (E), POWER DISTRIBUTION ASSEMBLY.

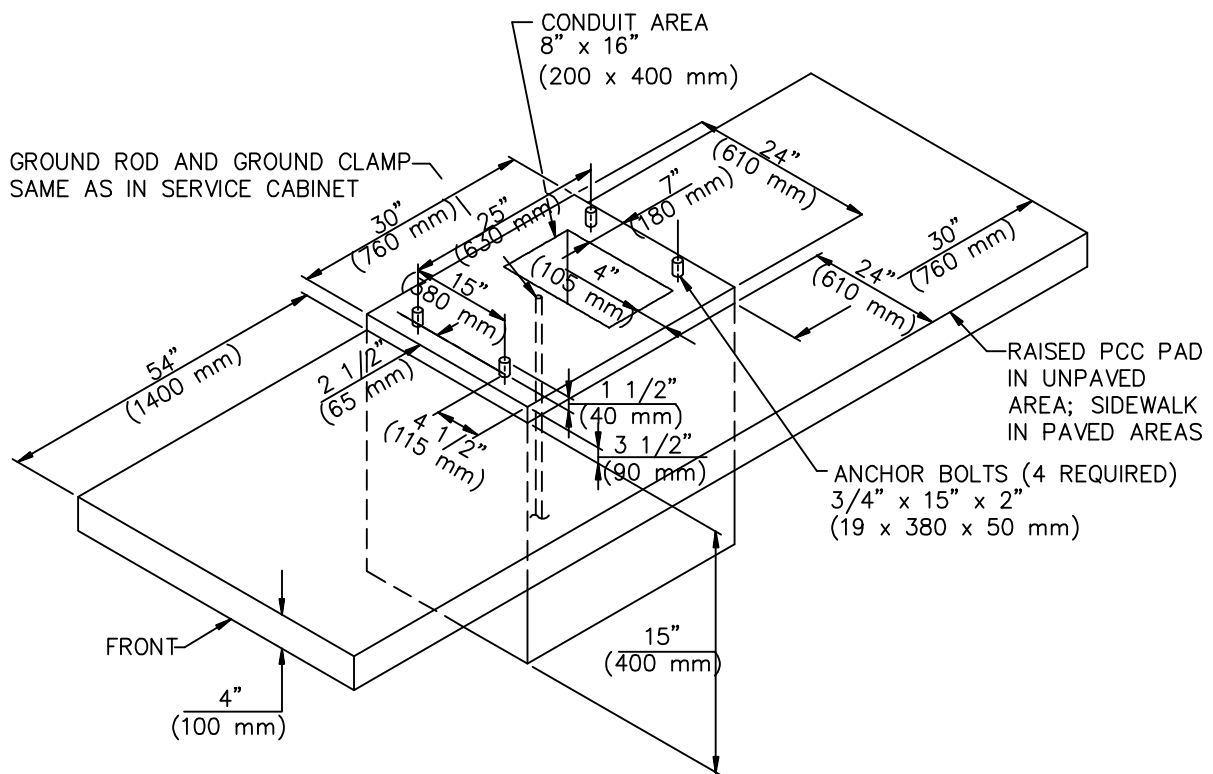


FOUNDATION DETAILS
For Model 332 and 334 cabinets
(Type 1 housing)

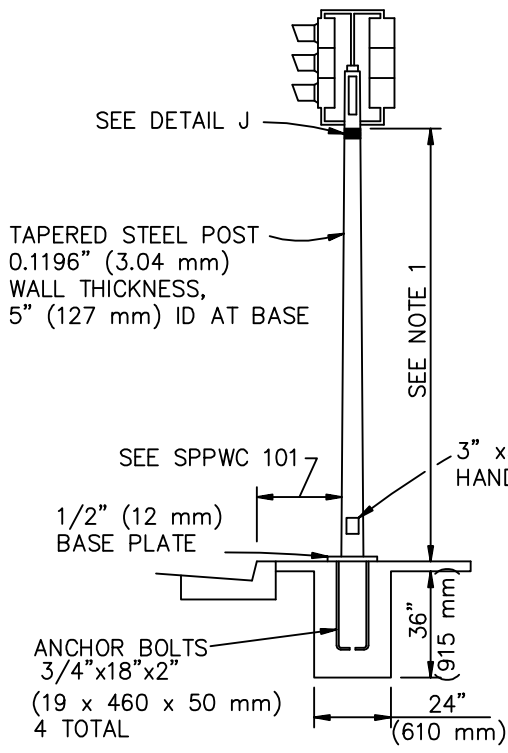




TYPE 1-A

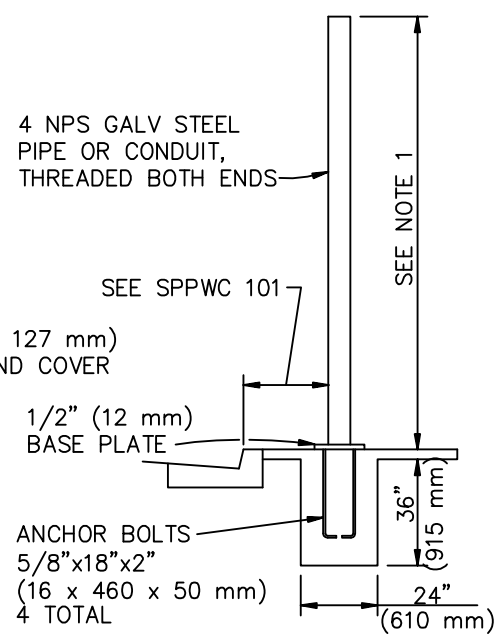

TYPE 1-B

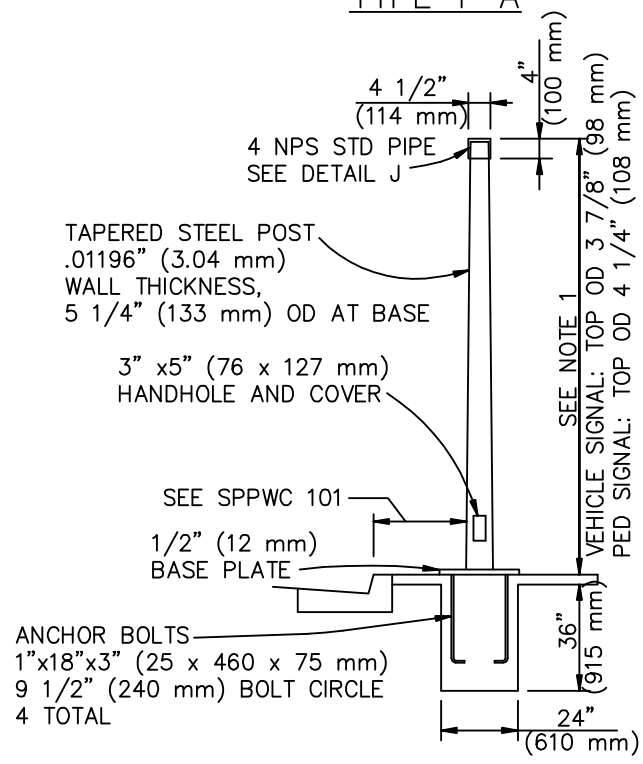

TYPE 1-D

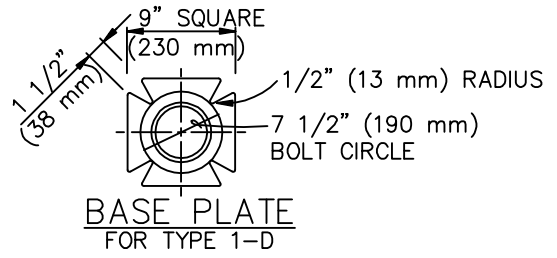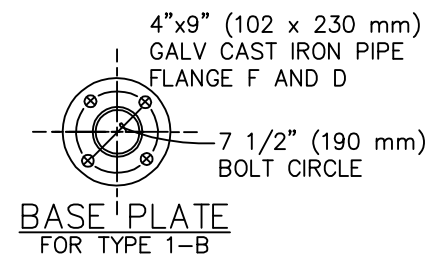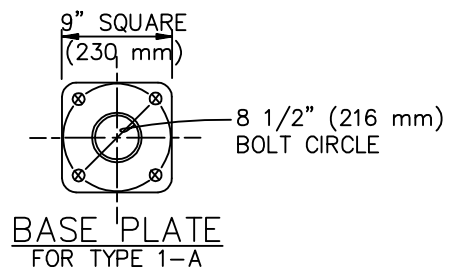


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009

SIGNAL STANDARDS


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
453-1
SHEET 1 OF 8

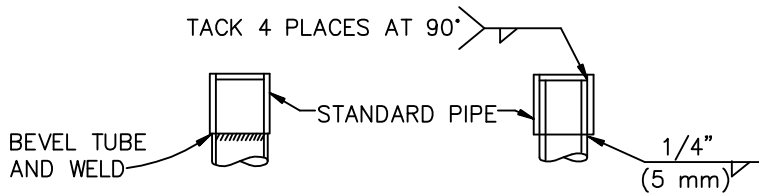


DETAIL J

TUBE MAY BE INSERTED INTO PIPE OR BUTTED AS APPROVED

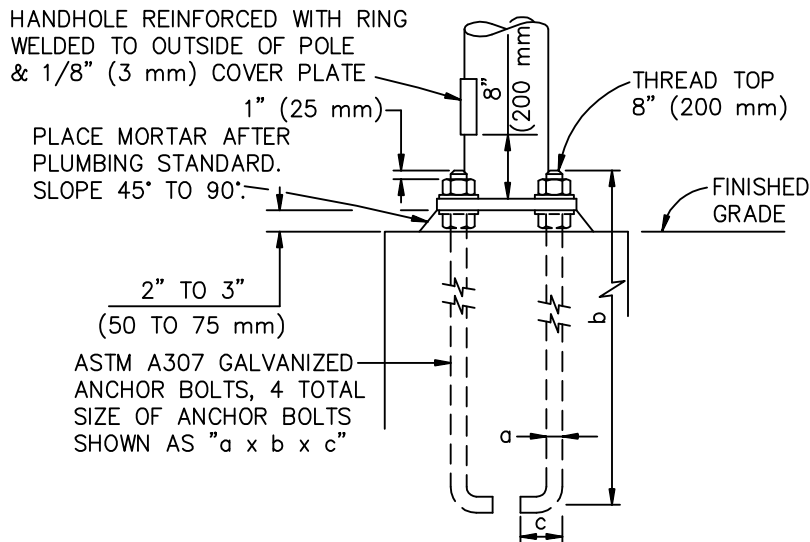

HANDHOLE AND ANCHORAGE

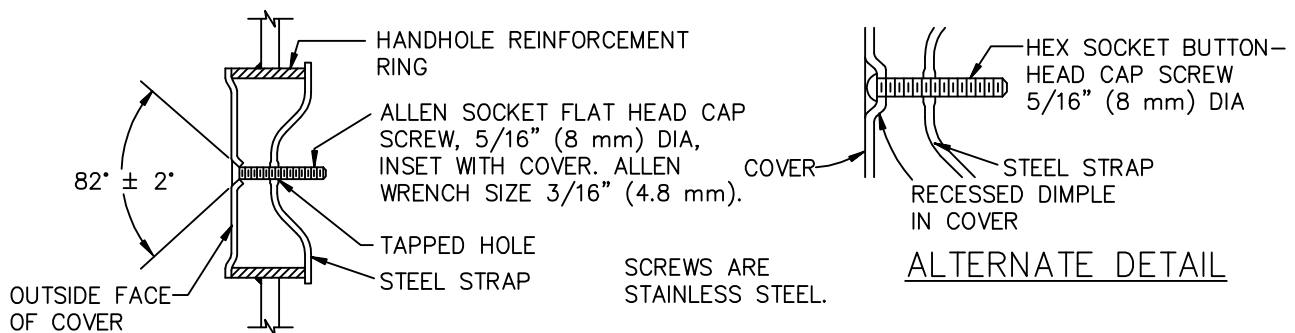

TAMPER RESISTANT HANDHOLE COVER

NOTES:

1. TYPE 1 STANDARDS SHALL BE 10' (3.05 m) LONG FOR VEHICLE SIGNALS AND 7' (2.13 m) LONG FOR PEDESTRIAN SIGNALS. LENGTHS ARE ± 2" (0.05 m).
2. TOP OF TYPE 1 STANDARDS SHALL BE 4 1/2" (114 mm) OD.
3. CONDUITS SHALL EXTEND 2" (50 mm) MAXIMUM ABOVE FINISHED SURFACE OF FOUNDATION AND FOR TYPES 1-A AND 1-D SHALL BE SLOPED TOWARD MANHOLE.
4. ANCHOR BOLTS SHALL BE BONDED TO CONDUIT OR GROUNDING CONDUCTOR.
5. CONDUIT BETWEEN STANDARD AND ADJACENT PULL BOX SHALL BE 2" (50 mm) MINIMUM.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

SIGNAL STANDARDS

453-1

SHEET 2 OF 8

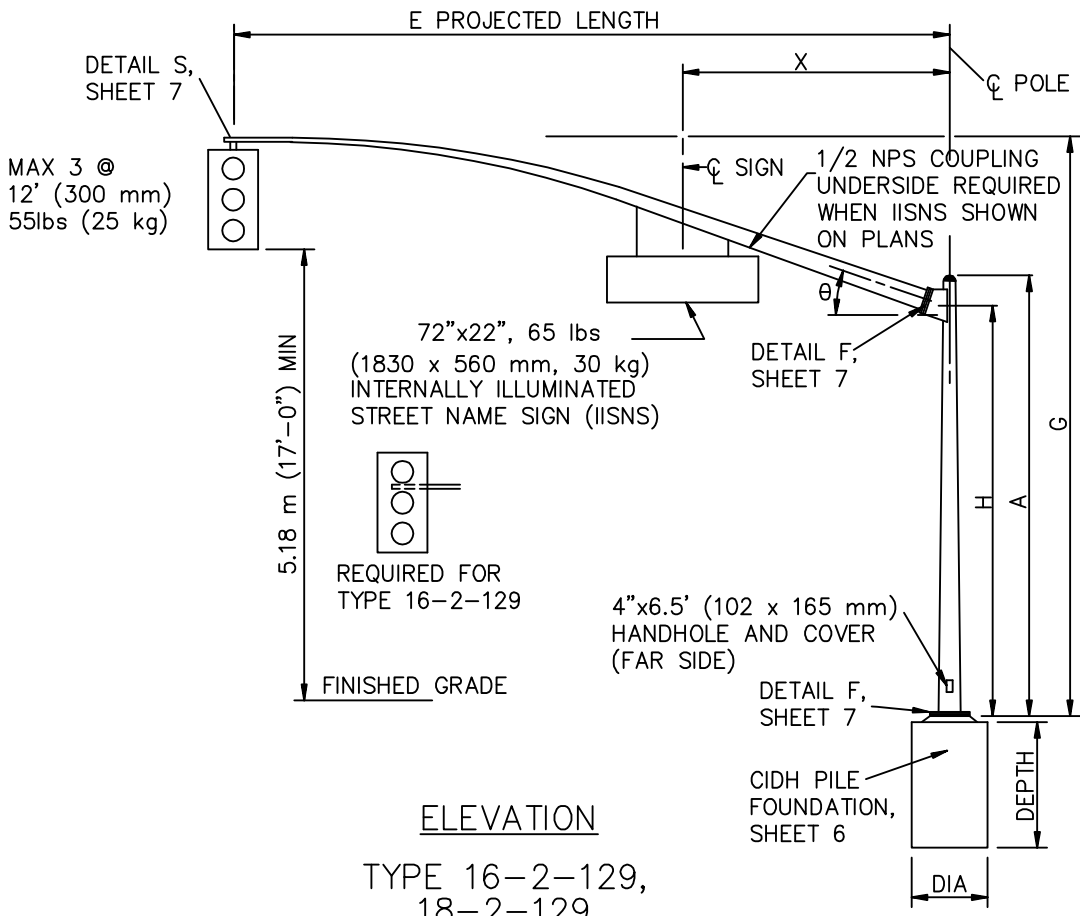

ELEVATION

TYPE 16-2-129,
18-2-129


POLE DATA						
POLE TYPE	A HEIGHT (m)	MIN OD, (mm)		THICK, (mm)	B LENGTH (m)	ALTERNATIVE SECTION
		BASE	TOP			
16-2-129	17' (5.2)		8.438" (214)		NONE	
17-2-129	30' (9.1)	(273)	6.625" (168)	0.180"	3.0	8" (203) 6.625"
19-2-129	30' (9.1)	10.75"	6.625" (168)	(4.55)	(9')	9.375" (238) (168)

SEE SHEET 4 FOR OTHER DIMENSIONS

BASE PLATE						
POLE TYPE	C, (mm)	D1 BOLT CIRCLE, (mm)	THICK, (mm)	ANCHOR BOLTS	LUMINAIRE ARM, (m)	SIGNAL ARM (m)
16-2-129	18.0"	17.50"	1.25" (32)	1.5"x42"x6" (38 x 1067 x 152 mm)	NONE	20' (6.1)
17-2-129	(457)	(445)	1.50" (38)	2"x42"x6" (51 x 1067 x 152 mm)	6'-15' 12'*	20' (6.1)
19-2-129					(1.8-4.6 3.7*)	25' OR 30' (7.6 OR 9.1)

*DEFAULT VALUE

SIGNAL ARM DATA			LUMINAIRE ARM DATA				
E PROJECTED LENGTH, (m)	G MOUNTING HEIGHT, (m)	MIN OD AT POLE, (mm)	M PROJECTED LENGTH, (m)	N RISE, (mm)	MIN OD AT POLE, (mm)	P MOUNTING HEIGHT	
						30' (9.) POLE	35' (10.7) POLE
15' (4.6)	22'-4" (6.8)	6.625" (168)	1.8 (6'-0")	24" (610)	3 1/4" (83)	31'-6" (9.6)	36'-6" (11.1)
20' (6.1)	21'-8" (6.6)	6.625" (168)	2.4 (8'-0")	30" (760)	3 1/2" (89)	32'-0" (9.8)	37'-0" (11.3)
25' (7.6)	22'-8" (6.9)	7.313" (186)	3.1 (10'-0")	39" (990)	3 7/8" (98)	32'-9" (10.0)	37'-9" (11.5)
30' (9.1)	23'-0" (7.0)	8.000" (203)	3.7 (12'-0")	51" (1290)	3 7/8" (98)	33'-9" (10.3)	38'-9" (11.9)
			4.6 (15'-0")	57" (1450)	4 1/4" (108)	34'-3" (10.5)	39'-3" (12.0)

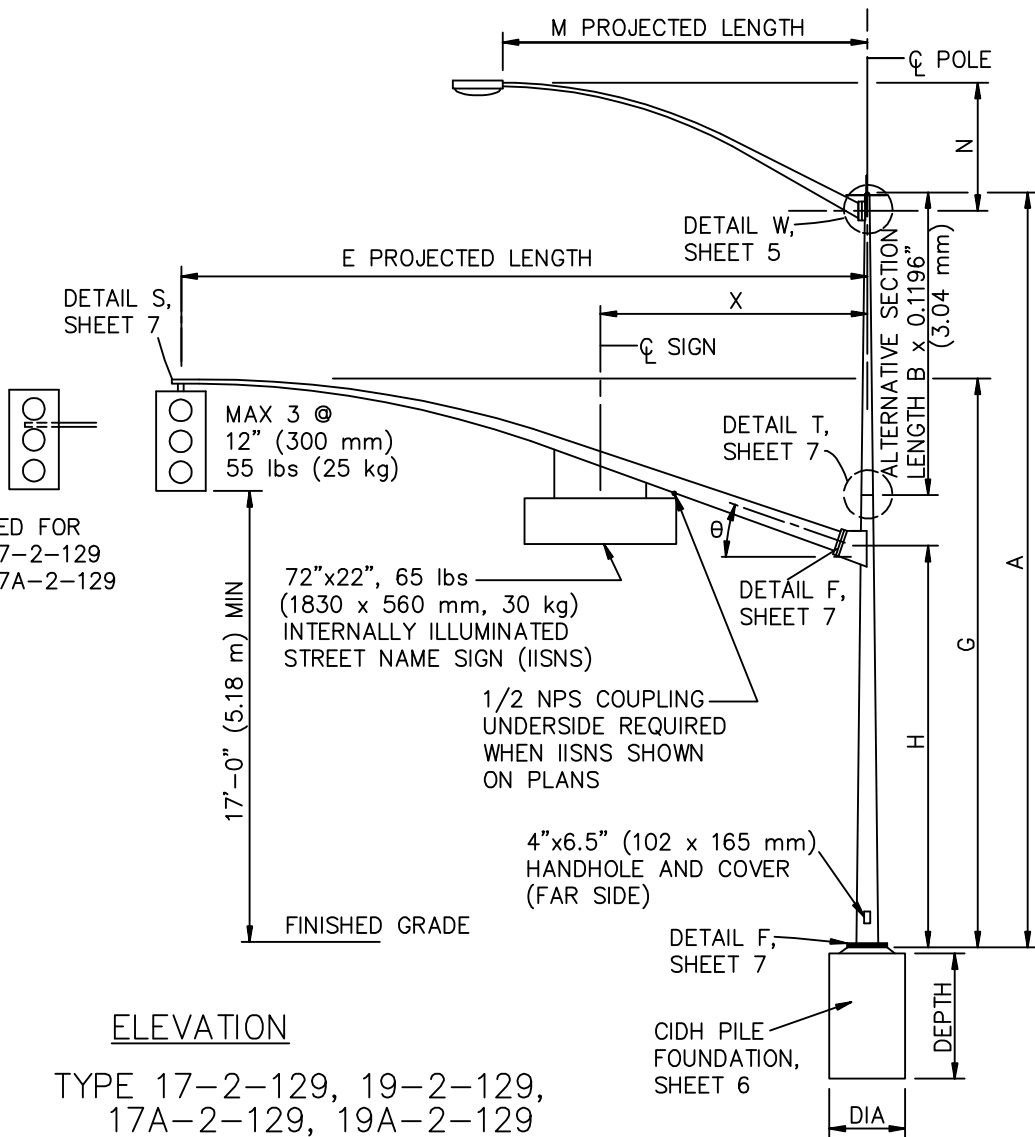




REQUIRED FOR
TYPE 17-2-129
TYPE 17A-2-129

ELEVATION


TYPE 17-2-129, 19-2-129,
17A-2-129, 19A-2-129

SEE SHEET 3 FOR OTHER DIMENSIONS

SIGNAL ARM:		DESIGN:	
H	16' (4.9 m)	CALTRANS LOAD CASE	2
THICK	0.180" (4.55 mm)	WIND VELOCITY	180 mph (129 kph)
I BOLT CIRCLE	12" (305 mm)	CIDH PILE FOUNDATION:	
HS CAP SCREWS	32-7NC-76	DIAMETER	30" (760 mm)
J PLATE SIZE	12" (305 mm)	DEPTH	7'-3" (2.2 m)
K ARM PLATE THICK	1.25" (32 mm)	REINFORCED	YES
L POLE PLATE THICK	1.50" (38 mm)		
θ	23°		
X MAX	10'-6" (3.2 m)		
LUMINAIRE ARM:			
THICKNESS	3.04 mm (0.1196")		

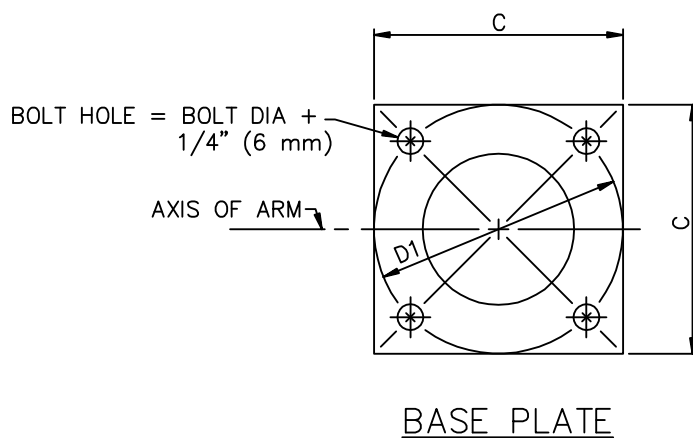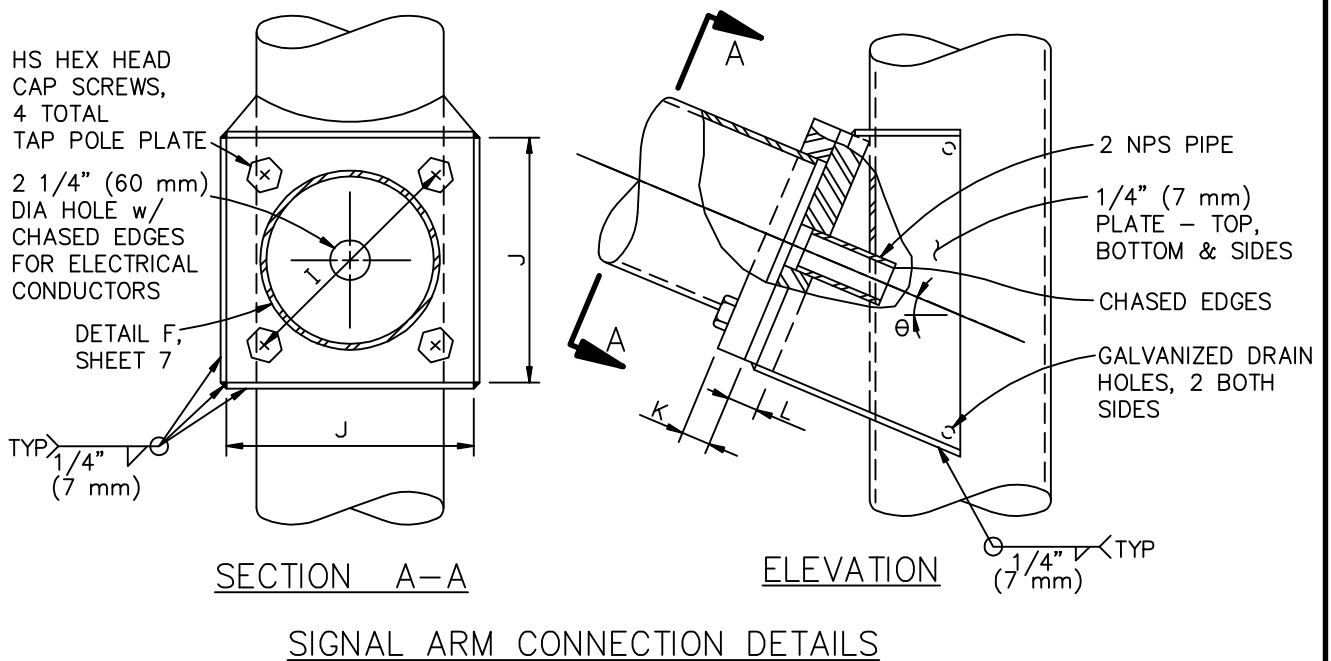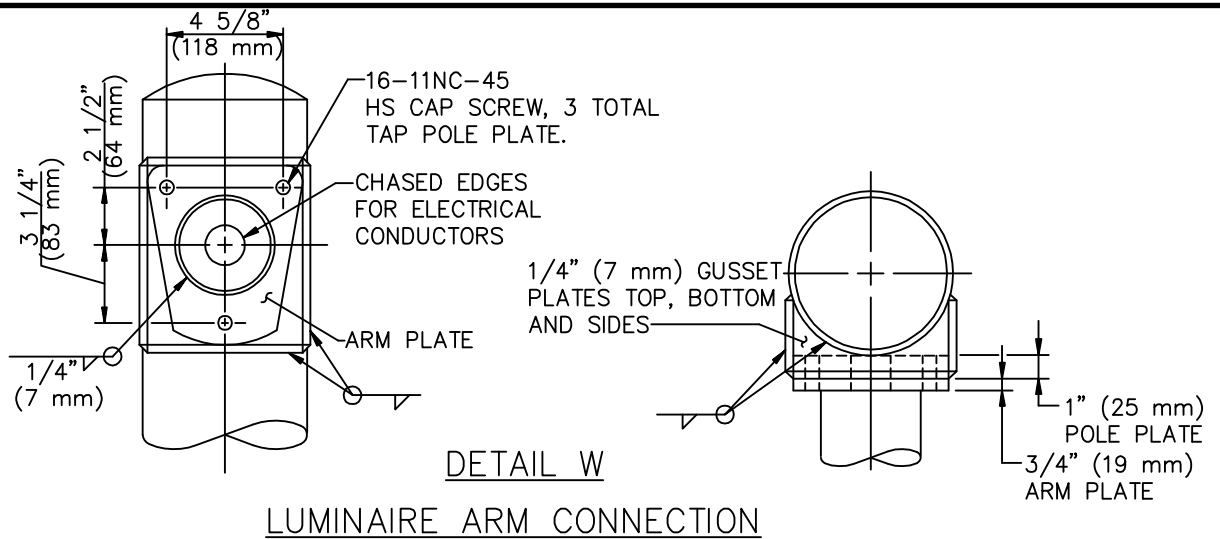


1"x1/4"
(25 x 7 mm)
BACKING RING.
TACK WELD

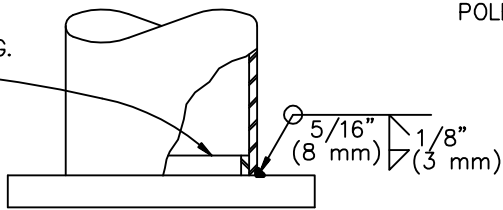

USE THIS DETAIL FOR 2-PLY POLES


ELEVATION B

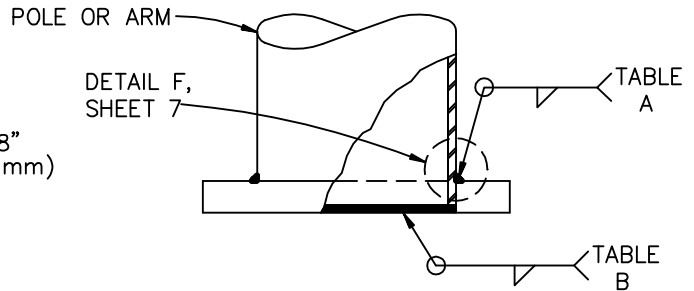

ELEVATION A


TABLE A	
WALL THICKNESS	WELD SIZE
0.1196" (3.04)	1/4" (7)
0.1793" (4.55)	5/16" (8)
0.2391" (6.07)	3/8" (10)
0.3125" (7.94)	7/16" (11)

TABLE B	
WALL THICKNESS	WELD SIZE
0.1196" (3.04)	1/8" (4)
0.1793" (4.55)	3/16" (5)
0.2391" (6.07)	1/4" (7)
0.3125" (7.94)	5/16" (7)

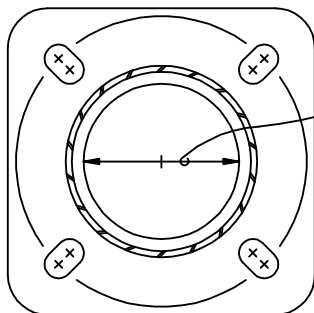

PLAN
DETAIL B

HOLE DIA =
POLE ID - 2" (51 mm)

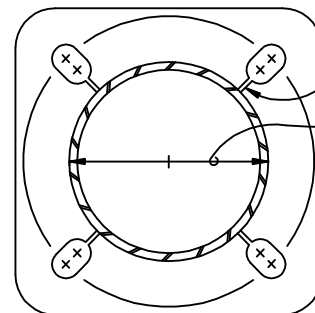


PLAN
DETAIL A

SLITS NOT
PERMITTED
WITH
DETAIL F


POLE OD
+ 1/16"
(2 mm)

ALTERNATIVE BASE PLATE DETAILS

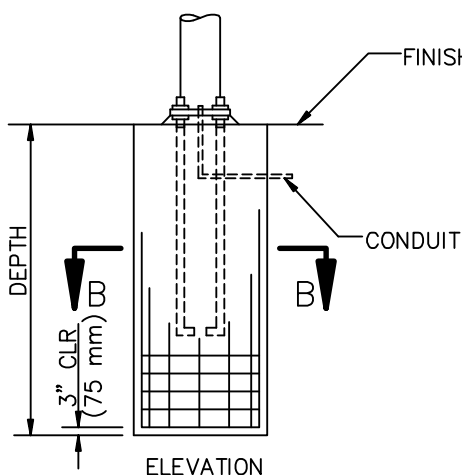

#8 (#25M)
TOTAL 10

2" CLR
(50 mm)



SECTION B-B

#4 (#13M) @ 6" (150 mm)
OR #4 (#13M) SPIRAL @
6" (150 mm) PITCH WITH
18" (450 mm) LAP AT
SPLICE AND 135° HOOK
AT TERMINATIONS

CAST-IN-DRILLED HOLE PILE FOUNDATION
REINFORCED PILE


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

SIGNAL STANDARDS

453-1


SHEET 6 OF 8

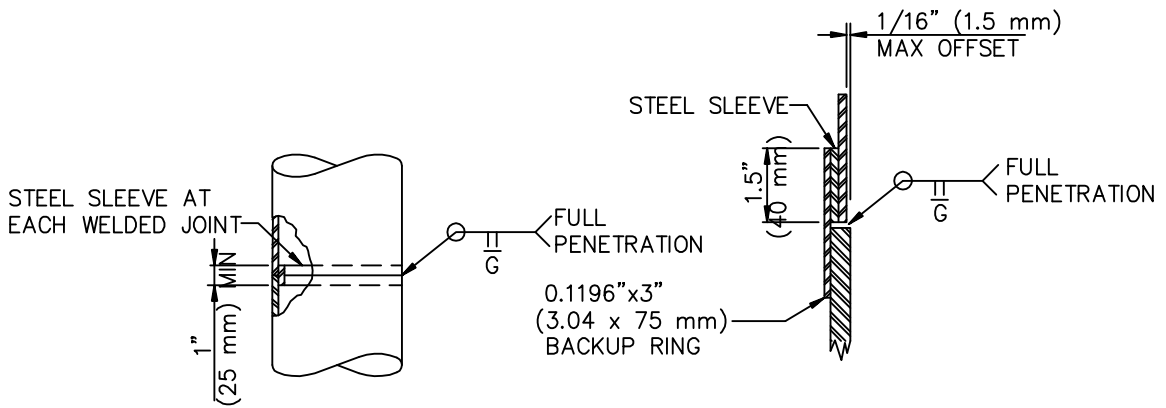


FOR UNIFORM TUBE THICKNESS

DETAIL T
AT TUBE THICKNESS CHANGE

POLE SPLICES

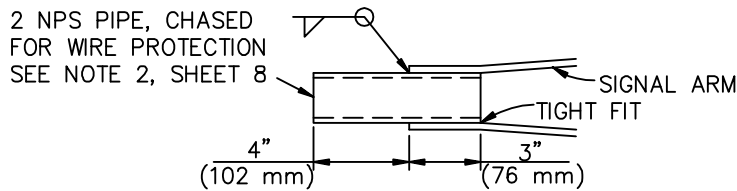


DETAIL TS-TIP TENON

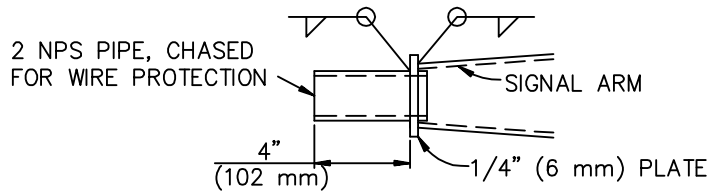


DETAIL TL-TIP TENON


THIS DETAIL SUPERSEDES DETAIL S WHEN SO DESIGNATED

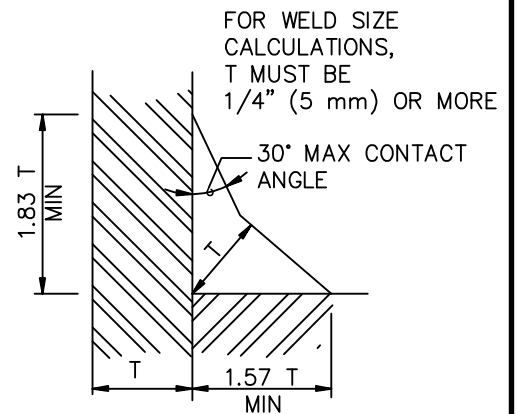

DETAIL F
FATIGUE RESISTANT WELD

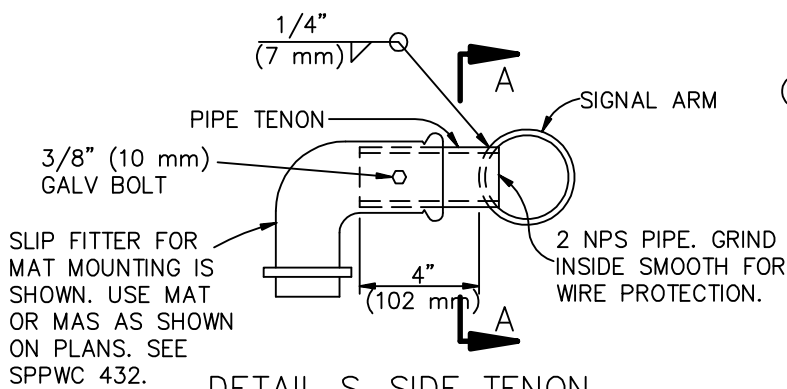

DETAIL S-SIDE TENON

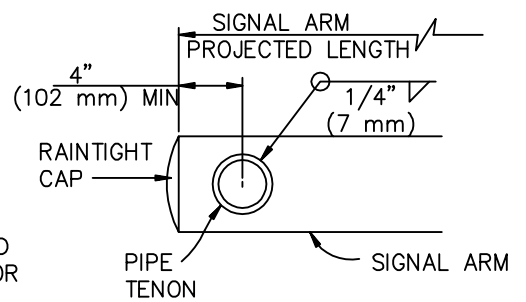

SECTION A-A

PIPE TENONS

IDENTIFICATION NUMBER

ATTACH A STAMPED METAL TAG WITH EACH POLE'S IDENTIFICATION NUMBER TO SHAFT ABOVE HANDHOLE. NUMBER SHALL BE MINIMUM 1/4" (7 mm) HIGH. ATTACH SIMILAR TAG TO THE TOP OF THE SIGNAL MAST ARM NEAR THE POLE PLATE.

SAMPLE IDENTIFICATION NUMBER:

TYPE LOAD CASE DESIGN WIND VELOCITY
 SIGNAL ARM LENGTH CALTRANS STD PLAN YEAR
 MAXIMUM ONLY FOR POLES WITH
 FATIGUE RESISTANT
 WELDS
 19A - 3 - 129 - 9.1 - 99 - F
 USE SL FOR SPECIAL LOAD CASE

SPECIFICATIONS

DESIGN: AASHTO SPECIFICATIONS FOR THE DESIGN AND CONSTRUCTION OF STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES, AND TRAFFIC SIGNALS, DATED 1994.


WIND LOADING: 129 km/h AASHTO

UNIT STRESSES, STRUCTURAL STEEL:

fy = 48 ksi (331 MPa), TAPERED SHEET STEEL
fy = 36 ksi (248 MPa) UNLESS OTHERWISE NOTED







CONSTRUCTION: STANDARD SPECIFICATIONS AND THE SPECIAL PROVISIONS

HIGH STRENGTH CAP SCREWS:

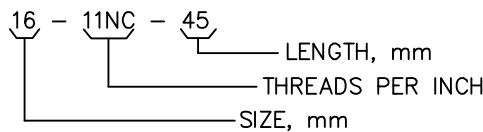

NOTES

1. PROVIDE FOUR ASTM A-307 ANCHOR BOLTS FOR EACH POLE. PROVIDE A HEX NUT, LEVELLING NUT AND TWO WASHERS FOR EACH BOLT.
2. LUMINAIRE ARMS SHALL BE ROUND, TAPERED STEEL TUBES, TAPER OF 0.137" TO 0.140" PER FT (11.45 TO 11.66 mm/m) WITH AN END SECTION 2 3/8" (60 mm) OD FOR MOUNTING HARDWARE. EXTENSIONS OF 2 NPS PIPE 7" (178 mm) LONG MAY BE USED AT THE OPTION OF THE MANUFACTURER. WHEN LOW PRESSURE SODIUM LUMINAIRES ARE REQUIRED, THE EXTENSION SHALL BE 15" (381 mm).
3. SIGNAL ARMS SHALL BE ROUND, TAPERED STEEL TUBES, MAXIMUM TAPER 0.140" PER FT (11.66mm/m).
4. HANDHOLE REINFORCEMENT RING SHALL BE 1/4"x2" (6 x 51 mm) FOR 0.1196" TO 0.2391" THICK POLES (3.04 TO 6.07 mm); 3/8"x2" (10 x 51 mm) FOR 0.3125" (7.94 mm) THICK POLES.
5. USE DETAIL F, SHEET 7, FATIGUE RESISTANT WELD, AT SIGNAL ARM PLATE AND POLE BASE PLATE.
6. IN LIEU OF THE TORQUE REQUIREMENTS FOR HS BOLTS, CAP SCREWS SHALL BE TIGHTENED BY THE TURN-OF-NUT METHOD 1/3 TURN FROM A SNUG, TIGHT CONDITION. NO WASHER IS REQUIRED.
7. DURING POLE ERECTION, RAKE THE POST AS NECESSARY WITH THE USE OF LEVELLING NUTS TO PRODUCE A PLUMB POLE AXIS.



SV-1-T

SV-2-TA


TV-1

TV-1-T

TV-2-T

SIDE SIGNAL MOUNTINGS

TOP SIGNAL MOUNTINGS

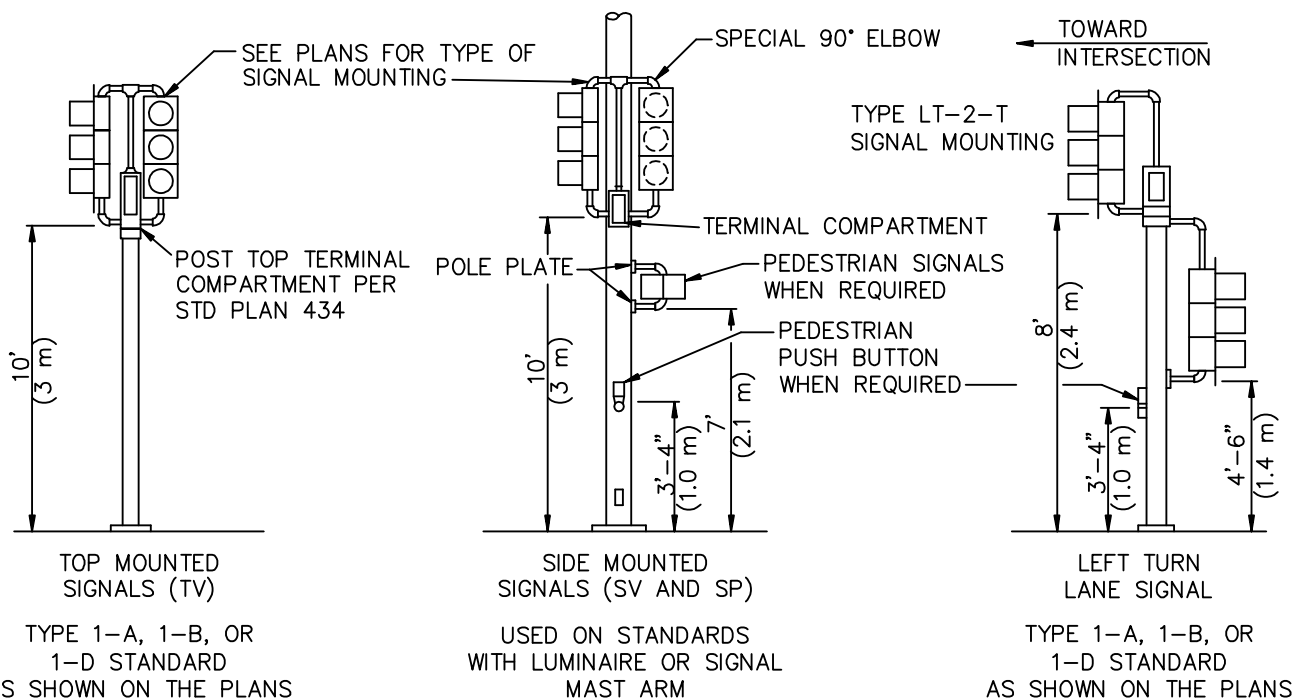

TYPICAL SIGNAL INSTALLATIONS

NOTES

ABBREVIATIONS

- TV TOP MOUNTED VEHICLE SIGNALS
- SV SIDE MOUNTED VEHICLE SIGNALS
- T TERMINAL COMPARTMENT
- 1,2 NUMBER OF SIGNAL FACES

1. MOUNTINGS SHALL BE ORIENTED TO PROVIDE MAXIMUM HORIZONTAL CLEARANCE TO ADJACENT ROADWAY.
2. BRACKET ARMS SHALL BE LONG ENOUGH TO PERMIT PROPER ALIGNMENT OF SIGNALS AND BACKPLATE INSTALLATION.
3. SEE SPPWC 455 FOR ATTACHMENT FITTING DETAILS.
4. ALL ARROW INDICATIONS SHALL BE 12" (300 mm).
5. ALL PROGRAMMED VISIBILITY SIGNAL HEADS SHALL BE PROVIDED WITH BACKPLATES.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009


SIGNAL HEADS AND FIXTURES

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


454-1

SHEET 1 OF 3

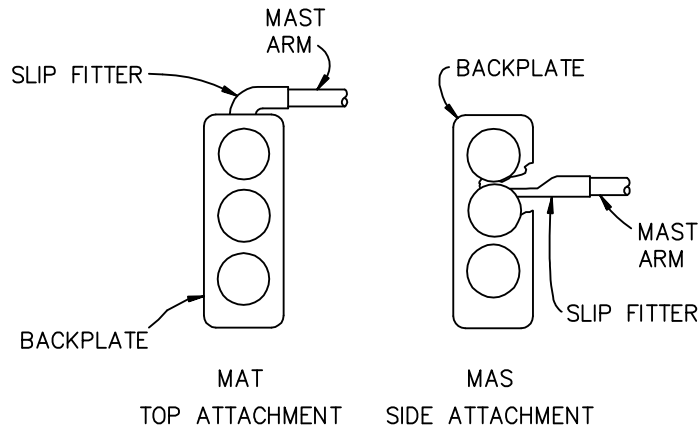








MAST SIGNAL MOUNTINGS

8" ± 1/2" (200 ± 13 mm) FOR 8" (200 mm) SECTIONS
 5 1/2" ± 1/2" (140 ± 13 mm) FOR 12" (300 mm) SECTIONS

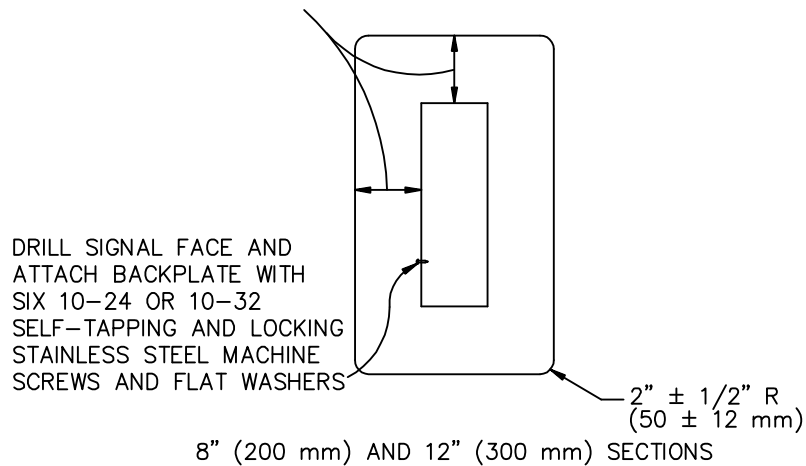

BACKPLATE

1/16" (1.5 mm) MIN THICKNESS
 3001-14 ALUMINUM, OR PLASTIC
 WHEN SPECIFIED



SP-1-T

SP-2-T

TP-1


TP-2-T

SIDE MOUNTINGS



TOP MOUNTINGS

PEDESTRIAN SIGNALS AND MOUNTINGS


NOTE: "CLAM SHELL" MOUNTINGS ARE ALSO ACCEPTABLE.

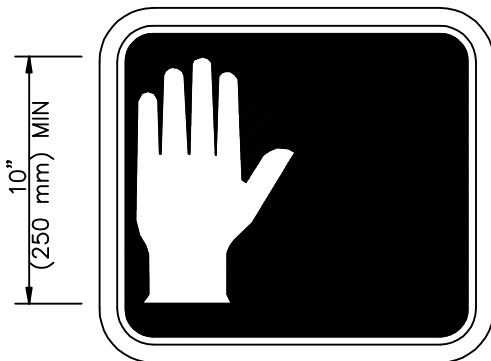


PEDESTRIAN SIGNAL FACE
SYMBOL TYPE

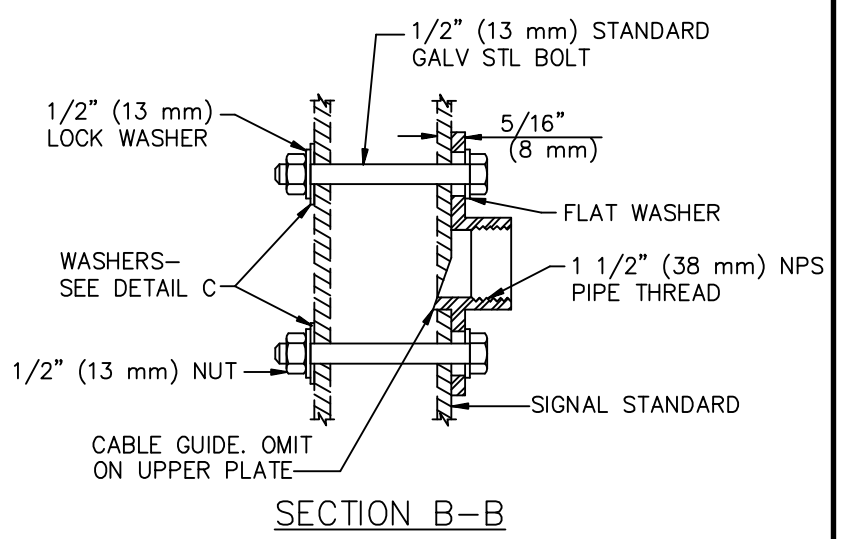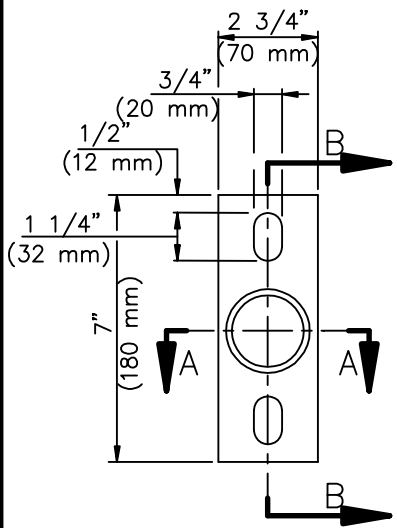


POLE PLATE
FOR SIDE MOUNTINGS

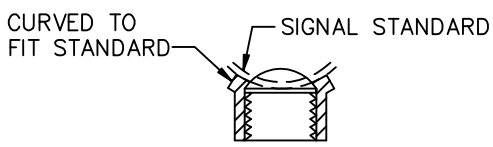

SECTION A-A

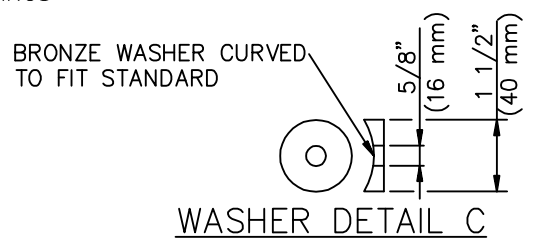


WASHER DETAIL C

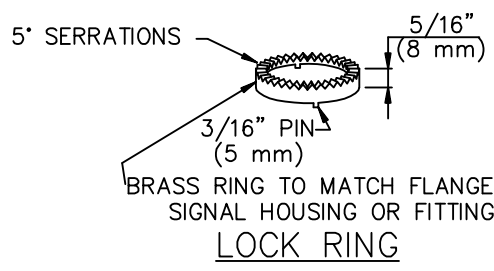


LOCK RING

USE WHERE LOCKING RING IS NOT INTEGRAL WITH SIGNAL HOUSING OR FITTING.

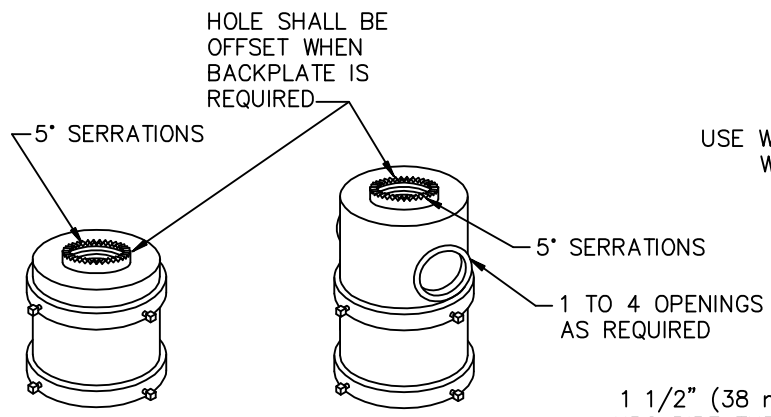

TOP MOUNTINGS

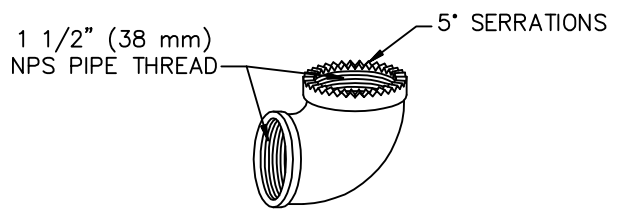

SPECIAL 90° ELBOW

ONE FOR EACH FACE, EXCEPT THOSE WITH SPECIAL SLIP FITTER MOUNTING


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009


SIGNAL FITTINGS

STANDARD PLAN
455-1
SHEET 1 OF 2

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

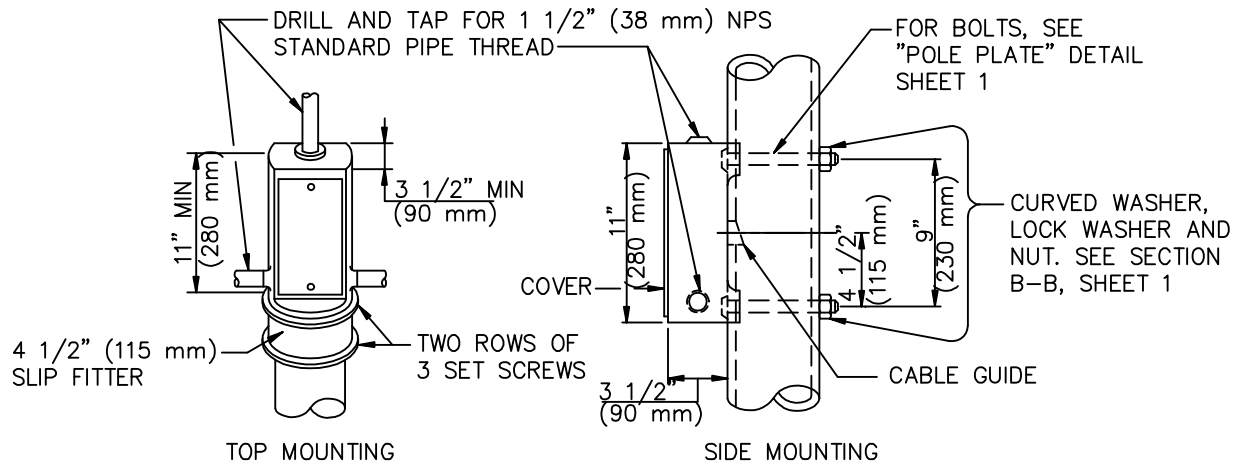


TERMINAL COMPARTMENTS

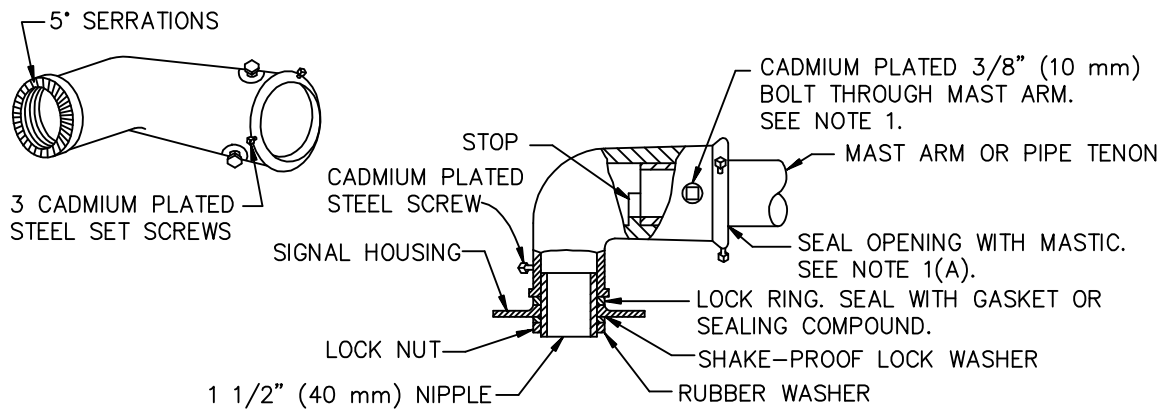

MAST ARM MOUNTING – TYPE "MAT"

FOR 2" (50 mm) NPS PIPE, SEE NOTE 1.

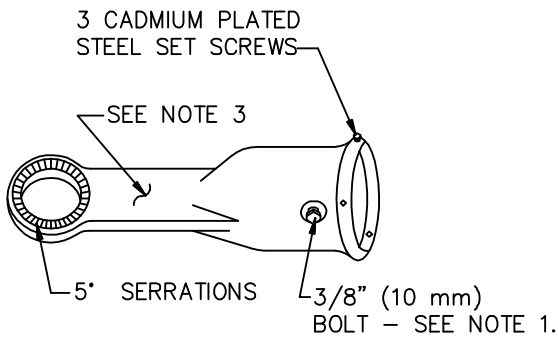


MAST ARM MOUNTING
TYPE "MAS"

FOR 2" (50 mm) NPS PIPE,
SEE NOTE 1.


NOTES

1. AFTER MAST ARM SIGNAL HAS BEEN PLUMBED AND SECURED, DRILL 7/16" (11 mm) HOLE THROUGH MAST ARM TENON IN LINE WITH SLIP FITTER HOLE. PLACE A 3/8" (10 mm) GALVANIZED BOLT WITH WASHER UNDER BOLT HEAD THROUGH HOLE AND SECURE WITH WASHER, NUT, AND LOCKNUT.
(A) SEAL OPENINGS BETWEEN MAS, MAT OR MAS-5 MOUNTINGS AND MAST ARM.
2. (A) THREADED TOP-MOUNTED SLIP FITTER OPENINGS SHALL BE 1 1/2" (38 mm) NPS.
(B) SERRATIONS IN FITTINGS SHALL MATCH THOSE ON BOTTOM OF SIGNAL HEADS OR IN LOCK RING.
(C) TOP OPENING SHALL BE OFFSET WHEN BACKPLATE IS USED.
3. WIREWAY SHALL HAVE A CROSS SECTION AREA OF 0.95 SQ. IN. (600 mm²) MIN, AND MIN WIDTH OF 13 mm (1/2").

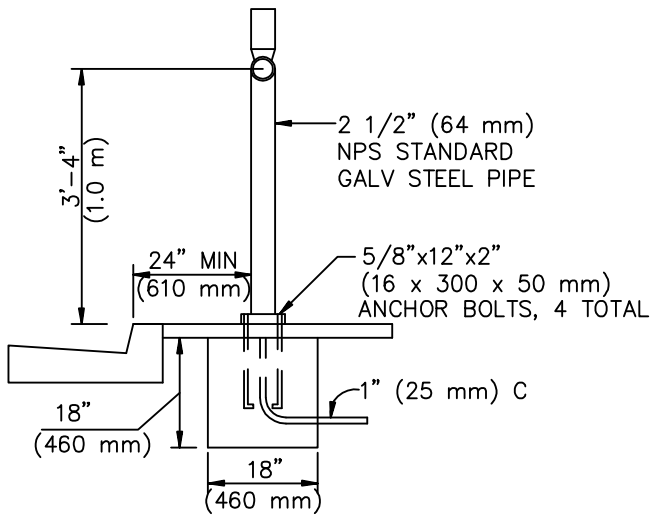


ELEVATION

EXTEND CONDUIT 2" (50 mm) MAX ABOVE FINISHED SURFACE OF FOUNDATION. BOND ANCHOR BOLTS TO CONDUIT OR GROUNDING CONDUCTOR.

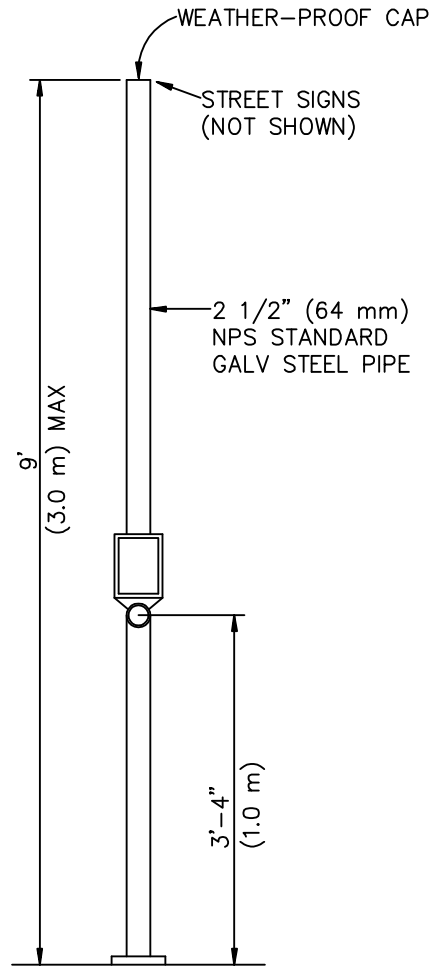


FOUNDATION AND ANCHOR BOLT DETAILS SAME AS PED PUSH BUTTON POST

COMBINED STREET SIGN AND PEDESTRIAN PUSH BUTTON POST

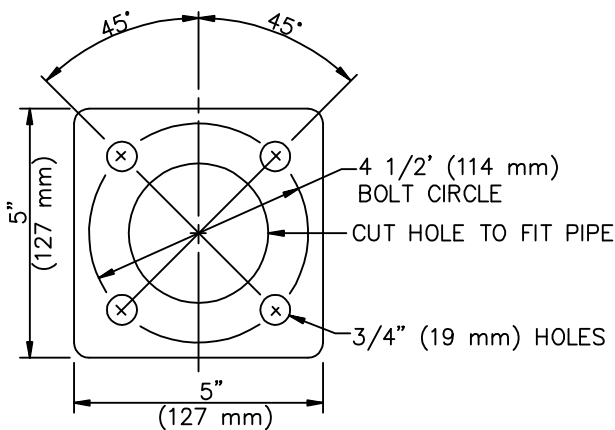

BASE PLATE

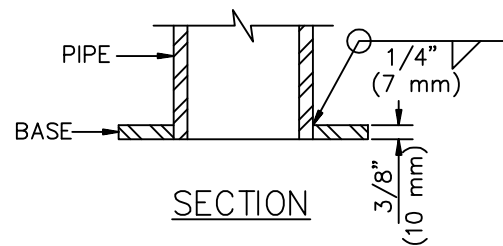

SECTION

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005

PEDESTRIAN PUSH BUTTON STAND


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


456-1

SHEET 1 OF 4

5/8"x1 3/4" (16 x 44 mm)
SQUARE OR HEX HEAD
GALV STL BOLTS




TACK WELD TWO
OPPOSITE FLATS
OF EACH BOLT

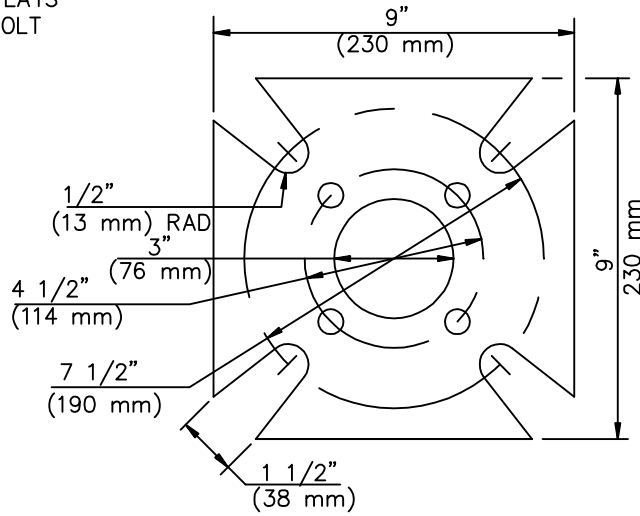


ADAPTER BASE PLATE


ADAPTER BASE PLATE
INSTALLATION DETAIL

INSTALL WHERE SPECIFIED.
CONSTRUCT FOUNDATION AND
ANCHORAGE FOR TYPE 1 SIGNAL
STANDARD PER SPPWC 431.

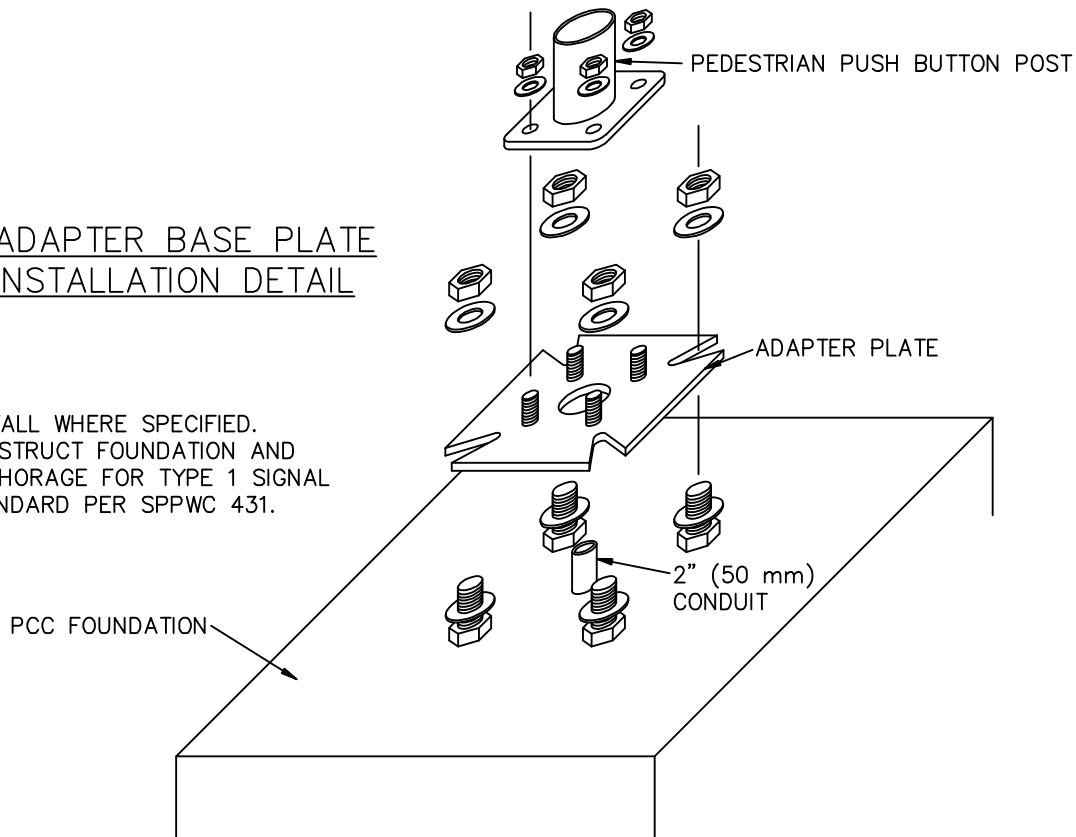

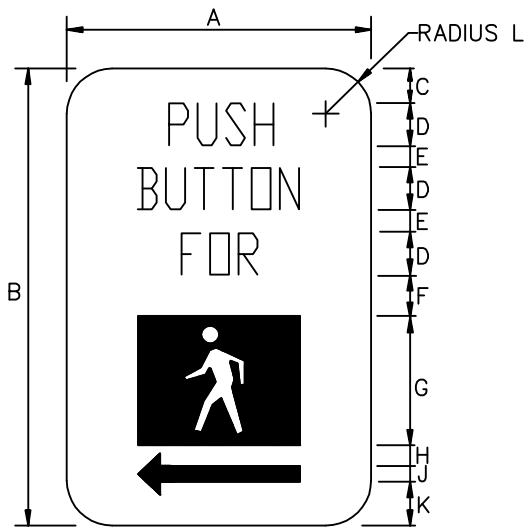


ALTERNATIVE SYMBOL AND ARROW DIRECTIONS:
LEFT, RIGHT OR BOTH



LEFT



RIGHT




BOTH


FOR BICYCLE LANES
(USE ONLY WHEN SPECIFIED)
BLACK LEGEND ON WHITE BACKGROUND



LEFT



RIGHT




BOTH

FOR 3-LIGHT SIGNALS
(USE ONLY WHEN SPECIFIED)
BLACK LEGEND ON WHITE BACKGROUND

SIGN DIMENSIONS, INCHES (mm)										
A	B	C	D	E	F	G	H	J	K	L
5" (130)	7 1/2" (190)	9/16" (15)	3/4" (20)	3/8" (10)	7/16" (12)	2 1/8" (50)	3/8" (10)	1/4" (6)	11/16" (17)	3/4" (20)

PEDESTRIAN PUSH BUTTON SIGNS

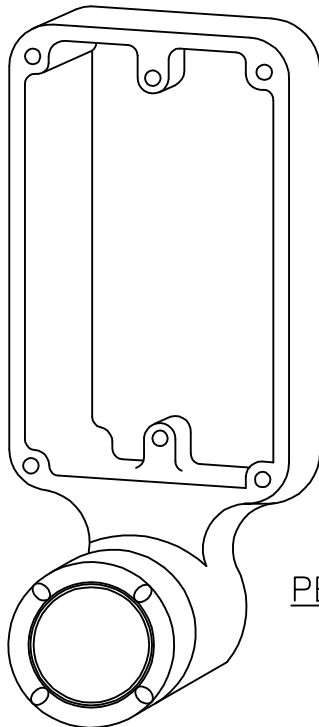

NOTES

1. BACK CASTING SHAPE SHALL FIT CURVATURE OF POST.
2. PROVIDE COVER FITTING FOR TOP OF POST, WHEN PPB IS MOUNTED ON PEDESTRIAN PUSH BUTTON POST.
3. INSTALL PUSH BUTTON ON CROSSWALK SIDE OF STANDARD.
4. ACTUATOR SHALL BE 2" (50 mm) MIN DIAMETER.

PEDESTRIAN PUSH BUTTON

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION


PEDESTRIAN PUSH BUTTON STAND

STANDARD PLAN


456-1

SHEET 3 OF 4

BLACK LETTERS
AND BORDERS ON
WHITE BACKGROUND
EXCEPT AS SHOWN

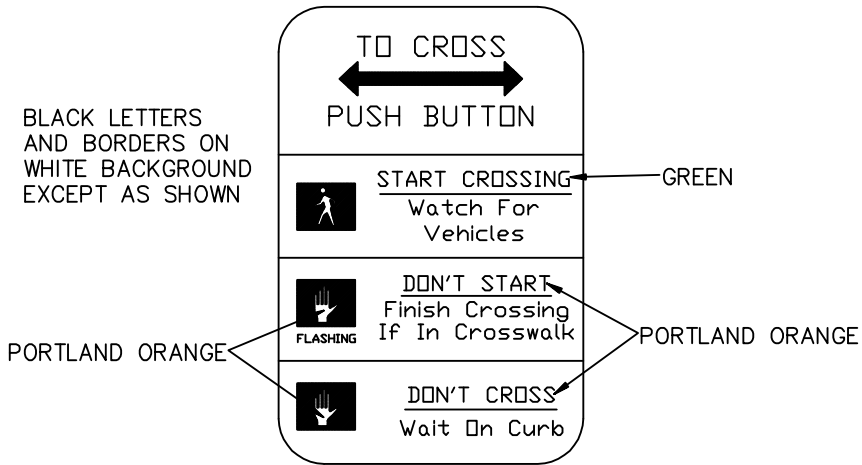


EDUCATIONAL COVER PLATE
(USE ONLY WHEN SPECIFIED)

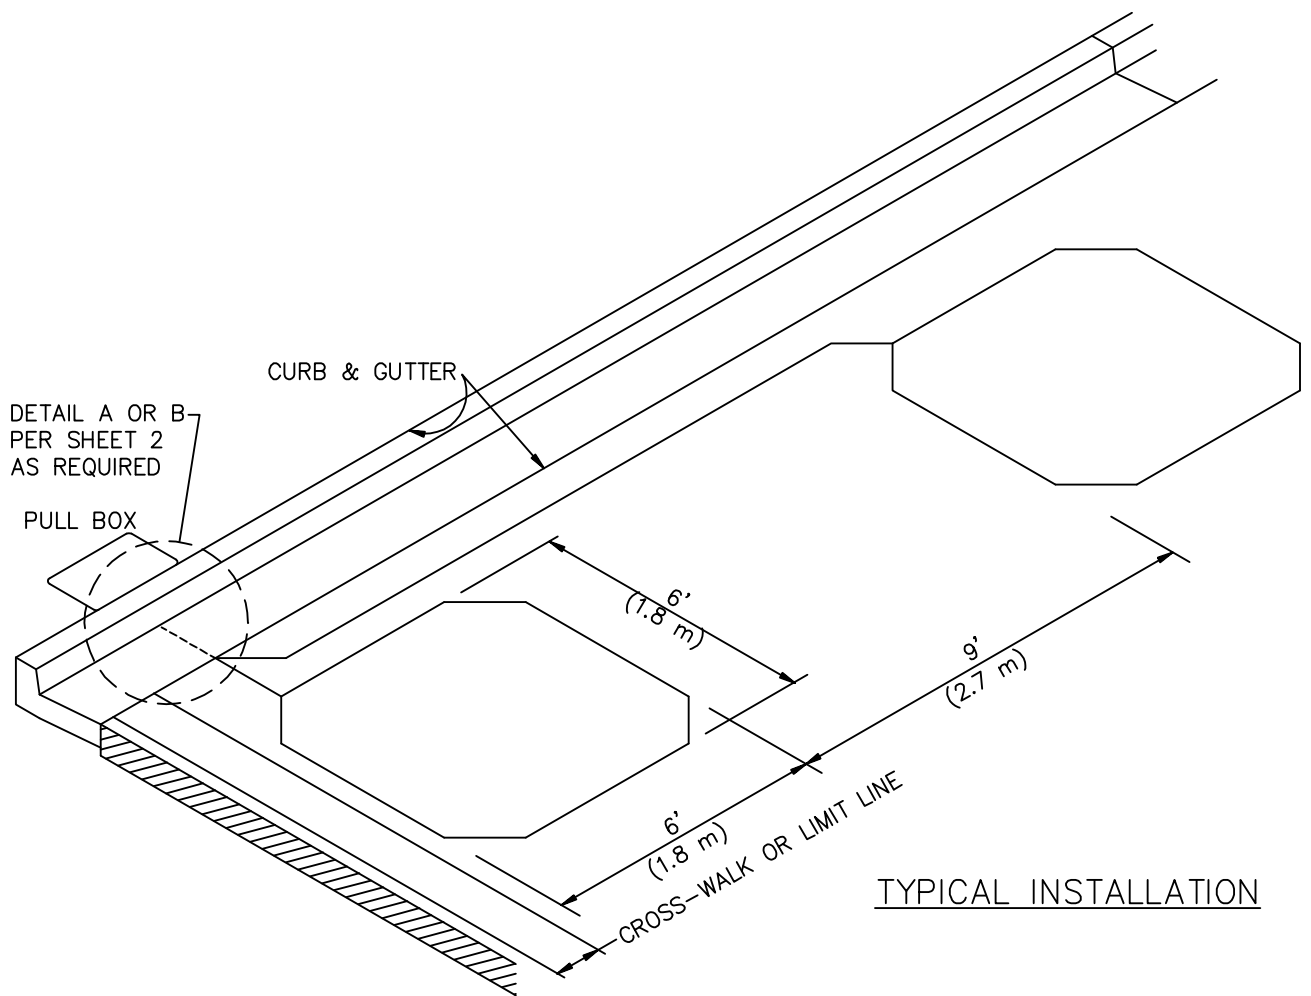

TYPICAL INSTALLATION

NOTES:

1. LOOPS MAY BE OCTAGONAL AS SHOWN, OR CIRCULAR.
2. CONSTRUCT OCTAGONAL LOOPS WITH 12" (300 mm) CORNER CUTOFFS.
3. INSTALL WEDGES EACH 6' (1.8 m) TO MAINTAIN MINIMUM EPOXY COVER.
4. INSTALL LOOPS ALTERNATING CLOCKWISE AND COUNTERCLOCKWISE.
5. IN PAVEMENT RESURFACING AREAS, INSTALL LOOPS IN UNDERLYING PAVEMENT BEFORE RESURFACING.

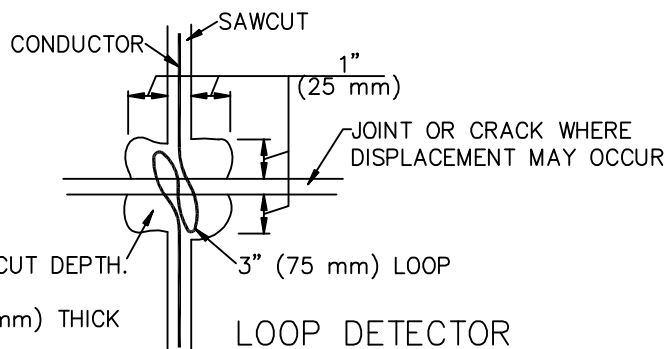

CHIP OUT TO AT LEAST SAWCUT DEPTH.
 COVER CABLE WITH SAND.
 FILL WITH AT LEAST 1" (25 mm) THICK
 EPOXY TO FINISHED SURFACE.

LOOP DETECTOR
 EXPANSION JOINT

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 2005
 REV. 2009




LOOP DETECTORS


STANDARD PLAN

457-1


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 2

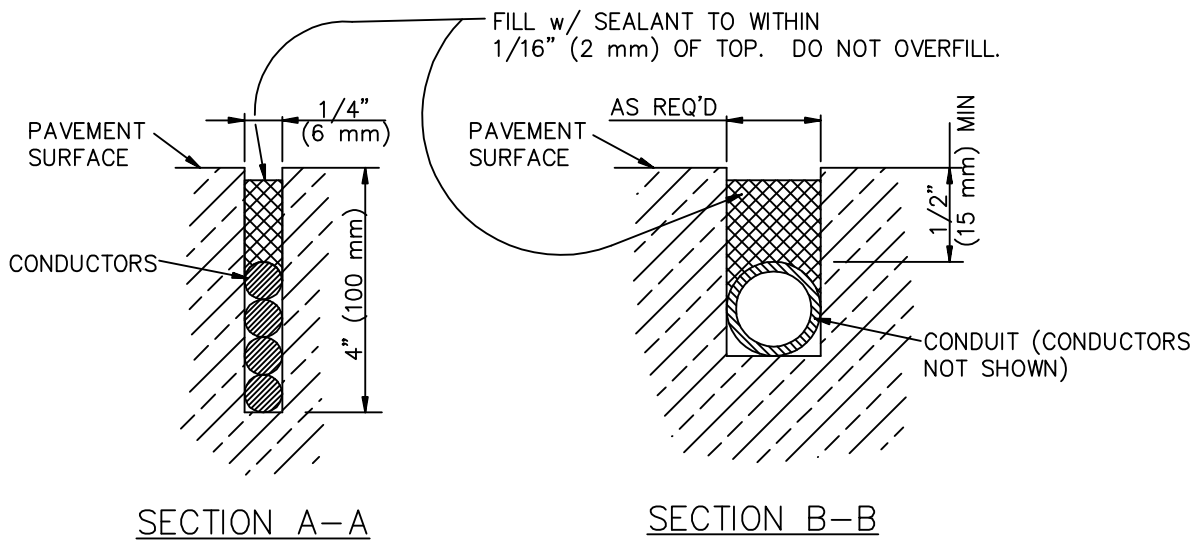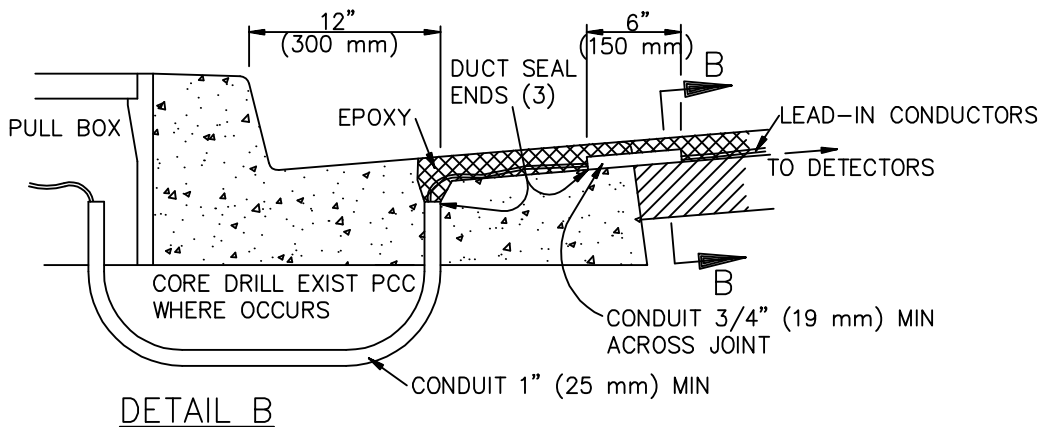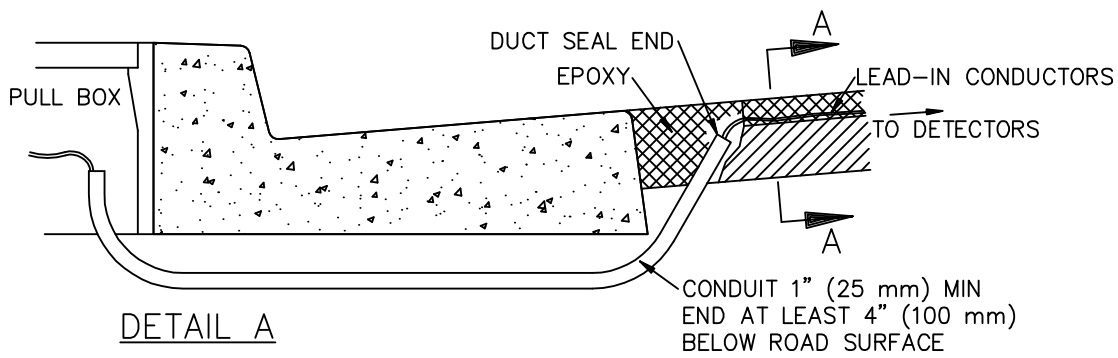


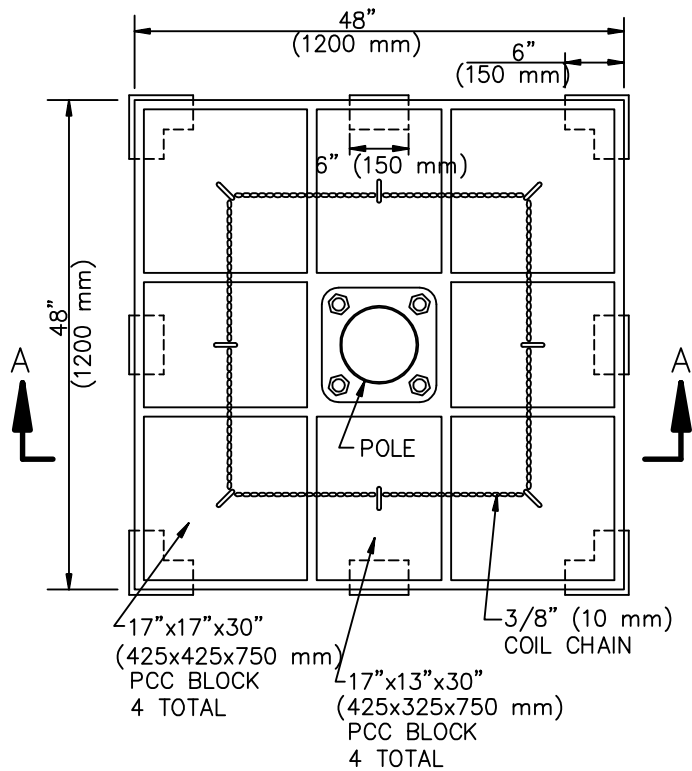

TYPE 16M STANDARD - PLAN

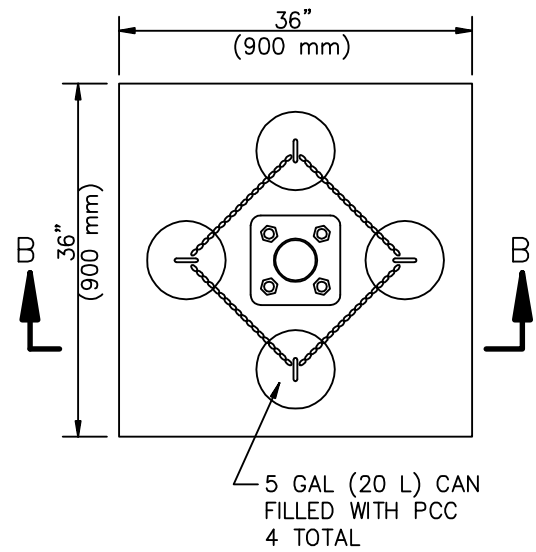


TYPE 1 STANDARD - PLAN

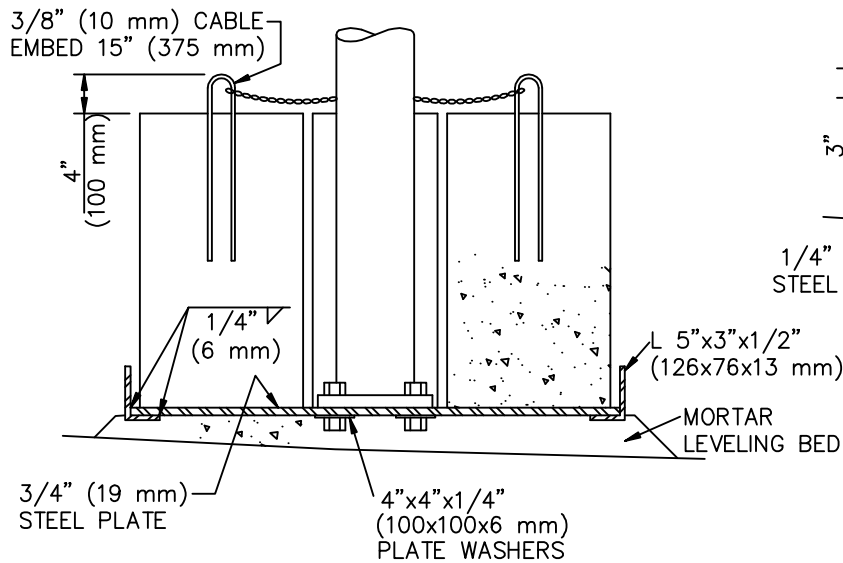

NOTES:

1. FOR TYPE 16M STANDARD, MAST ARM LENGTH SHALL NOT EXCEED 15' (4.5 m). CLEARANCE FROM ROADWAY TO BOTTOM OF BACK PLATE SHALL BE AT LEAST 17' (5.1 m). MAX NUMBER OF HEADS IS THREE: ONE ON MAST AND TWO ON POLE.
2. MORTAR LEVELING BED NOT REQUIRED ON CRUSHED BASE, DIRT, OR WHEN SLOPE IS LESS THAN 2%. POLE SHALL NEVERTHELESS BE SET PLUMB.
3. DRILL HOLES IN STEEL PLATE TO MATCH BASE PLATE BOLT CIRCLE.

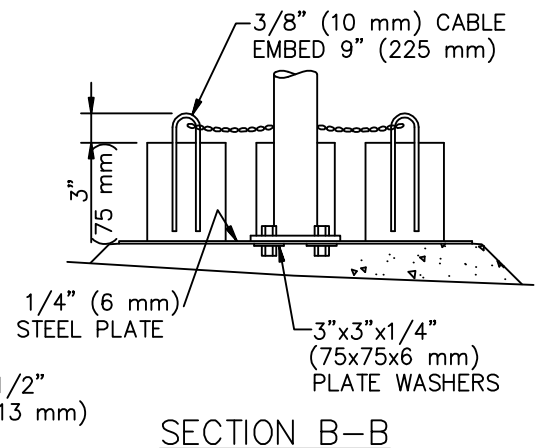

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
2005
REV. 2009

TEMPORARY SIGNALS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION






















STANDARD PLAN


458-1

SHEET 1 OF 1

SECTION 5

Landscaping and Irrigation Systems

POINT OF CONNECTION	POC
WATER METER	
PIPE – LATERAL LINE	
PIPE – PRESSURE WATER MAIN	
PIPE – POTABLE WATER	
SLEEVE – EXISTING	
SLEEVE – NEW	
BACKFLOW PREVENTION ASSEMBLY – DOUBLE CHECK TYPE	
BACKFLOW PREVENTION ASSEMBLY – REDUCED PRESSURE	
VACUUM BREAKER ASSEMBLY – ATMOSPHERIC TYPE	
VACUUM BREAKER ASSEMBLY – PRESSURE TYPE	
PRESSURE REGULATOR	
PRESSURE RELIEF	
PUMP	
Y-STRAINER	
THRUST BLOCK	
ANGLE VALVE	
GATE VALVE	
QUICK COUPLER VALVE – ABOVE GRADE	
QUICK COUPLER VALVE – BELOW GRADE	
HOSE BIBB	
REMOTE CONTROL VALVE	

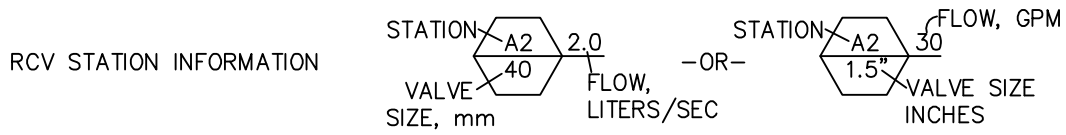

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 2005, 2009

LANDSCAPE IRRIGATION SYMBOLS


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


500-2

SHEET 1 OF 2

SWING JOINT ASSEMBLY –
SINGLE




SWING JOINT ASSEMBLY –
DOUBLE




SHRUB HEAD*

1/4 CIRCLE




1/2 CIRCLE



LAWN HEAD*


1/4 CIRCLE




1/2 CIRCLE




FULL



BUBBLER HEAD




ELECTRICAL METER CABINET



AUTOMATIC CONTROLLER & CABINET




ELECTRICAL CONDUIT




CONTROL WIRES – DIRECT BURIAL



CONTROL WIRES – IN CONDUIT



PULL BOX



*SEE PLANS FOR SYMBOLS USED FOR MULTIPLE TYPES AND SIZES


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

LANDSCAPE IRRIGATION SYMBOLS

STANDARD PLAN

500-2

SHEET 2 OF 2

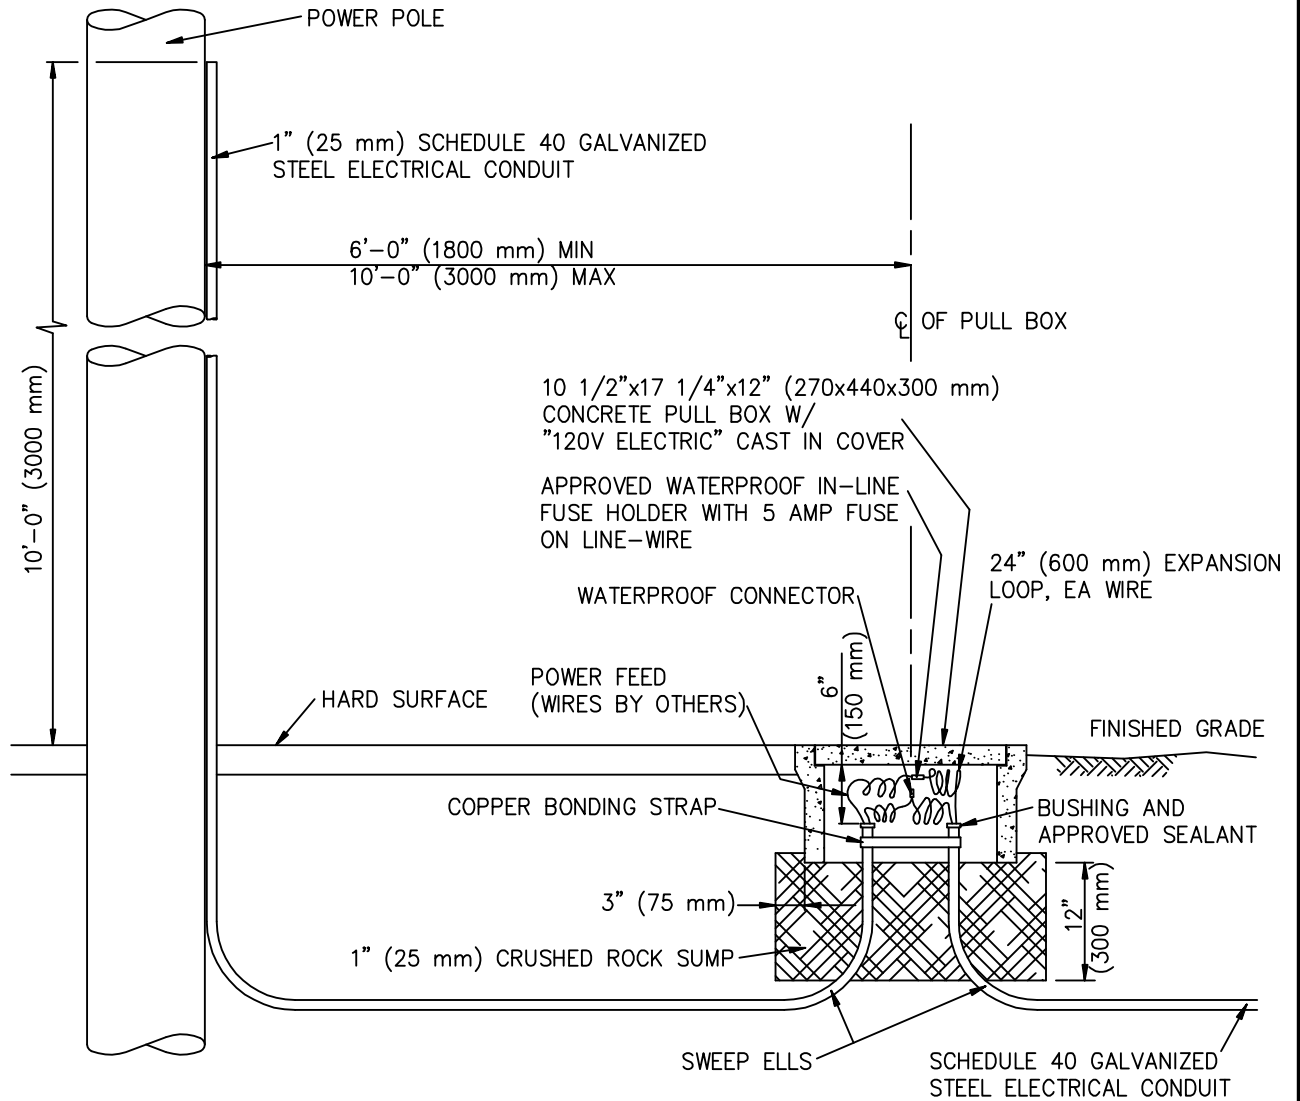

NOTES:

1. AREA AROUND BOX MAY BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF BOX:
 AT GRADE FOR HARD SURFACE
 1/2" (12 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
3. CRUSHED ROCK SHALL COVER ELECTRICAL BOX SIDE OPENINGS TO PREVENT SOIL ENTRY.
4. WATERPROOF CONNECTORS SHALL BE SUBJECT TO ENGINEER'S APPROVAL.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009


ELECTRICAL SERVICE

STANDARD PLAN

501-3


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 3

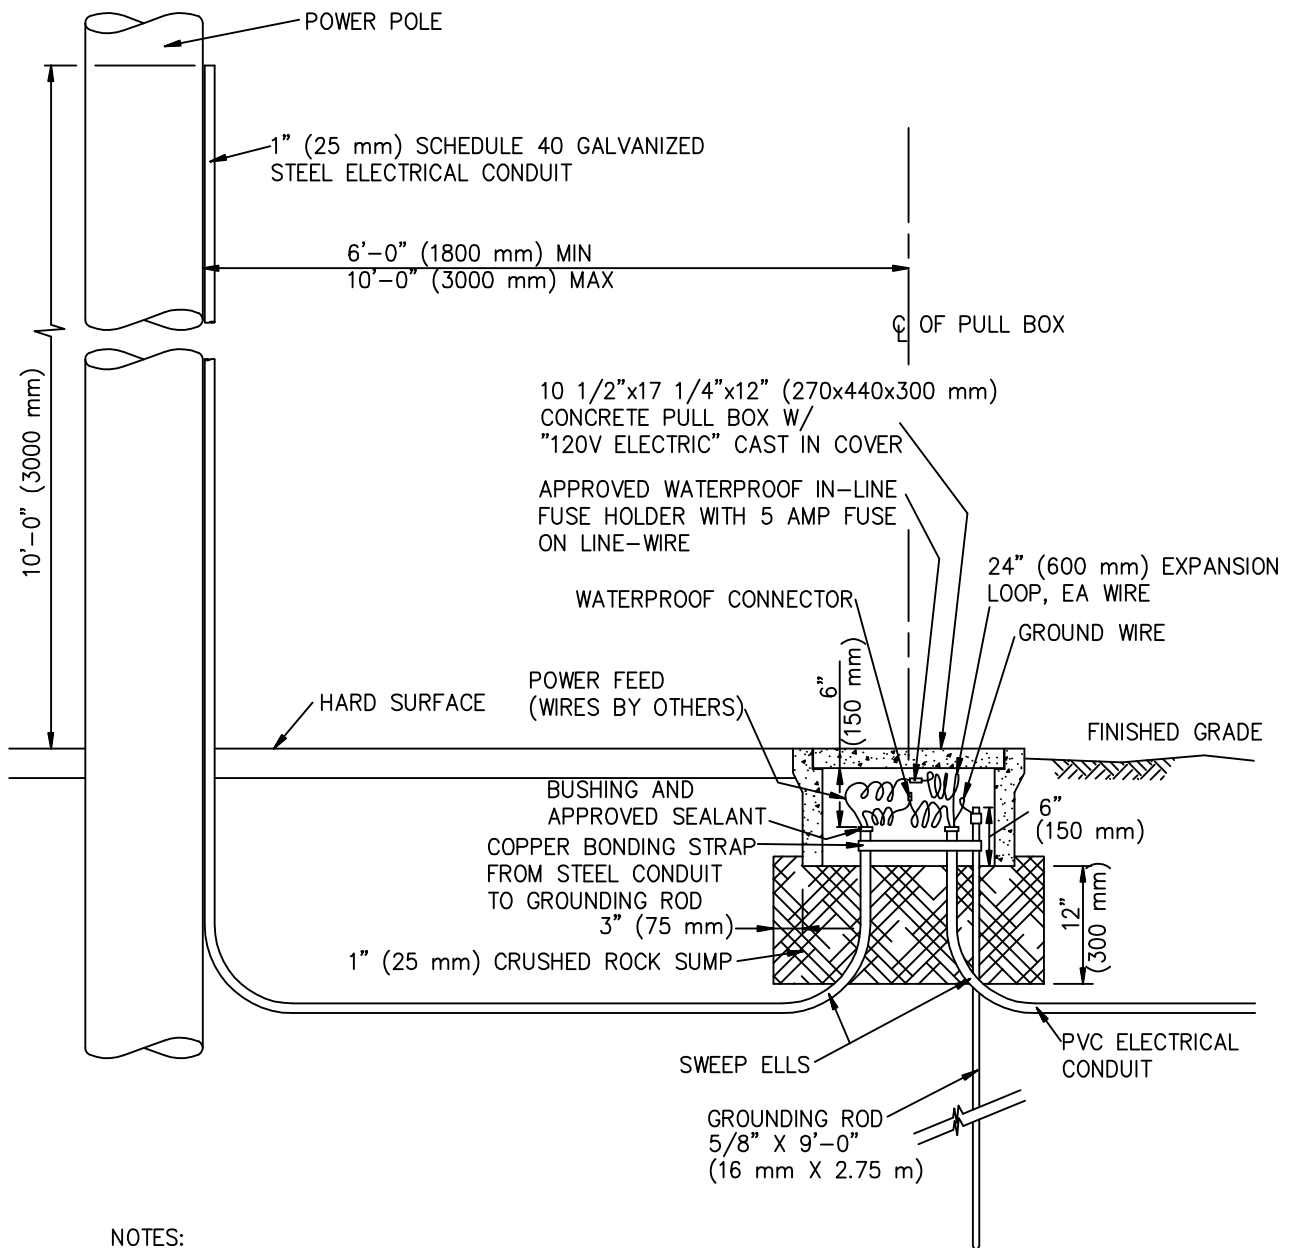

NOTES:

1. AREA AROUND BOX MAY BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF BOX:
AT GRADE FOR HARD SURFACE
1/2" (12 mm) ABOVE GRADE FOR LAWN
1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
3. CRUSHED ROCK SHALL COVER ELECTRICAL BOX SIDE OPENINGS TO PREVENT SOIL ENTRY.
4. WATERPROOF CONNECTORS SHALL BE SUBJECT TO APPROVAL BY THE ENGINEER.
5. GROUND WIRE SHALL BE CONTINUOUS No. 10 COPPER, WRAPPED AROUND AND BONDED TO GROUNDING ROD WITH AN APPROVED CLAMP.
6. GROUNDING ROD SHALL BE COPPER-CLAD STEEL.

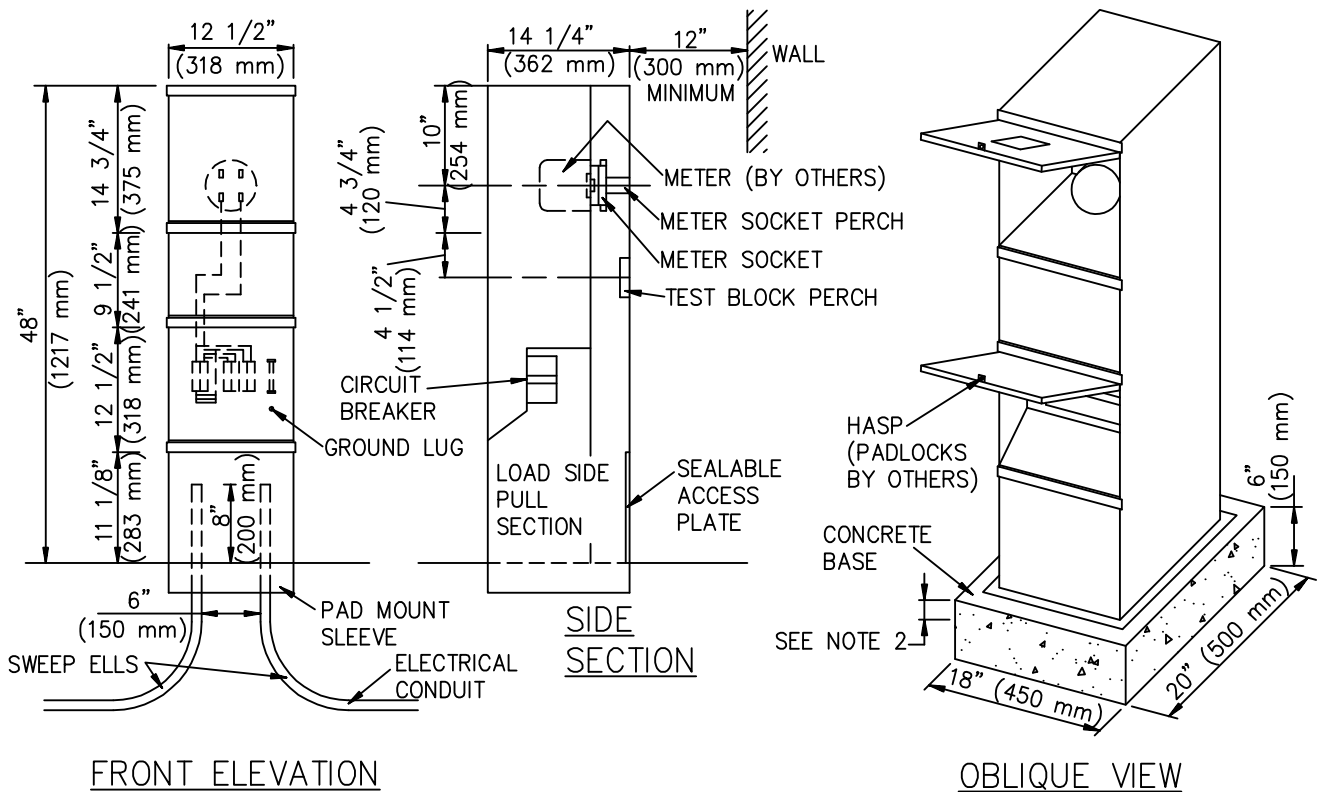


FRONT ELEVATION

OBLIQUE VIEW

NOTES:

1. AREA AROUND BOX MAY BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF CONCRETE BASE:
 AT GRADE FOR HARD SURFACE
 1/2" (12 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
3. CONCRETE BASE SHALL BE CLASS 450-C-2000 (265-C-14)
4. CONTRACTOR SHALL FILL PAD MOUNT WITH 1" (25 mm) CRUSHED ROCK 12" (300 mm) DEEP.
5. MATERIAL (UNLESS OTHERWISE NOTED):
 BODY - 12 GAGE (2.75 mm) GALVANIZED STEEL. DEAD FRONT AND COVERS -
 16 GAGE (1.61 mm) GALVANIZED STEEL. FINISH - IRON PHOSPHATE DIP,
 ZINC CHROMATE PRIME, GREEN BAKED ENAMEL SURFACE.
6. CABINET SHALL INCLUDE 2 POLE MAIN CIRCUIT BREAKER, 100 A.

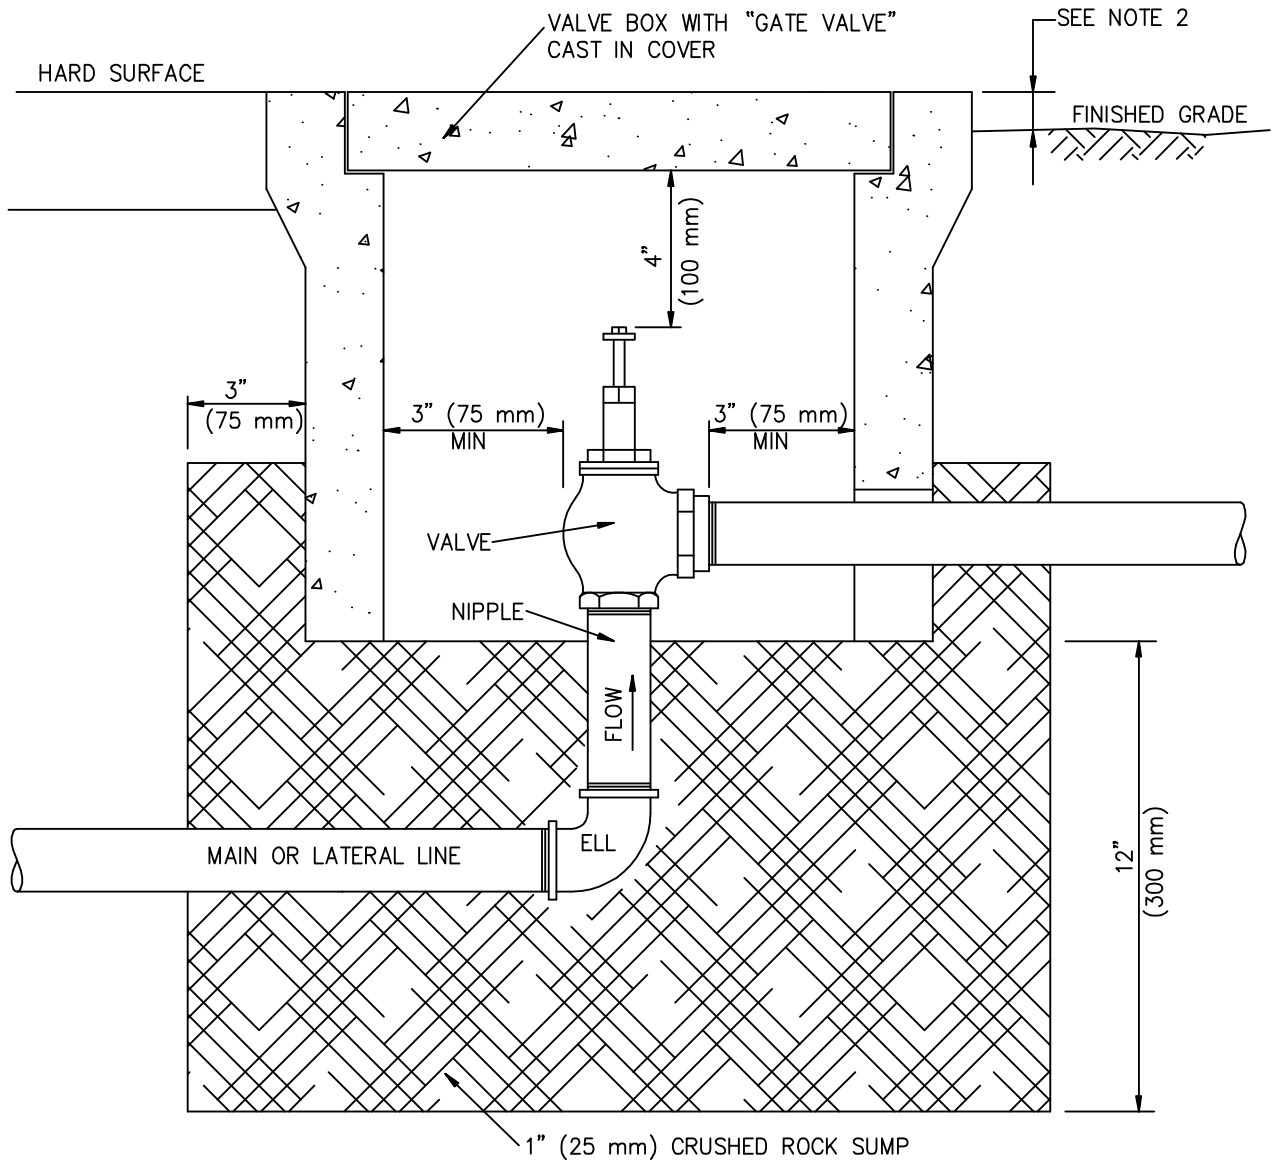

NOTES:

1. AREA AROUND BOX MAY BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF BOX:
 AT GRADE FOR HARD SURFACE
 1/2" (12 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
3. CLOSE NIPPLES SHALL NOT BE USED.
4. CRUSHED ROCK SHALL COVER VALVE BOX PIPE OPENINGS TO PREVENT SOIL ENTRY.

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009


ANGLE VALVE

STANDARD PLAN

502-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 1

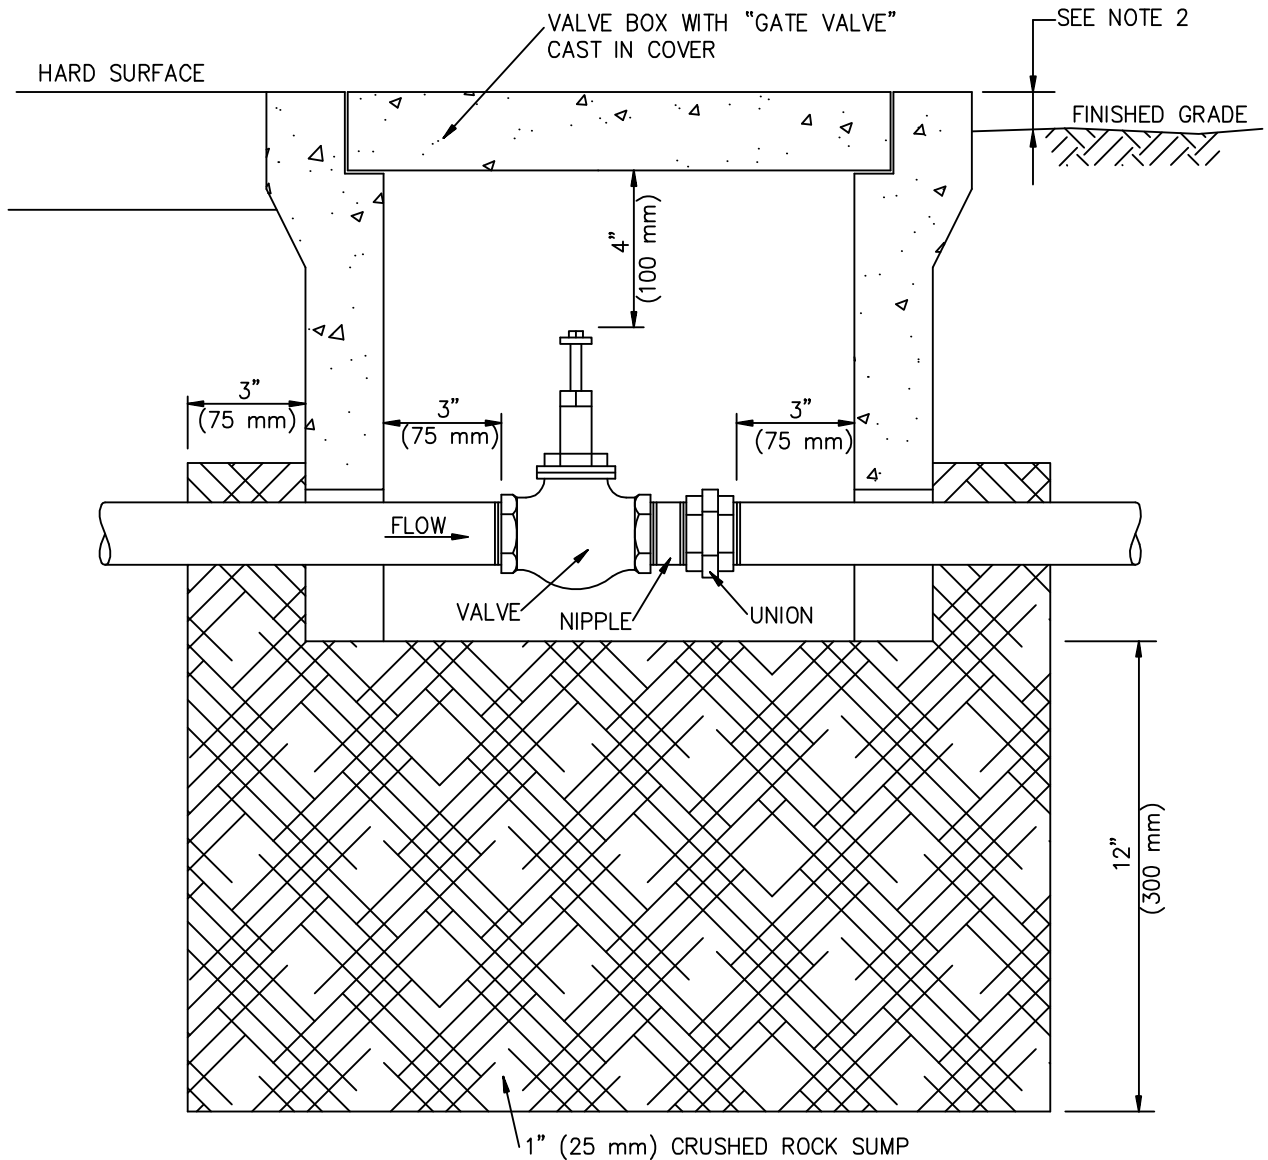

NOTES:

1. AREA AROUND BOX MAY BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF BOX:
 AT GRADE FOR HARD SURFACE
 1/2" (12 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
3. CLOSE NIPPLES SHALL NOT BE USED.
4. CRUSHED ROCK SHALL COVER VALVE BOX PIPE OPENINGS TO PREVENT SOIL ENTRY.

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009


GATE VALVE

STANDARD PLAN


503-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 1

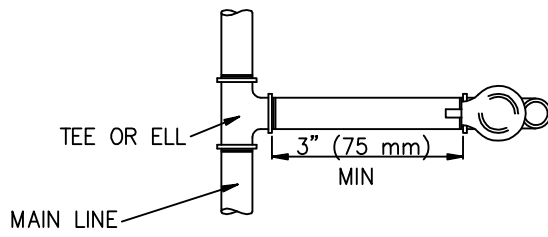

PLAN

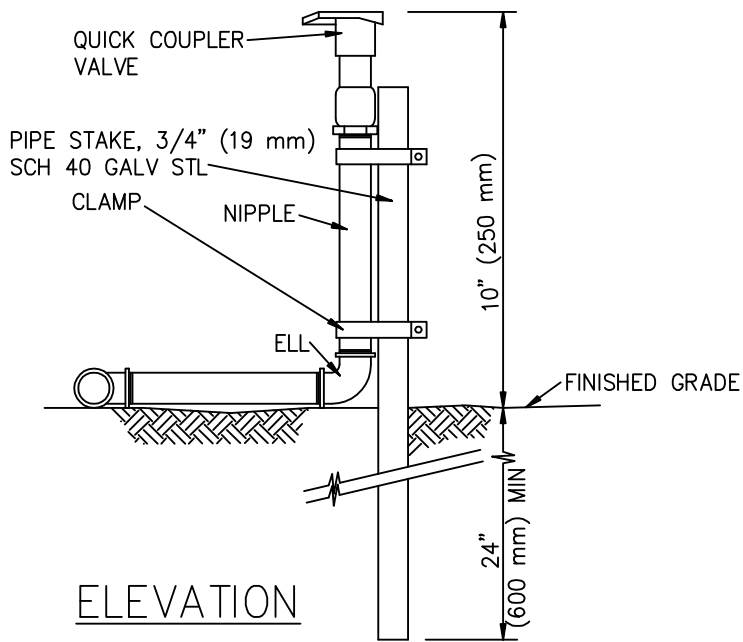


ELEVATION

NOTES:

1. PIPE AND FITTINGS SHALL BE SCHEDULE 40 GALVANIZED STEEL.
2. PIPE SIZE FROM MAIN LINE SHALL MATCH QUICK COUPLER INLET DIAMETER.
3. DISSIMILAR METALS SHALL BE SEPARATED BY AN APPROVED DIELECTRIC COUPLING.
4. CLAMPS SHALL BE STEEL (COMMERCIAL QUALITY, GALVANIZED OR CADMIUM PLATED) OR STAINLESS STEEL.
5. PLASTIC PIPE SHALL NOT BE USED ABOVE FINISHED GRADE.

ABOVE-GRADE PIPING INSTALLATION

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2005, 2009


QUICK COUPLER VALVE

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

504-3

SHEET 1 OF 2

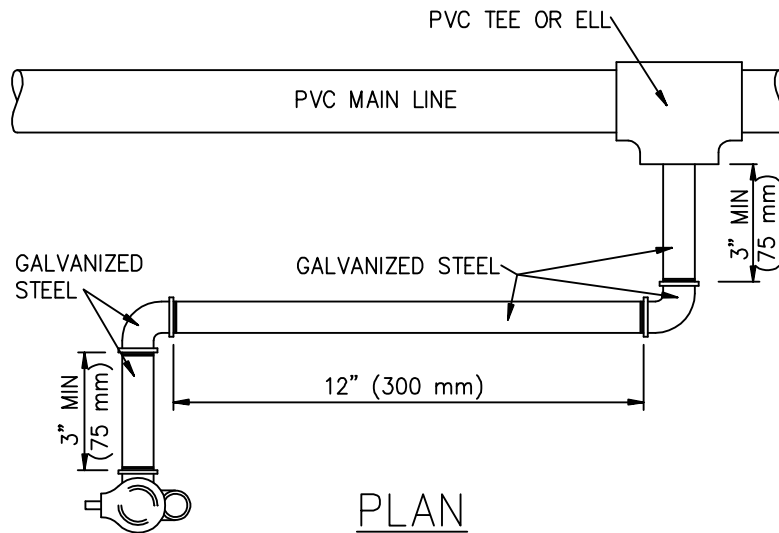

PLAN

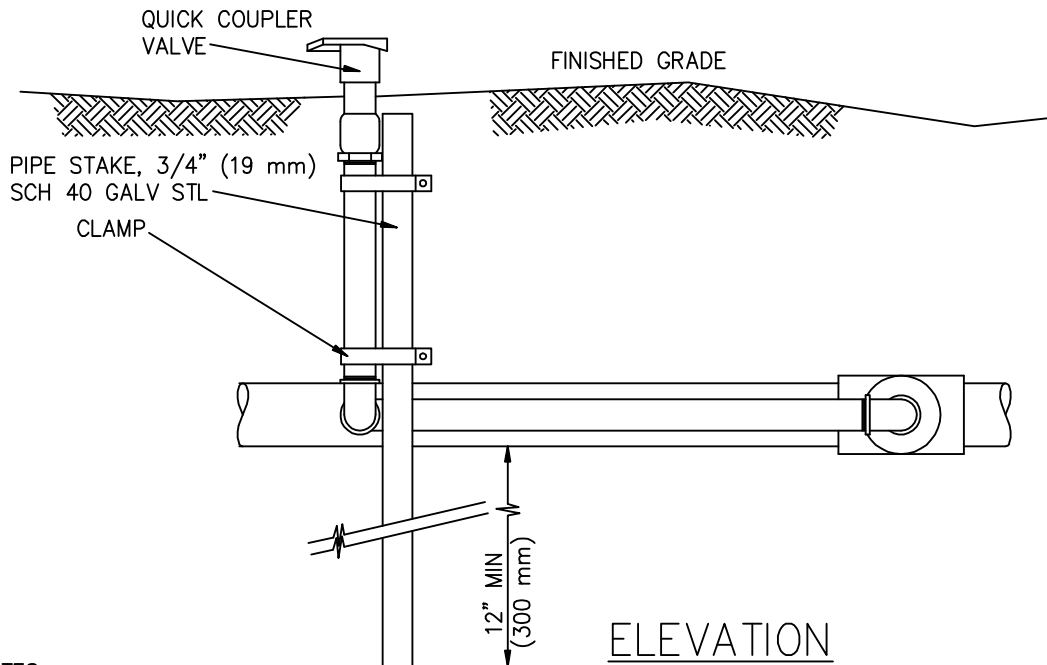


ELEVATION

NOTES:

1. GALVANIZED STEEL PIPE AND FITTINGS SHALL BE SCHEDULE 40. PVC PIPE AND FITTINGS SHALL BE SCHEDULE 80.
2. VALVE IN LAWN AREAS SHALL BE SET AT GRADE. IN SHRUB AREAS, VALVE SHALL BE SET 4" (100 mm) ABOVE FINISHED GRADE.
2. PIPE SIZE FROM MAIN LINE SHALL MATCH QUICK COUPLER INLET DIAMETER.
3. DISSIMILAR METALS SHALL BE SEPARATED BY AN APPROVED DIELECTRIC COUPLING.
4. CLAMPS SHALL BE STEEL (COMMERCIAL QUALITY, GALVANIZED OR CADMIUM PLATED) OR STAINLESS STEEL.
5. PLASTIC PIPE SHALL NOT BE USED ABOVE FINISHED GRADE.

BELOW-GRADE PIPING INSTALLATION

SYMBOL ON PLAN





STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

QUICK COUPLER VALVE

504-3

SHEET 2 OF 2

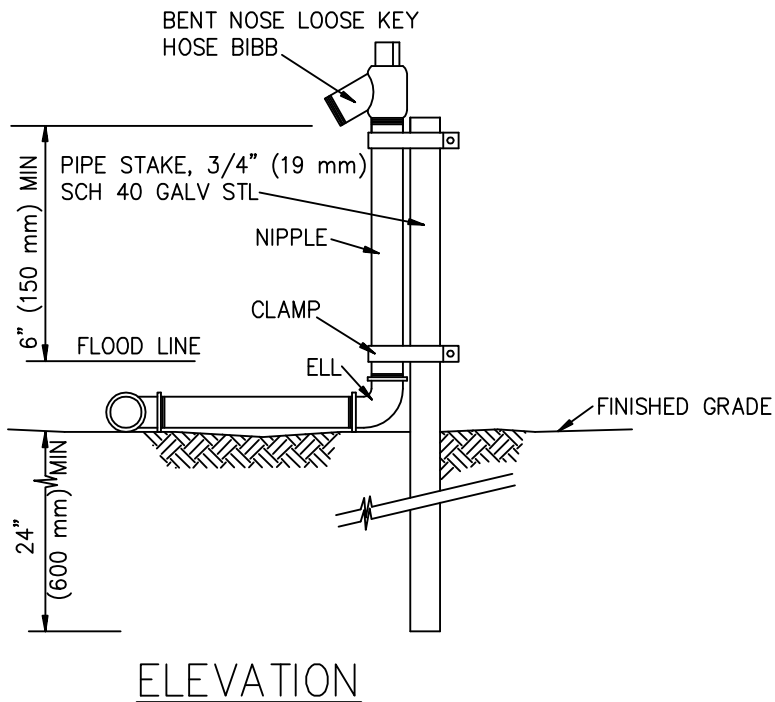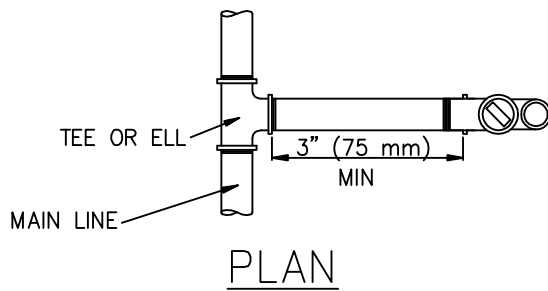


NOTES:

1. PIPE AND FITTINGS SHALL BE SCHEDULE 40 GALVANIZED STEEL.
2. PIPE SIZE FROM MAIN LINE SHALL MATCH QUICK COUPLER INLET DIAMETER.
3. DISSIMILAR METALS SHALL BE SEPARATED BY AN APPROVED DIELECTRIC COUPLING.
4. CLAMPS SHALL BE STEEL (COMMERCIAL QUALITY, GALVANIZED OR CADMIUM PLATED) OR STAINLESS STEEL.
5. PLASTIC PIPE SHALL NOT BE USED ABOVE FINISHED GRADE.

ABOVE-GRADE PIPING INSTALLATION

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2005, 2009


HOSE BIBB VALVE

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

505-3

SHEET 1 OF 2

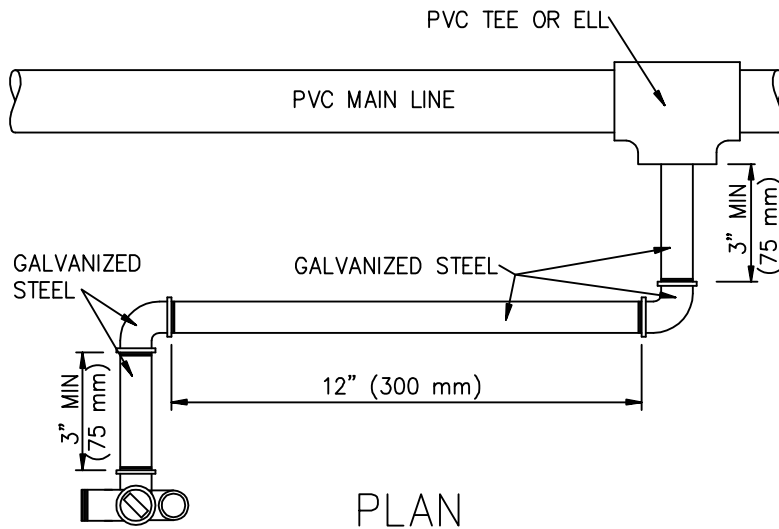

PLAN

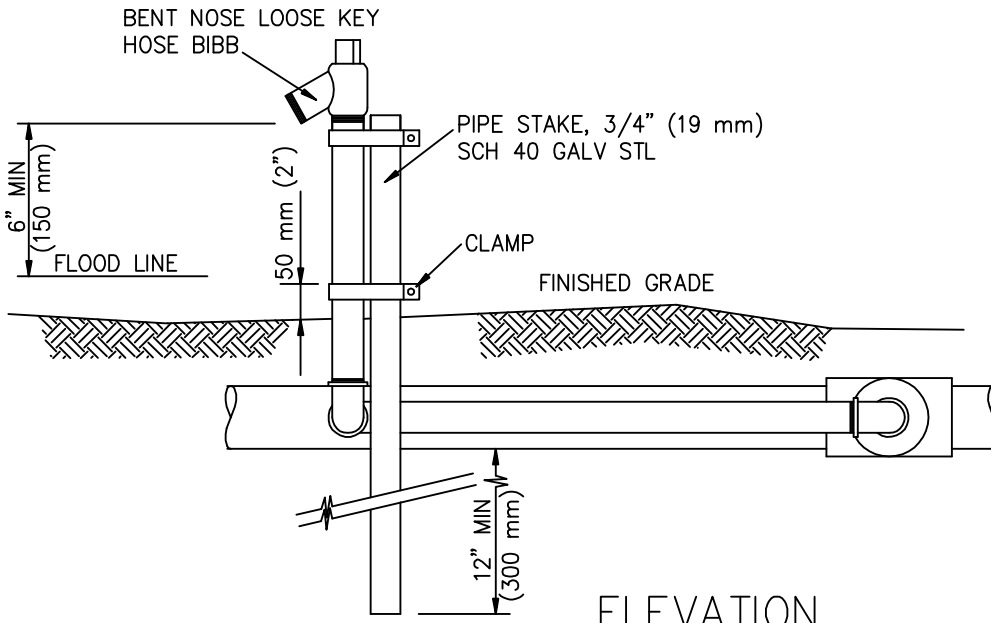


ELEVATION

NOTES:

1. GALVANIZED STEEL PIPE AND FITTINGS SHALL BE SCHEDULE 40. PVC PIPE AND FITTINGS SHALL BE SCHEDULE 80.
2. VALVE IN LAWN AREAS SHALL BE SET AT GRADE. IN SHRUB AREAS, VALVE SHALL BE SET 4" (100 mm) ABOVE FINISHED GRADE.
2. PIPE SIZE FROM MAIN LINE SHALL MATCH QUICK COUPLER INLET DIAMETER.
3. DISSIMILAR METALS SHALL BE SEPARATED BY AN APPROVED DIELECTRIC COUPLING.
4. CLAMPS SHALL BE STEEL (COMMERCIAL QUALITY, GALVANIZED OR CADMIUM PLATED) OR STAINLESS STEEL.
5. PLASTIC PIPE SHALL NOT BE USED ABOVE FINISHED GRADE.

BELOW-GRADE PIPING INSTALLATION

SYMBOL ON PLAN




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

HOSE BIBB VALVE

505-3

SHEET 2 OF 2

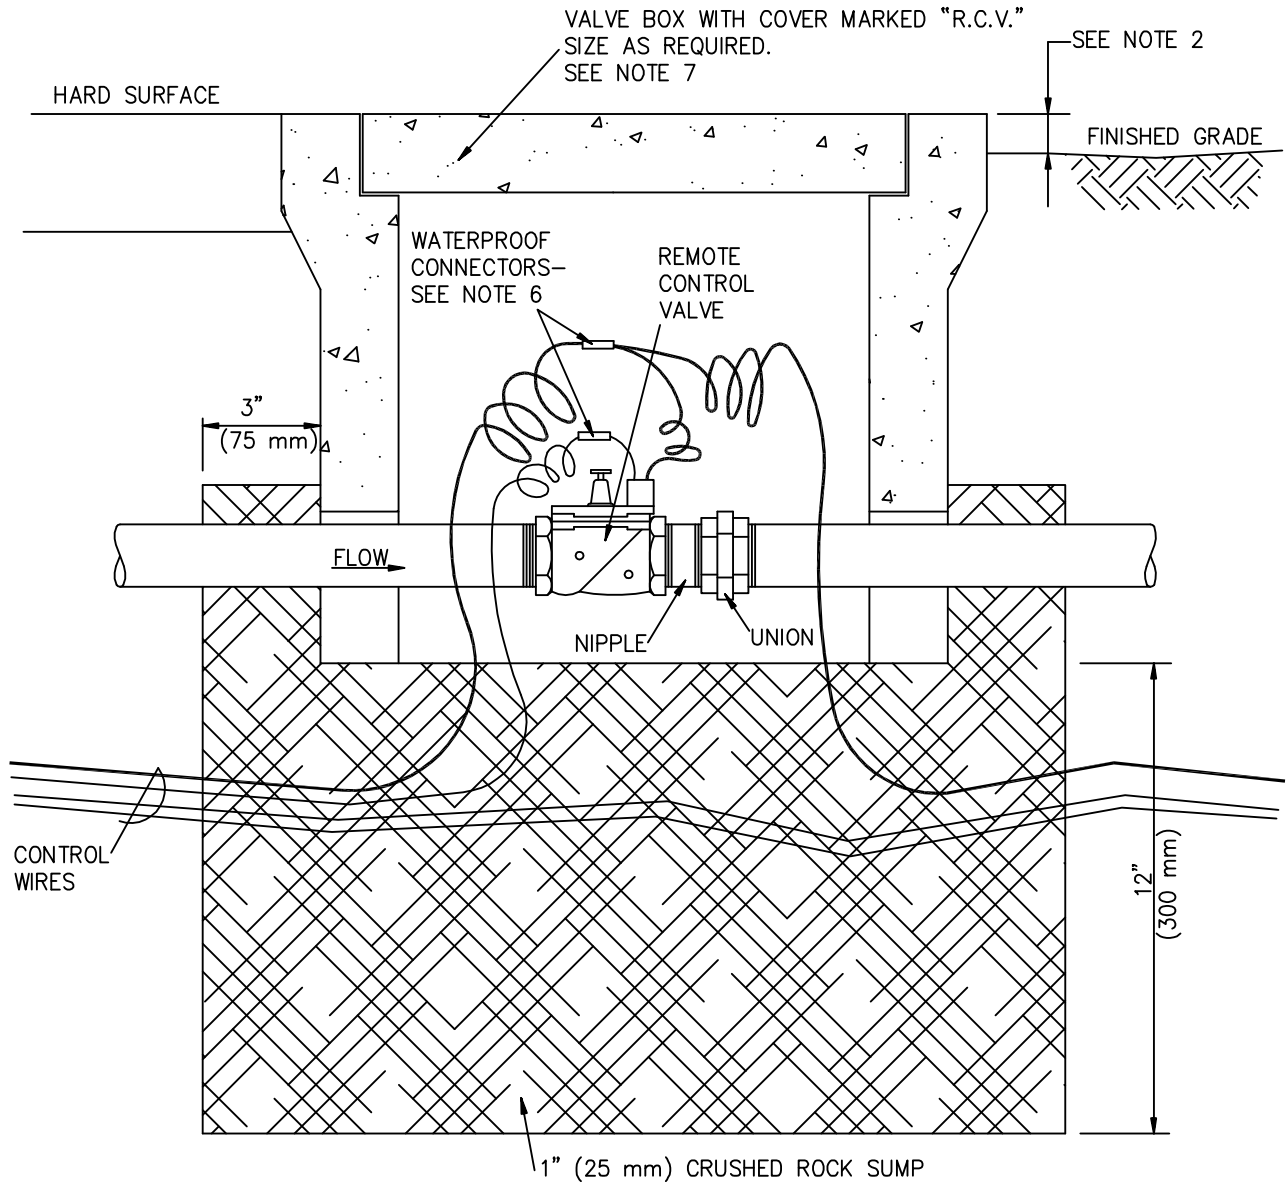

NOTES:

1. AREA AROUND BOX MAY EITHER BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF BOX:
 AT GRADE FOR HARD SURFACE
 1/2" (12 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
3. CLOSE NIPPLES SHALL NOT BE USED.
4. CRUSHED ROCK SHALL COVER VALVE BOX PIPE OPENINGS TO PREVENT SOIL ENTRY.
5. PIPE AND FITTINGS SHALL BE SCHEDULE 80 PVC.
6. WATERPROOF CONNECTORS SHALL BE SUBJECT TO ENGINEER'S APPROVAL.
7. VALVE BOX SHALL BE AS SPECIFIED, EITHER:
 CASE 1—CONCRETE BOX w/ CONCRETE COVER
 CASE 2—CONCRETE BOX w/ LOCKING CAST IRON COVER
 CASE 3—PLASTIC BOX w/ LOCKING PLASTIC COVER
8. PROVIDE 24" (600 mm) EXPANSION LOOP FOR EACH CONTROL WIRE IN BOX.

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009


REMOTE CONTROL VALVE

STANDARD PLAN

506-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 1

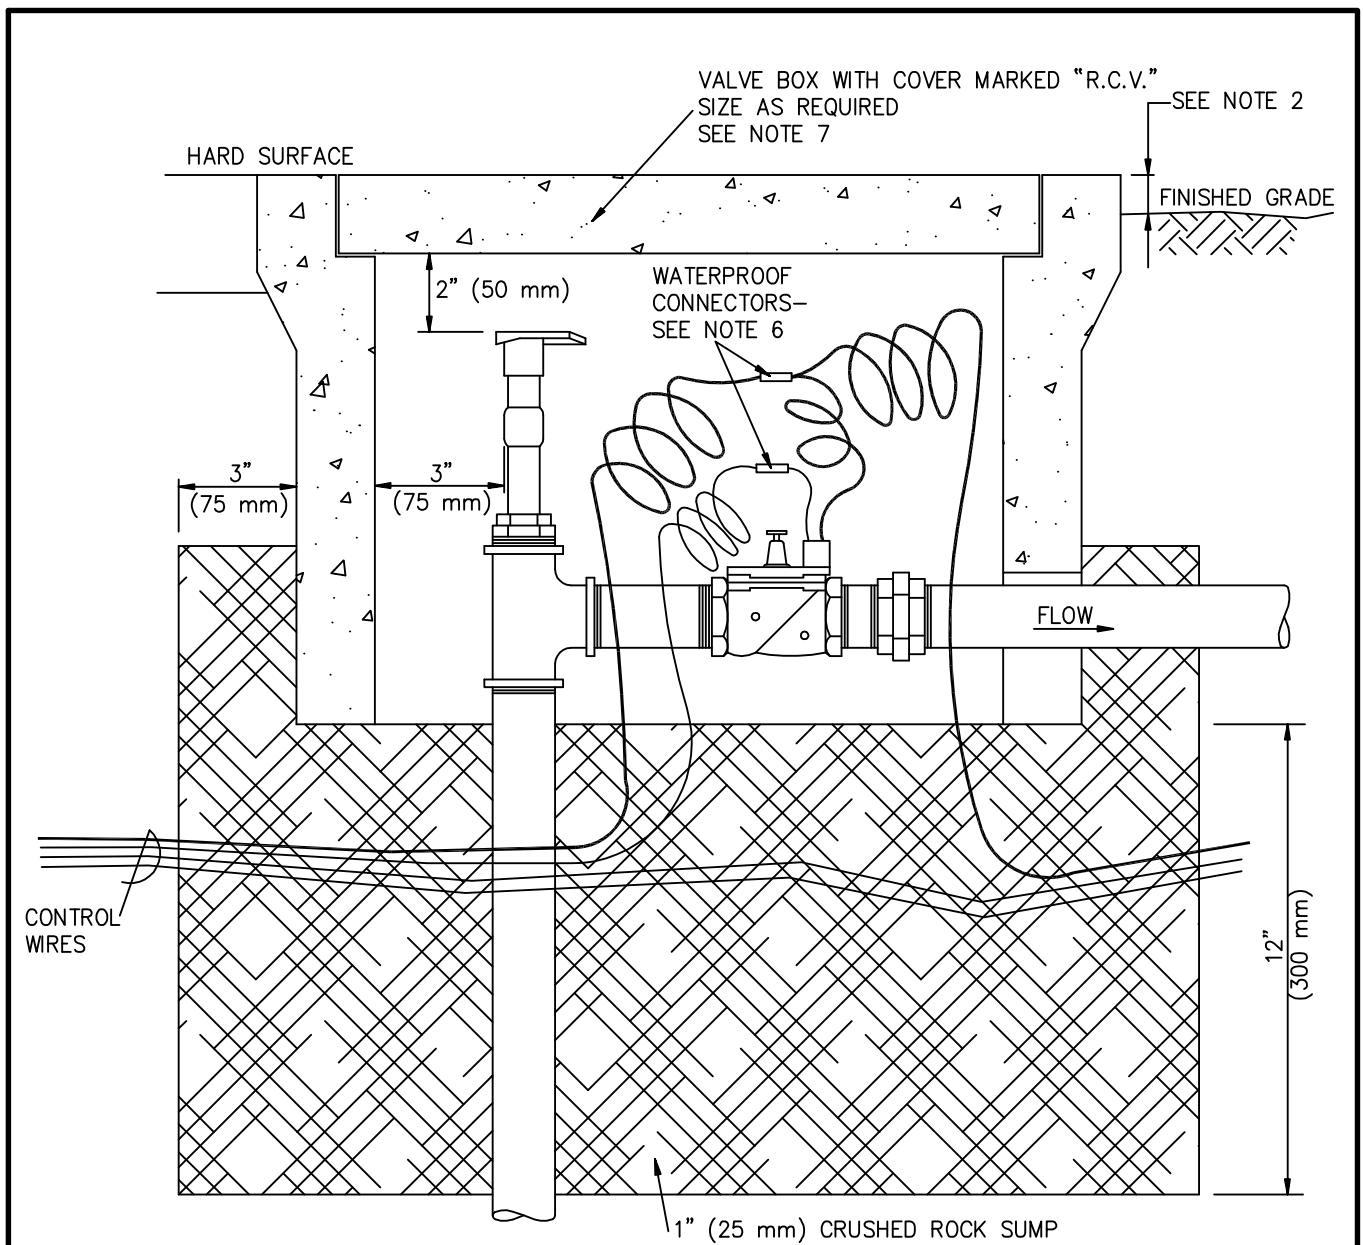

NOTES:

1. AREA AROUND BOX MAY EITHER BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF BOX:
 AT GRADE FOR HARD SURFACE
 1/2" (12 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
3. CLOSE NIPPLES SHALL NOT BE USED.
4. CRUSHED ROCK SHALL COVER VALVE BOX PIPE OPENINGS TO PREVENT SOIL ENTRY.
5. PIPE AND FITTINGS SHALL BE SCHEDULE 80 PVC.
6. WATERPROOF CONNECTORS SHALL BE SUBJECT TO ENGINEER'S APPROVAL.
7. VALVE BOX SHALL BE AS SPECIFIED, EITHER:
 CASE 1—CONCRETE BOX w/ CONCRETE COVER
 CASE 2—CONCRETE BOX w/ LOCKING CAST IRON COVER
 CASE 3—PLASTIC BOX w/ LOCKING PLASTIC COVER
8. PROVIDE 24" (600 mm) EXPANSION LOOP FOR EACH CONTROL WIRE IN BOX.

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009


**REMOTE CONTROL VALVE
 WITH QUICK COUPLER**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

507-3


SHEET 1 OF 1

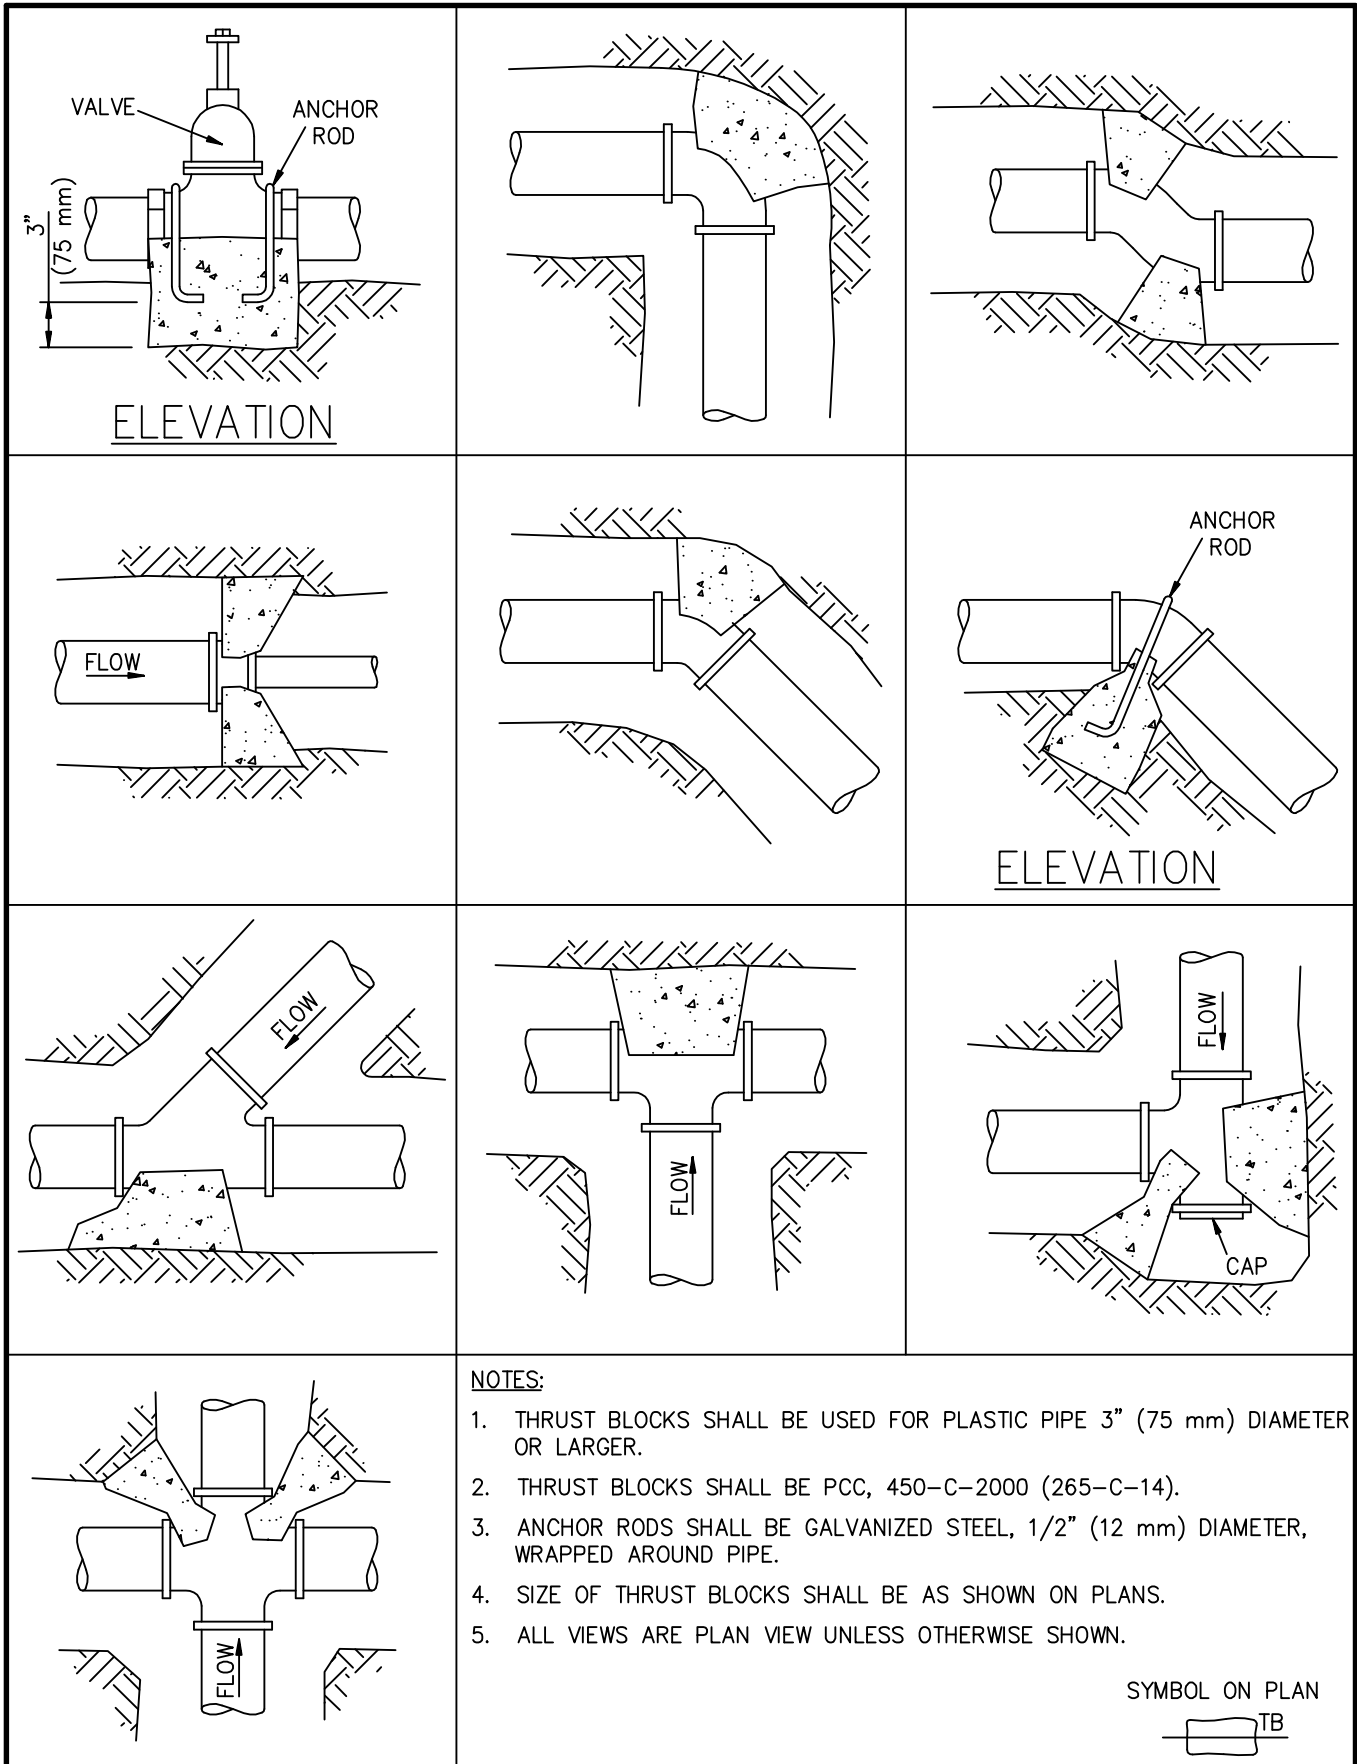

NOTES:

1. THRUST BLOCKS SHALL BE USED FOR PLASTIC PIPE 3" (75 mm) DIAMETER OR LARGER.
2. THRUST BLOCKS SHALL BE PCC, 450-C-2000 (265-C-14).
3. ANCHOR RODS SHALL BE GALVANIZED STEEL, 1/2" (12 mm) DIAMETER, WRAPPED AROUND PIPE.
4. SIZE OF THRUST BLOCKS SHALL BE AS SHOWN ON PLANS.
5. ALL VIEWS ARE PLAN VIEW UNLESS OTHERWISE SHOWN.

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2005, 2009


THRUST BLOCKS FOR PLASTIC PIPE

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

508-3

SHEET 1 OF 1

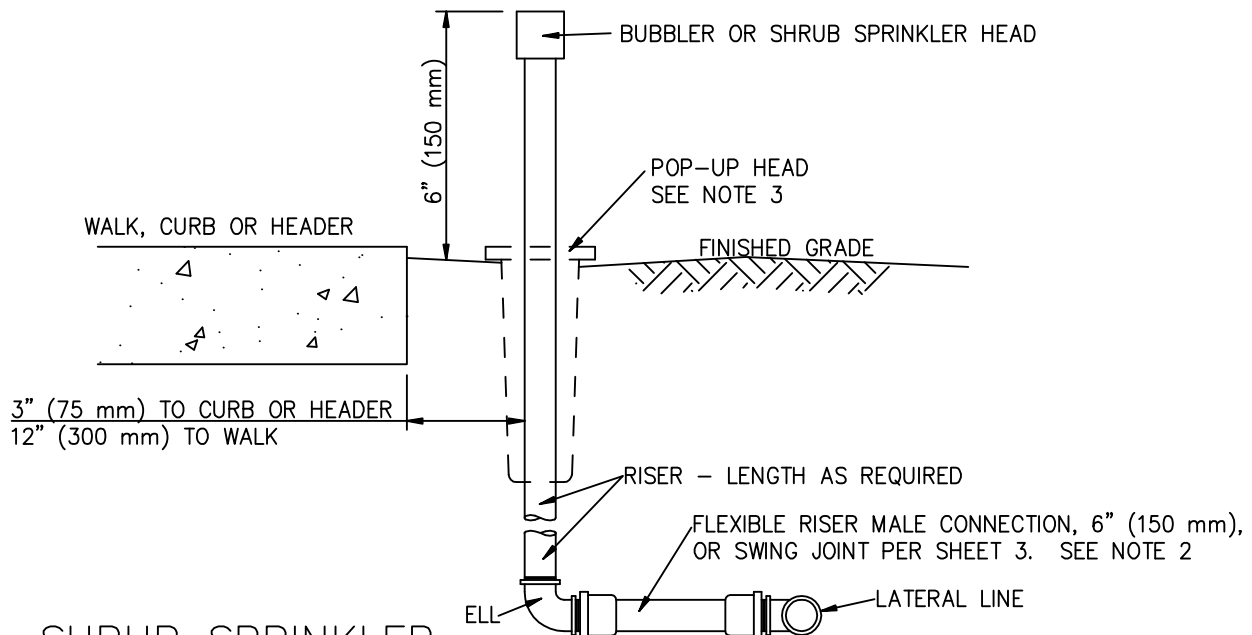

SHRUB SPRINKLER

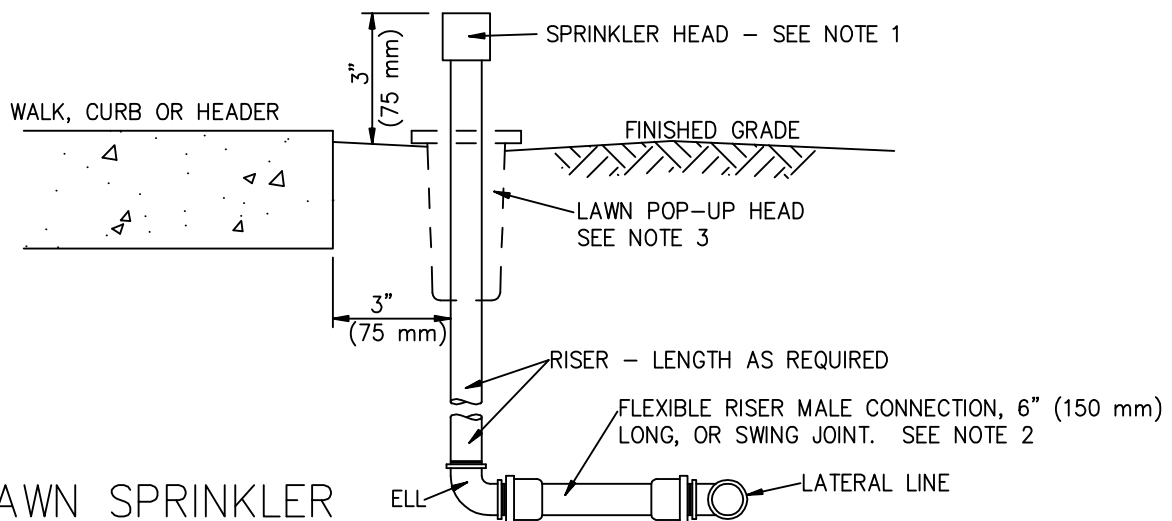

LAWN SPRINKLER

NOTES:

1. PIPE AND FITTINGS SHALL BE SCHEDULE 80 PVC.
2. FLEXIBLE RISERS SHALL BE SUBJECT TO APPROVAL BY THE ENGINEER. CONTRACTOR MAY USE SWING JOINTS PER DETAIL, SHEET 3, INSTEAD OF FLEXIBLE RISERS.
3. INSTALL LAWN HEADS 3" (75 mm) ABOVE GRADE. BEFORE FIRST MOWING, ADJUST NON-POP-UP LAWN HEADS TO FINISHED GRADE.
4. INSTALL POP-UP BODIES 1/4" (10 mm) ABOVE FINISHED GRADE.
5. ELLS AND RISERS SHALL BE MADE OF THE SAME MATERIAL.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2005, 2009


IRRIGATION SPRINKLER HEAD

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

509-3

SHEET 1 OF 3

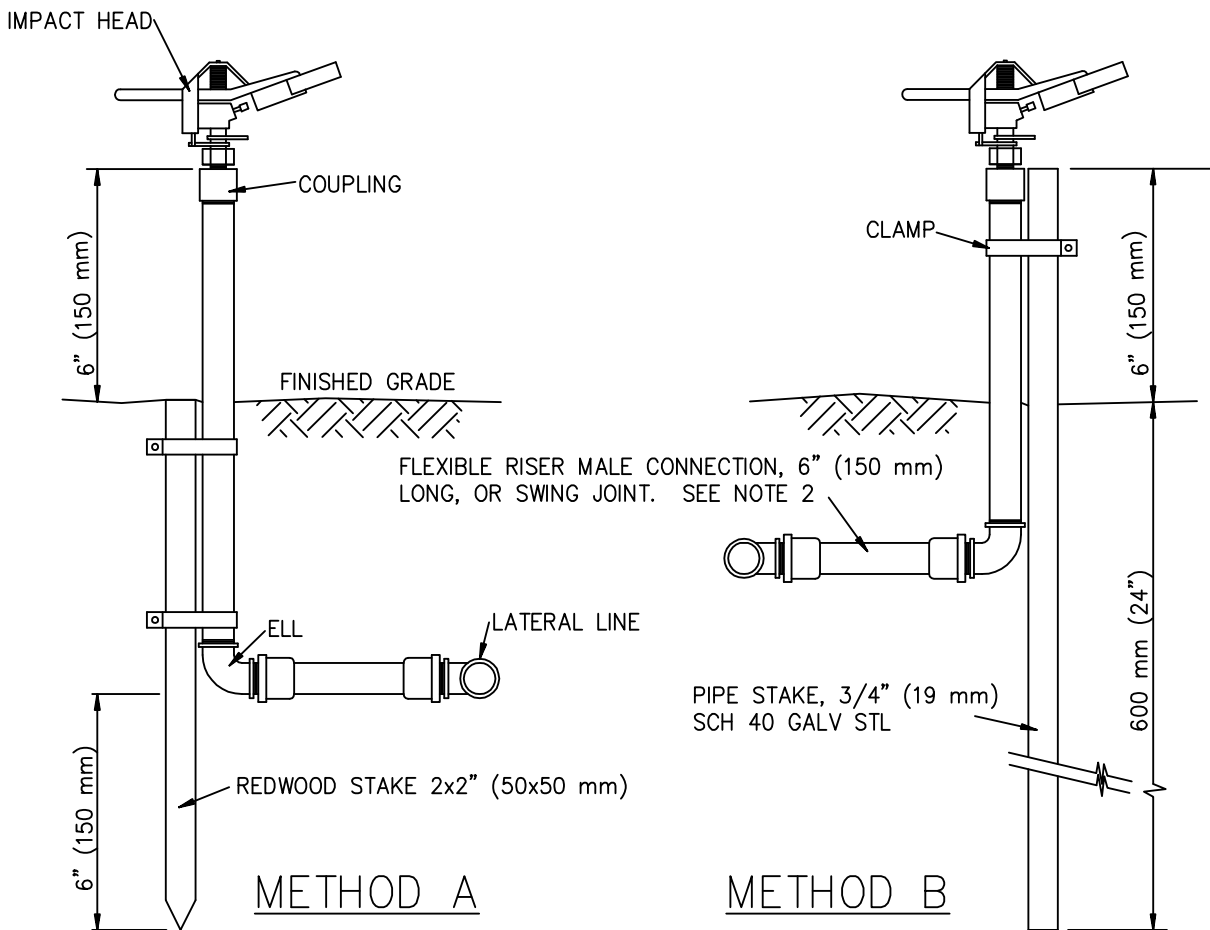

NOTES:

1. PIPE AND FITTINGS SHALL BE SCHEDULE 40 GALVANIZED STEEL.
2. FLEXIBLE RISERS SHALL BE SUBJECT TO APPROVAL BY THE ENGINEER. CONTRACTOR MAY USE SWING JOINTS PER DETAIL, SHEET 3, INSTEAD OF FLEXIBLE RISERS.
3. DISSIMILAR METALS SHALL BE SEPARATED BY AN APPROVED DIELECTRIC COUPLING.
4. CLAMPS SHALL BE STEEL (COMMERCIAL QUALITY, GALVANIZED OR CADMIUM PLATED) OR STAINLESS STEEL.
5. PLASTIC PIPE SHALL NOT BE USED ABOVE FINISHED GRADE.

IMPACT SPRINKLER



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

IRRIGATION SPRINKLER HEAD

STANDARD PLAN

509-3

SHEET 2 OF 3

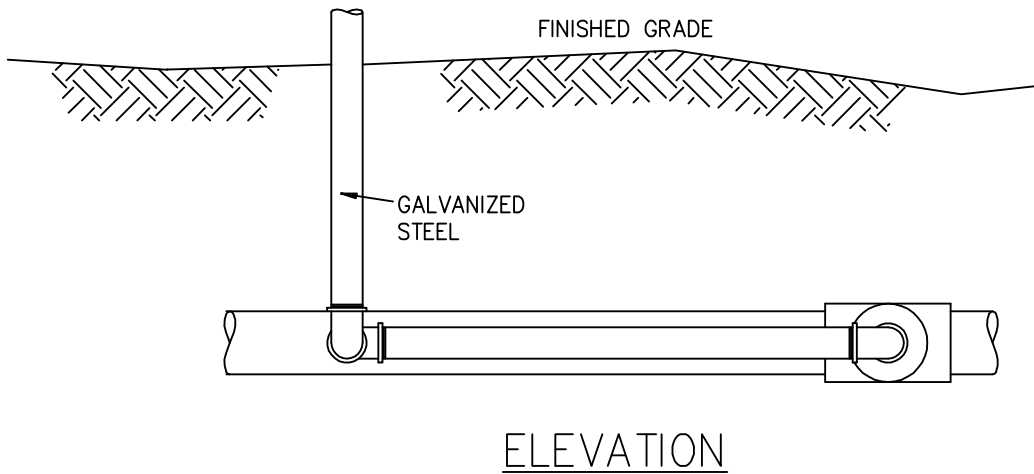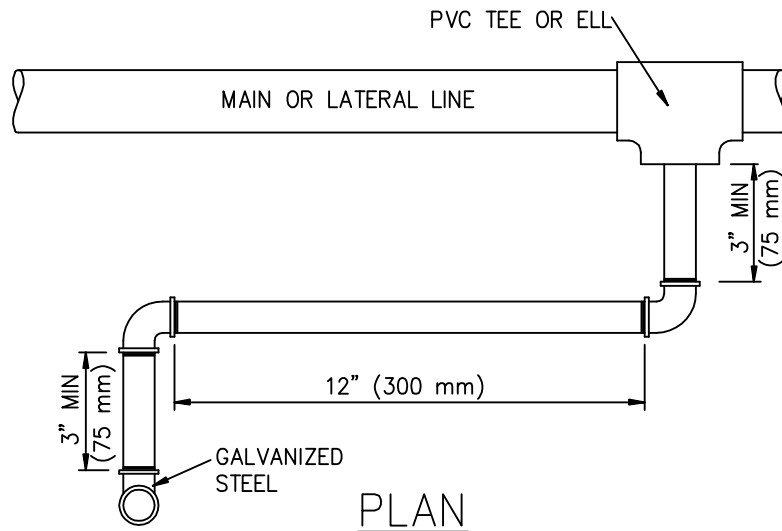

NOTES:

PIPE AND FITTINGS SHALL BE SCHEDULE 80 PVC UNLESS SHOWN OTHERWISE. GALVANIZED STEEL PIPE AND FITTINGS SHALL BE SCHEDULE 40.

SWING JOINT DETAIL


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

IRRIGATION SPRINKLER HEAD

STANDARD PLAN

509-3

SHEET 3 OF 3

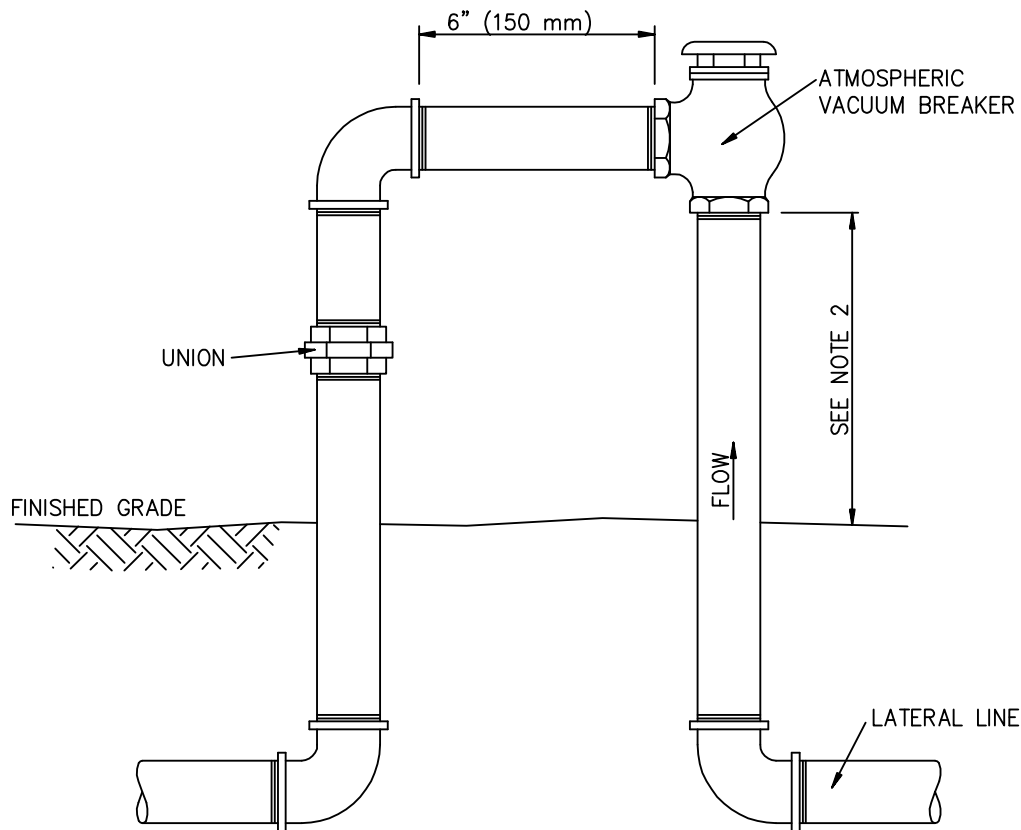


ATMOSPHERIC TYPE, 2" (50 mm) AND SMALLER

NOTES:

1. PIPE AND FITTINGS SHALL BE SCHEDULE 40 GALVANIZED STEEL UNLESS OTHERWISE NOTED.
2. ATMOSPHERIC TYPE VACUUM BREAKER SHALL BE INSTALLED DOWNSTREAM OF CONTROL VALVE AND AT LEAST 6" (150 mm) ABOVE THE HIGHEST OUTLET OR THE FLOOD LINE, WHICHEVER IS HIGHER.
3. DEVICES AND INSTALLATIONS SHALL COMPLY WITH LOCAL HEALTH AND WATER AGENCY REQUIREMENTS.
4. CLOSE NIPPLES SHALL NOT BE USED.
5. USE APPROVED PLASTIC TAPE 1/2" (12 mm) WIDE AT ALL THREADED CONNECTIONS. COAT EXPOSED THREADS WITH APPROVED RUST-INHIBITING SEALANT.

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2005, 2009


VACUUM BREAKER ASSEMBLY

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

510-3

SHEET 1 OF 2

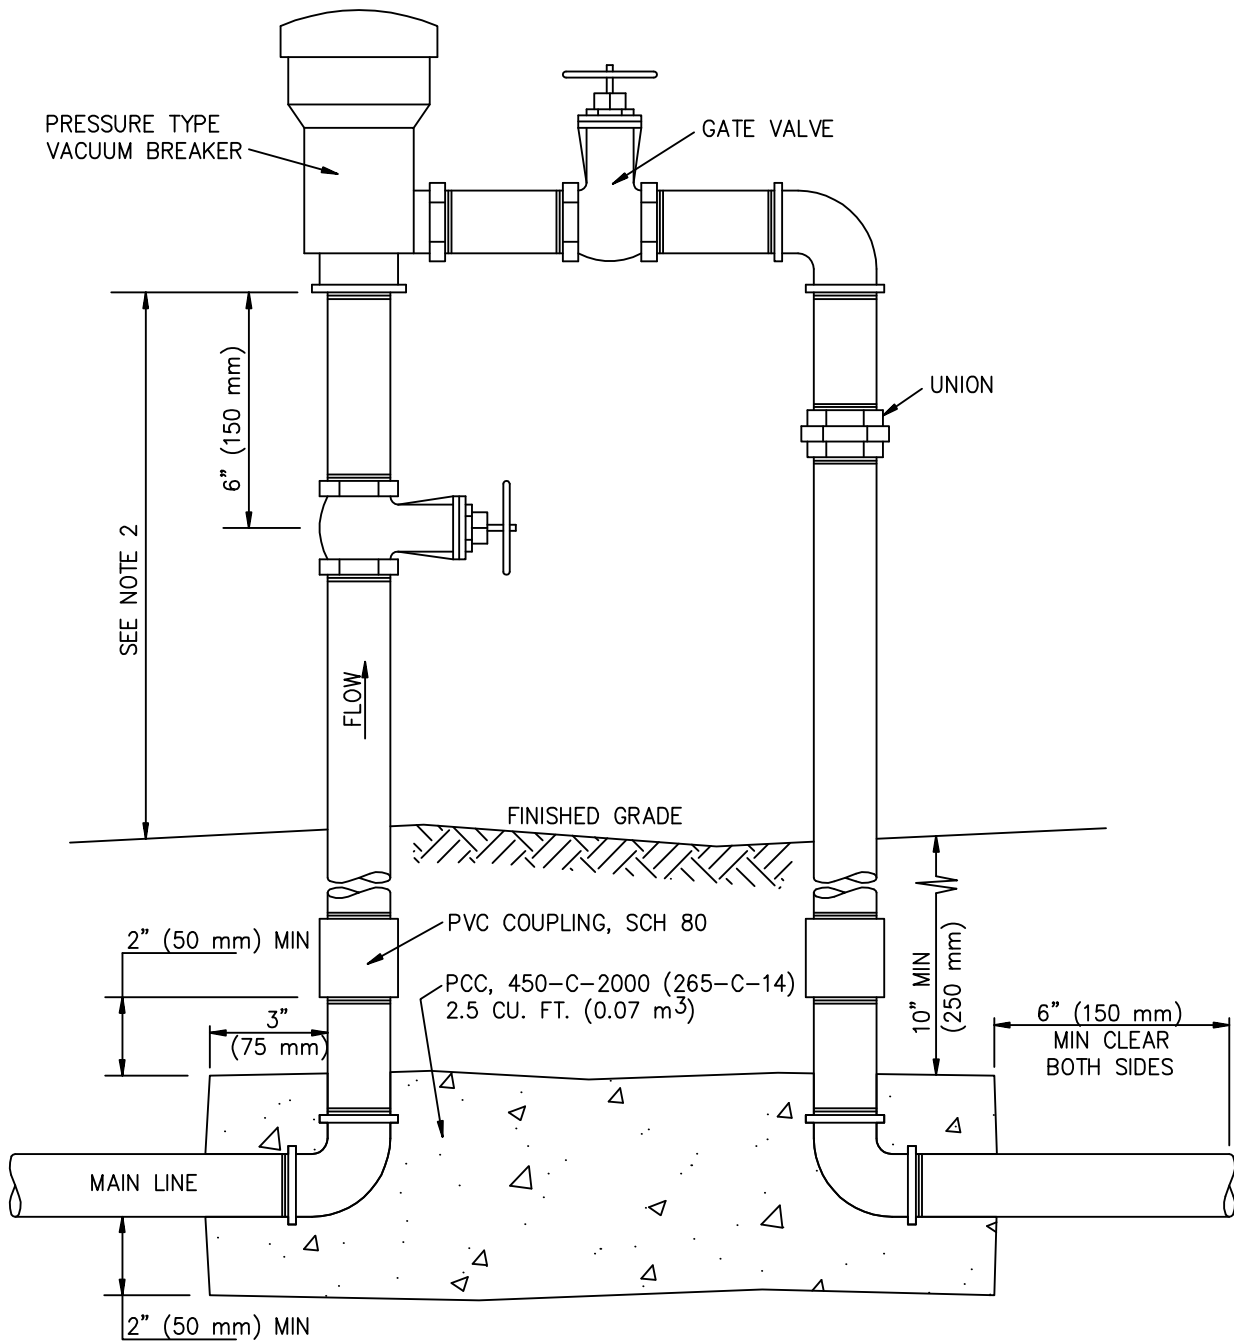

PRESSURE TYPE, 2" (50 mm) AND SMALLER

NOTES:

1. PIPE AND FITTINGS SHALL BE SCHEDULE 40 GALVANIZED STEEL UNLESS OTHERWISE NOTED.
2. PRESSURE TYPE VACUUM BREAKER SHALL BE INSTALLED AT LEAST 12" (300 mm) ABOVE THE HIGHEST OUTLET OR THE FLOOD LINE, WHICHEVER IS HIGHER. PRESSURE TYPE VACUUM BREAKERS SHALL NOT BE SUBJECTED TO BACK PRESSURE OR DRAINAGE.
3. DEVICES AND INSTALLATIONS SHALL COMPLY WITH LOCAL HEALTH AND WATER AGENCY REQUIREMENTS.
4. CLOSE NIPPLES SHALL NOT BE USED.
5. USE APPROVED PLASTIC TAPE 1/2" (12 mm) WIDE AT ALL THREADED CONNECTIONS. COAT EXPOSED THREADS WITH APPROVED RUST-INHIBITING SEALANT.
6. DISSIMILAR METALS SHALL BE SEPARATED BY AN APPROVED DIELECTRIC COUPLING.
7. PLASTIC PIPE SHALL NOT BE USED ABOVE FINISHED GRADE.

SYMBOL ON PLAN




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

VACUUM BREAKER ASSEMBLY

510-3

SHEET 2 OF 2

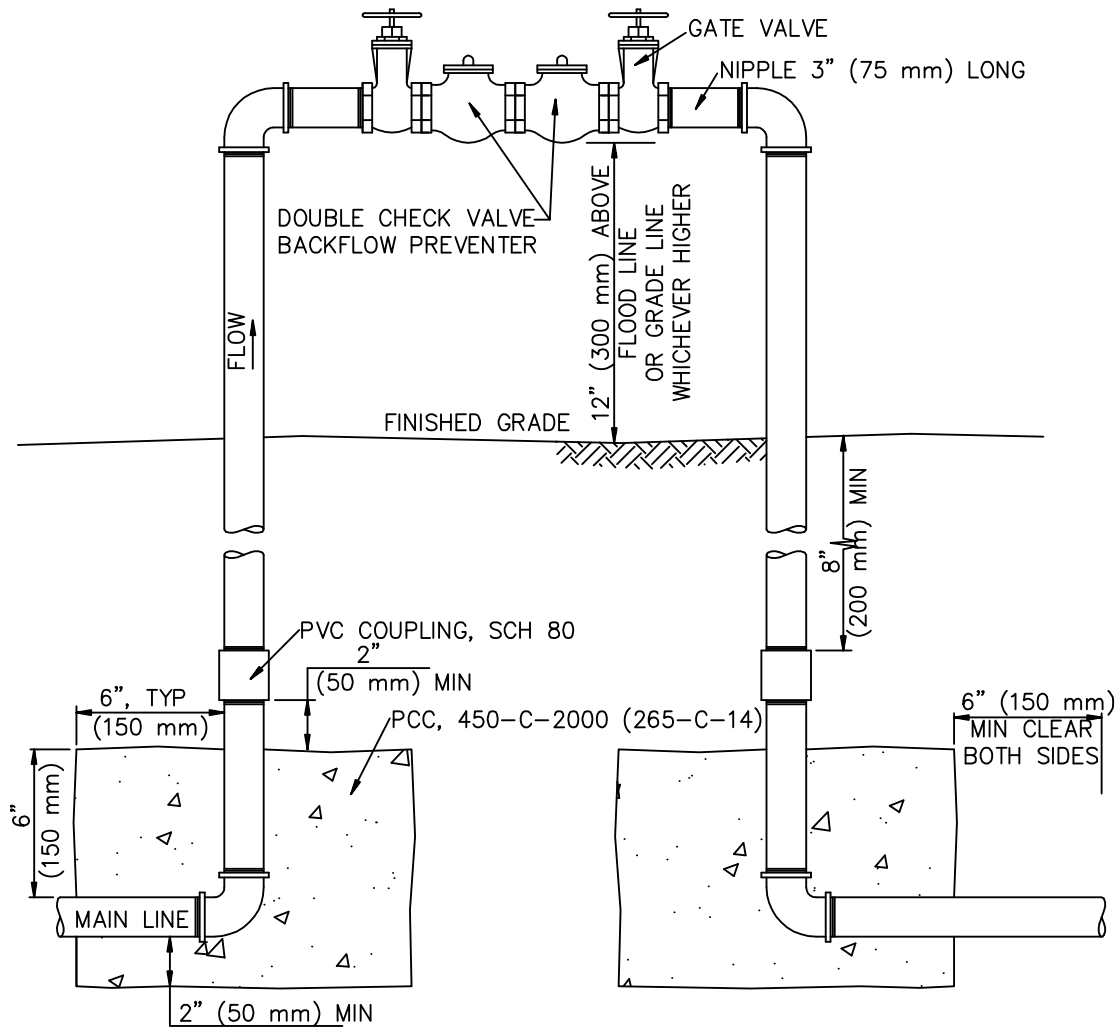

NOTES:

1. PIPE AND FITTINGS SHALL BE SCHEDULE 40 GALVANIZED STEEL UNLESS OTHERWISE NOTED.
2. DEVICES AND INSTALLATIONS SHALL COMPLY WITH LOCAL HEALTH AND WATER AGENCY REQUIREMENTS.
3. VALVE ASSEMBLIES MAY HAVE SCREWED OR FLANGED FITTINGS.
4. USE APPROVED PLASTIC TAPE 1/2" (12 mm) WIDE AT ALL THREADED CONNECTIONS. COAT EXPOSED THREADS WITH APPROVED RUST-INHIBITING SEALANT.
5. DISSIMILAR METALS SHALL BE SEPARATED BY AN APPROVED DIELECTRIC COUPLING.
6. PLASTIC PIPE SHALL NOT BE USED ABOVE FINISHED GRADE.

SYMBOL ON PLAN

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009


**BACKFLOW PREVENTER ASSEMBLY
 DOUBLE CHECK TYPE**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

511-3

SHEET 1 OF 1

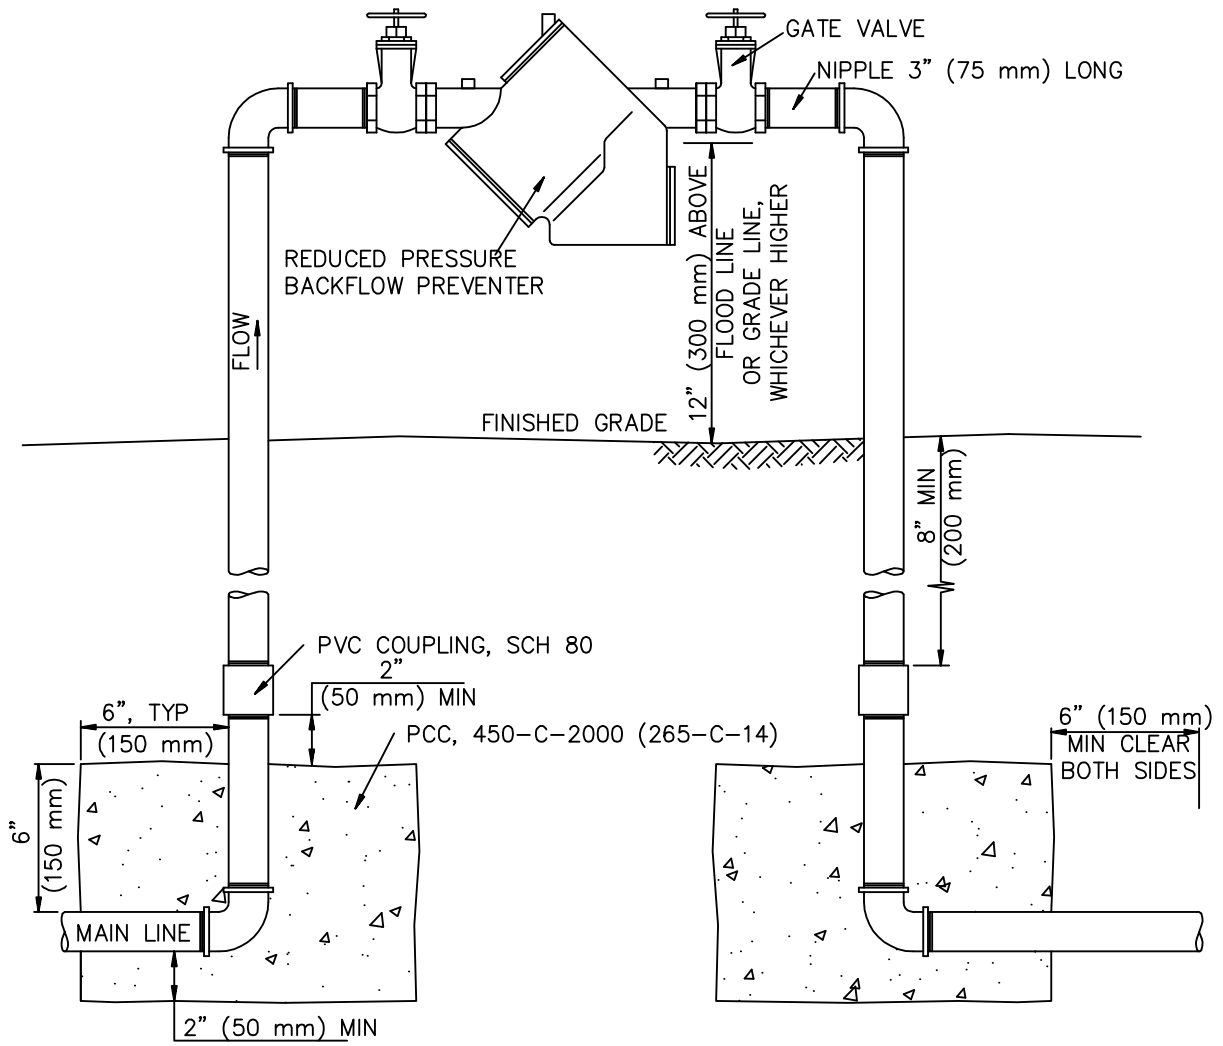


NOTES:


1. PIPE AND FITTINGS SHALL BE SCHEDULE 40 GALVANIZED STEEL UNLESS OTHERWISE NOTED.
2. DEVICES AND INSTALLATIONS SHALL COMPLY WITH LOCAL HEALTH AND WATER AGENCY REQUIREMENTS.
3. VALVE ASSEMBLIES MAY HAVE SCREWED OR FLANGED FITTINGS.
4. USE APPROVED PLASTIC TAPE 1/2" (12 mm) WIDE AT ALL THREADED CONNECTIONS. COAT EXPOSED THREADS WITH APPROVED RUST-INHIBITING SEALANT.
5. DISSIMILAR METALS SHALL BE SEPARATED BY AN APPROVED DIELECTRIC COUPLING.
6. PLASTIC PIPE SHALL NOT BE USED ABOVE FINISHED GRADE.

SYMBOL ON PLAN
 — BPA —

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION		
PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1984 REV. 1996, 2005, 2009	<h2 style="margin: 0;">BACKFLOW PREVENTER ASSEMBLY</h2> <h2 style="margin: 0;">REDUCED PRESSURE TYPE</h2> <p style="margin: 0; font-size: small;">USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION</p>	STANDARD PLAN <h1 style="margin: 0;">512-3</h1> SHEET 1 OF 1

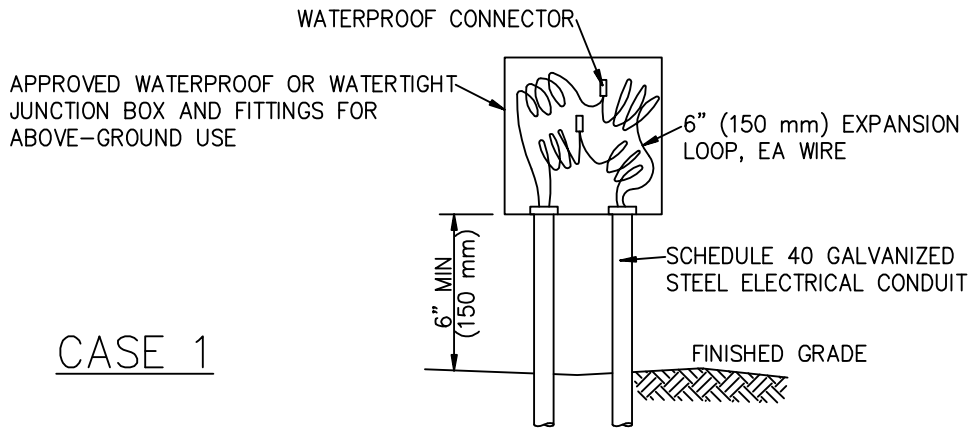

CASE 1

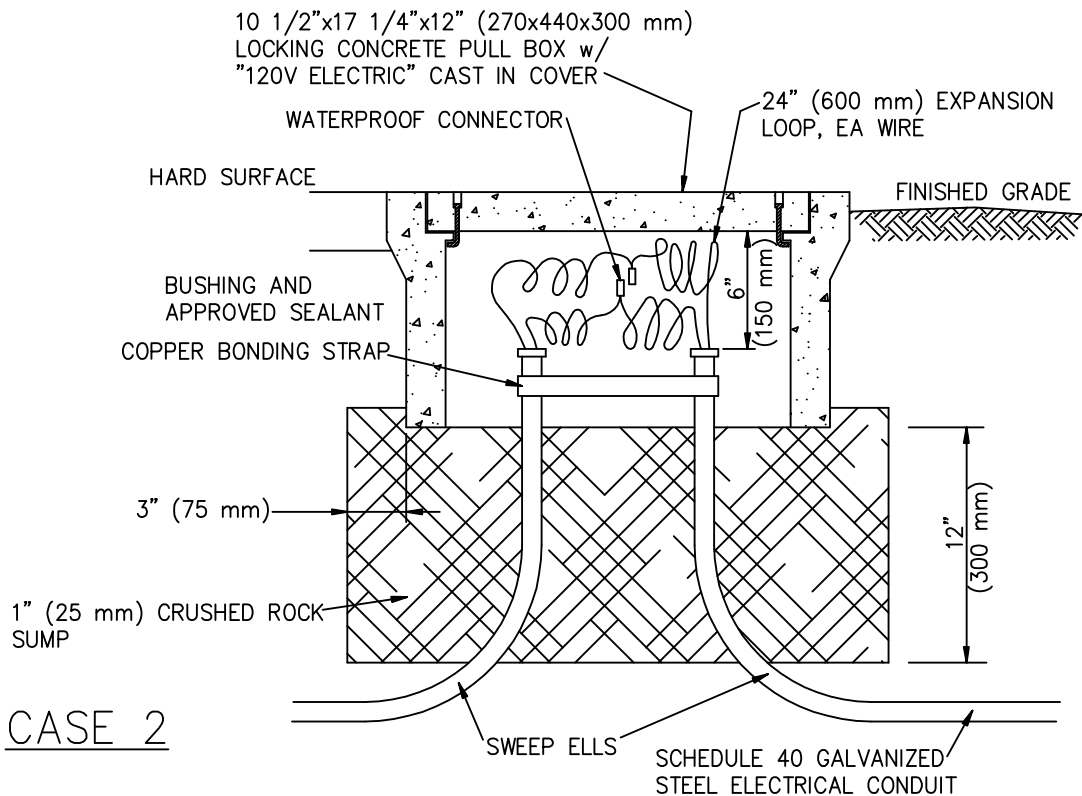


CASE 2

NOTES:

1. AREA AROUND BOX MAY BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF BOX:
 AT GRADE FOR HARD SURFACE
 1/2" (12 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
3. CRUSHED ROCK SHALL COVER ELECTRICAL BOX SIDE OPENINGS TO PREVENT SOIL ENTRY.
4. WATERPROOF CONNECTORS SHALL BE SUBJECT TO ENGINEER'S APPROVAL.
5. PVC CONDUIT MAY BE USED FOR CASE 2 IF APPROPRIATE GROUND WIRES ARE INSTALLED.

HIGH VOLTAGE INSTALLATION

SYMBOL ON PLAN


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009


ELECTRICAL PULL BOX

STANDARD PLAN

513-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 2

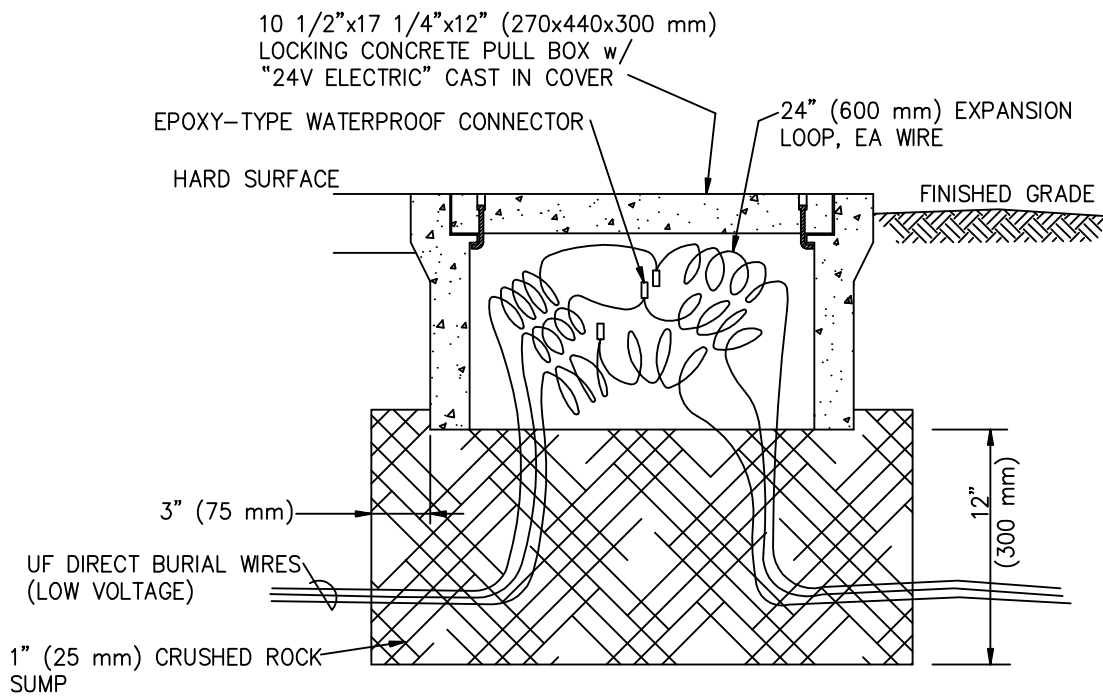


NOTES:

1. AREA AROUND BOX MAY BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF BOX:
 AT GRADE FOR HARD SURFACE
 1/2" (12 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
3. CRUSHED ROCK SHALL COVER ELECTRICAL BOX SIDE OPENINGS TO PREVENT SOIL ENTRY.
4. LOW VOLTAGE WIRES UNDER ROADWAY SHALL BE WITHIN CONTINUOUS CONDUIT WITH 90° SWEEP ELLS TERMINATING WITHIN PULL BOXES. SEE PLANS FOR SIZE AND TYPE OF BOXES.

LOW VOLTAGE INSTALLATION

SYMBOL ON PLAN




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

ELECTRICAL PULL BOX

513-3

SHEET 2 OF 2

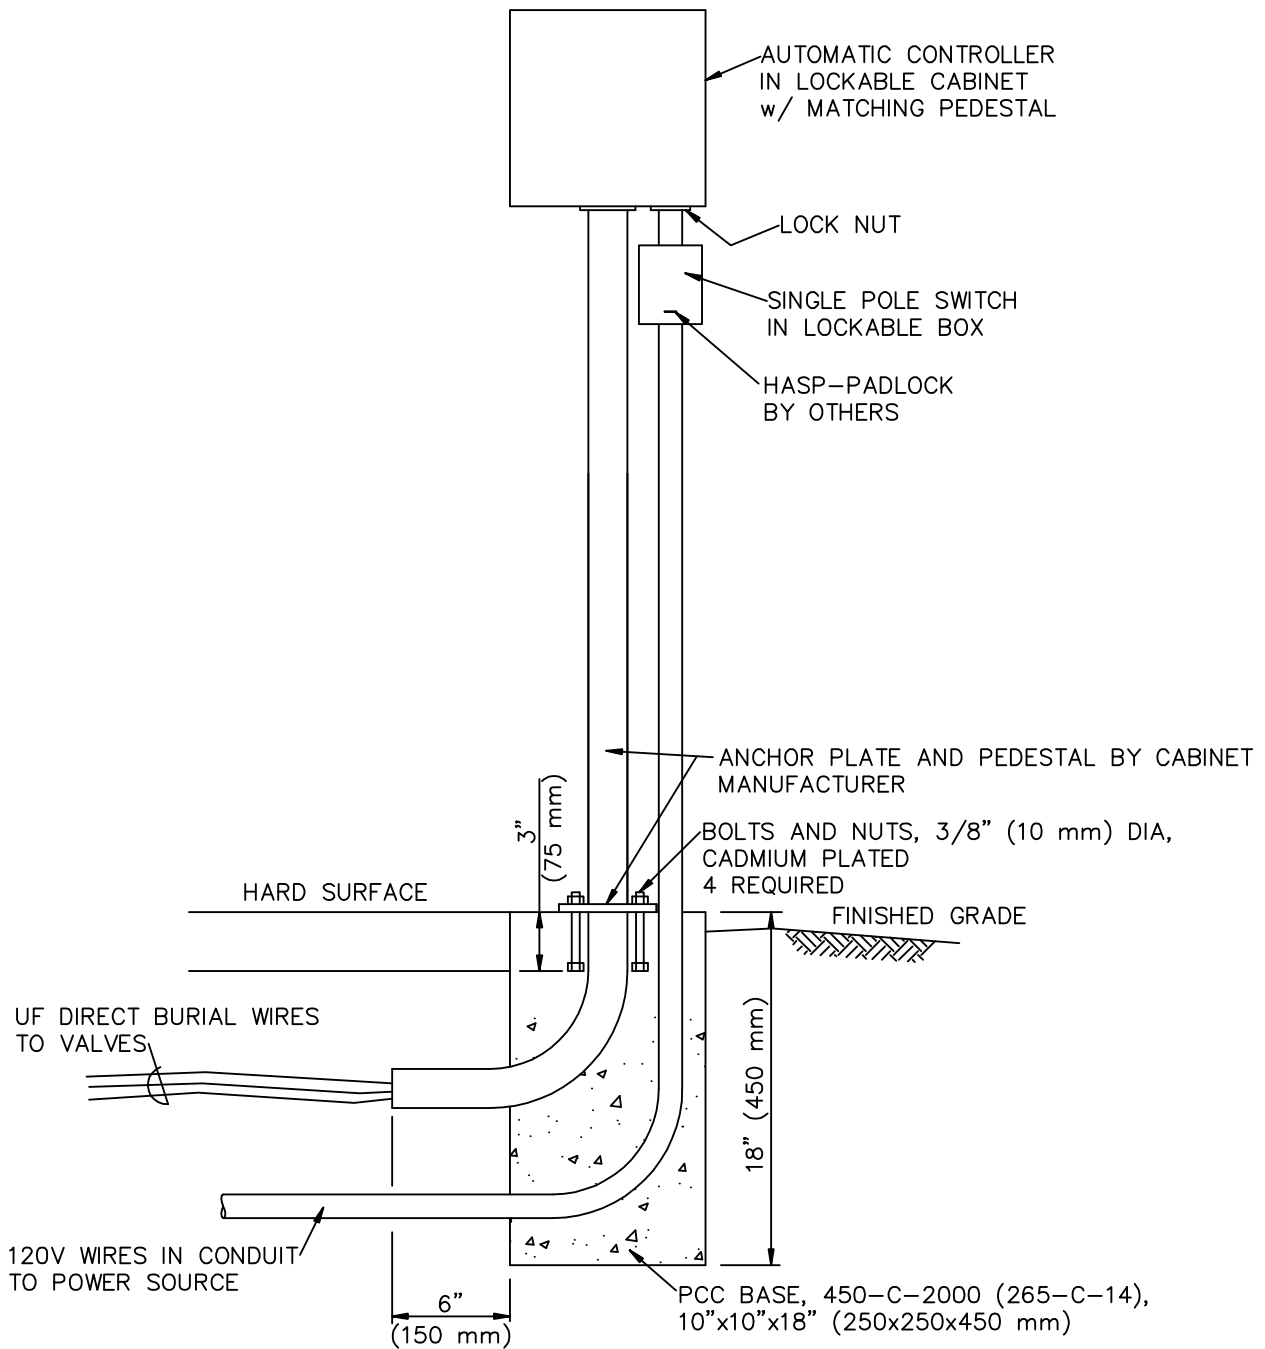

PEDESTAL MOUNT - TYPE A

NOTES:

1. AREA AROUND BOX MAY BE PLANTED, HARD SURFACE, OR A COMBINATION OF BOTH.
2. TOP OF BASE:
 AT GRADE FOR HARD SURFACE
 1/2" (15 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2005, 2009



IRRIGATION CONTROLLER ENCLOSURE

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

514-3

SHEET 1 OF 4

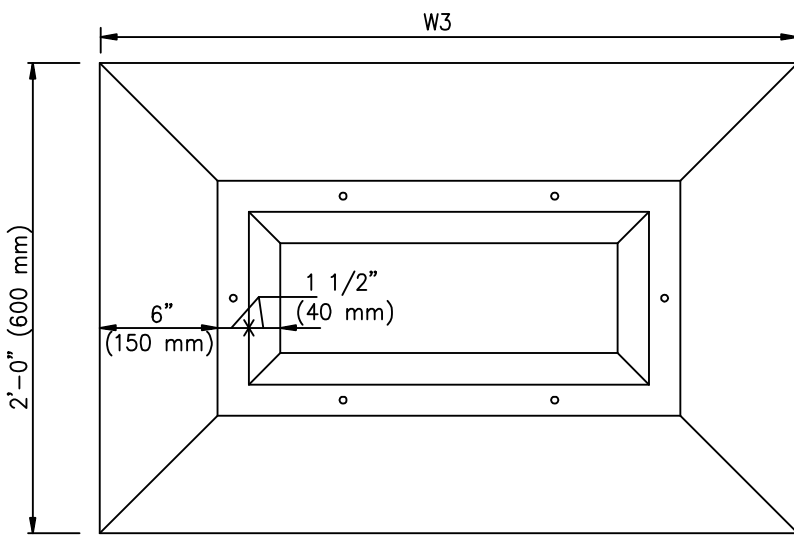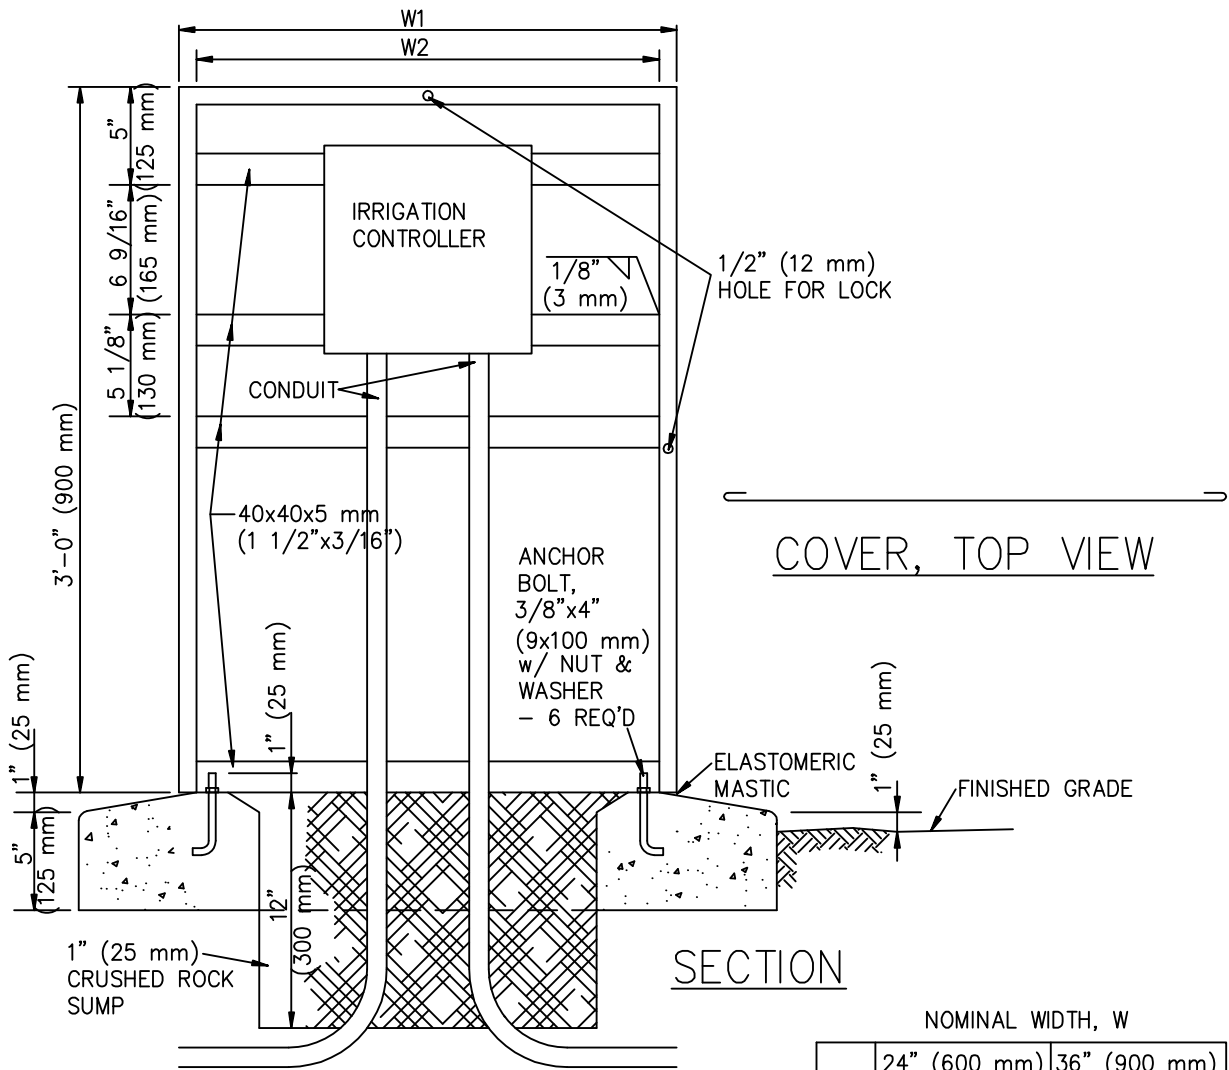

PLAN OF CONCRETE BASE

PEDESTAL MOUNT - TYPE B

NOMINAL WIDTH, W

	24" (600 mm)	36" (900 mm)
W1	2'-7/8" (630 mm)	3'-7/8" (935 mm)
W2	1'-11" (585 mm)	2'-11" (890 mm)
W3	2'-11" (890 mm)	3'-11" (1190 mm)

NOTES:

1. CONCRETE SHALL BE CLASS 450-C-2000 (265-C-14).
2. UNLESS OTHERWISE NOTED, ENCLOSURE SHALL BE 3/16" (5 mm) PLATE STEEL. PAINT ENCLOSURE WITH TWO COATS OF RUST INHIBITING PAINT (COLOR WILL BE SELECTED BY ENGINEER).

SYMBOL ON PLAN




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

IRRIGATION CONTROLLER ENCLOSURE

514-3

SHEET 2 OF 4

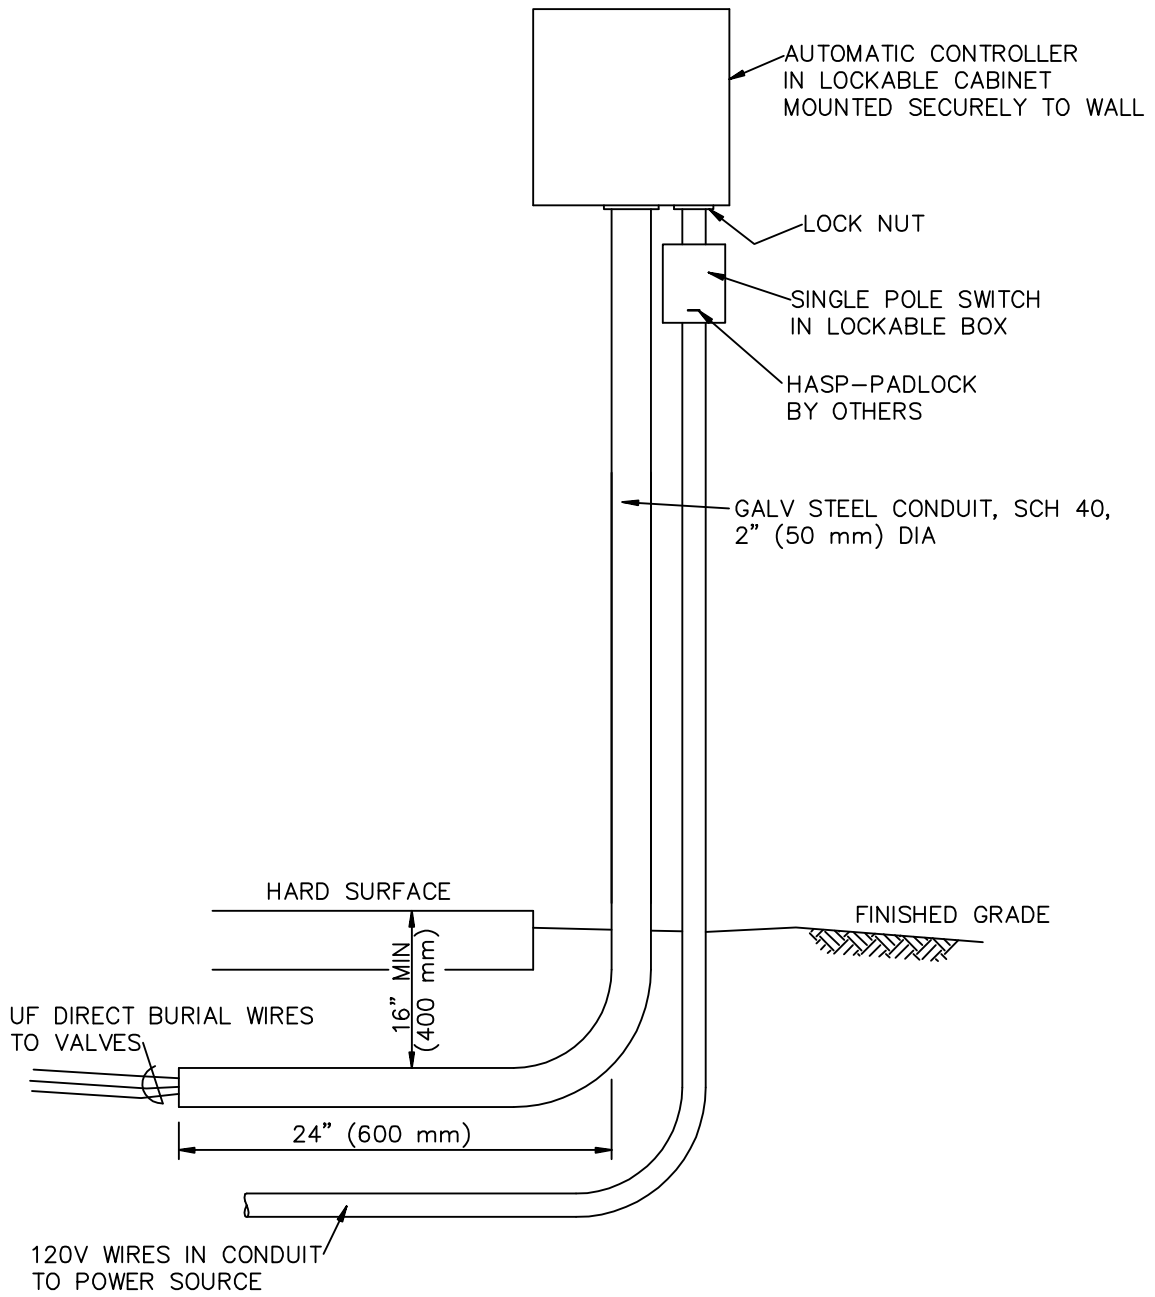

WALL MOUNT - TYPE C

SYMBOL ON PLAN




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


IRRIGATION CONTROLLER ENCLOSURE

514-3


SHEET 3 OF 4

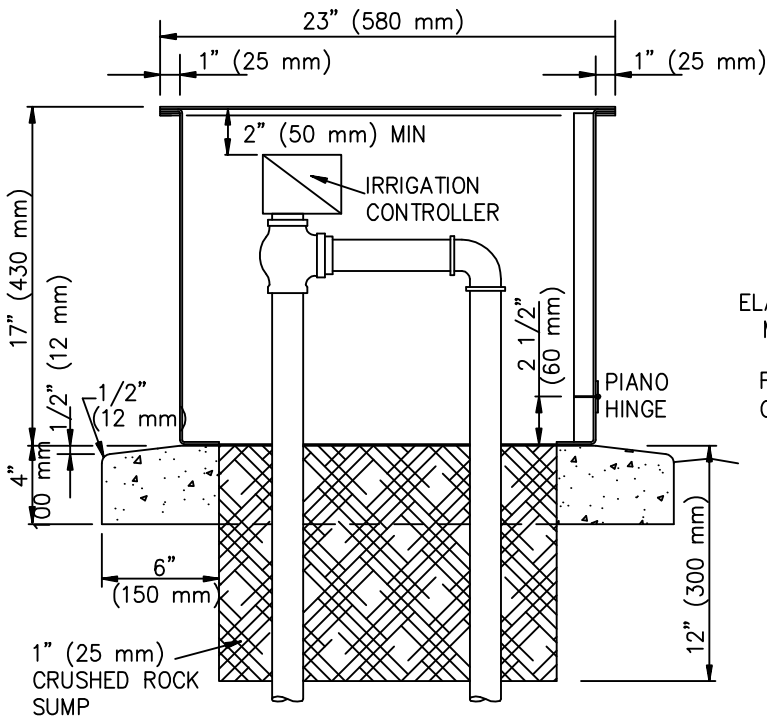


SECTION

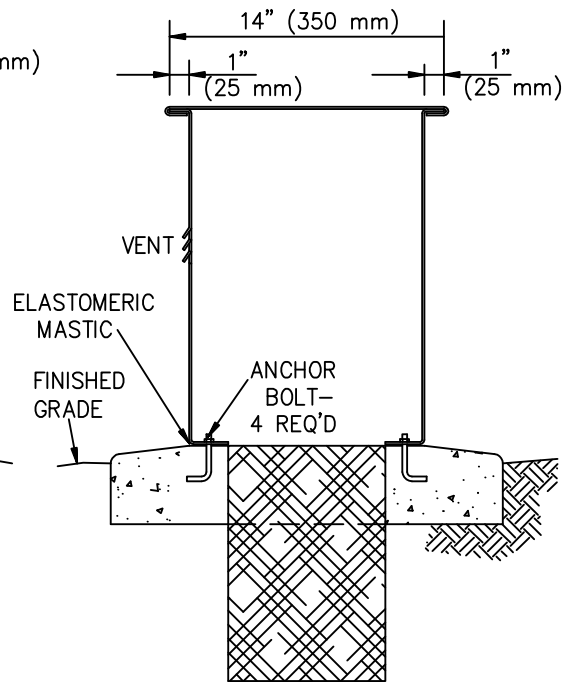

END VIEW

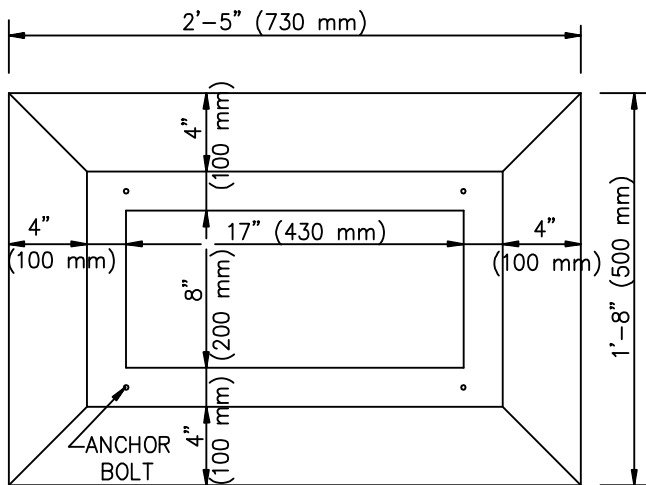


PLAN OF CONCRETE BASE

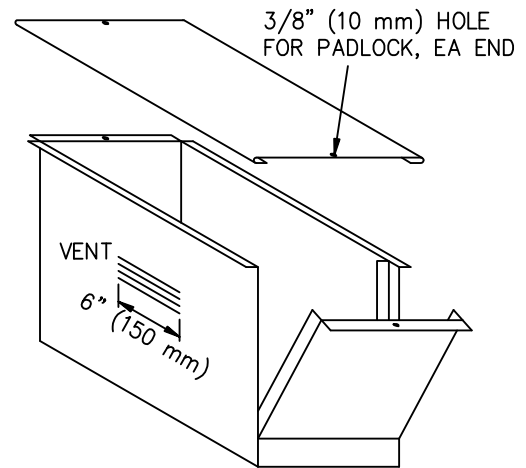

OBLIQUE VIEW

NOTES:

1. CONCRETE SHALL BE CLASS 450-C-2000 (265-C-14).
2. UNLESS OTHERWISE NOTED, ENCLOSURE SHALL BE 12 GAGE (2.75 mm) STEEL. PAINT ENCLOSURE WITH TWO COATS OF RUST INHIBITING PAINT (COLOR WILL BE SELECTED BY ENGINEER).



CORNER DETAIL

TYPE D

SYMBOL ON PLAN




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

IRRIGATION CONTROLLER ENCLOSURE

514-3

SHEET 4 OF 4

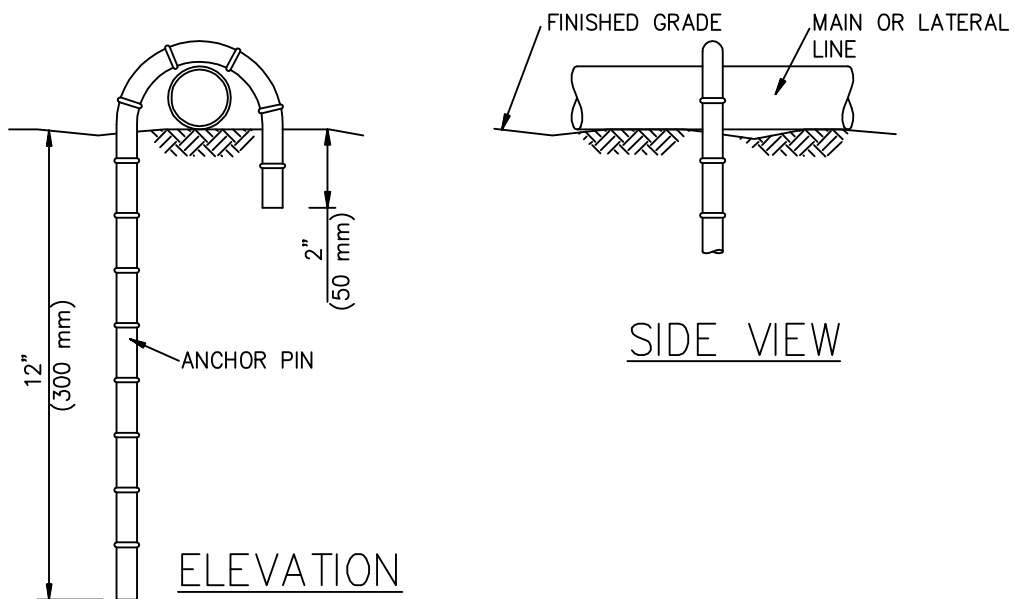

NOTES:

1. PINS SHALL BE #4 (#13M) REINFORCING BARS.
2. PINS SHALL BE PLACED 10' (3 m) APART FOR MAIN LINE.
3. PINS SHALL BE PLACED NO MORE THAN 15' (4.5 m) APART FOR LATERAL LINE.
4. ON SLOPES, THE 12" (300 mm) LEG OF THE PIN SHALL BE PLACED ON THE DOWNHILL SIDE.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009


PIPE PINNING

STANDARD PLAN


515-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 1

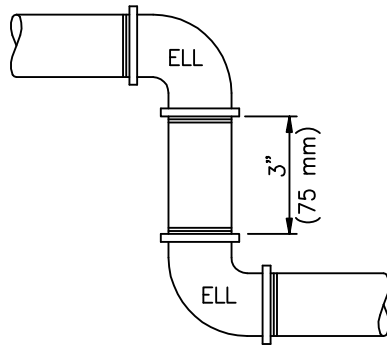

SWING JOINT PLAN DETAIL

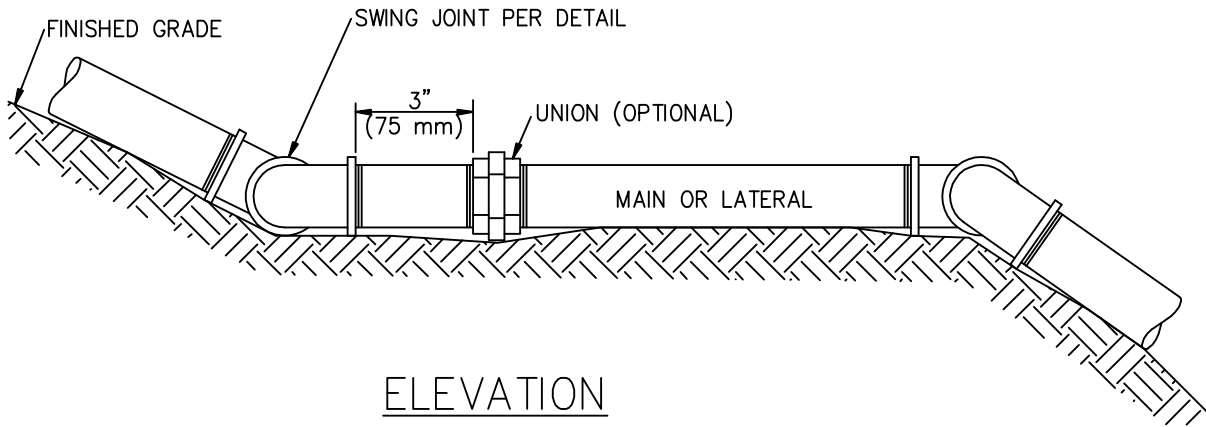


ELEVATION

NOTES:

1. PIPE AND FITTINGS SHALL BE SCHEDULE 40 GALVANIZED STEEL UNLESS OTHERWISE NOTED.
2. SWING JOINTS SHALL BE INSTALLED AT EACH CHANGE OF GRADE.
3. PIPE SHALL BE PINNED PER STANDARD PLAN 515.

SINGLE SWING JOINT ASSEMBLY

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2005, 2009


SWING JOINT ASSEMBLY

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

517-3

SHEET 1 OF 2

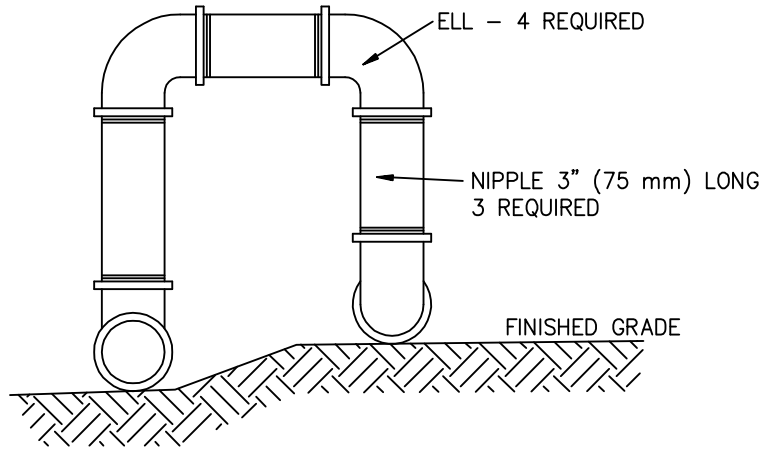

ELEVATION

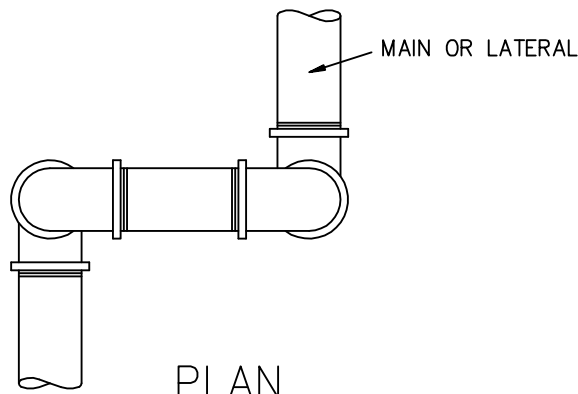


PLAN

NOTES:

1. PIPE AND FITTINGS SHALL BE SCHEDULE 40 GALVANIZED STEEL UNLESS OTHERWISE NOTED.
2. DOUBLE SWING JOINTS SHALL BE INSTALLED WHERE CHANGES OF GRADE AND ALIGNMENT OCCUR SIMULTANEOUSLY.
2. DOUBLE SWING JOINTS SHALL ALSO BE INSTALLED AS EXPANSION JOINTS ON LONG RUNS OF GALVANIZED PIPE, EACH 300' (90 m) MAXIMUM.
3. PIPE SHALL BE PINNED PER STANDARD PLAN 515.

DOUBLE SWING JOINT

SYMBOL ON PLAN




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


SWING JOINT ASSEMBLY

517-3

SHEET 2 OF 2

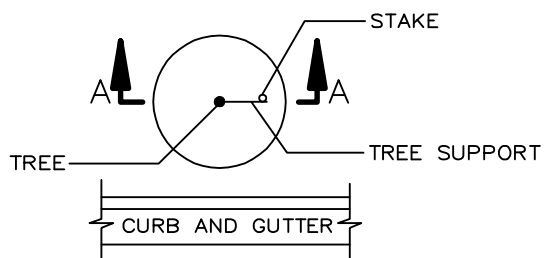

PLAN

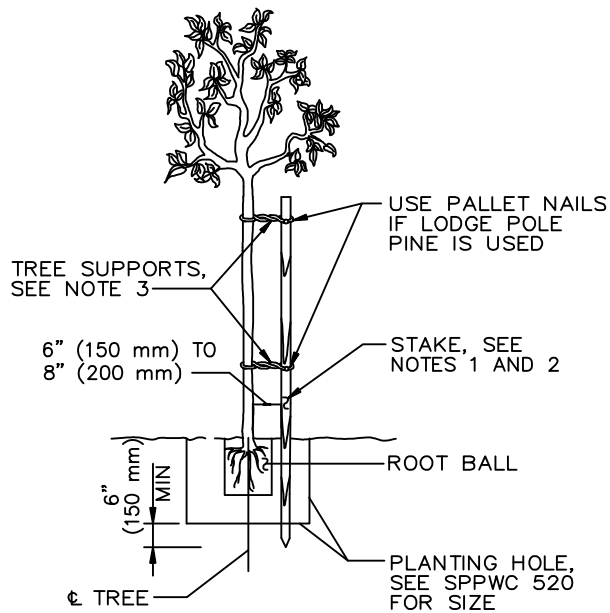

SECTION A-A

SINGLE STAKING

NOTES:

1. STAKE SHALL BE EITHER 2" (50 mm) DIAMETER LODGE POLE PINE, TREATED WITH COPPER NAPHTHANATE OR PRESSURE TREATED WITH CHROMATED COPPER ARSENATE, OR GALVANIZED STEEL PIPE, PER SSPWC 308-4.6.1 (METHOD A).
2. HEIGHT OF STAKE SHALL BE 10' (3 m); HOWEVER, IT SHALL NOT BE HIGHER THAN THE TOP OF THE TREE.
3. TREE SUPPORTS SHALL BE PER SSPWC 308-4.6.1.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARD, INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2005, 2009


TREE STAKING

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

518-3

SHEET 1 OF 3

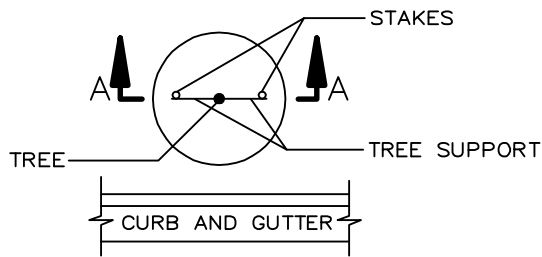

PLAN

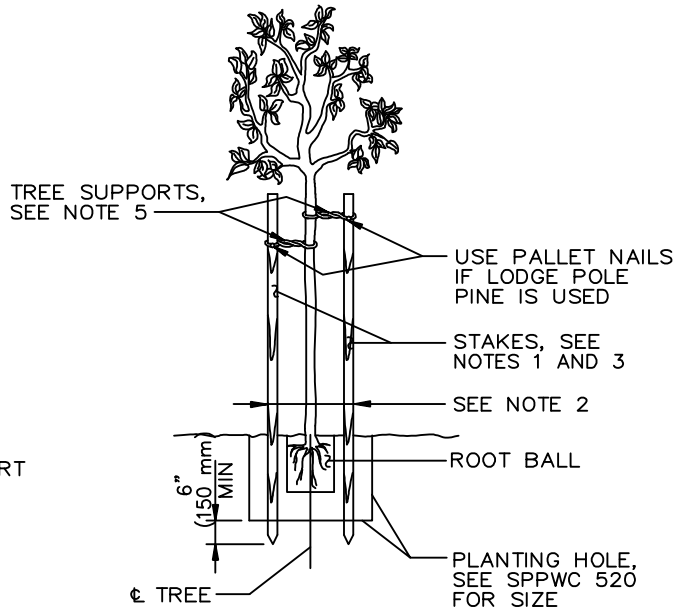

SECTION A-A

LENGTH OF STAKES	
TREE SIZE	LENGTH
15 GAL (55 L)	10' (3 m)*
24" (600 mm) BOX	12' (3.6 m)
30" (750 mm) BOX	12' (3.6 m)
36" (900 mm) - 48" (1200 mm) BOX	SEE NOTE 4

*USE 12' (3.6 m) WITH CASE 2. SEE SPPWC 520.

DOUBLE STAKING

NOTES:


1. STAKE SHALL BE EITHER 2" (50 mm) DIAMETER LODGE POLE PINE, TREATED WITH COPPER NAPHTHANATE OR PRESSURE TREATED WITH CHROMATED COPPER ARSENATE, OR GALVANIZED STEEL PIPE, PER SSPWC 308-4.6.1 (METHOD A).
2. PLACE STAKES 18" (450 mm) APART FOR 15GAL (55 L) TREE. PLACE STAKES AT OUTER EDGE OF ROOT BALL FOR LARGER SIZE (BOX) TREES.
3. HEIGHT OF STAKES SHALL NOT BE HIGHER THAN THE TOP OF THE TREE.
4. FOR 36" (900 mm) OR LARGER BOX TREES-STAKE OR GUY AT THE DIRECTION OF THE ENGINEER.
5. TREE SUPPORTS SHALL BE PER SSPWC 308-4.6.1.

GUY WIRE SIZES

24"-48" BOX (600-1200 mm) 2 STRAND #12 BWG (2.7 mm) ZINC COATED


OVER 48" (1200 mm) BOX 3 STRAND #12 BWG (2.7 mm) ZINC COATED

MULTIPLE STRANDS SHALL BE TWISTED TOGETHER

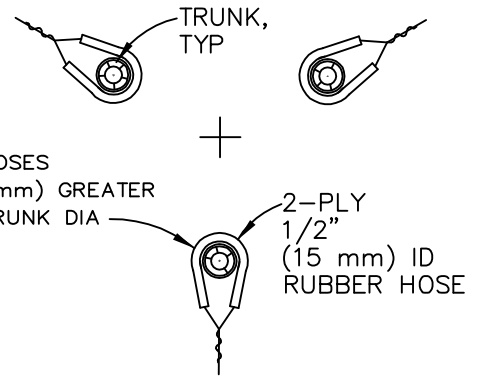


TYING PLAN


INSTALL WIRE TIES BETWEEN INDIVIDUAL GUYS PRIOR TO TENSIONING GUYS

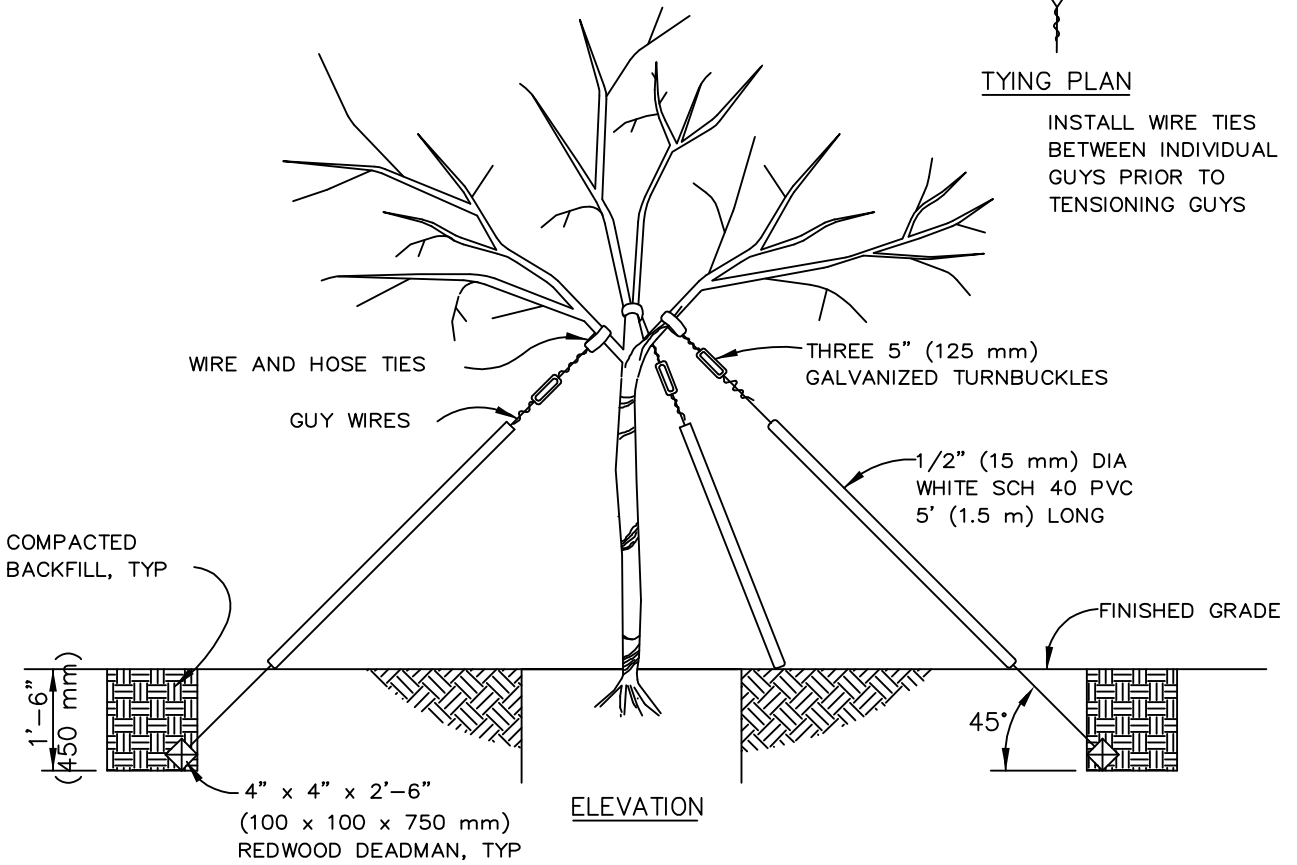


ELEVATION

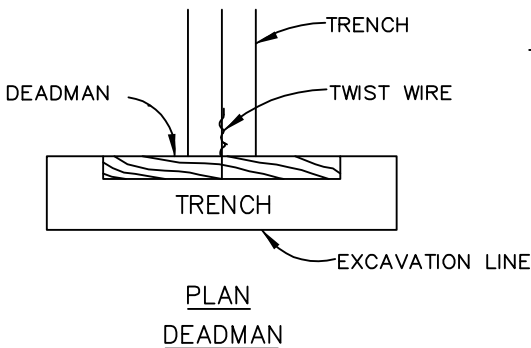


TREE GUYING

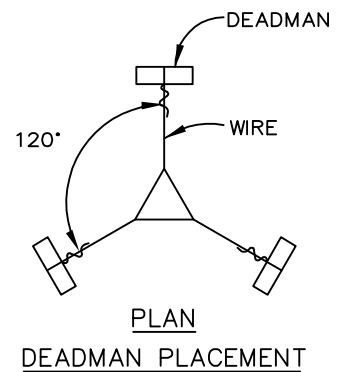

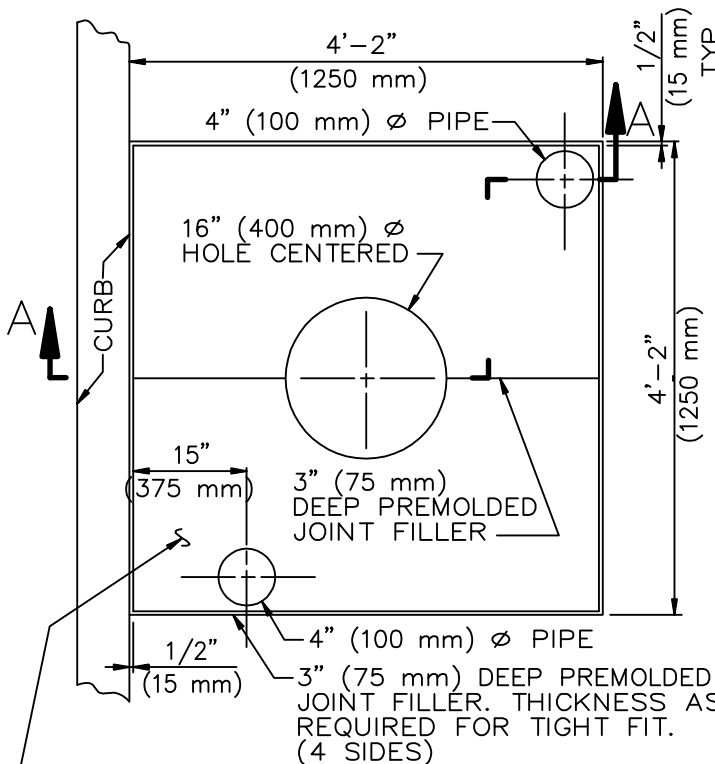


4'-1" x 4'-1" x 3"
 (1225 mm x 1225 mm x 75 mm)
 NATURAL COLOR PERMEABLE
 CONCRETE TREE WELL COVER
 DIMENSIONS ± 1/4" (6 mm)

CASE 1

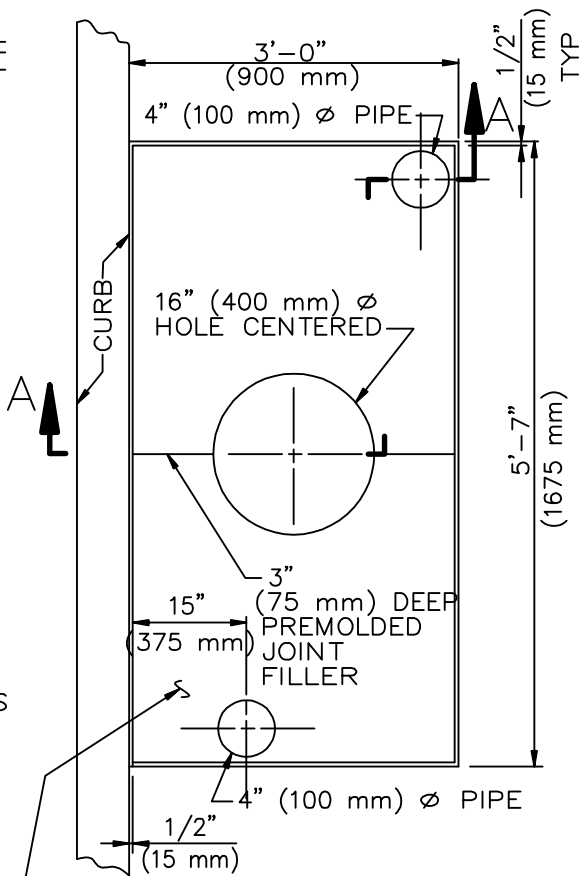

2'-11" x 5'-6" x 3"
 (875 mm x 1650 mm x 75 mm)
 NATURAL COLOR PERMEABLE
 CONCRETE TREE WELL COVER
 DIMENSIONS ± 1/4" (6 mm)

CASE 2

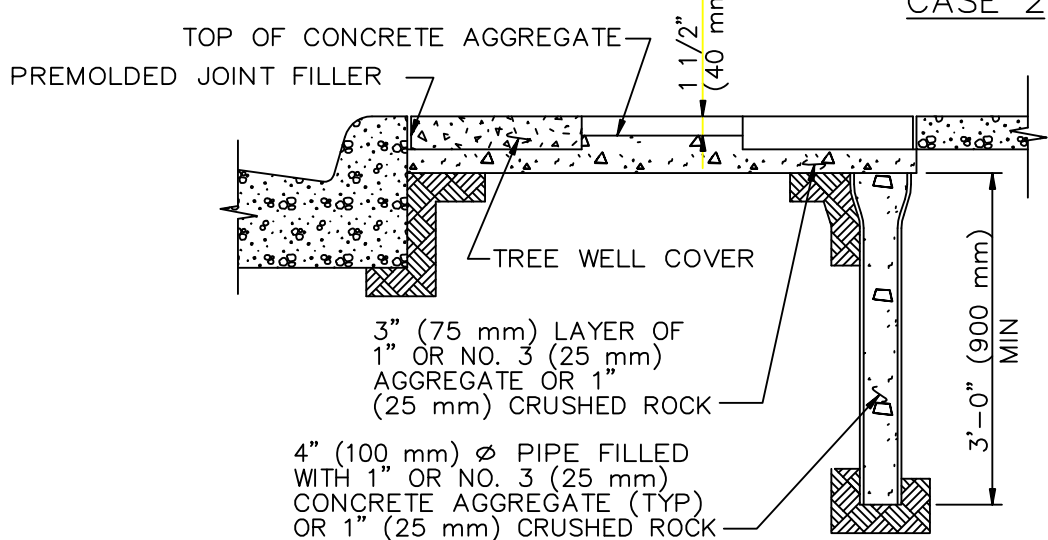

SECTION A-A

NOTE:
 SEE SHEETS 3 AND 7 FOR NOTES PERTAINING TO THIS SHEET.

TYPE 1


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009

TREE WELL


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
519-3
 SHEET 1 OF 7

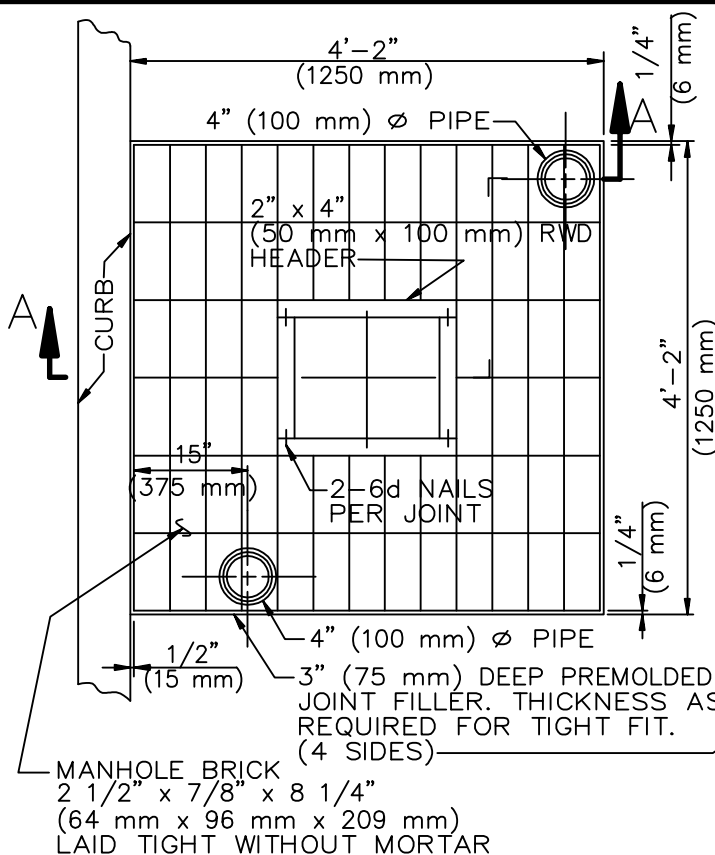


MANHOLE BRICK
 2 1/2" x 7/8" x 8 1/4"
 (64 mm x 96 mm x 209 mm)
 LAID TIGHT WITHOUT MORTAR

CASE 1

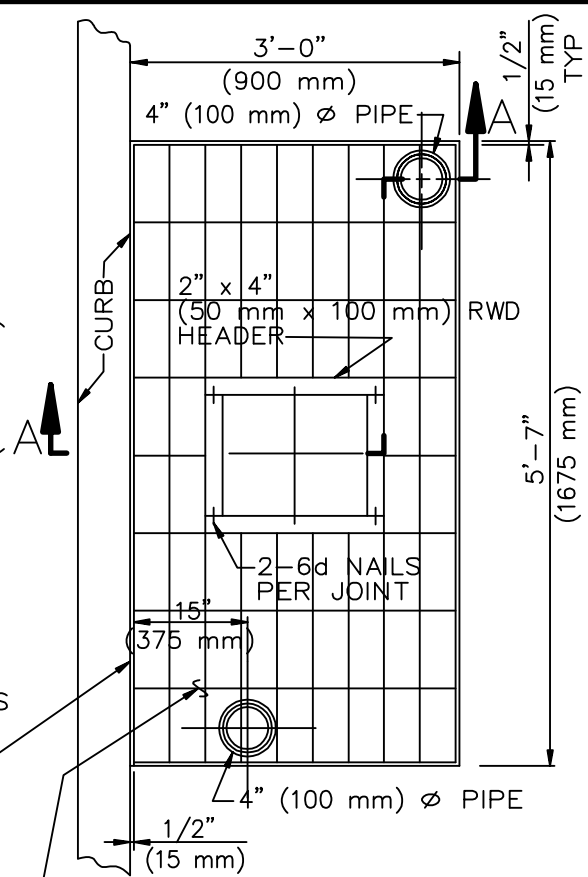

MANHOLE BRICK
 2 1/2" x 7/8" x 8 1/4"
 (64 mm x 96 mm x 209 mm)
 LAID TIGHT WITHOUT MORTAR


CASE 2

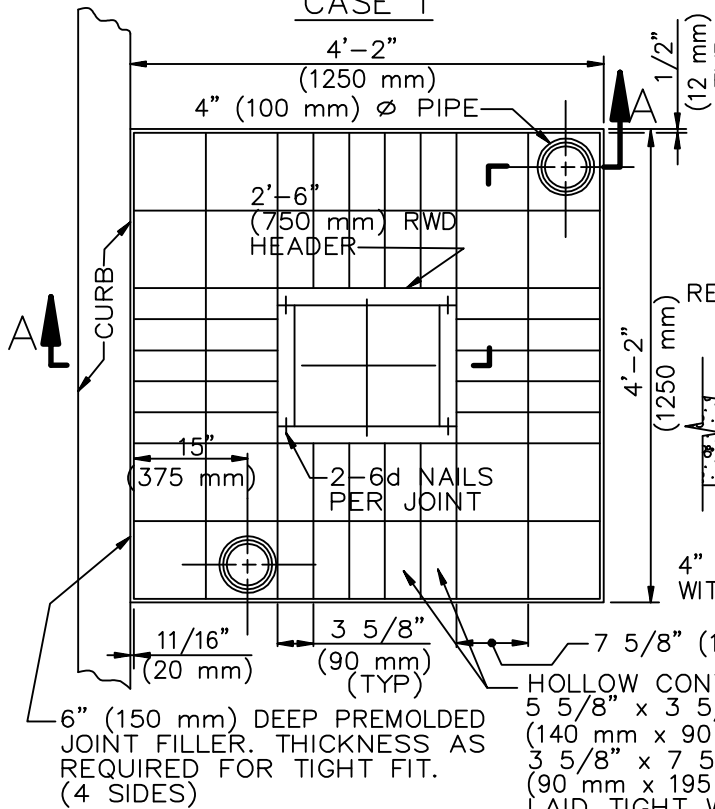

6" (150 mm) DEEP PREMOLDED
 JOINT FILLER. THICKNESS AS
 REQUIRED FOR TIGHT FIT.
 (4 SIDES)

HOLLOW CONCRETE BLOCK
 5 5/8" x 3 5/8" x 7 5/8"
 (140 mm x 90 mm x 195 mm) AND
 3 5/8" x 7 5/8" x 7 5/8"
 (90 mm x 195 mm x 195 mm)
 LAID TIGHT WITHOUT MORTAR

CASE 3

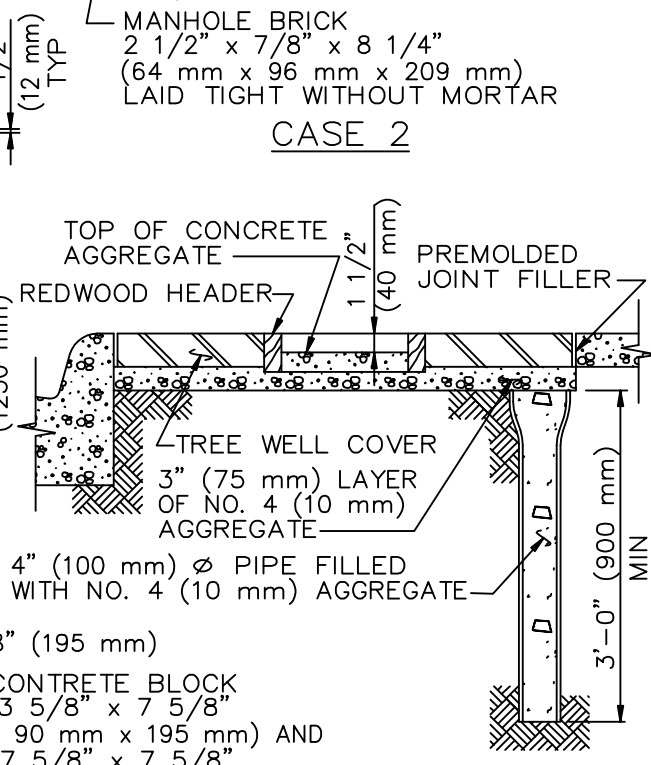

SECTION A-A

NOTE:
 SEE SHEETS 3 AND 7 FOR NOTES
 PERTAINING TO THIS SHEET.

TYPE 2

NOTES FOR TYPE 1 TREE WELL

1. THE COVER SHALL BE MADE OF PERMEABLE CONCRETE WITH A MINIMUM COMPRESSIVE STRENGTH OF 1200 PSI (8.5 MPa) AND SHALL BE CAST-IN PLACE OR PRECAST "AGRIPERM" OR EQUIVALENT. CAST-IN-PLACE CONCRETE SHALL CONSIST OF ONE PART CEMENT TO FOUR PARTS 3/8" (10 mm) GRAVEL AND APPROXIMATE 4 GALLONS (15 LITERS) OF WATER PER 94 LB (42.5 kg) OF CEMENT. THE GRAVEL SHALL BE CLEAN WITH FINES REMOVED. THE CONCRETE MIXTURE SHALL BE DEPOSITED AS NEAR AS POSSIBLE TO ITS FINAL LOCATION. THE EXCESS CONCRETE SHALL BE RODDED OFF IN A SAWING MOTION. A SURPLUS OF CONCRETE SHOULD BE MAINTAINED AGAINST THE FRONT SURFACE OF THE SCREED IN ORDER THAT LOW AREAS WILL BE FILLED AS THE SCREED PASSES OVER. RODDING SHALL BE HELD TO A MINIMUM. AFTER THE SURFACE IS FLAT NO OTHER FINISHING WILL BE REQUIRED. CURING COMPOUND TO WHICH WATERPROOFING MATERIALS HAVE BEEN ADDED WILL NOT BE PERMITTED.
2. EXISTING SIDEWALKS SHALL BE CAREFULLY SAWCUT PREPARATORY TO INSTALLATION OF TREE WELL COVERS. SAWCUT OVER-RUNS SHALL BE CLEANED AND FILLED WITH EPOXY APPROVED BY THE ENGINEER AND FINISHED TO SIDEWALK GRADE.
3. THE PIPE MAY BE CIP, ACP, VCP, ABS, PVC, GALV STL OR ASPHALT IMPREGNATED FIBER DUCT AND IT MAY BE BELL OR PLAIN END.
4. AFTER ALL OTHER WORK PERTINENT TO PLANTING HAS BEEN COMPLETED, EACH TREE SHALL BE WATERED IMMEDIATELY WITH A MINIMUM OF 20 GALLONS (75 LITERS) OF WATER, AND REPEATED 2 TIMES IN THE NEXT 3 DAYS, AFTER THE TREE HAS BEEN WATERED AND THE SOIL IS SUFFICIENTLY DRY, THE SOIL SHALL BE GRADED AND TAMPED. THE 3" (75 mm) LAYER OF AGGREGATE SHALL BE PLACED AND GRADED TO ACCEPT THE TREE WELL COVER FIRMLY, WITHOUT ROCKING, AND FLUSH WITH THE TOP SURFACE OF THE SIDEWALK. THE PREMOLDED JOINT FILLER SHALL BE CAREFULLY PLACED TO INSURE A TIGHT FIT WITH THE TOP OF THE JOINT FILLER FLUSH WITH THE ADJACENT SIDEWALK.
5. IF CAST-IN-PLACE, THERE SHALL BE A 3 MIL (0.075 mm) PLASTIC LINER BETWEEN WALK AND AGGREGATE

NOTES FOR TYPE 2 TREE WELL

1. EXISTING SIDEWALK SHALL BE CAREFULLY SAWCUT PREPARATORY TO LAYING OF CONCRETE BLOCKS OR BRICK. SAWCUT OVER-RUNS SHALL BE CLEANED AND FILLED WITH EPOXY APPROVED BY THE ENGINEER AND FINISHED TO SIDEWALK GRADE.
2. THE PIPE MAY BE CIP, ACP, VCP, ABS, PVC, GALV STL OR ASPHALT IMPREGNATED FIBER DUCT, AND IT MAY BE BELL OR PLAIN END.
3. NAILS SHALL BE GALVANIZED STEEL BOX.
4. AFTER ALL OTHER WORK PERTINENT TO PLANTING HAS BEEN COMPLETED, EACH TREE SHALL BE WATERED IMMEDIATELY WITH A MINIMUM OF 20 GALLONS (75 LITERS) OF WATER AND REPEATED 2 TIMES IN THE NEXT 3 DAYS. AFTER THE WATER HAS SETTLED AND THE SOIL IS SUFFICIENTLY DRY, THE SOIL SHALL BE GRADED AND TAMPED. A 3" (75 mm) LAYER OF AGGREGATE SHALL BE PLACED AND GRADED TO ACCEPT BRICKS FLUSH WITH THE TOP SURFACE OF THE SIDEWALK. THE PREMOLDED JOINT FILLER AND HEADERS SHALL BE CAREFULLY PLACED TO INSURE A TIGHT FIT WITH THE TOP OF THE JOINT FILLER FLUSH WITH THE ADJACENT SIDEWALK.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

TREE WELL

STANDARD PLAN


519-3

SHEET 3 OF 7

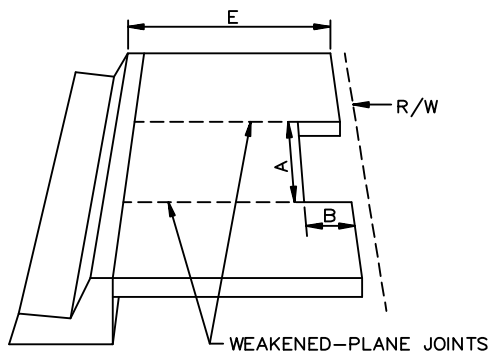

1 COVER REQUIRED

CASE 1: 3' x 18" (900 mm x 450 mm) TREE WELL
 CASE 2: 4' x 24" (1200 mm x 600 mm) TREE WELL

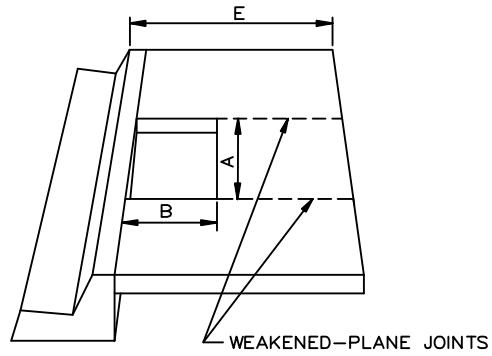


2 COVERS REQUIRED

CASE 3: 3' x 3' (900 mm x 900 mm) TREE WELL
 CASE 4: 4' x 4' (1200 mm x 1200 mm) TREE WELL

TREE WELLS

CASE	A	B	C	D	E	R
1	3'-0" (900 mm)	18" (450 mm)	2'-11" (975 mm)	17 1/2" (450 mm)	5'-0" (1500 mm) MIN	9" (225 mm)
2	4'-0" (1200 mm)	24" (600 mm)	3'-11" (1175 mm)	23 1/2" (600 mm)	5'-6" (1650 mm) MIN	15" (375 mm)
3	3'-0" (900 mm)	3'-0" (900 mm)	2'-11" (975 mm)	17 1/2" (450 mm)	6'-6" (1950 mm) MIN	9" (225 mm)
4	4'-0" (1200 mm)	4'-0" (1200 mm)	3'-11" (1175 mm)	23 1/2" (600 mm)	7'-6" (2250 mm) MIN	15" (375 mm)

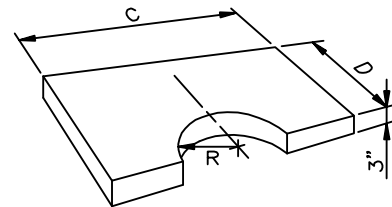


POROUS TREE WELL COVER (SEE NOTE 2)


NOTES FOR TYPE 3 TREE WELL

- SEE SHEET 7 FOR NOTES PERTAINING TO THE SHEET.
- PERMEABLE (POROUS) CONCRETE TREE WELL COVER:
 THE COVER SHALL BE MADE OF PERMEABLE CONCRETE WITH A MINIMUM COMPRESSIVE STRENGTH OF 1200 PSI (8.5 MPa) AND SHALL BE PRECAST & REINFORCED WITH 2 1/4" X 2 1/4" (60 mm x 60 mm) 16 GAUGE WIRE MESH. CONCRETE SHALL CONSIST OF ONE PART CEMENT TO FOUR PARTS 3/8" (10 mm) GRAVEL AND APPROXIMATELY FOUR GALLONS (15 LITERS) OF WATER PER SACK OF CEMENT. THE GRAVEL SHALL BE CLEAN WITH FINES REMOVED. CURING COMPOUND TO WHICH WATER-PROOFING MATERIALS HAVE BEEN ADDED WILL NOT BE PERMITTED.


TYPE 3

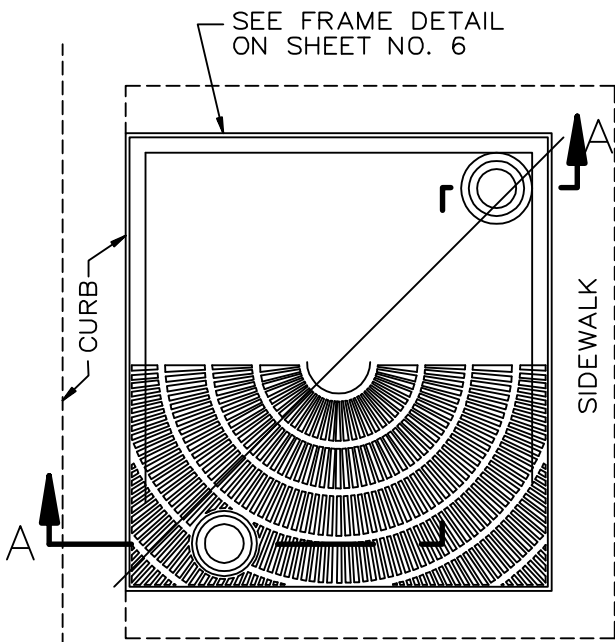


PLAN

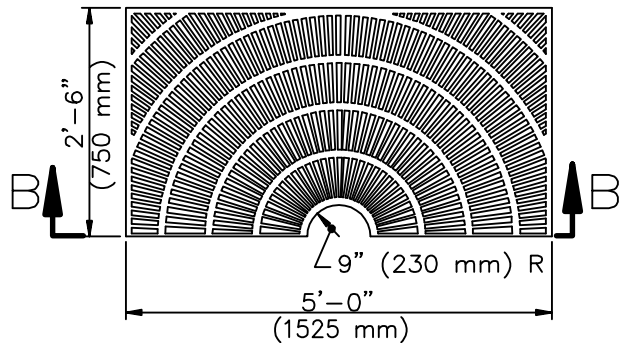

GRATE PLAN

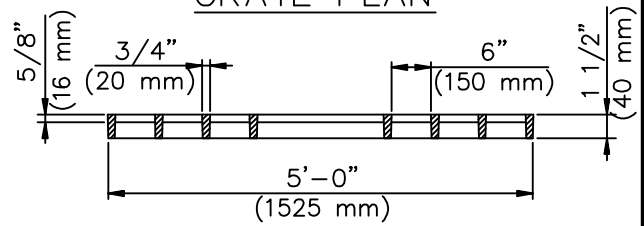

SECTION B-B

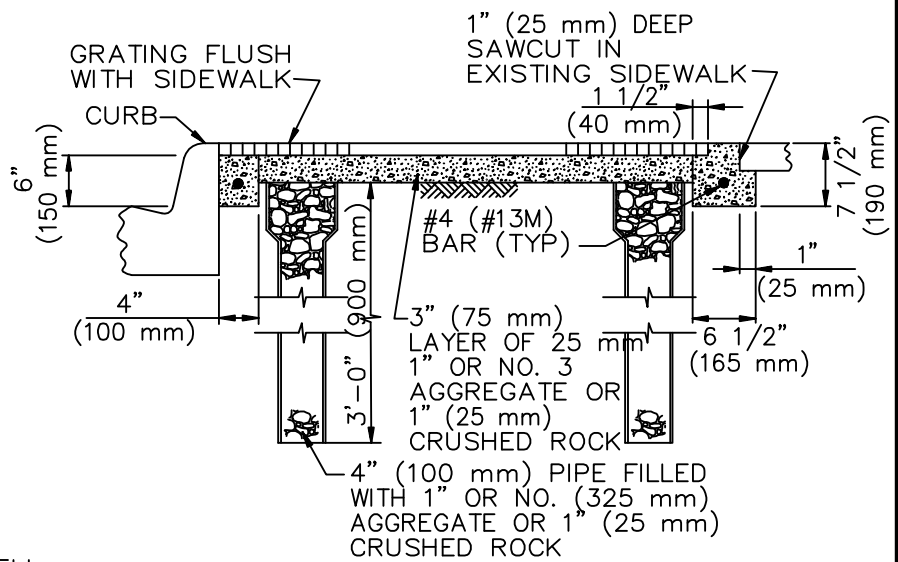

SECTION A-A

NOTES FOR TYPE 4 TREE WELL

1. GRATE MATERIAL TO BE CAST IRON.
2. GRATE PATTERN AS SPECIFIED ON PLANS OR IN SPECIFICATIONS.
3. EXISTING SIDEWALK SHALL BE CAREFULLY SAWCUT PREPARATORY TO LAYING OF FRAME. SAWCUT OVER-RUNS SHALL BE CLEANED AND FILLED WITH EPOXY APPROVED BY THE ENGINEER AND FINISHED TO SIDEWALK GRADE.
4. THE PIPE MAY BE CIP, ACP, VCP, ABS, PVC, GALV STL OR ASPHALT IMPREGNATED FIBER DUCT, AND IT MAY BE BELL OR PLAIN END.
5. AFTER ALL OTHER WORK PERTINENT TO PLANTING HAS BEEN COMPLETED. EACH TREE SHALL BE WATERED IMMEDIATELY WITH A MINIMUM OF 75 LITERS (20 GALLONS) OF WATER AND REPEATED 2 TIMES IN THE NEXT 3 DAYS. AFTER THE WATER HAS SETTLED AND THE SOIL IS SUFFICIENTLY DRY, THE SOIL SHALL BE GRADED AND TAMPED AND 3" (75 mm) CONCRETE AGGREGATE SHALL BE PLACED AND GRADED.

TYPE 4


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

TREE WELL

STANDARD PLAN

519-3

SHEET 5 OF 7

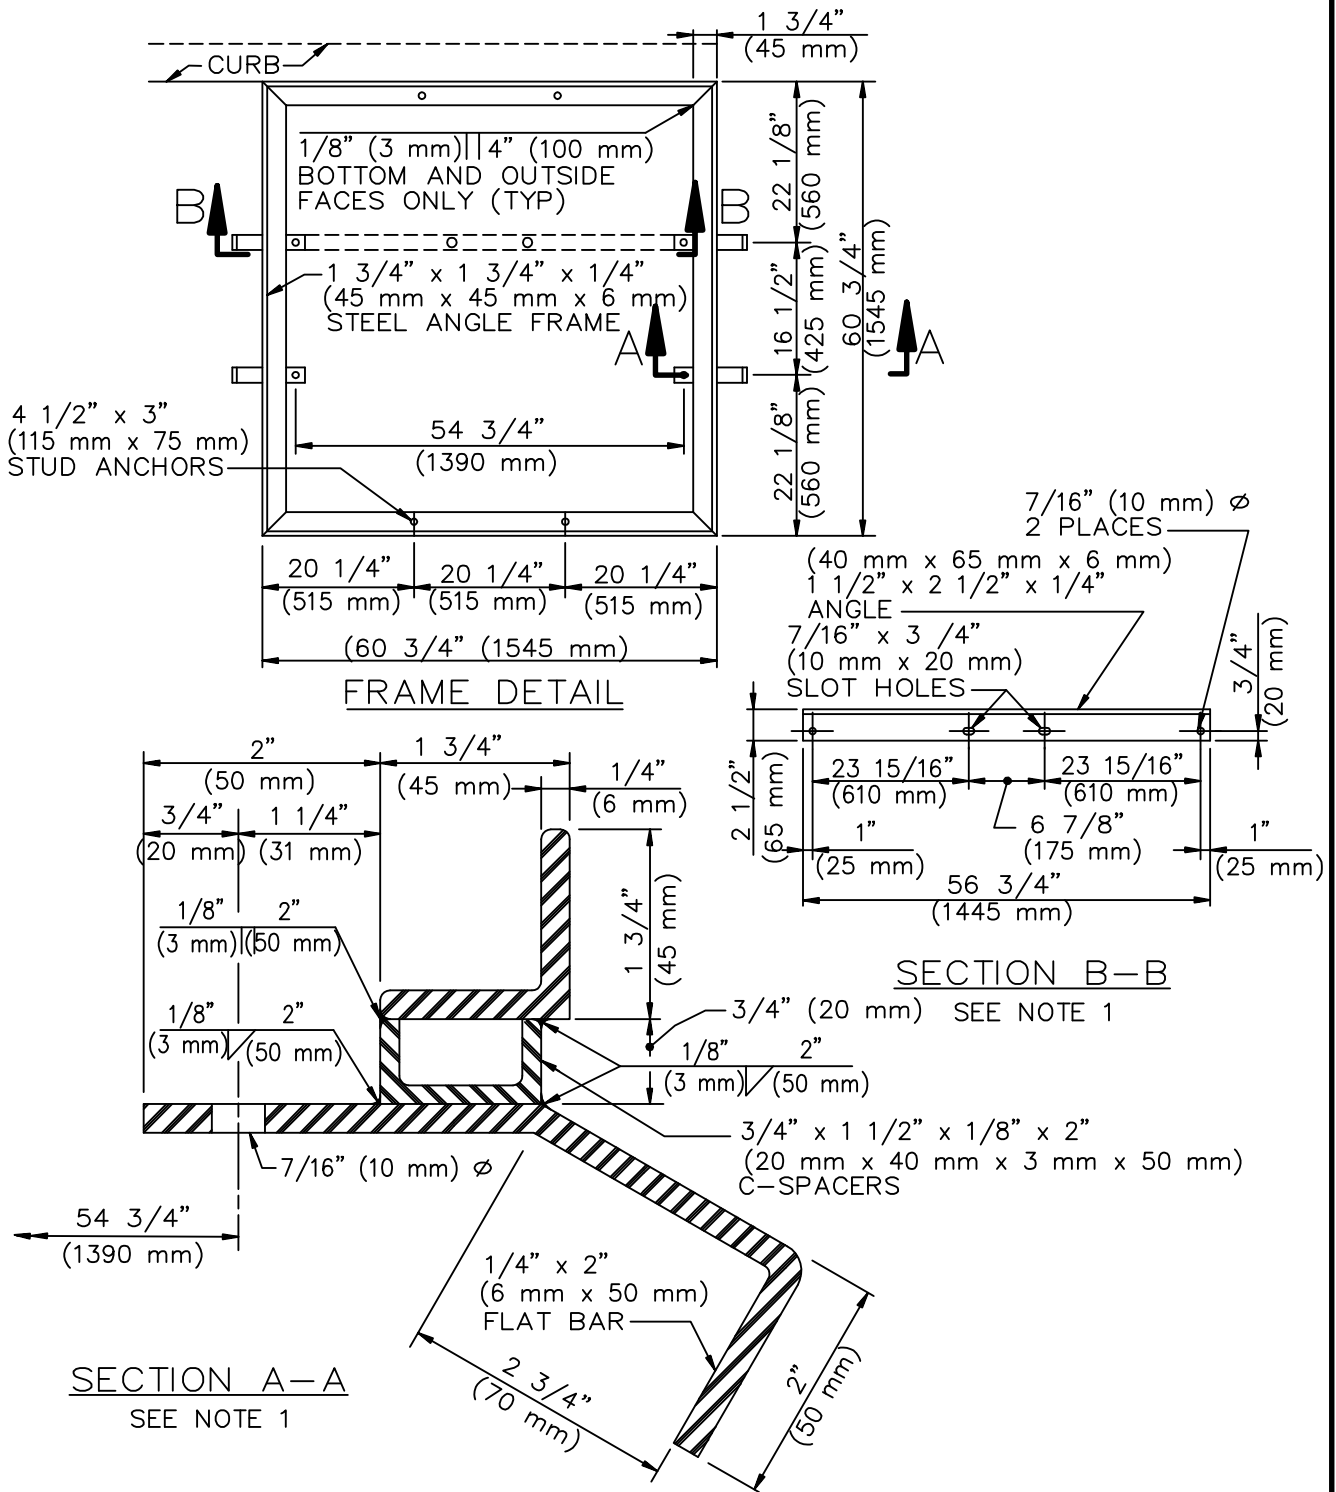

NOTES FOR TYPE 4 TREE WELL

1. SECTION A AND B REQUIRED ONLY WHEN TREE GUARD IS REQUIRED.
2. ALL METAL PARTS AND FRAME SHALL CONFORM TO THE SSPWC AND SHALL BE HOT DIP GALVANIZED AFTER FABRICATION.
3. SEE SHEET 7 FOR NOTES PERTAINING TO THIS SHEET.

TYPE 4

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION	STANDARD PLAN
TREE WELL	519-3
	SHEET 6 OF 7

GENERAL NOTES FOR ALL FOUR TYPES OF TREE WELL

1. TREE WELLS SHOULD BE SPACED APPROXIMATELY 50' (15 m) APART, BUT NOT LESS THAN ONE PER RESIDENTIAL LOT.
2. LOCATION OF TREE WELLS SUBJECT TO THE FOLLOWING MINIMUM CLEARANCES:
 - A. 50' (15 m) FROM BCR ON THE APPROACH TO AN INTERSECTION AND 15' (4.5 m) FROM THE ECR ON THE EXIT SIDE.
 - B. 20' (6 m) FROM LIGHT STANDARDS.
 - C. 10' (3 m) FROM FIRE HYDRANTS AND DRIVEWAYS.
 - D. 5' (1.5 m) FROM HOUSE WALKS AND UTILITY METERS.
3. COVERS SHALL BE COLORED BUFF USING AN ACCEPTABLE COLORING AGENT.
4. TREE WELL SHALL BE BACKFILLED WITH CLEAN DIRT FLUSH WITH ADJACENT WALK UNTIL TREE IS PLANTED.
5. DO NOT USE CASE 1 OR CASE 2 TREE WELL WHERE THERE IS AN EXISTING FENCE OR WALL AT THE R/W LINE.
6. TOP OF TREE WELL COVER SHALL BE FLUSH WITH ADJACENT SIDEWALK.
7. LOCATION OF TREE SUBJECT TO CHANGE AT THE DIRECTION OF THE ENGINEER.



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

TREE WELL



STANDARD PLAN

519-3

SHEET 7 OF 7

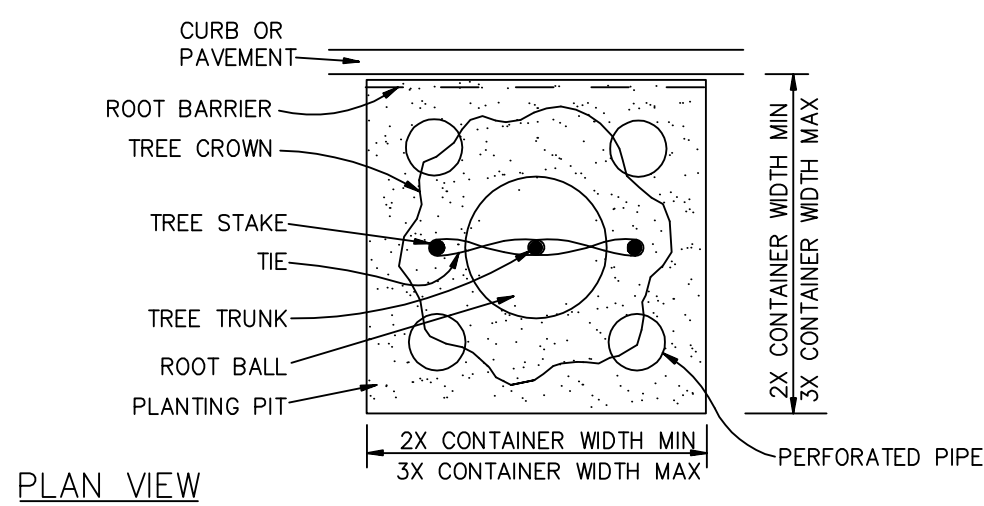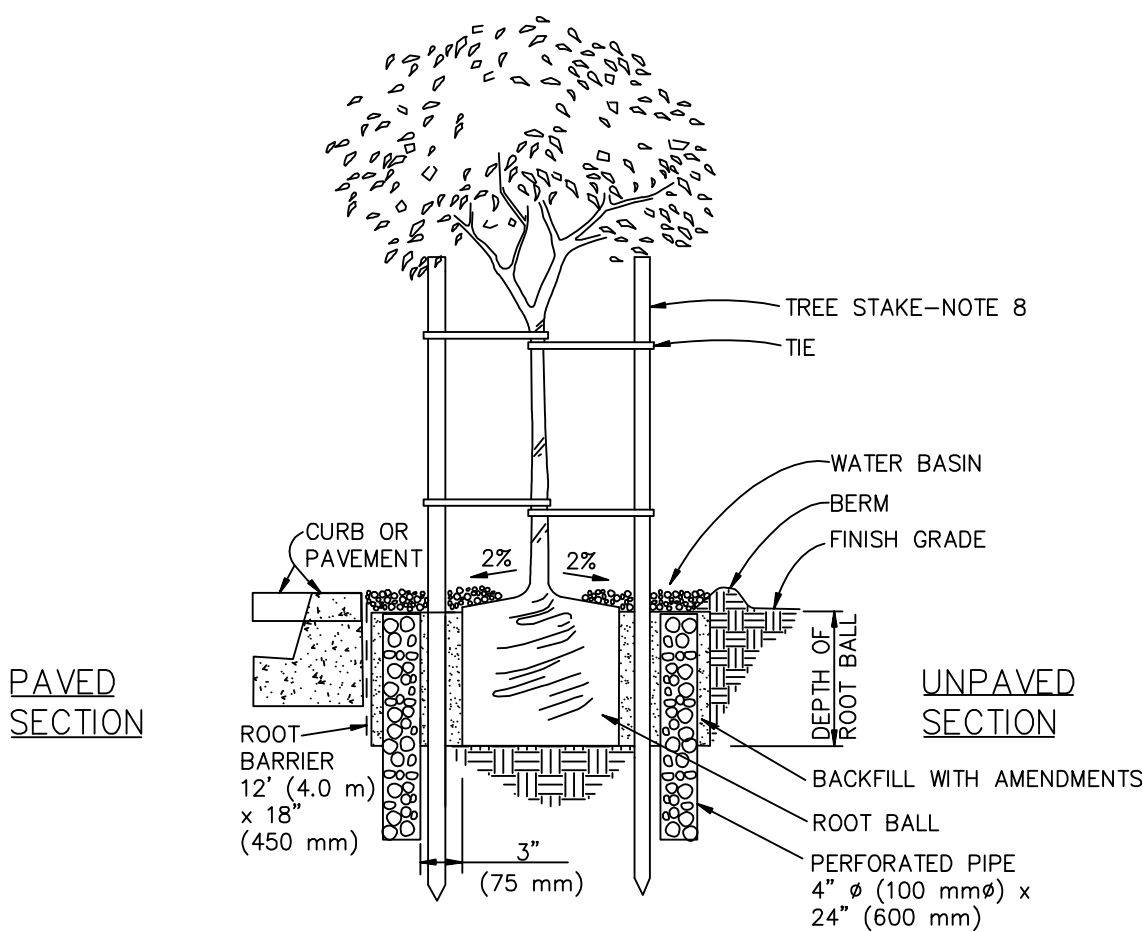


UNPAVED PARKWAY
15 GAL (60 LITER) OR 24" (600 mm) BOX

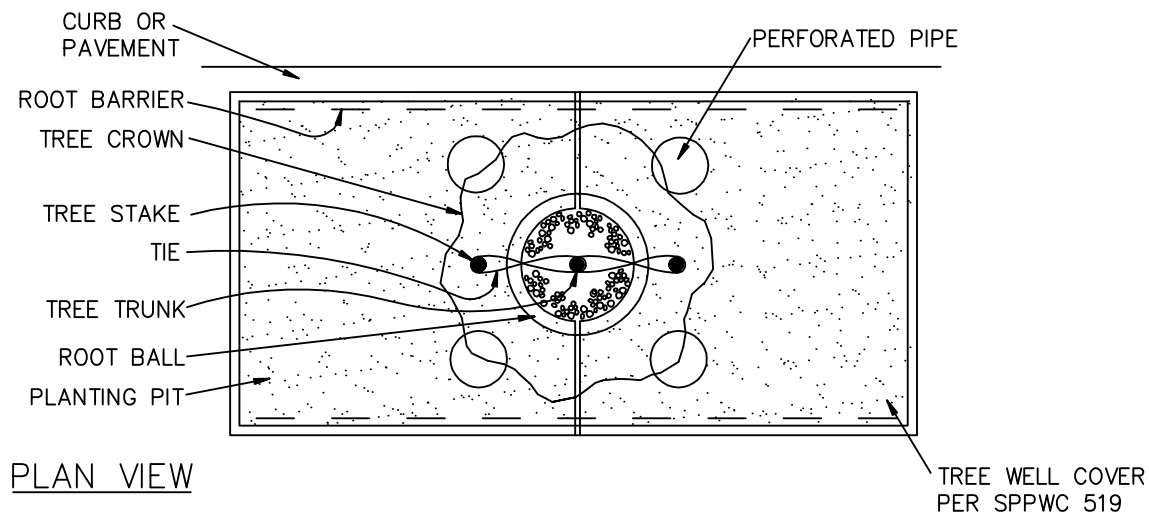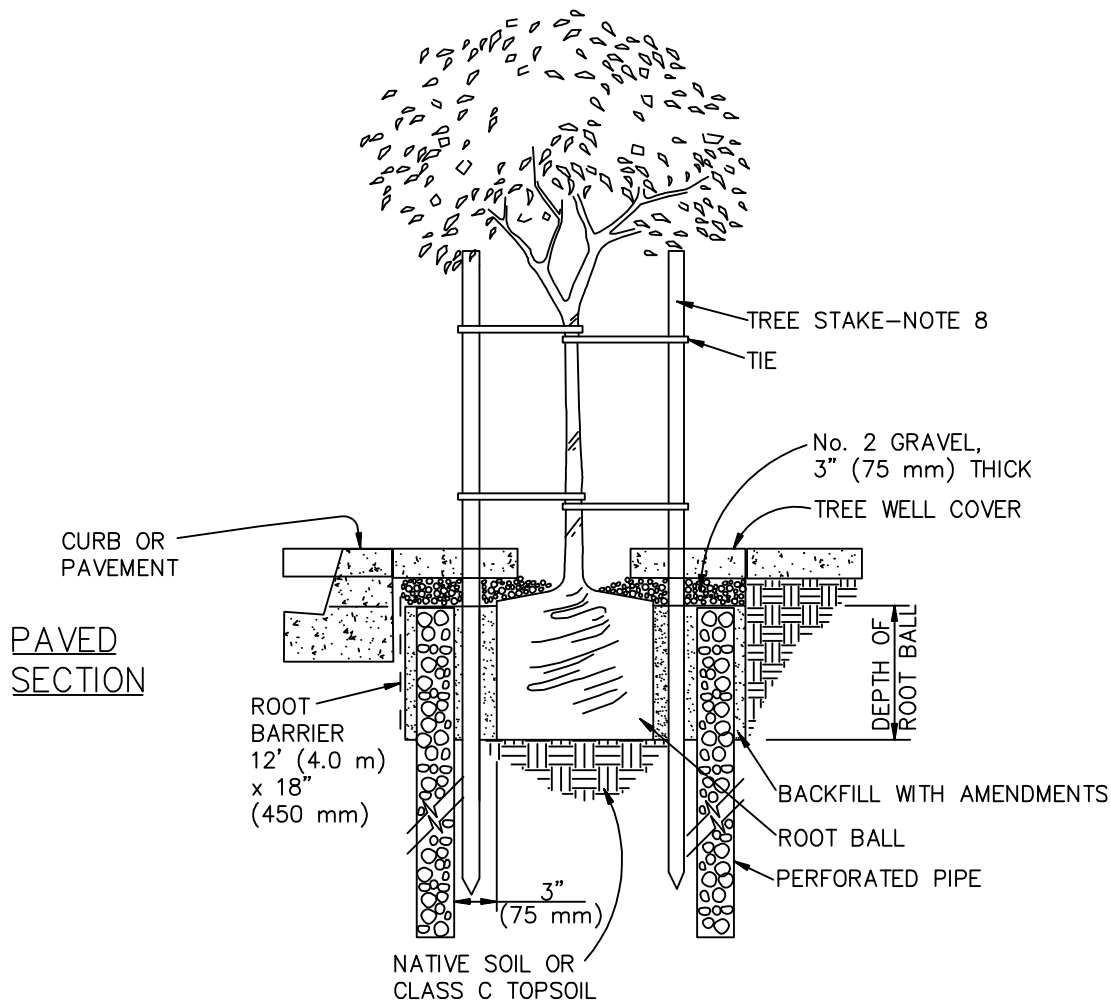


SIDEWALK TREE WELL
15 GAL (60 LITER) OR 24" (600 mm) BOX

SECTION

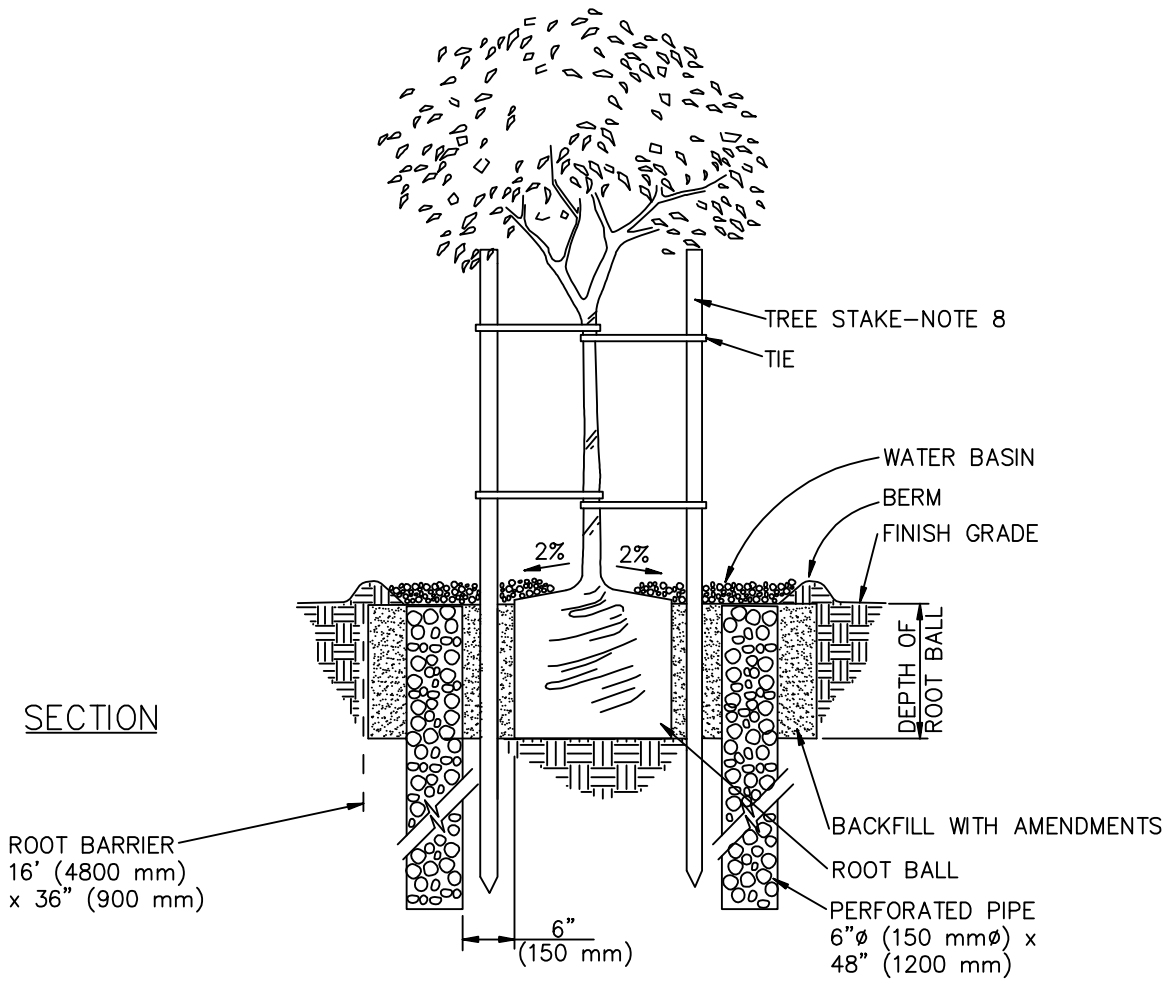


PLAN VIEW

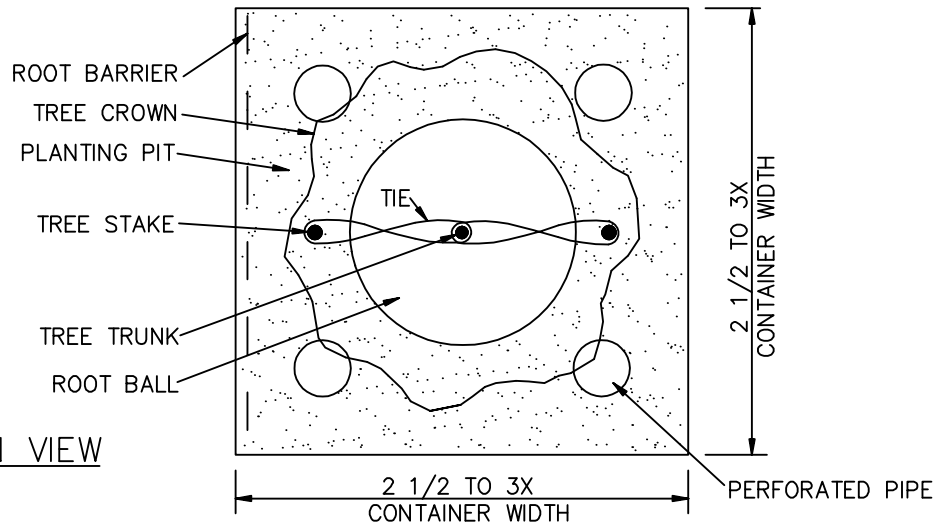

30" (750 mm) TO 48" (1200 mm) BOX

NOTES:

1. SET TOP OF ROOT BALL 1" (25 mm) ABOVE FINISH GRADE.
2. FOR 24" (600 mm) BOX TREES OR SMALLER, INSTALL ROOT BARRIERS IF TRUNK IS WITHIN 5' (1.5 m) OF CURB OR WALK.
FOR 30" TO 48" (750 mm TO 1200 mm) BOX TREES, INSTALL ROOT BARRIERS IF TRUNK IS WITHIN 10' (3.0 m) OF CURB OR WALK.
3. AMEND BACKFILL MIX PER SPECIFICATIONS. LEAVE TRUNK AND ROOT FLARE VISIBLE.
4. SET PERFORATED PIPE FLUSH WITH TOP OF BACKFILL. FILL PIPE WITH No. 2 GRAVEL PER SSPWC TABLE 200-1.4.(B) AND COVER WITH FILTER FABRIC. WRAP FABRIC 6" (150 mm) DOWN SIDES OF PIPE.
5. FORM 3 1/2" (90 mm) HIGH BERM AROUND BACKFILL AS A WATER BASIN.
6. TOP WATER BASIN WITH 3 1/2" (90 mm) OF No. 2 GRAVEL OR TYPE 1 MULCH PER THE SPECIAL PROVISIONS. KEEP GRAVEL OR MULCH 3 1/2"(90 mm) CLEAR OF TRUNK. LEAVE TRUNK AND ROOT FLARE VISIBLE.
7. REMOVE ALL NURSERY STAKES.
8. INSTALL NEW TREE STAKES PER SPPWC 518.
9. FASTEN TREE TO STAKES PER 308-4.6, TWO TIES PER STAKE.
10. AFTER PLANTING, PRUNE THE TREE AS APPROVED BY THE ENGINEER.
11. ROOT BARRIER, WHERE SHOWN, SHALL BE 80 MIL (2.0 mm) THICK.

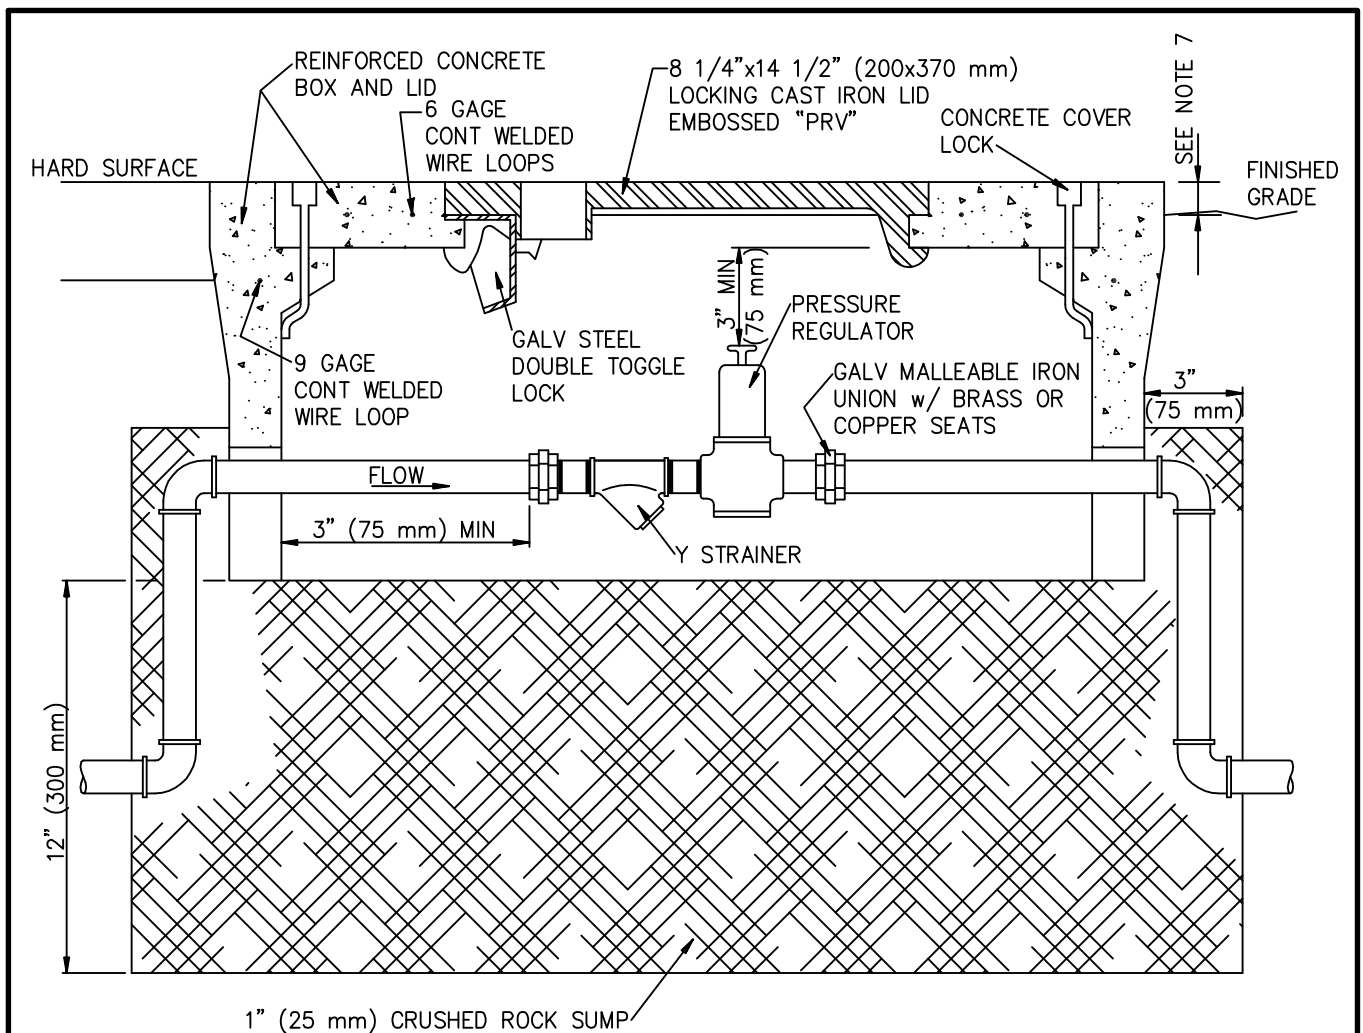

NOTES:

1. PRESSURE REGULATOR AND Y STRAINER SHALL BE BRASS OR BRONZE.
2. PRESSURE RATING SHALL BE AS SPECIFIED.
3. Y STRAINER SHALL BE FITTED WITH A 30 MESH SCREEN OF STAINLESS STEEL OR MONEL AND A BLOW-OFF COCK.
4. VALVE BOX SHALL BE SIZED TO CONTAIN ENTIRE Y STRAINER AND PRESSURE REGULATOR ASSEMBLY.
5. ASSEMBLY SHALL BE INSTALLED HORIZONTAL. BLOW-OFF COCK, ADJUSTMENT NUT, AND MAIN CAP ON REGULATOR SHALL BE ACCESSIBLE.
6. UNLESS OTHERWISE NOTED, FITTINGS SHALL BE THREADED SCHEDULE 80 PVC.
7. AREA AROUND VALVE BOX MAY BE PLANTED OR HARD SURFACE OR A COMBINATION OF BOTH.
 TOP OF VALVE BOX:
 AT GRADE FOR HARD SURFACE
 1/2" (12 mm) ABOVE GRADE FOR LAWN
 1" (25 mm) ABOVE GRADE FOR GROUND COVER OR SHRUBS
8. CRUSHED ROCK SHALL COVER BOX SIDE OPENINGS TO PREVENT SOIL ENTRY.
9. CLOSE NIPPLES ARE PROHIBITED.

SYMBOL ON PLAN



STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2005, 2009


PRESSURE REGULATOR INSTALLATION

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

521-3

SHEET 1 OF 1

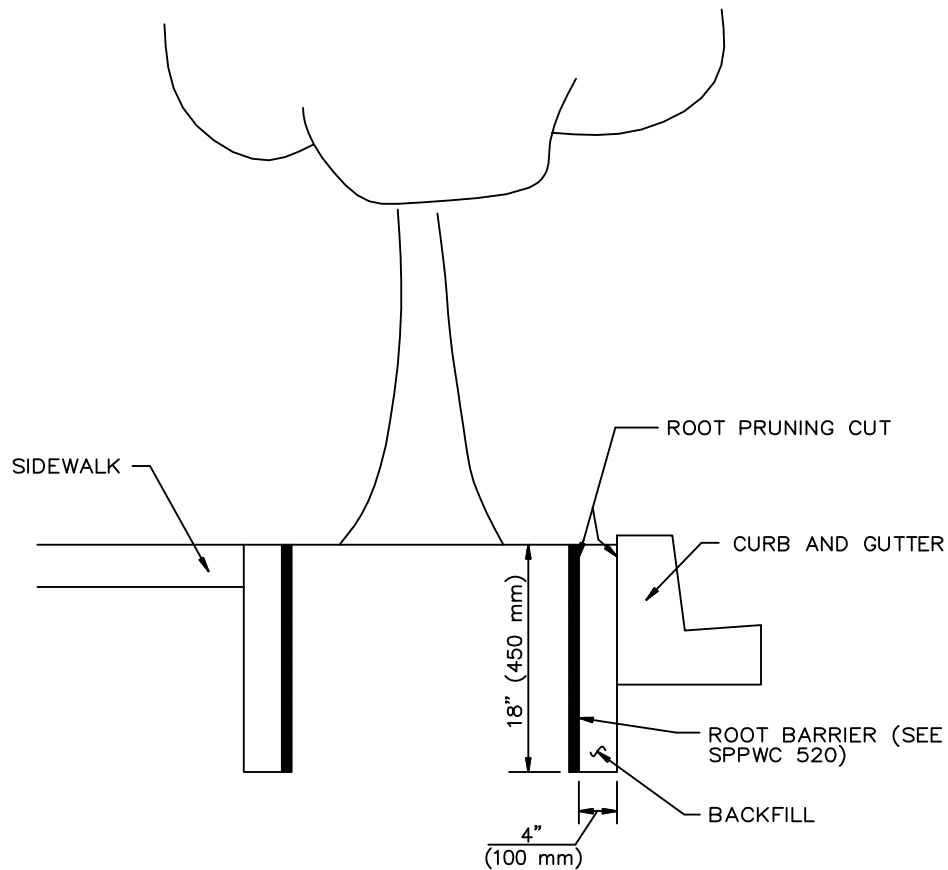

NOTES:

1. WHERE EXISTING PARKWAY TREES HAVE BEEN ROOT PRUNED, INSTALL CONTINUOUS, LINEAL ROOT BARRIER ADJACENT TO THE CURB AND/OR SIDEWALK.
2. LENGTH AND LOCATION OF ROOT BARRIER SHALL BE DETERMINED BY ENGINEER.
3. ROOT SEALER SHALL BE APPROVED BY THE ENGINEER AT LEAST 48 HOURS IN ADVANCE OF THE PRUNING OPERATION. IT SHALL BE APPLIED TO ALL CUT ROOT AREAS WHICH ARE LARGER THAN 2" (50 mm) IN DIAMETER. THE SEALER SHALL BE APPLIED AS SOON AS PRACTICAL AFTER THE CUTS HAVE BEEN MADE.
4. ROOT BARRIERS SHALL BE FABRICATED FROM A HIGH DENSITY, HIGH IMPACT PLASTIC AND BE EXPRESSLY DESIGNED FOR THE PURPOSE OF ROOT DEFLECTION.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARD, INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009


ROOT PRUNING

STANDARD PLAN


523-2

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


SHEET 1 OF 1

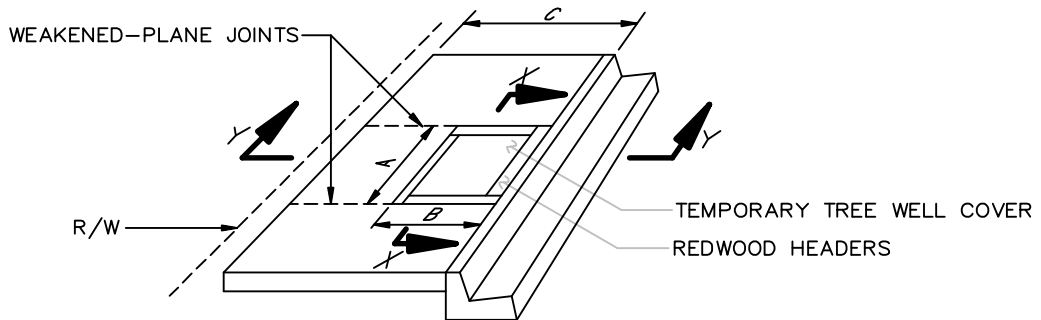

CASE 3: A=3' (900 mm) B=3' (900 mm) C=6'-6" (1950 mm) MIN
 CASE 4: A=4' (1200 mm) B=4' (1200 mm) C=7'-6" (2250 mm) MIN

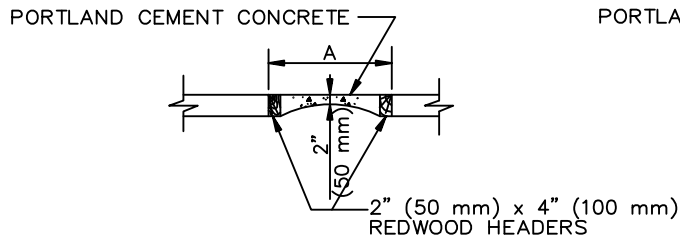

SECTION X-X

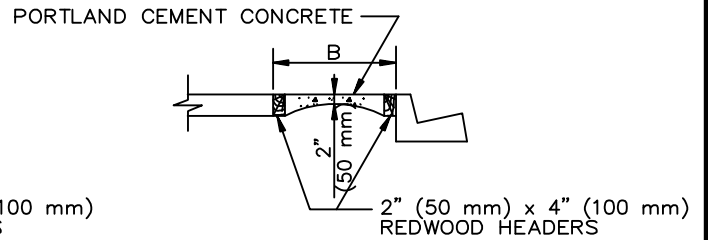

SECTION Y-Y

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARD, INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1996, 2009

TEMPORARY TREE WELL COVER

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

524-2

SHEET 1 OF 2

NOTES

1. TREE WELLS SHALL BE SPACED APPROXIMATELY 50' (15 m) APART, BUT NOT LESS THAN ONE PER RESIDENTIAL LOT.
2. LOCATION OF TREE WELLS SUBJECT TO THE FOLLOWING MINIMUM CLEARANCES:
 - A. 50' (15 m) FROM THE BCR ON THE APPROACH TO AN INTERSECTION AND 15' (4.5 m) FROM THE ECR ON THE EXIT SIDE.
 - B. 20' (6 m) FROM LIGHT STANDARDS.
 - C. 10' (3 m) FROM FIRE HYDRANTS AND DRIVEWAYS.
 - D. 5' (1.5 m) FROM HOUSE WALKS AND UTILITY METERS.
3. TEMPORARY TREE WELL COVER SHALL BE TAPERED TO A 2" (50 mm) THICKNESS AT THE CENTER FOR EASE OF BREAKING AND REMOVAL.
4. TEMPORARY TREE WELL COVER SHALL BE POURED IN PLACE. FINISH TO BE IDENTICAL WITH ADJACENT PCC WALK.
5. TEMPORARY TREE WELL COVER SHALL BE CASE 3 UNLESS OTHERWISE SPECIFIED.
6. LOCATION OF TREE WELL SUBJECT TO CHANGE AT THE DIRECTION OF THE ENGINEER.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

TEMPORARY TREE WELL COVER



STANDARD PLAN

524-2


SHEET 2 OF 2

SECTION 6

General Facilities

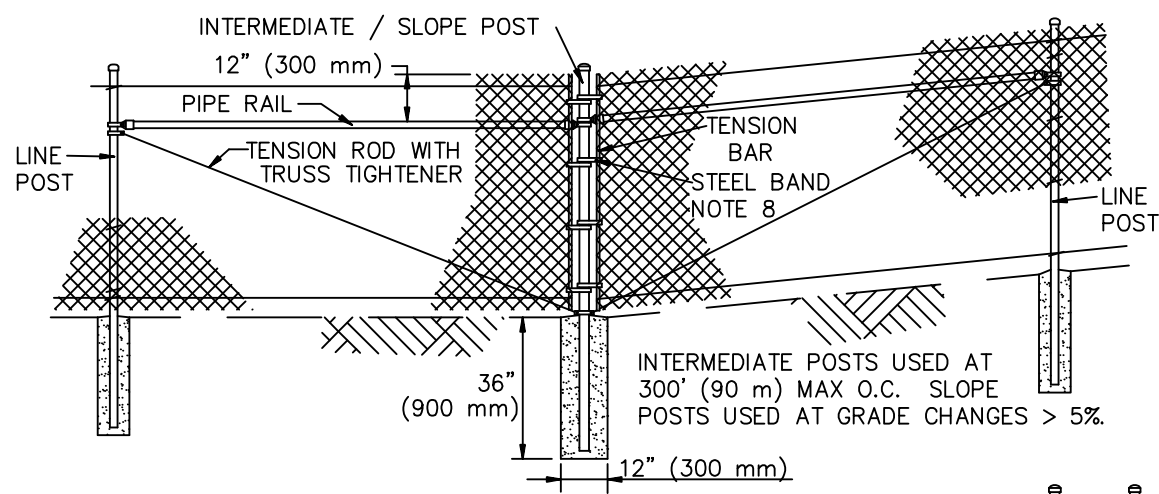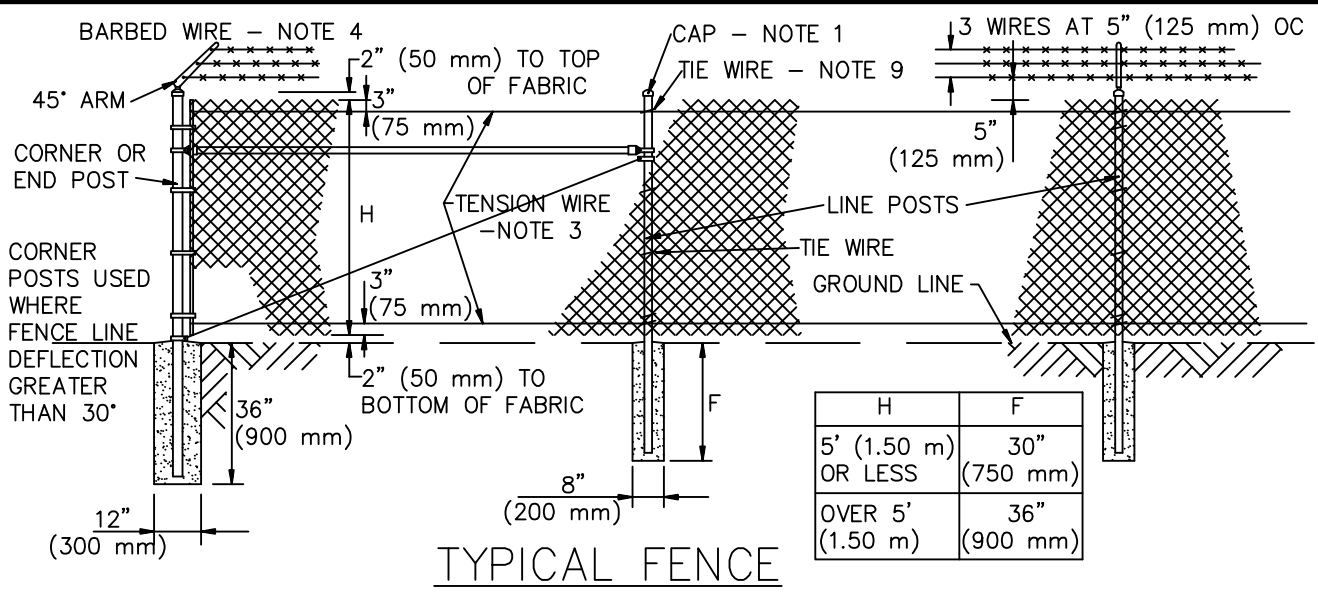

INTERMEDIATE / SLOPE POST




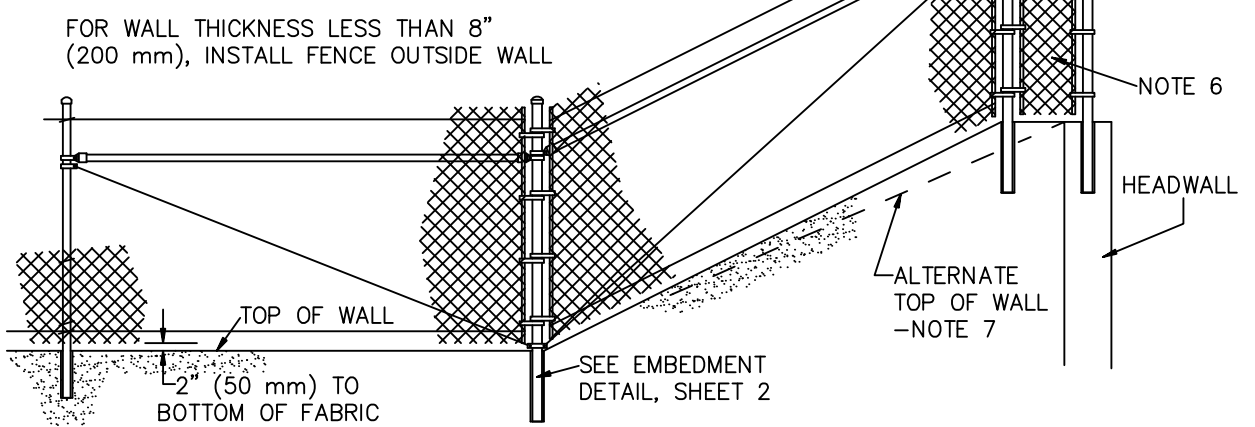


CHANNEL WALL AND WINGWALL AT HEADWALL

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION




PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1984 REV. 1996, 2005	<h1 style="margin: 0;">CHAIN LINK FENCE AND GATES</h1> <p style="font-size: small; margin: 0;">USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION</p>	STANDARD PLAN <h2 style="margin: 0;">600-3</h2> SHEET 1 OF 3
---	---	---

BARBED WIRE - NOTE 4

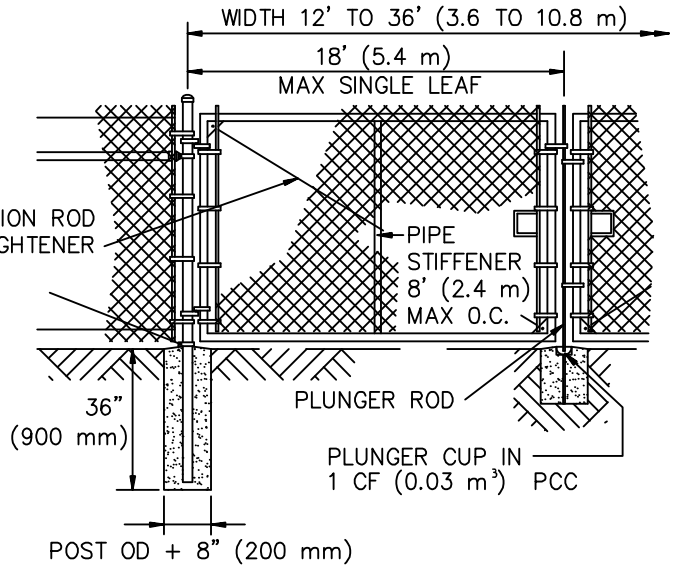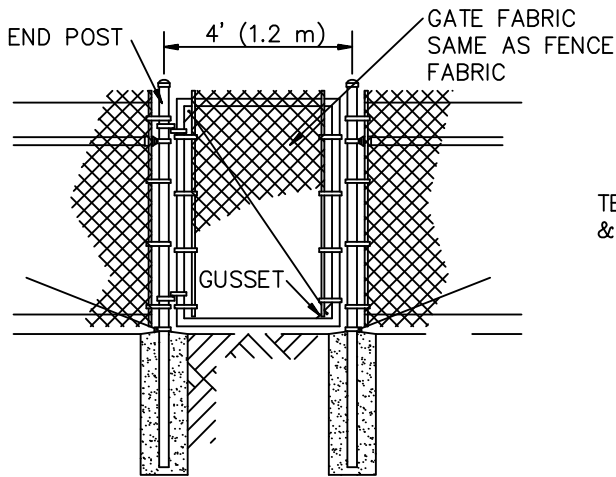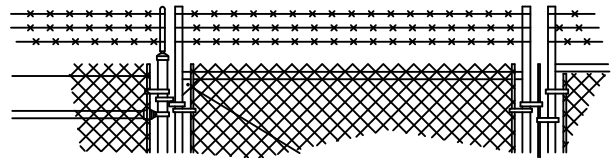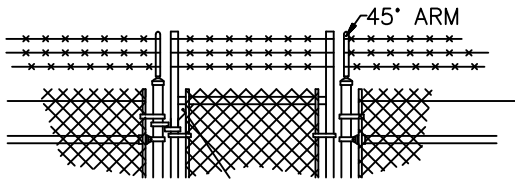


WALK GATE

DRIVE GATE

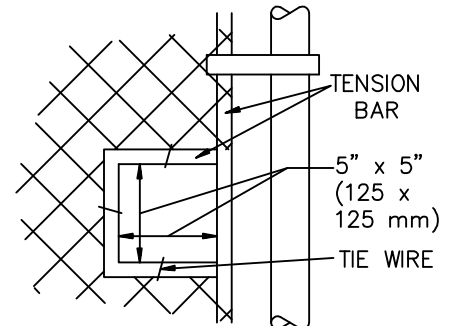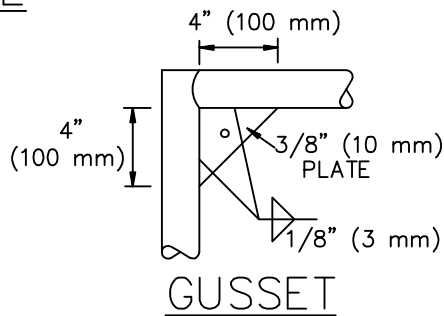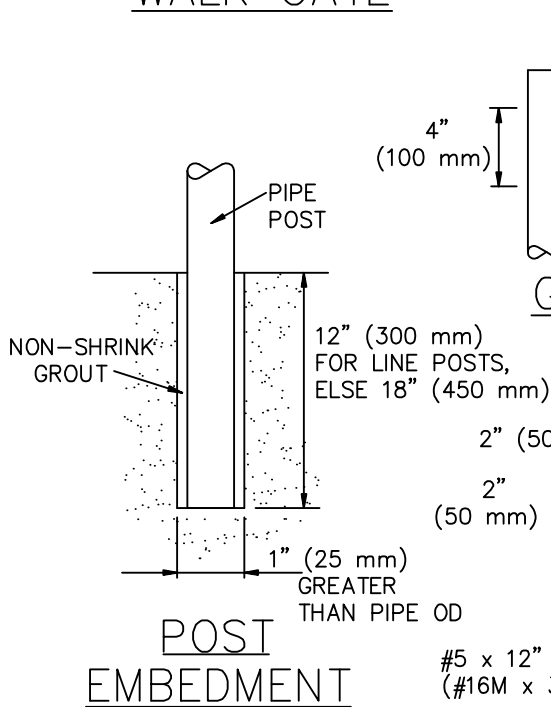

CHAIN AND LOCK
CUT-OUT

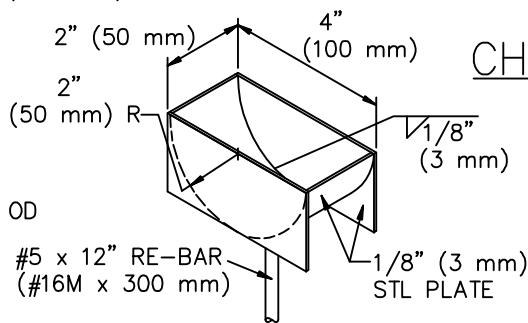

PLUNGER CUP
ISOMETRIC

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

CHAIN LINK FENCE AND GATES

600-3

SHEET 2 OF 3

NOTES:

1. SECURE DRIVE-FIT GALVANIZED CAP TO POST WITH 1/4" (6 mm) ROUND-HEAD RIVET.
2. H DENOTES FABRIC WIDTH AND NOMINAL FENCE HEIGHT. H = 5' (1.5 m) UNLESS OTHERWISE NOTED.
3. IF FENCE WITH TOP RAIL IS SPECIFIED, DELETE STEEL TENSION WIRE AT TOP, AND PIPE RAILS AT INTERMEDIATE, SLOPE, END AND CORNER POSTS. EXTEND TENSION ROD TO TOP RAIL.
4. BARBED WIRE SHALL BE USED ONLY WHEN SPECIFIED.
5. POST SPACING IS MAXIMUM 10' (3.0 m).
6. FILL CLEAR OPENINGS GREATER THAN 3" (75 mm) WITH FABRIC. FOR OPENINGS LESS THAN 18" (450 mm), TIE FABRIC TO POSTS.
7. USE ONE POST FOR COMBINED SLOPE AND CORNER POST IF TOP OF CHANNEL WALL IS CONSTRUCTED AS SHOWN FOR "ALTERNATE".
8. STEEL BANDS AT TENSION BARS SHALL BE 1/8" x 1" (3 x 25 mm), MINIMUM, SPACED AT MAXIMUM 16" (400 mm).
9. SECURE TENSION WIRES TO EACH LINE POST WITH TIE WIRES.




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

CHAIN LINK FENCE AND GATES

600-3

SHEET 3 OF 3

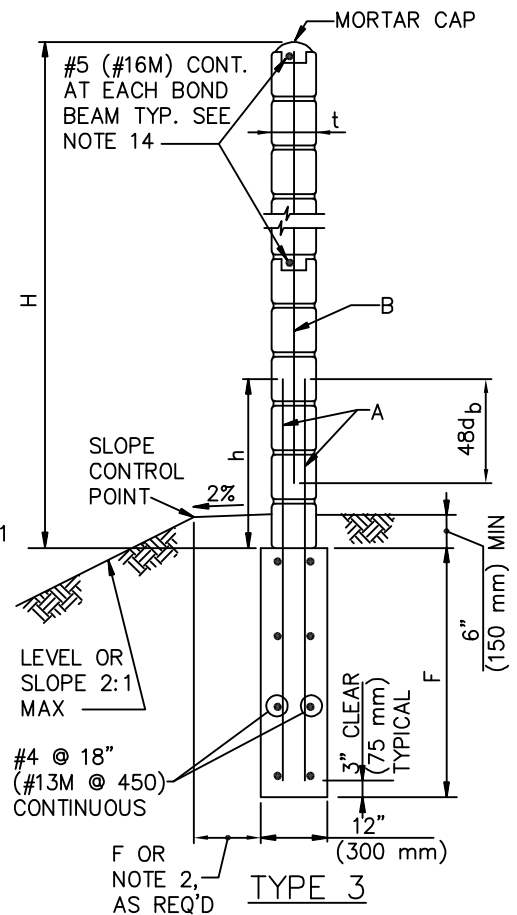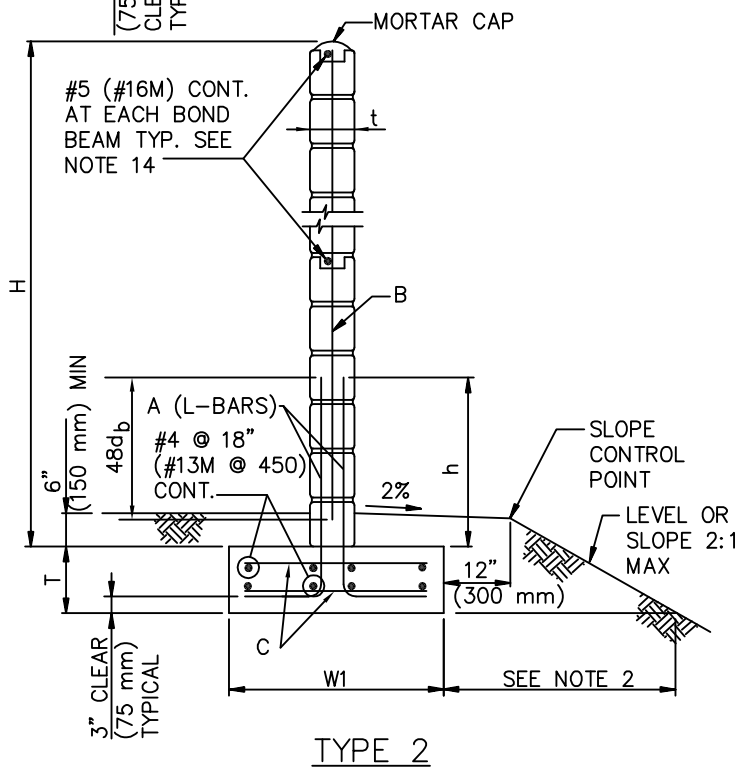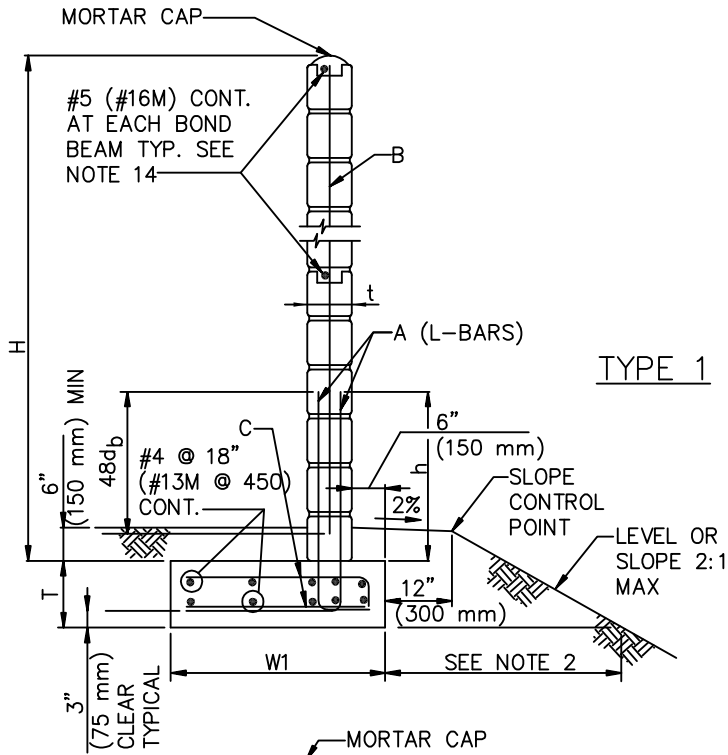

DETAILS FOR DOUBLE REINFORCEMENT
SEE REINFORCING SCHEDULES FOR REQD USE

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2005, 2009




REINFORCED CONCRETE BLOCK WALL

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

601-3

SHEET 1 OF 6

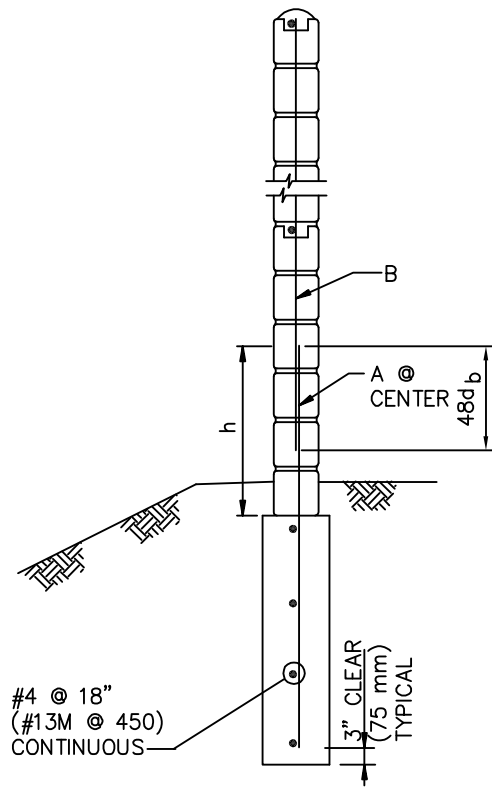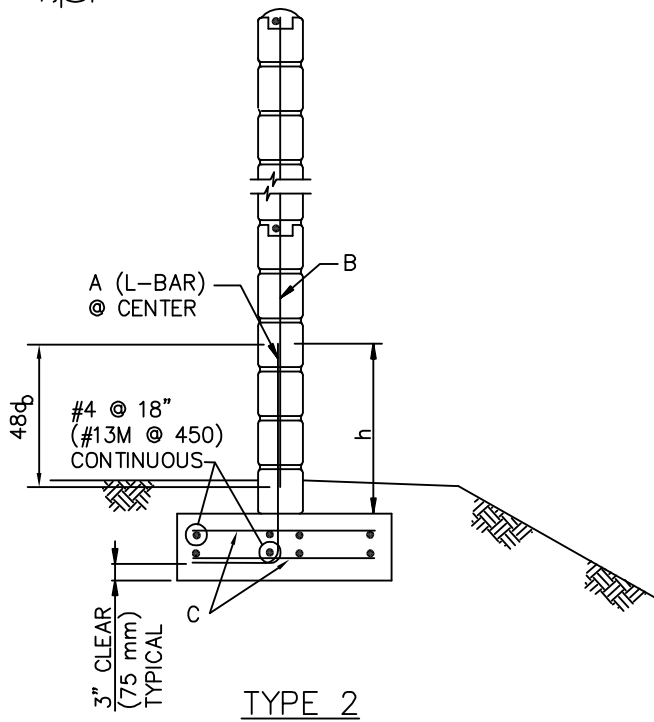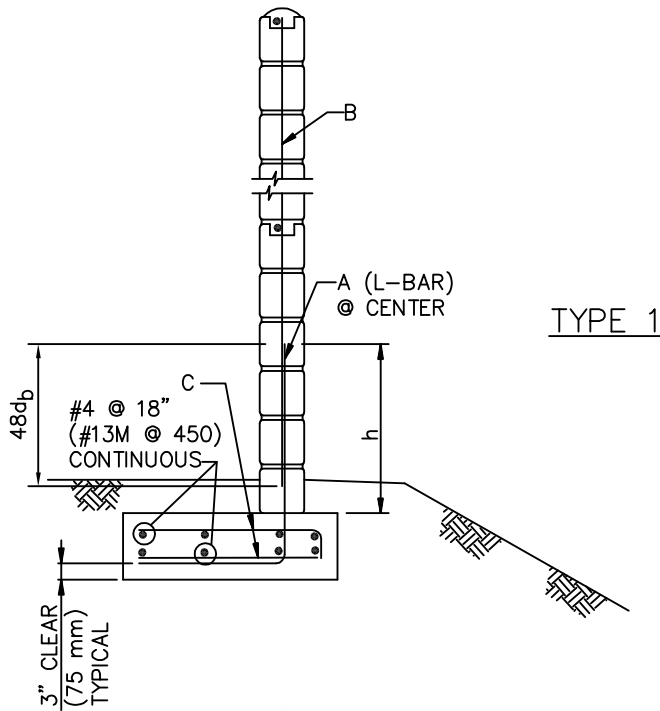

DETAILS FOR SINGLE REINFORCEMENT
 SEE REINFORCING SCHEDULES FOR ALLOWED USE
 SEE SHEET 1 FOR OTHER DIMENSIONS AND DETAILS


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

REINFORCED CONCRETE BLOCK WALL

STANDARD PLAN


601-3

SHEET 2 OF 6

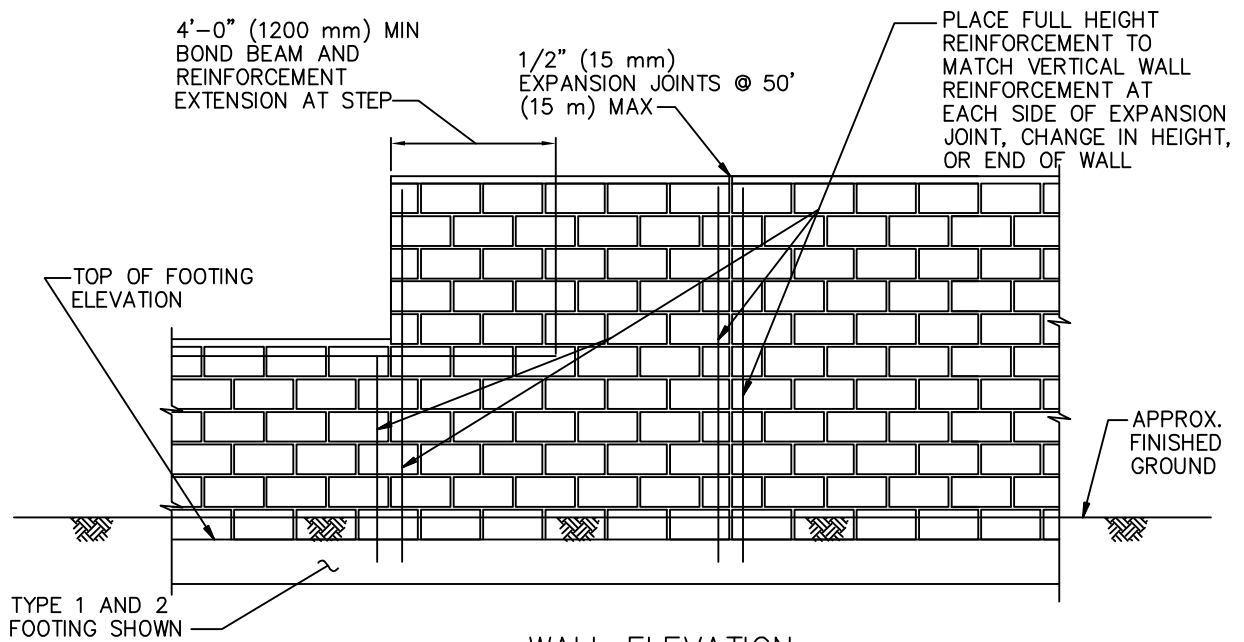


WALL ELEVATION

ALL CELLS WITH VERTICAL REINFORCEMENT AND BOND BEAMS SHALL BE GROUTED SOLID


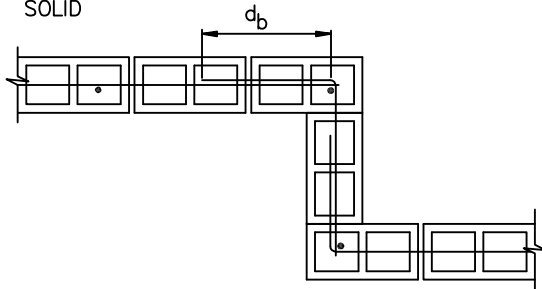


CORNER DETAIL

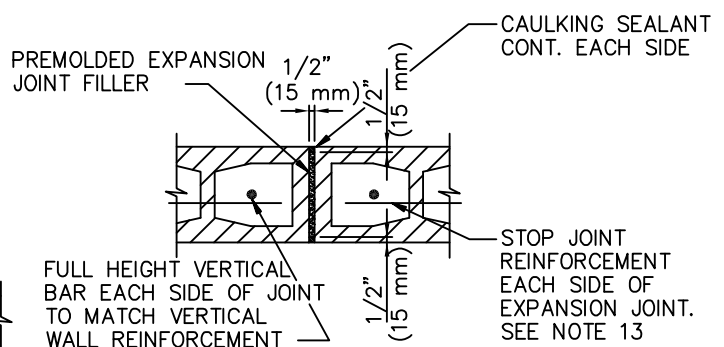

EXPANSION JOINT DETAIL

NOTE:
SINGLE VERTICAL REINFORCING BARS SHALL BE CENTERED IN CELLS. DOUBLE ROWS OF VERTICAL REINFORCING BARS SHALL HAVE THE REINFORCEMENT PLACED IN EACH FACE (EF).

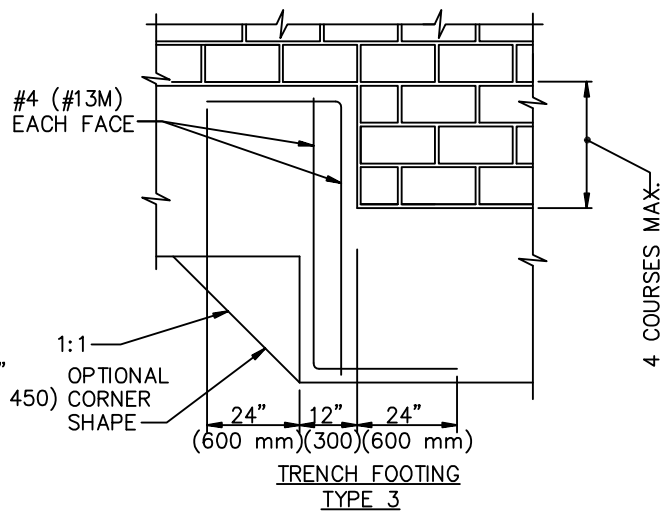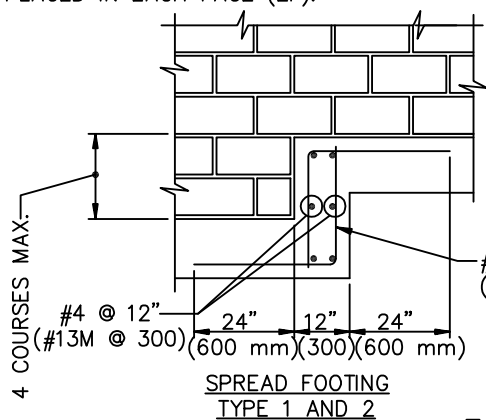

FOOTING STEP DETAILS

LATERAL LOAD = 15 PSF (720 Pa)									
STEM		FOOTING				REINFORCING BARS			
						CUTOFF	SPACING, O.C.		
H	t	T	W1 (TYPE 1)	W2 (TYPE 2)	F (TYPE 3)	h	A	B	C
6'-0" (1.8 m)	6" (150 mm)	12" (300 mm)	2'-3" (675 mm)	2'-3" (675 mm)	2'-9" (825 mm)	30" (750 mm)	#4 @ 48"* (#13M@1200*)	#4 @ 48" (#13M@1200)	#4 @ 48"* (#13M@1200*)
8'-0" (2.4 m)	8" (200 mm)	12" (300 mm)	2'-9" (825 mm)	2'-6" (750 mm)	3'-3" (975 mm)	30" (750 mm)	#4 @ 32"* (#13M@800*)	#4 @ 32" (#13M@800)	#4 @ 32"* (#13M@800*)
10'-0" (3.0 m)	8" (200 mm)	12" (300 mm)	3'-9" (1125 mm)	3'-0" (900 mm)	3'-9" (1125 mm)	30" (750 mm)	#4 @ 32"EF (#13M@800EF)	#4 @ 32" (#13M@800)	#4 @ 32" (#13M@800)

LATERAL LOAD = 20 PSF (960 Pa)									
STEM		FOOTING				REINFORCING BARS			
						CUTOFF	SPACING, O.C.		
H	t	T	W1 (TYPE 1)	W2 (TYPE 2)	F (TYPE 3)	h	A	B	C
6'-0" (1.8 m)	6" (150 mm)	300 mm	2'-9" (825 mm)	2'-6" (750 mm)	3'-3" (975 mm)	30" (750 mm)	#5 @ 32"* (#16M@800*)	#4 @ 32" (#13M@800)	#4 @ 32"* (#13M@800*)
8'-0" (2.4 m)	8" (200 mm)	300 mm	3'-3" (975 mm)	3'-0" (900 mm)	3'-9" (1125 mm)	30" (750 mm)	#4 @ 32"EF (#13M@800EF)	#4 @ 32" (#13M@800)	#4 @ 32" (#13M@800)
10'-0" (3.0 m)	8" (200 mm)	300 mm	4'-3" (1275 mm)	3'-6" (1050 mm)	4'-3" (1275 mm)	42" (1050 mm)	#5 @ 32"EF (#16M@800EF)	#4 @ 32" (#13M@800)	#5 @ 32" (#16M@800)

LATERAL LOAD = 25 PSF (1200 Pa)									
STEM		FOOTING				REINFORCING BARS			
						CUTOFF	SPACING, O.C.		
H	t	T	W1 (TYPE 1)	W2 (TYPE 2)	F (TYPE 3)	h	A	B	C
6'-0" (1.8 m)	6" (150 mm)	300 mm	3'-0" (900 mm)	2'-9" (825 mm)	3'-6" (1050 mm)	30" (750 mm)	#5 @ 16"* (#16M@400*)	#4 @ 32" (#13M@800)	#4 @ 32" (#13M@800)
8'-0" (2.4 m)	8" (200 mm)	300 mm	3'-9" (1125 mm)	3'-3" (975 mm)	4'-0" (1200 mm)	30" (750 mm)	#4 @ 16"EF (#13M@400EF)	#4 @ 32" (#13M@800)	#4 @ 32" (#13M@800)
10'-0" (3.0 m)	8" (200 mm)	300 mm	4'-9" (1425 mm)	4'-0" (1200 mm)	4'-9" (1425 mm)	50" (1250 mm)	#5 @ 16"EF (#16M@400EF)	#4 @ 32" (#13M@800)	#5 @ 32" (#16M@800)

NOTE

SINGLE VERTICAL REINFORCING BARS SHALL BE CENTERED IN CELL.

* FOR SINGLE A-BARS IN FOUNDATION, SEE SHEET 2.

DOUBLE ROWS OF VERTICAL REINFORCING WHERE INDICATED SHALL BE PLACED AT EACH FACE (EF).

DESIGN CRITERIA:

MATERIALS DESIGN DATA:

REINFORCING STEEL $f_y = 60 \text{ KSI (400 MPa)}$

CONCRETE 28TH-DAY STRENGTH:

FOOTING $f'_c = 2,500 \text{ PSI (17 MPa)}$

CONCRETE MASONRY:

PARTIALLY GROUTED $f'_m = 1,500 \text{ PSI (10 MPa)}$

DESIGN CODE:..... GOVERNING BUILDING CODE

DESIGN METHOD:

CONCRETE ULTIMATE STRENGTH METHOD

CONCRETE MASONRY WORKING STRESS METHOD

FOUNDATION:

ALLOWABLE SOIL BEARING PRESSURE 1,000 PSF (48 kPa)

ALLOWABLE LATERAL SOIL BEARING PRESSURE 100 PSF / FT OF DEPTH
(157 kPa / m OF DEPTH)

LATERAL SLIDING RESISTANCE AT CONTACT AREA..... 130 PSF (6.2 kPa)

BUT NOT TO EXCEED 0.40 X DL

SOIL DENSITY 110 PCF (1760 kg/m³)

FACTORS OF SAFETY FOR SPREAD FOOTING (BASED ON SERVICE LOAD CONDITIONS):

OVERTURNING 1.75 MINIMUM

SLIDING 1.5 MINIMUM

1/3 INCREASE IS ALLOWED FOR SHORT TERM LOADS.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

REINFORCED CONCRETE BLOCK WALL

601-3

SHEET 5 OF 6

GENERAL NOTES:

1. CONSULT WITH LOCAL GOVERNING AGENCY FOR DETERMINATION OF LATERAL LOAD AND WALL TYPE LISTED IN TABLES, FOR PROJECT-SPECIFIC USE.
2. DISTANCE OF THE FOOTING FROM DESCENDING SLOPE SHALL BE PER LATEST GOVERNING BUILDING CODE OR PER AGENCY REQUIREMENTS.
3. SPECIAL INSPECTION IS NOT REQUIRED FOR WALLS.
4. GROUND LINE TO BE AT THE SAME ELEVATION ON BOTH SIDES OF THE WALL. WALL SHALL NOT BE USED TO RETAIN EARTH.
5. USE TABULAR INFORMATION FOR THE NEXT HIGHER H FOR INTERMEDIATE WALL HEIGHTS THAT ARE BETWEEN THE H'S GIVEN.
6. CONCRETE SHALL BE 500-C-2500 (295-C-17) PER SSPWC 201-1.1.2.
7. REINFORCING SHALL BE LAPPED A MINIMUM 48 BAR DIA. GRADE 60 UNLESS NOTED OTHERWISE PER SSPWC SECTION 201-2, 303-4.1.3, JOINT REINFORCING WIRE: ASTM A82.
8. ALL REINFORCED CONCRETE CONSTRUCTION SHALL BE IN ACCORDANCE WITH SSPWC 303.
9. FOR TYPE OF BLOCKS, BOND PATTERN AND JOINT FINISH, SEE PROJECT PLANS.
10. ALL MASONRY CONSTRUCTION TO BE IN ACCORDANCE WITH SSPWC 303-4.
11. HOLLOW MASONRY UNITS...ASTM C-90. TYPE I. NORMAL WEIGHT UNITS.
MORTAR ...1:1/2:3, PORTLAND CEMENT - LIME - SAND RATIO, 1800 PSI (13 MPa) PER SSPWC 202-2.2.1.
GROUT1:3:2 PORTLAND CEMENT - SAND - PEA GRAVEL RATIO, 2,000 PSI (14 MPa) PER SSPWC 202-2.2.2.
12. PROVIDE FULL MORTAR BED AT THE BOTTOM OF THE FIRST COURSE AND OMIT MORTAR BETWEEN VERTICAL JOINTS OF LOWEST EXPOSED COURSE.
13. WHEN BLOCKS ARE LAID IN STACKED BOND, CONTINUOUS HORIZONTAL JOINT REINFORCEMENT SPACED AT 4'-0" (1200 mm) OC SHALL BE PROVIDED IN ADDITION TO THE BOND BEAM REINFORCEMENT PER SSPWC 303-4.1.2, LOCATE REINFORCEMENT IN JOINTS THAT ARE APPROXIMATE MIDPOINT BETWEEN BOND BEAMS.
14. BOND BEAMS SHALL BE PLACED AT TOP OF WALL AND SUBSEQUENTLY SPACED NOT TO EXCEED 4'-0" (1200 mm) O.C. BELOW.
15. ONLY CELLS WITH REINFORCING BARS SHALL BE GROUTED PER SSPWC 303-4.1.3.
16. HORIZONTAL JOINTS SHALL BE TOOLED CONCAVE OR WEATHERED. VERTICAL JOINTS SHALL BE TOOLED CONCAVE OR RAKED. WEATHERED AND RAKED JOINTS ARE NOT PERMITTED FOR SLUMPED BLOCKS.




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

REINFORCED CONCRETE BLOCK WALL


STANDARD PLAN

601-3



SHEET 6 OF 6

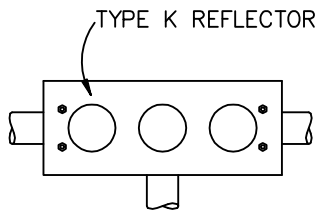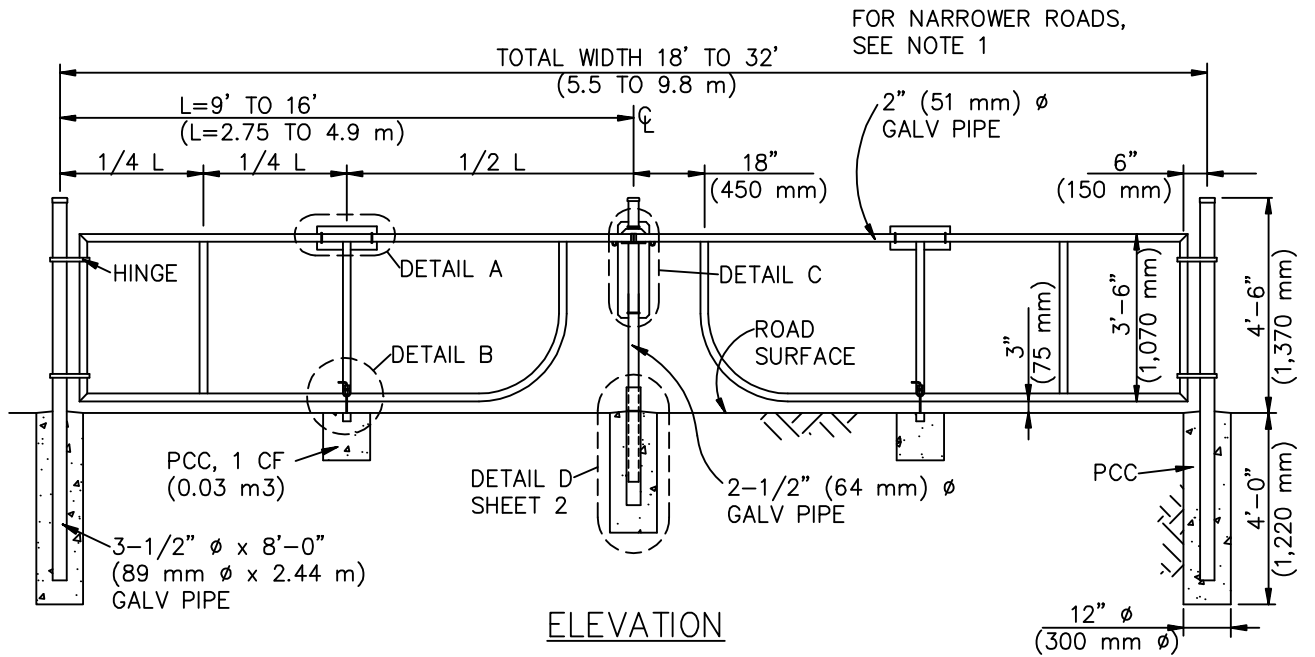

DETAIL A

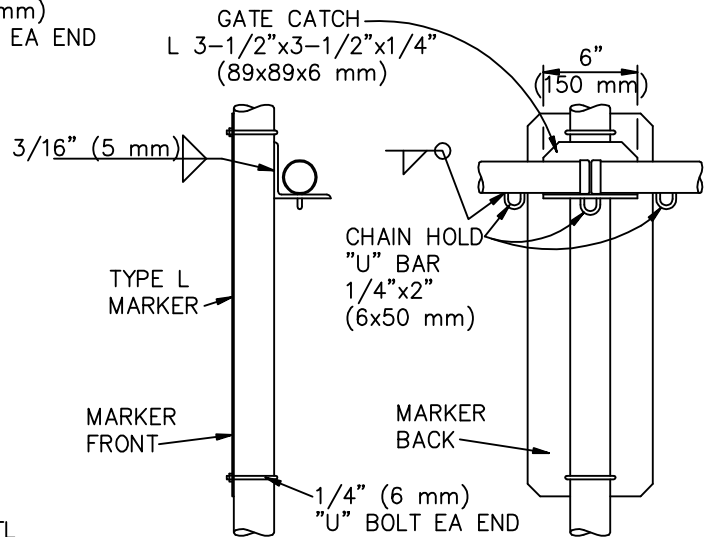

DETAIL C

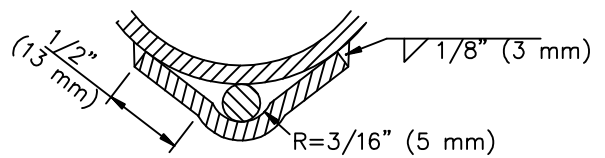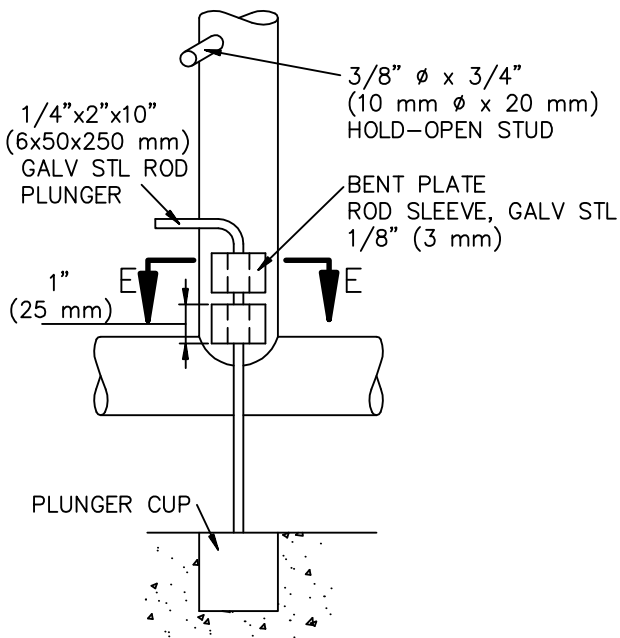

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2005, 2009

**STANDARD PIPE GATE
FOR ACCESS ROADS**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

602-3


SHEET 1 OF 2

NOTES:




1. FOR ROADWAYS 16'-0" (4.8 m) WIDE OR LESS, USE A SINGLE GATE. PLACE THE ANGLE CATCH ON A PERMANENT END POST.
2. PIPE SHALL BE STANDARD WEIGHT, PER AISC STANDARDS.
3. CUT THE PIPE TO PROVIDE A CLOSE FIT-UP OF THE JOINTS.
4. USE 100% PENETRATION WELDS FOR PIPE CONNECTIONS.
5. PAINT GATE WITH ONE COAT OF ALUMINUM PAINT AFTER FABRICATION.
6. GATE HINGES SHALL BE HEAVY DUTY, MALLEABLE IRON OR STEEL, INDUSTRIAL SERVICE TYPE, WITH 270° SWING.
7. TYPE K AND TYPE L MARKERS SHALL CONFORM TO STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION ("CALTRANS") STANDARDS. THE REFLECTORS SHALL BE FILM-TYPE.
8. SECURE NUTS AT U BOLT ENDS FROM REMOVAL BY WELDING OR PEENING AFTER INSTALLING MARKERS.

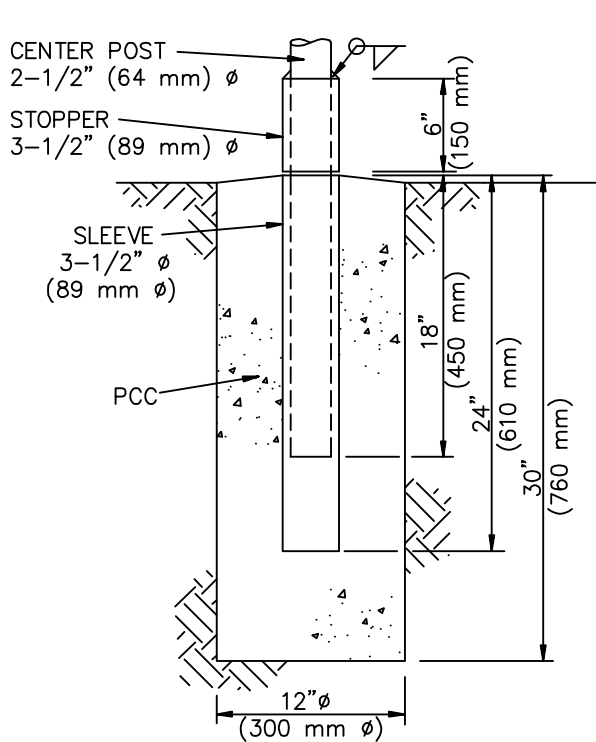

DETAIL D

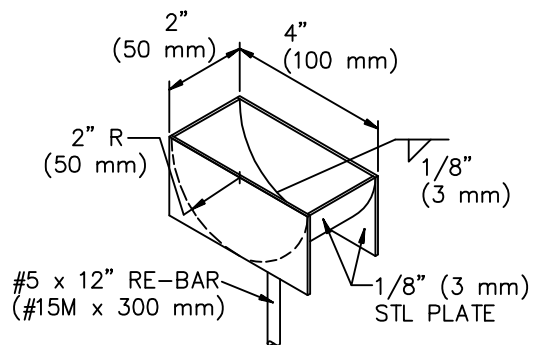

PLUNGER CUP
ISOMETRIC

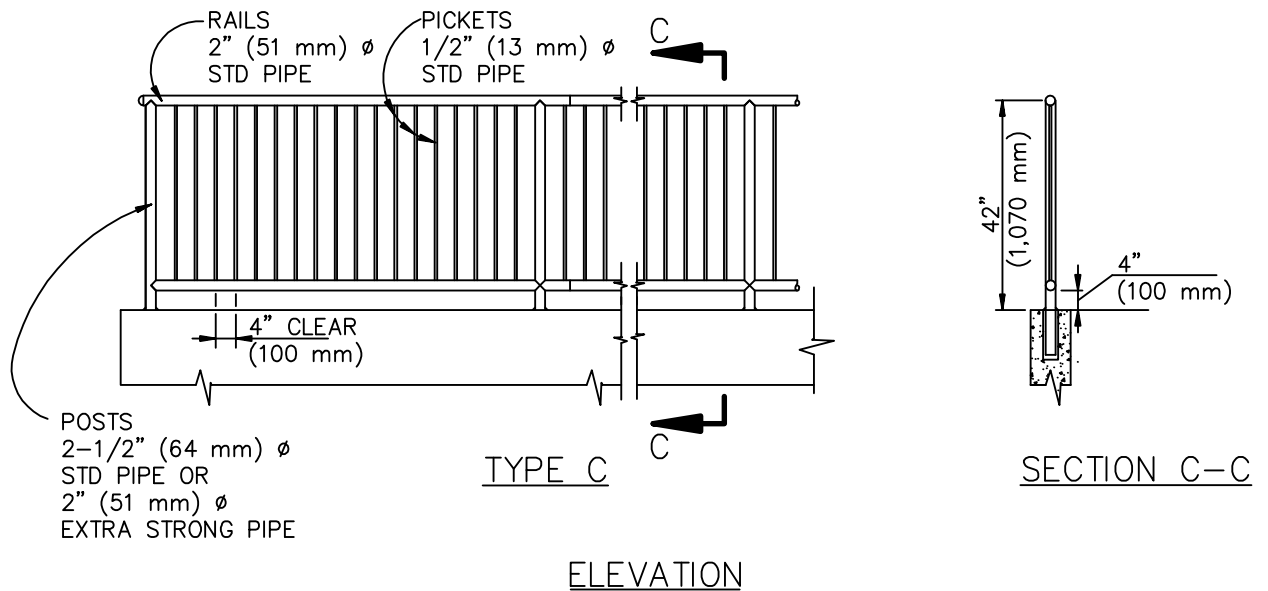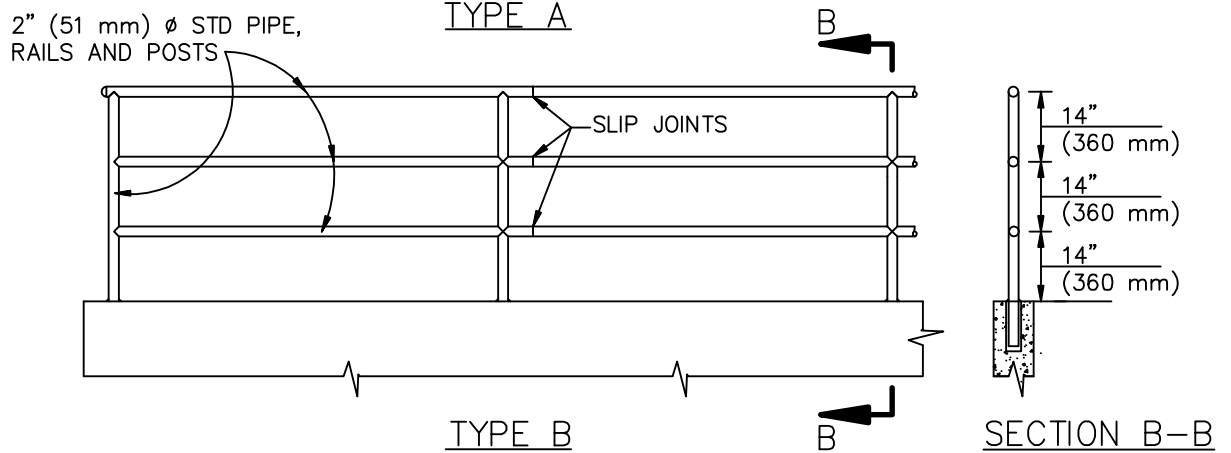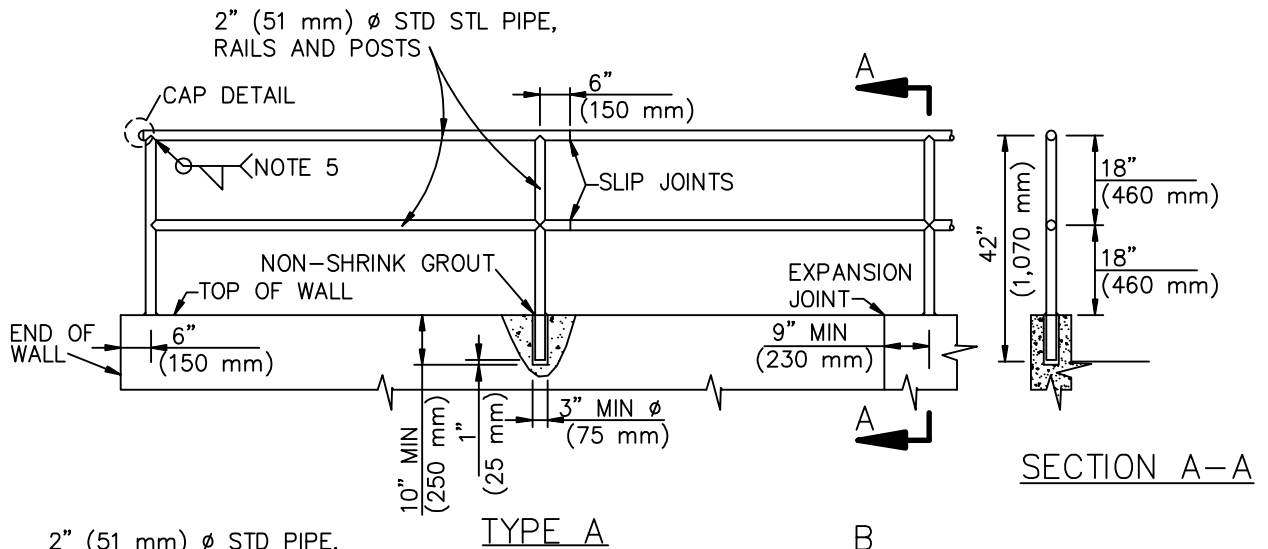

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2005, 2009


METAL HAND RAILINGS

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

606-3


SHEET 1 OF 3

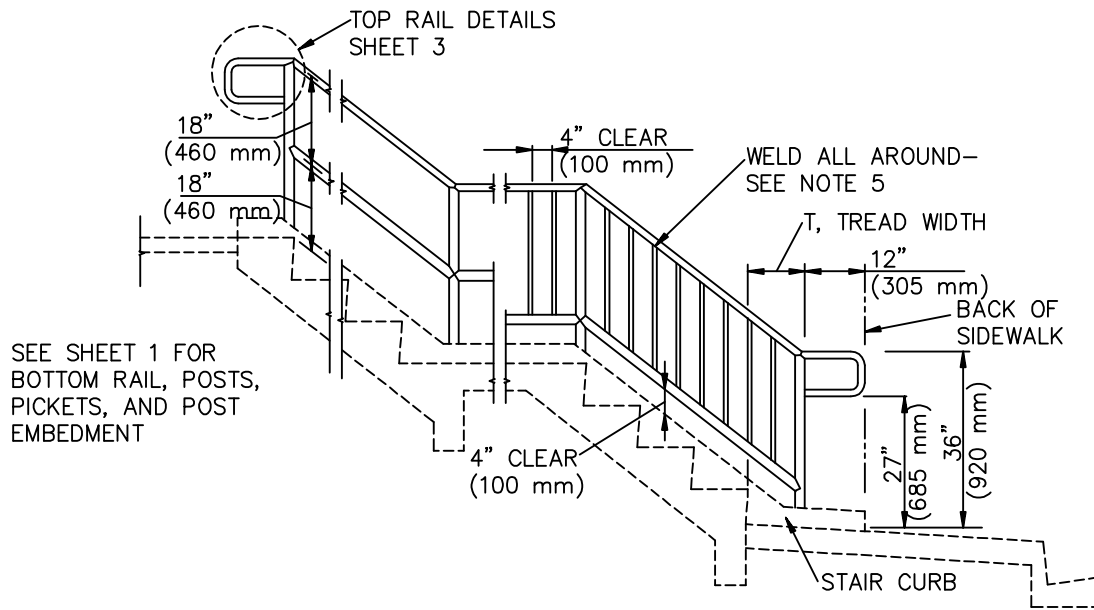


TYPE A

TYPE C

HANDRAIL INSTALLATION ON STAIRWAYS

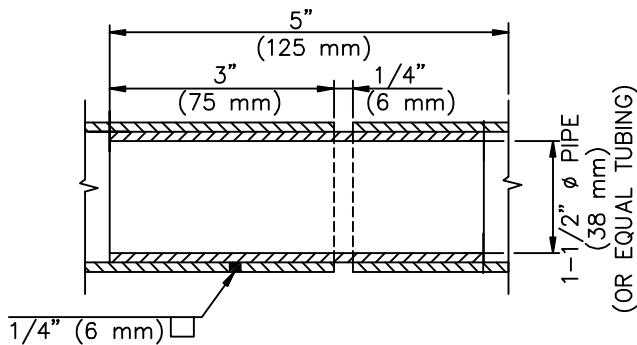




SLIP JOINT DETAIL




CAP DETAIL FOR RAIL END

NOTES:


1. USE TYPE C WHERE ADJACENT GRADE IS MORE THAN 2'-6" (760 mm) BELOW LANDING OR SIDEWALK FINISHED SURFACE.
2. RAILS, POSTS, AND PICKETS SHALL BE GALVANIZED STEEL PIPE.
3. PROVIDE SLIP JOINTS AT STAIRWAY EXPANSION JOINTS, 24' (7.3 m) MAXIMUM.
4. MAXIMUM SPACING OF POSTS SHALL BE 8'-0" (2.44 m) ON STRAIGHT ALIGNMENTS, AND 6'-0" (1.83 m) ON CURVED ALIGNMENTS WITH LESS THAN 30' (9.1 m) RADIUS. MAKE SPACING UNIFORM BETWEEN CHANGES IN ALIGNMENT.
5. WELDS SHALL BE SLOT OR FILLET WELDS EQUAL TO THICKNESS OF PIPE. WELD ALL JOINTS ALL AROUND.

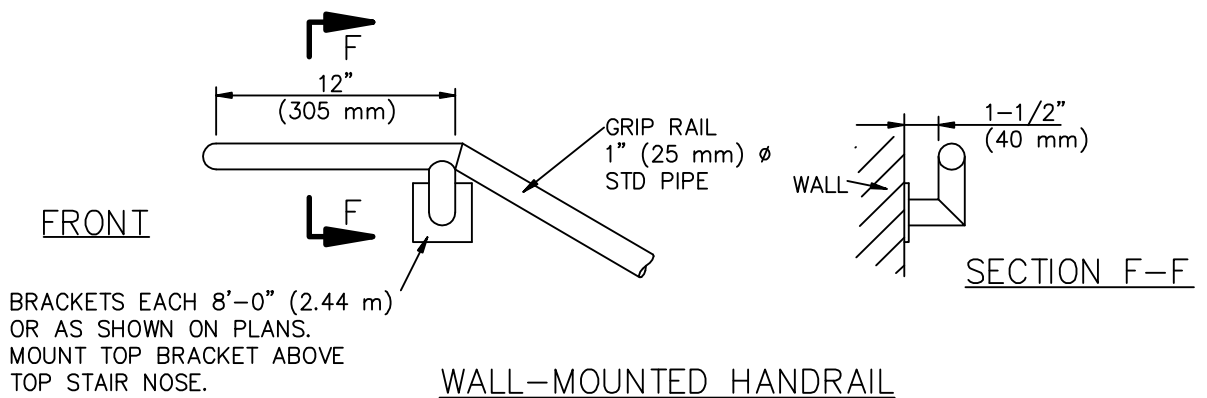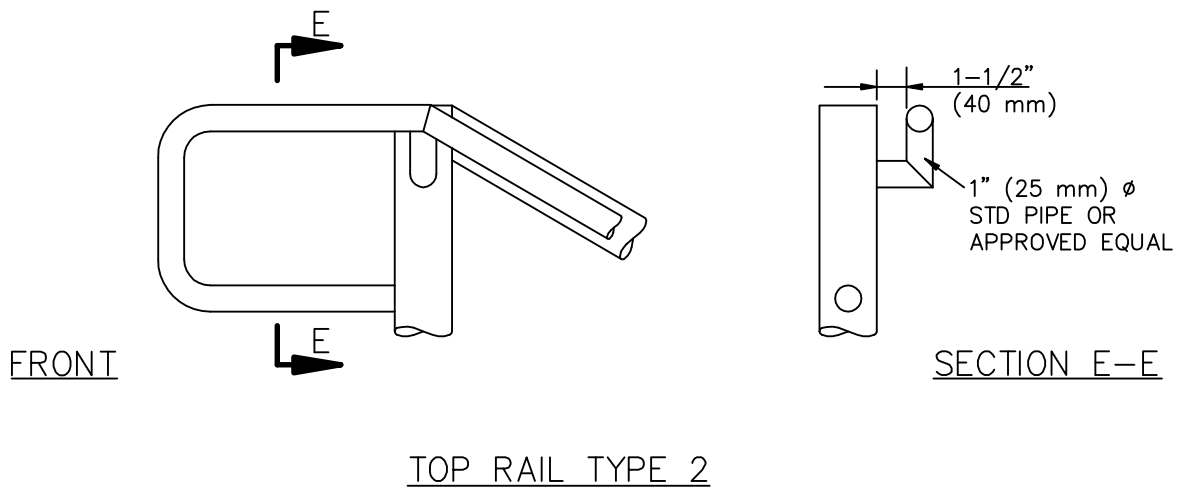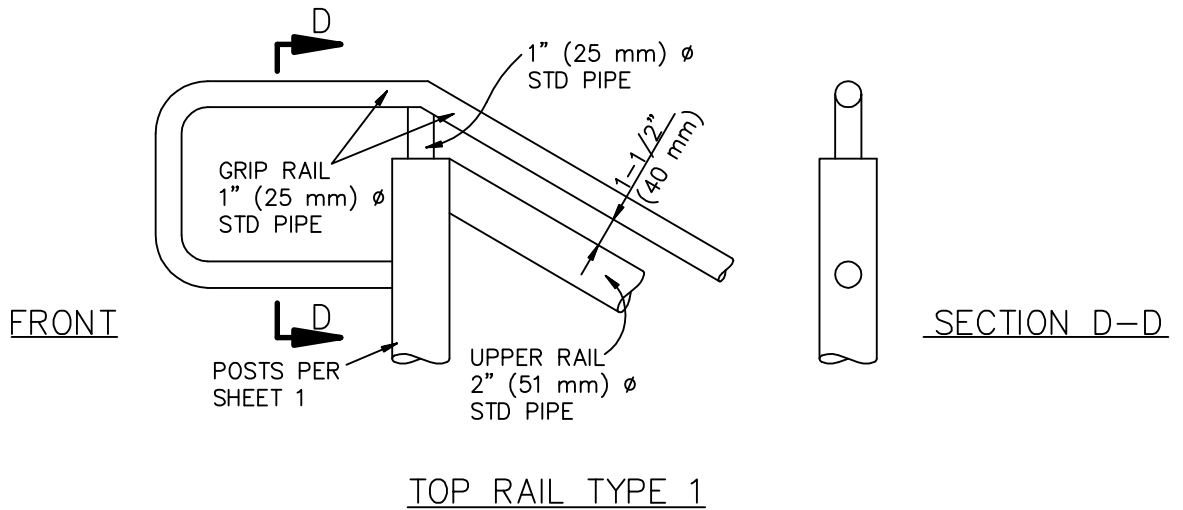

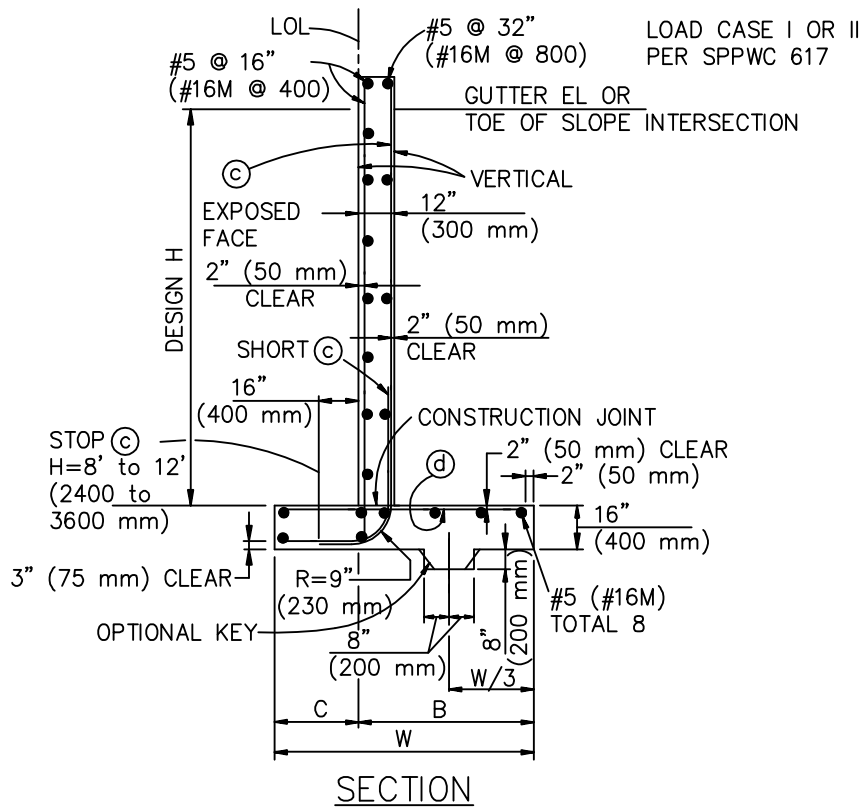

NUMBER ABOVE SHORT C BARS IS DISTANCE, INCHES (mm), FROM TOP OF FOOTING TO END OF SHORT BARS

BARS ALONG EXPOSED FACE NOT SHOWN

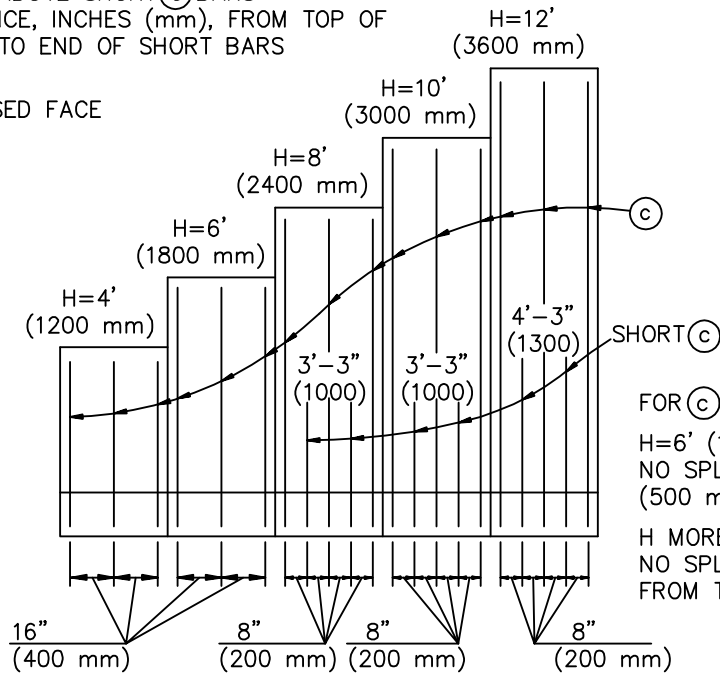

FOR C AND SHORT C BARS
 H=6' (1800 mm) OR LESS:
 NO SPLICES WITHIN 20" (500 mm) FROM TOP OF FOOTING
 H MORE THAN 6' (1800 mm):
 NO SPLICES WITHIN H/4 FROM TOP OF FOOTING

ELEVATION

SIMILAR TO CALTRANS TYPE 1A

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1993
 REV. 1996, 2005, 2009

**REINFORCED CONCRETE
 RETAINING WALL TYPE 1**

STANDARD PLAN

610-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


SHEET 1 OF 2

TABLE OF REINFORCING STEEL, DIMENSIONS AND DATA

DESIGN H	4' (1200 mm)	6' (1800 mm)	8' (2400 mm)	10' (3000 mm)	12' (3600 mm)
W	3'-2" (1000)	4'-2" (1300)	5'-2" (1600)	6'-2" (1900)	7'-2" (2200)
C	1'-0" (300)	1'-4" (400)	1'-8" (500)	2'-0" (600)	2'-4" (700)
B	2'-2" (700)	2'-10" (900)	3'-6" (1100)	4'-2" (1300)	4'-10" (1500)
⊙ BARS	#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#5 @ 8" (#16M @ 200)	#6 @ 8" (#19M @ 200)	#8 @ 8" (#25M @ 200)
⊙ BARS	(#5 @ 16") (#16M @ 400)	#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#5 @ 8" (#16M @ 200)	#6 @ 8" (#19M @ 200)
CASE I TOE PRESSURE, psf (kPa)	1590 (75)	1930 (95)	2240 (110)	2550 (125)	2840 (135)
CASE II TOE PRESSURE, psf (kPa)	1060 (50)	1460 (70)	1860 (90)	2280 (110)	2700 (130)

NOTES:

1. SEE SPPWC 617 FOR STANDARD WALL DETAILS.
2. METRIC REINFORCING BAR SPACING IS IN MILLIMETERS.

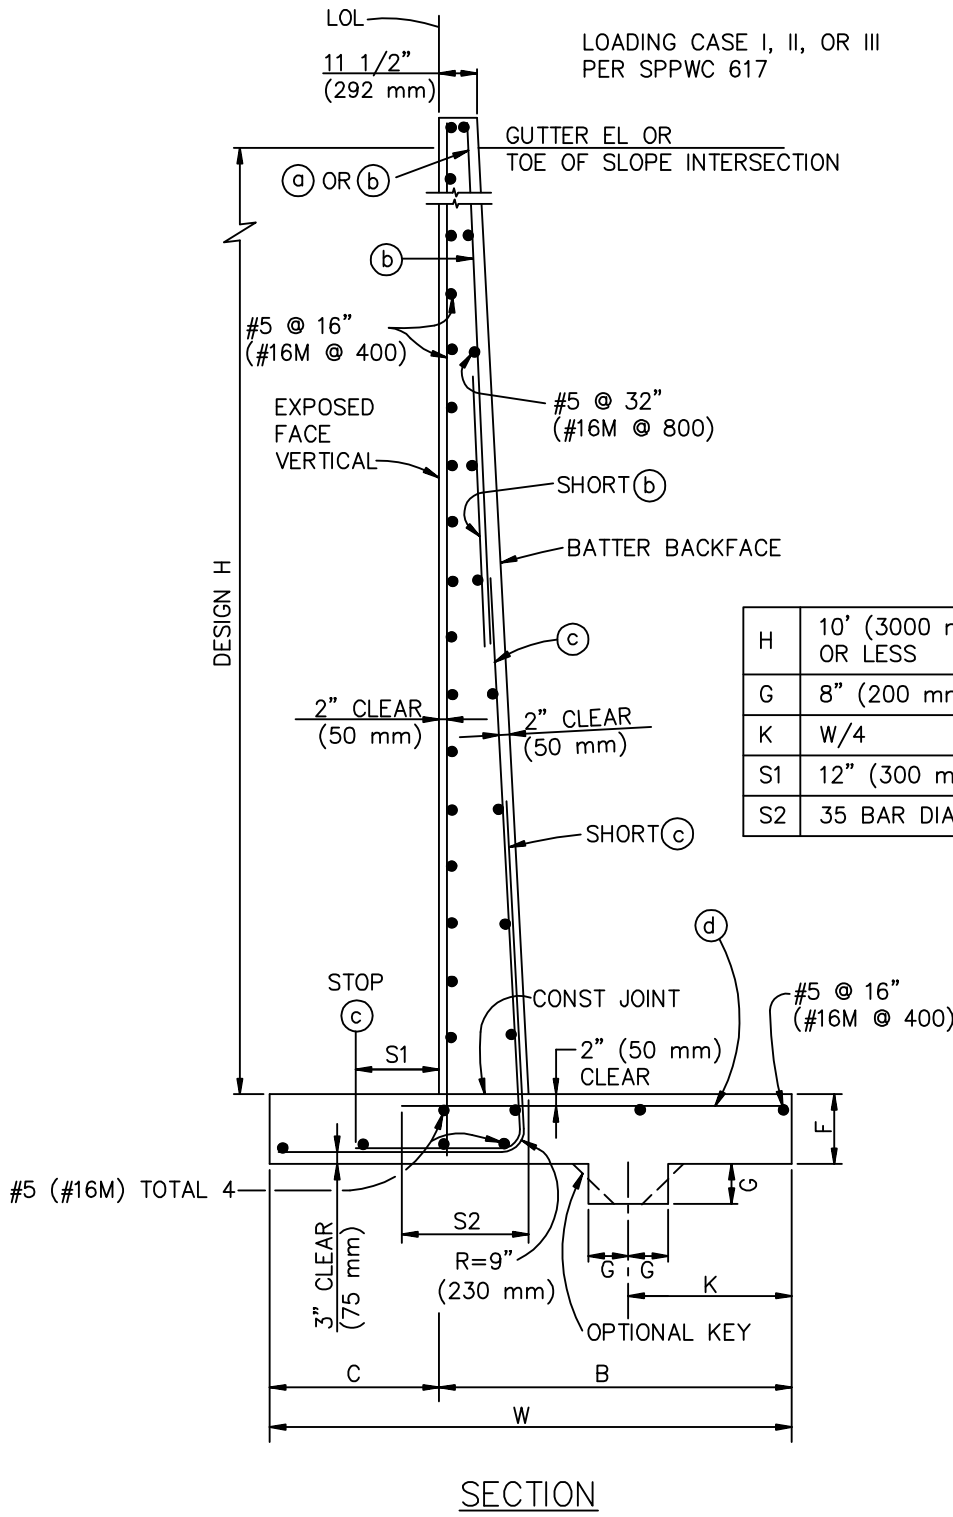

NOTE:

SEE SPPWC 617 FOR STANDARD WALL DETAILS.

SIMILAR TO CALTRANS TYPE 1

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION		
PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1993 REV. 1996, 2005, 2009	<h2 style="margin: 0;">REINFORCED CONCRETE RETAINING WALL TYPE 2</h2>	STANDARD PLAN <b style="font-size: 1.5em;">611-3 SHEET 1 OF 3
USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION		

H, FT (mm)	20' (6100)	22' (6700)	24' (7300)	26' (7900)
SHORT (b) LENGTH	7'-0" (2200)	8'-0" (2500)	7'-9" (2400)	11'-0" (3400)

ELEVATION

BARS ALONG EXPOSED FACE
NOT SHOWN

NUMBER ABOVE BARS SHOWS
DISTANCE, INCHES (mm), FROM
TOP OF FOOTING TO UPPER
END OF BARS

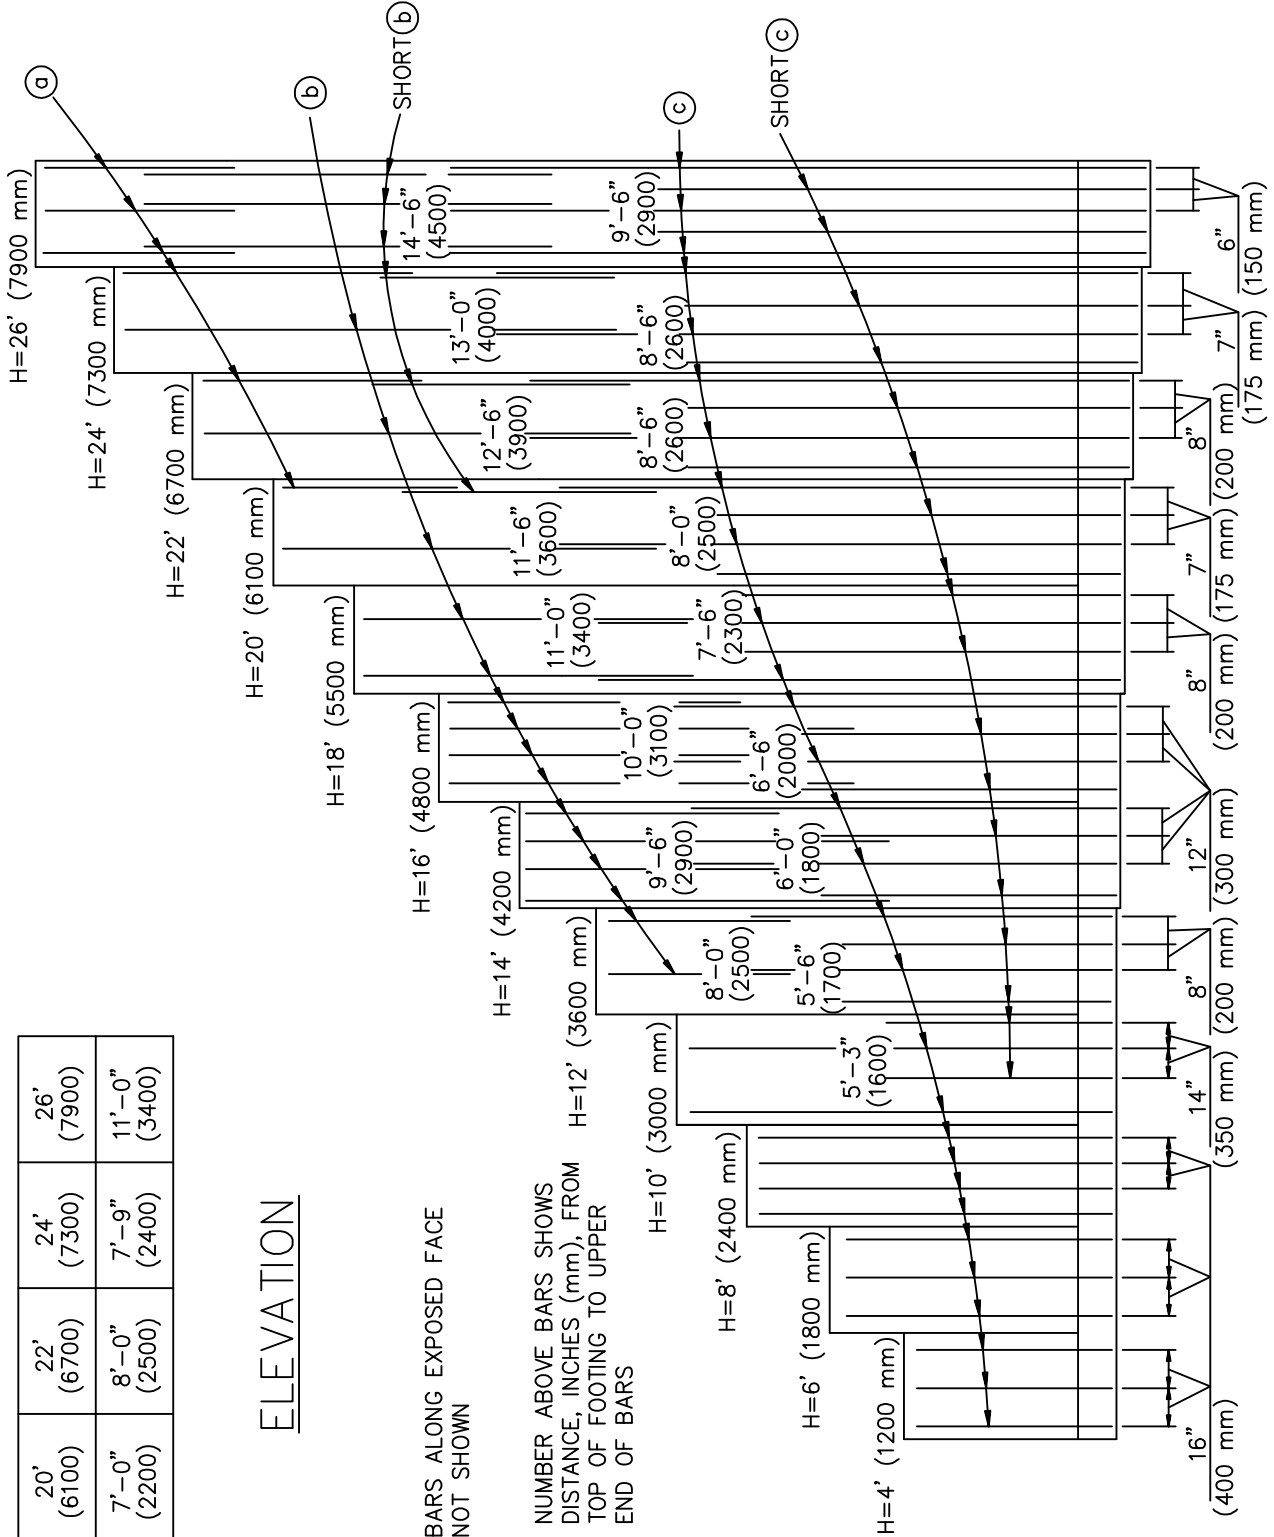


TABLE OF REINFORCING STEEL DIMENSIONS AND DATA

DESIGN H	4' (1200 mm)	6' (1800)	8' (2400)	10' (3000)	12' (3600)	14' (4200)	
W	3'-2" (1000)	4'-2" (1300)	5'-2" (1600)	6'-2" (1900)	7'-2" (2200)	8'-0" (2450)	
C	1'-0" (300)	1'-4" (400)	1'-8" (500)	2'-0" (600)	2'-4" (700)	2'-8" (800)	
B	2'-2" (700)	2'-10" (900)	3'-6" (1100)	4'-2" (1300)	4'-10" (1500)	5'-4" (1650)	
F	1'-4" (400)	1'-4" (400)	1'-4" (400)	1'-4" (400)	1'-4" (400)	1'-6" (450)	
BATTER	100: 4	100: 4	100: 4	100: 4	100: 4	100: 4	
Ⓐ BARS	—	—	—	—	—	—	
Ⓑ BARS	—	—	—	—	#5 @ 16" (#16M @ 400)	#5 @ 12" (#16M @ 300)	
Ⓒ BARS	#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#6 @ 14" (#19M @ 350)	#6 @ 8" (#19M @ 200)	#8 @ 12" (#25M @ 300)	
Ⓓ BARS	#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#5 @ 14" (#16M @ 350)	#6 @ 8" (#16M @ 200)	#8 @ 12" (#25M @ 300)	
TOE PRESSURE	LOAD CASE I	1600 psf (80 kPa)	1900 (90)	2200 (105)	2500 (120)	2800 (135)	3300 (160)
	LOAD CASE II	1100 (55)	1500 (70)	2000 (95)	2300 (110)	2700 (130)	3300 (160)
	LOAD CASE III	1300 (65)	1700 (80)	2100 (100)	2500 (120)	2900 (140)	3400 (165)
DESIGN H	16' (4800)	18' (5500)	20' (6100)	22' (6700)	24' (7300)	26' (7900)	
W	9'-0" (2750)	10'-0" (3050)	11'-0" (3350)	12'-0" (3700)	13'-3" (4050)	14'-3" (4350)	
C	3'-0" (900)	3'-4" (1000)	3'-8" (1100)	4'-0" (1200)	4'-5" (1350)	4'-9" (1450)	
B	6'-0" (1850)	6'-8" (2050)	7'-4" (2250)	8'-0" (2500)	8'-10" (2700)	9'-6" (2900)	
F	1'-6" (450)	1'-6" (450)	1'-6" (450)	1'-8" (500)	1'-10" (550)	2'-2" (650)	
BATTER	100: 4	100: 4	100: 4	100: 4	100: 5	100: 6	
Ⓐ BARS	—	—	#5 @ 28" (#16M @ 700)	#5 @ 32" (#16M @ 800)	#5 @ 28" (#16M @ 700)	#5 @ 12" (#16M @ 300)	
Ⓑ BARS	#5 @ 12" (#16M @ 300)	#6 @ 16" (#19M @ 400)	#8 @ 14" (#25M @ 350)	#8 @ 16" (#25M @ 400)	#8 @ 14" (#25M @ 350)	#8 @ 12" (#25M @ 300)	
Ⓒ BARS	#9 @ 12" (#29M @ 300)	#9 @ 8" (#29M @ 200)	#9 @ 7" (#29M @ 175)	#11 @ 8" (#36M @ 200)	#11 @ 7" (#36M @ 175)	#11 @ 6" (#36M @ 150)	
Ⓓ BARS	#9 @ 12" (#29M @ 300)	#9 @ 8" (#29M @ 200)	#8 @ 7" (#29M @ 175)	#11 @ 8" (#36M @ 200)	#11 @ 7" (#36M @ 175)	#11 @ 6" (#36M @ 150)	
TOE PRESSURE	LOAD CASE I	3500 psf (450 kPa)	4000 (450)	4300 (205)	4600 (220)	4900 (235)	5300 (255)
	LOAD CASE II	3600 (175)	4200 (200)	4700 (225)	5500 (265)	5900 (285)	6500 (310)
	LOAD CASE III	3800 (180)	4300 (205)	4800 (230)	5400 (260)	5800 (280)	6500 psf (310 kPa)

METRIC REINFORCING BAR SPACING IS IN MILLIMETERS


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**REINFORCED CONCRETE
RETAINING WALL TYPE 2**

611-3

SHEET 3 OF 3

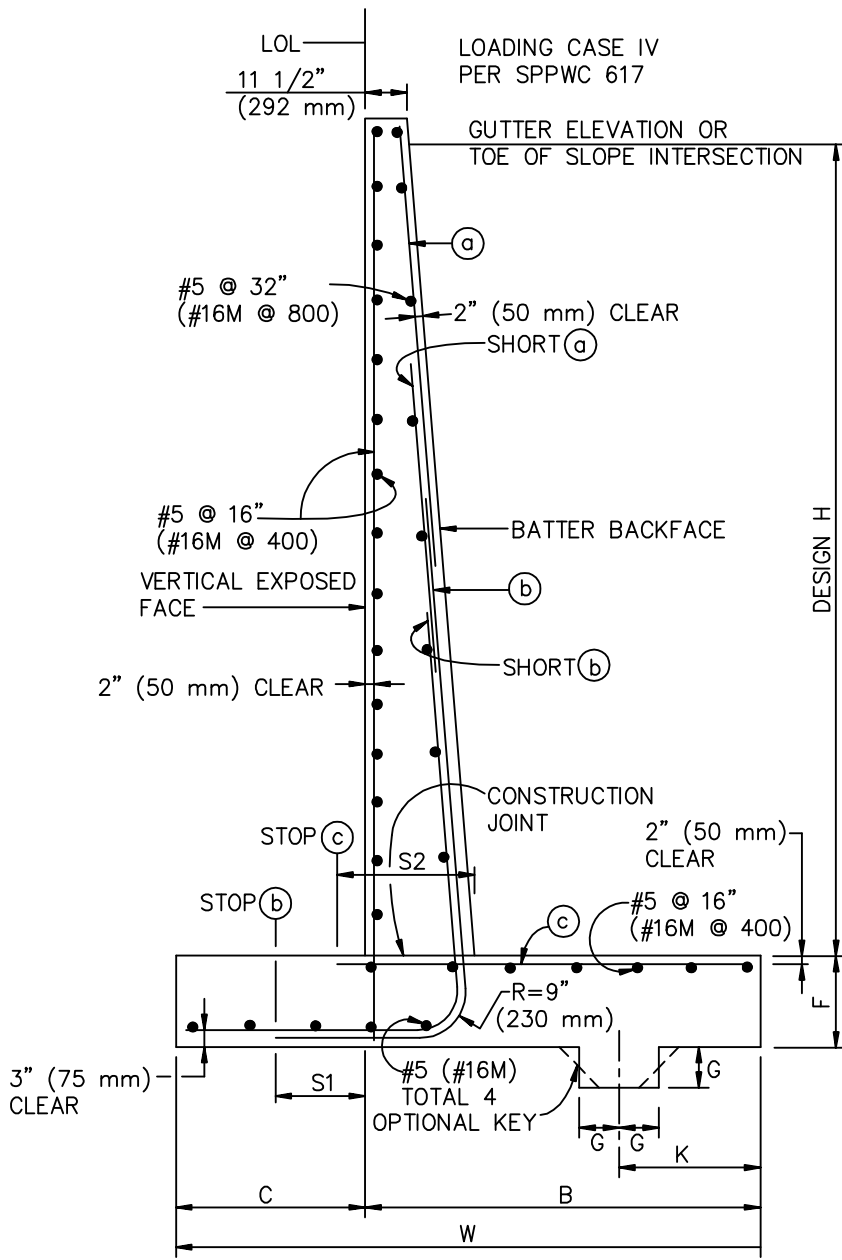


SECTION

NOTE:
SEE SPPWC 617 FOR STANDARD WALL DETAILS.

SIMILAR TO CALTRANS TYPE 2

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION		
PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1993 REV. 1996, 2005, 2009	<h2 style="margin: 0;">REINFORCED CONCRETE RETAINING WALL TYPE 3</h2>	STANDARD PLAN <h1 style="margin: 0;">612-3</h1>
USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION		SHEET 1 OF 3

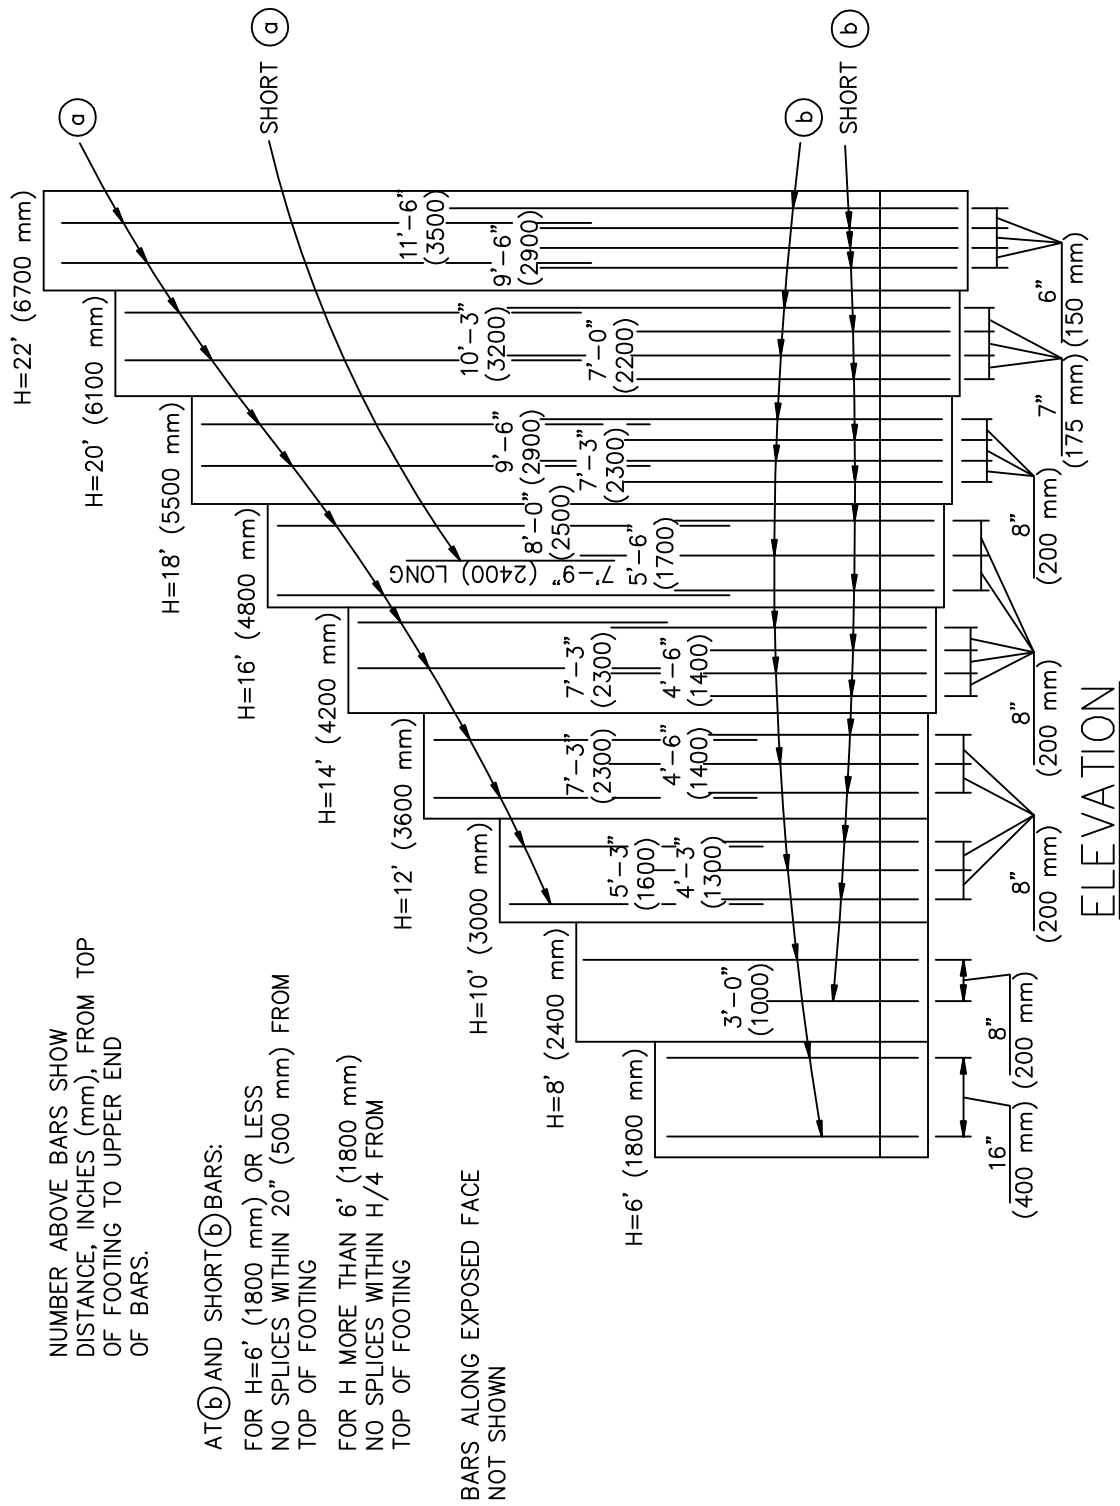

NUMBER ABOVE BARS SHOW
DISTANCE, INCHES (mm), FROM TOP
OF FOOTING TO UPPER END
OF BARS.

AT (a) AND SHORT (b) BARS:
FOR H=6' (1800 mm) OR LESS
NO SPLICES WITHIN 20" (500 mm) FROM
TOP OF FOOTING
FOR H MORE THAN 6' (1800 mm)
NO SPLICES WITHIN H/4 FROM
TOP OF FOOTING


BARS ALONG EXPOSED FACE
NOT SHOWN

ELEVATION

TABLE OF REINFORCING STEEL, DIMENSIONS AND DATA

DESIGN H	6' (1800 mm)	8'	10'	12'	14'	16'	18'	20'	22'
W	3'-10" (1200)	5'-3" (1600)	6'-7" (2000)	8'-1" (2500)	9'-10" (3000)	11'-4" (3500)	13'-0" (4000)	14'-10" (4600)	17'-6" (5400)
C	1'-4" (400)	1'-7" (500)	1'-10" (550)	2'-1" (650)	2'-6" (750)	2'-10" (850)	3'-1" (950)	3'-8" (1150)	4'-4" (1350)
B	2'-6" (800)	3'-8" (1100)	4'-9" (1450)	6'-0" (1850)	7'-4" (2250)	8'-6" (2650)	9'-11" (3050)	11'-2" (3450)	13'-2" (4050)
F	1'-4" (400)	1'-4" (400)	1'-4" (400)	1'-4" (400)	1'-6" (450)	1'-10" (550)	2'-2" (650)	2'-6" (750)	2'-10" (850)
G	12" (300)	12" (300)	12" (300)	18" (450)	18" (450)	18" (450)	18" (450)	18" (450)	18" (450)
K	W/4	W/4	W/4	W/3	W/3	W/3	W/3	W/3	W/3
S1	14" (350)	16" (400)	16" (400)	16" (400)	16" (400)	32" (800)	32" (800)	32" (800)	32" (800)
S2	35 BAR DIA	35 BAR DIA	35 BAR DIA	35 BAR DIA	35 BAR DIA	45 BAR DIA	45 BAR DIA	45 BAR DIA	45 BAR DIA
BATTER	100: 4	100: 4	100: 4	100: 4	100: 4	100: 4	100: 5	100: 6	100: 7
Ⓐ BARS	—	—	#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#6 @ 16" (#19M @ 400)	#6 @ 8" (#19M @ 200)	#8 @ 16" (#25M @ 400)	(#8 @ 14") (#25M @ 350)	#8 @ 12" (#25M @ 300)
Ⓑ BARS	#5 @ 16" (#16M @ 400)	#5 @ 8" (#16M @ 200)	#6 @ 8" (#19M @ 200)	#8 @ 8" (#25M @ 200)	#9 @ 8" (#29M @ 200)	#11 @ 8" (#36M @ 200)	#11 @ 8" (#36M @ 200)	(#11 @ 7") (#36M @ 175)	#11 @ 6" (#36M @ 150)
Ⓒ BARS	#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#6 @ 16" (#19M @ 400)	#6 @ 8" (#19M @ 200)	#6 @ 8" (#19M @ 200)	#8 @ 8" (#25M @ 200)	#8 @ 8" (#25M @ 200)	(#8 @ 7") (#25M @ 175)	#8 @ 6" (#25M @ 150)
TOE PRESS. LOAD CASE IV	2540 psf (125 kPa)	3170 (155)	3880 (185)	4470 (215)	4950 (240)	5720 (275)	6540 (315)	(6970) 335	6990 (335)

METRIC REINFORCING BAR SPACING IS IN MILLIMETERS

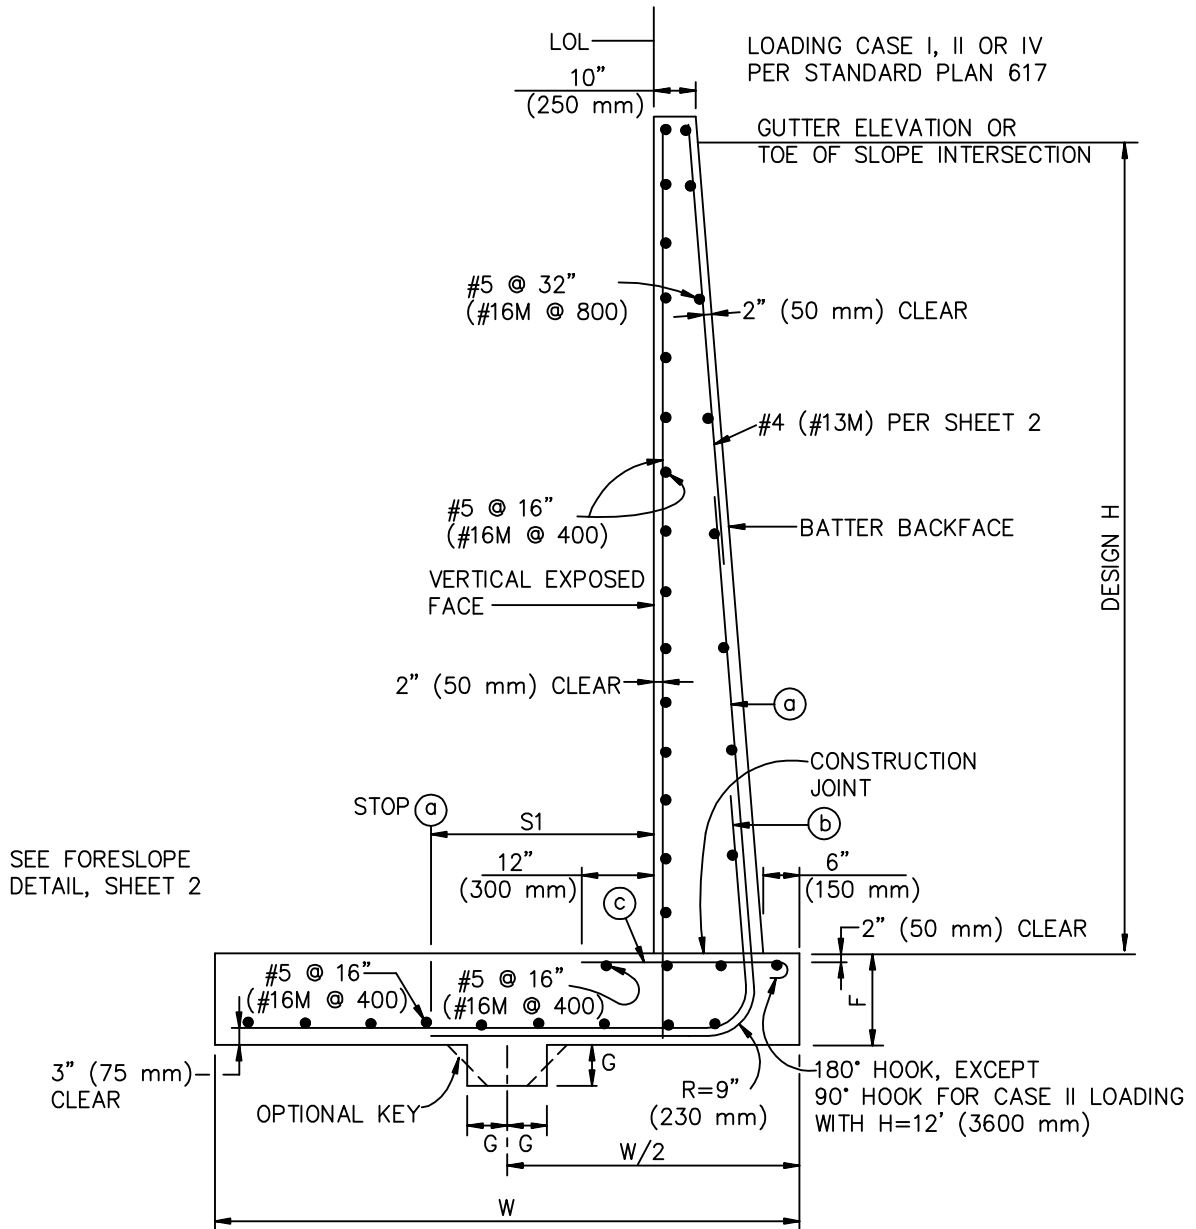

SEE FORESLOPE
DETAIL, SHEET 2

SECTION

NOTE:

SEE SPPWC 617 FOR STANDARD WALL DETAILS.

NO SIMILAR CALTRANS TYPE

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2005, 2009


REINFORCED CONCRETE RETAINING WALL TYPE 4

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


613-3

SHEET 1 OF 3

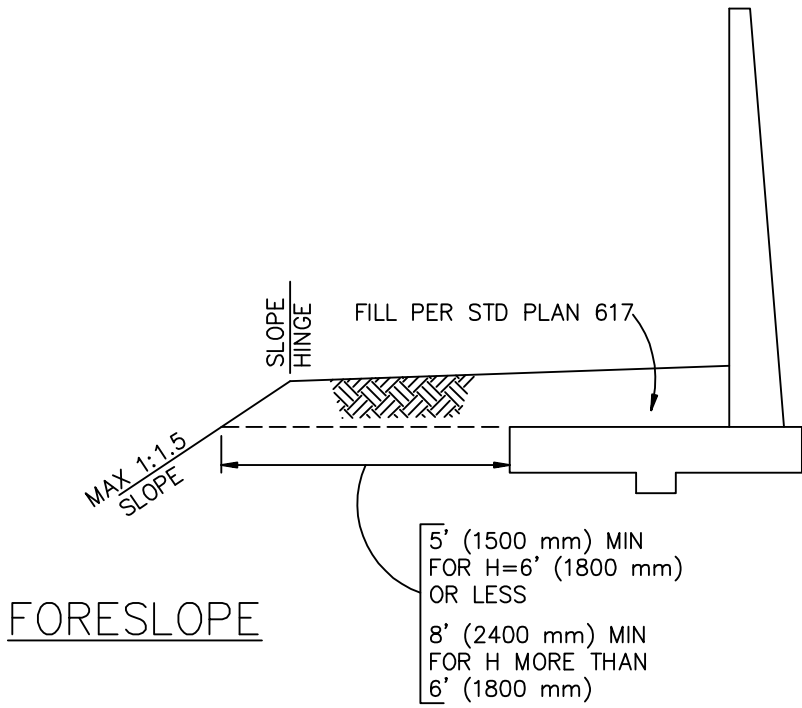

NUMBER ABOVE BAR SHOWS DISTANCE, INCHES (mm), FROM TOP OF FOOTING TO END OF BAR.

BARS ALONG EXPOSED FACE NOT SHOWN

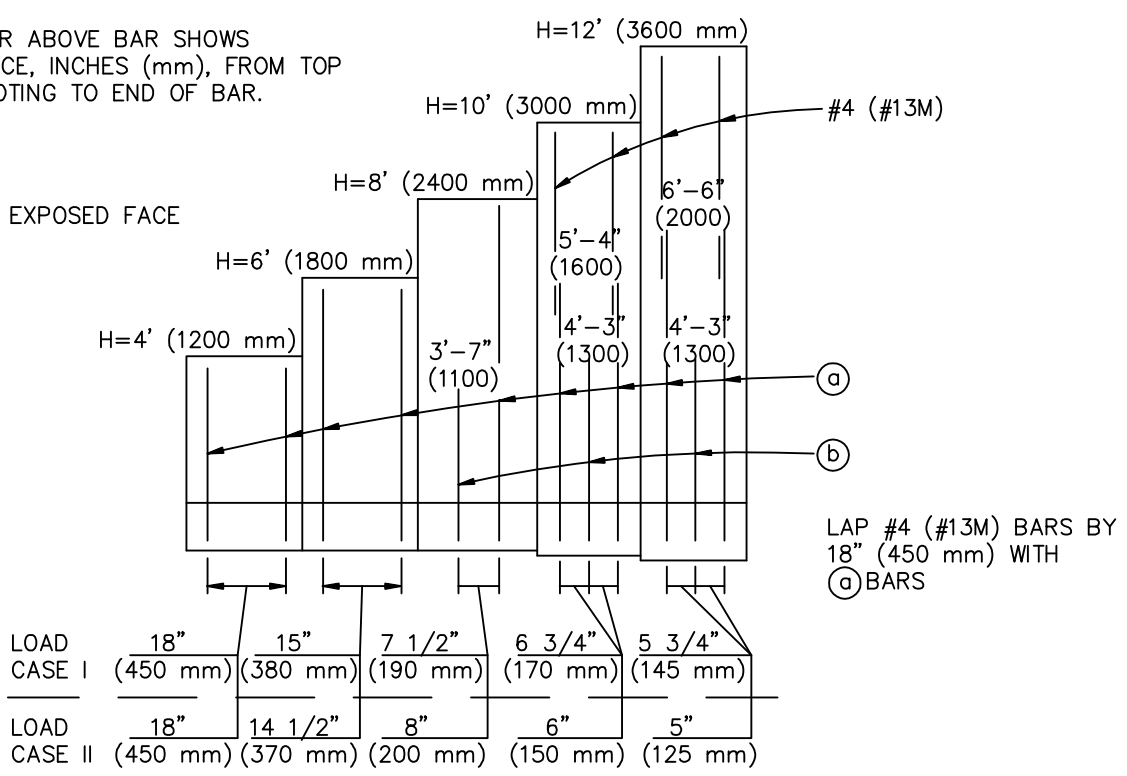

ELEVATION

LOAD CASE I OR II

H	4' (1200 mm)	6' (1800)	8' (2400)	10' (3000)	12' (3600)
W	3'-8" (1120)	5'-3" (1600)	7'-1" (2160)	9'-4" (2840)	11'-9" (3580)
F	0'-10" (250)	0'-10" (250)	0'-10" (250)	0'-11" (280)	1'-1" (330)
C	2'-4" (710)	3'-11" (1190)	5'-9" (1750)	8'-0" (2440)	10'-5" (3180)
G	8" (200)	8" (200)	8" (200)	12" (300)	12" (300)
BATTER	NONE	NONE	NONE	NONE	100:1
(a) BARS	#4 @ 18" (#13M @ 450)	#5 @ 15" (#16M @ 380)	#4 @ 15" (#13M @ 380)	#5 @ 13 1/2" (#16M @ 340)	#6 @ 11 1/2" (#19M @ 290)
(b) BARS	—————	—————	#6 @ 15" (#19M @ 380)	#7 @ 13 1/2" (#22M @ 340)	#7 @ 11 1/2" (#22M @ 290)
(c) BARS	#4 @ 18" (#13M @ 450)	#4 @ 15" (#13M @ 380)	#4 @ 15" (#13M @ 380)	#4 @ 13 1/2" (#13M @ 340)	#4 @ 11 1/2" (#13M @ 290)
TOE SOIL PRESSURE	630 psf (30 kPa)	650 (30)	660 (30)	660 (30)	700 (35)

LOAD CASE IV


H	4' (1200 mm)	6' (1800)	8' (2400)	10' (3000)	12' (3600)
W	3'-8" (1120)	5'-3" (1600)	7'-1" (2160)	9'-4" (2840)	11'-10" (3600)
F	0'-10" (250)	0'-10" 250	0'-10" 250	1'-0" 300	1'-3" 380
C	2'-4" (710)	3'-11" (1190)	5'-9" (1750)	8'-0" (2440)	10'-5" (3180)
G	8" (200)	8" (200)	8" (200)	12" (300)	12" (300)
BATTER	NONE	NONE	NONE	100:1	100:2
(a) BARS	#4 @ 18" (#13M @ 450)	#5 @ 14 1/2" (#16M @ 370)	#4 @ 16" (#13M @ 400)	#5 @ 12" (#16M @ 300)	#6 @ 10" (#19M @ 250)
(b) BARS	—————	—————	#7 @ 16" (#22M @ 400)	#7 @ 12" (#22M @ 300)	#7 @ 10" (#22M @ 250)
(c) BARS	#4 @ 18" (#13M @ 450)	#4 @ 14 1/2" (#13M @ 370)	#4 @ 16" (#13M @ 400)	#4 @ 12" (#13M @ 300)	#4 @ 10" (#13M @ 250)
TOE SOIL PRESSURE	490 psf (25 kPa)	560 (25)	610 (30)	680 (35)	750 (35)

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**REINFORCED CONCRETE
RETAINING WALL TYPE 4**
613-3

SHEET 3 OF 3


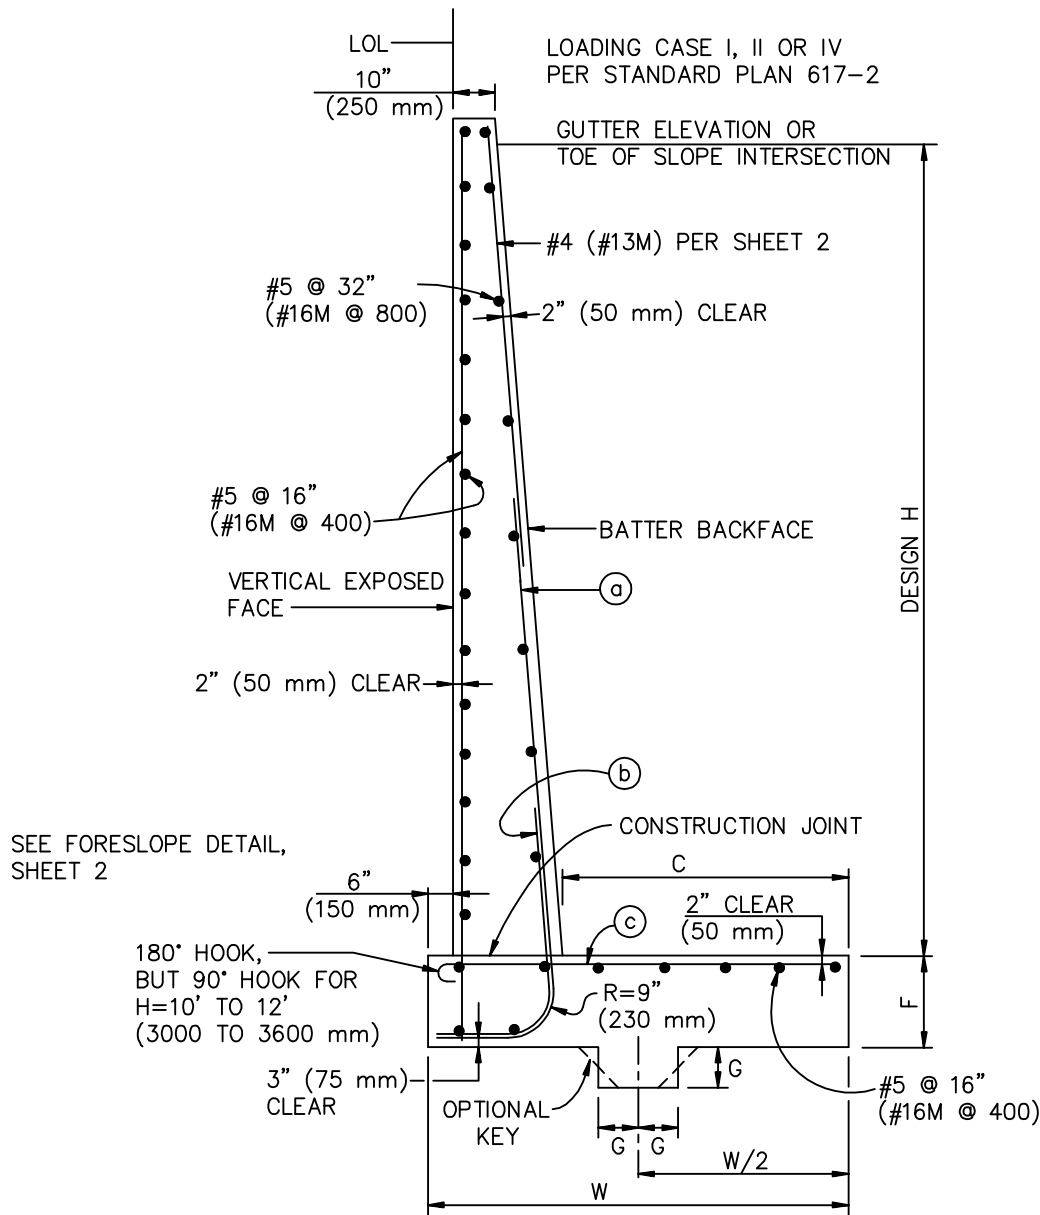


SECTION

NOTE:
SEE SPPWC 617 FOR STANDARD WALL DETAILS.

NO SIMILAR CALTRANS TYPE

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION		
PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1984 REV. 1996, 2005, 2009	<h2 style="margin: 0;">REINFORCED CONCRETE RETAINING WALL TYPE 5</h2>	STANDARD PLAN <h1 style="margin: 0;">614-3</h1>
USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION		SHEET 1 OF 3

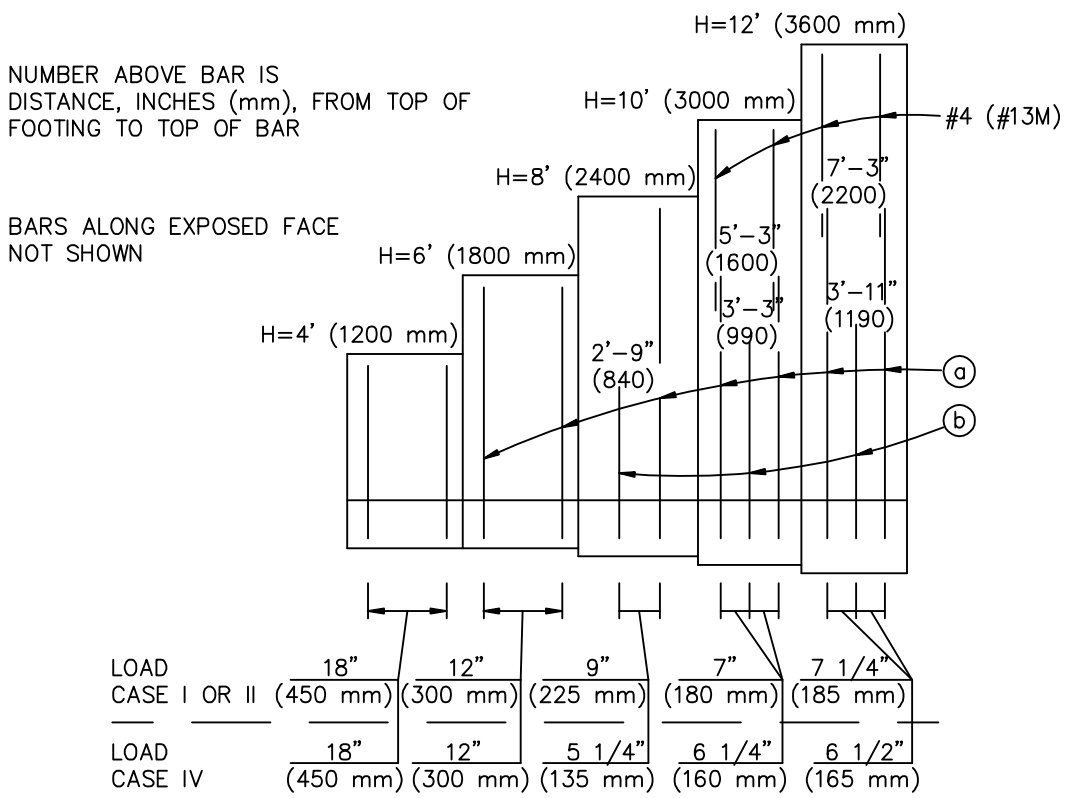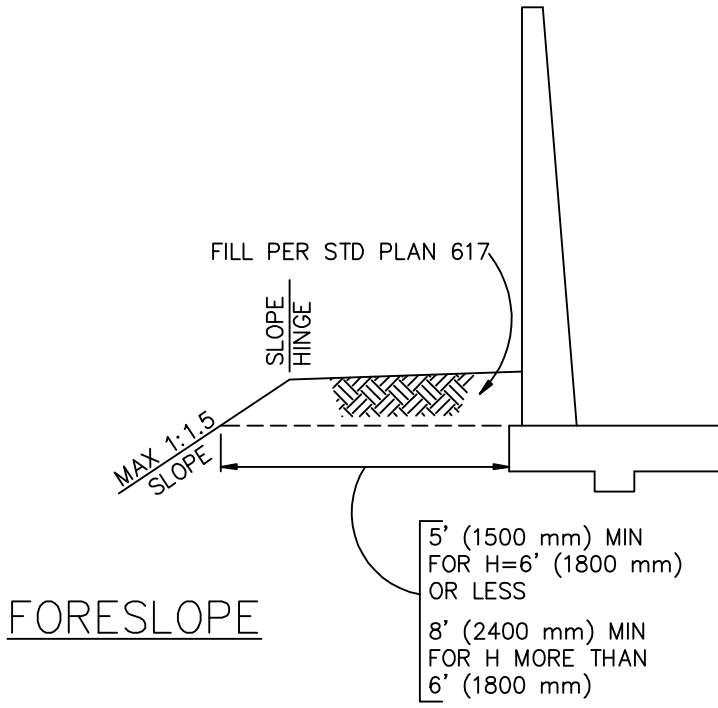

ELEVATION

LOAD CASE I OR II

H	4' (1200 mm)	6' (1800)	8' (2400)	10' (3000)	12' (3600)
W	3'-8" (1120)	4'-10" (1470)	6'-0" (1830)	7'-2" (2180)	8'-4" (2540)
F	0'-10" (250)	0'-10" (250)	0'-10" (250)	0'-10" (250)	1'-0" (300)
C	2'-4" (710)	3'-6" (1070)	4'-8" (1420)	5'-10" (1780)	6'-10" (2080)
G	8" (200)	8" (200)	8" (200)	8" (200)	12" (300)
BATTER	NONE	NONE	NONE	NONE	100:1.5
Ⓐ BARS	#4 @ 18" (#13M @ 460)	#4 @ 12" (#13M @ 300)	#5 @ 18" (#16M @ 460)	#6 @ 14" (#19M @ 360)	#7 @ 14 1/2" (#22M @ 370)
Ⓑ BARS	—————	—————	#5 @ 18" (#16M @ 460)	#6 @ 14" (#19M @ 360)	#7 @ 14 1/2" (#22M @ 370)
Ⓒ BARS	#4 @ 18" (#13M @ 460)	#5 @ 12" (#16M @ 300)	#8 @ 18" (#25M @ 460)	#9 @ 14" (#29M @ 360)	#10 @ 14 1/2" (#32M @ 370)
TOE SOIL PRESSURE	1110 psf (55 kPa)	1580 (75)	2040 (100)	2500 (120)	3050 (145)

LOAD CASE IV

H	4' (1200 mm)	6' (1800)	8' (2400)	10' (3000)	12' (3600)
W	3'-8" (1120)	5'-8" (1730)	7'-11" (2410)	10'-3" (3120)	12'-8" (3860)
F	0'-10" (250)	0'-10" (250)	0'-11" (275)	1'-0" (300)	1'-2" (350)
C	2'-4" (710)	4'-4" (1320)	6'-7" (2010)	8'-10" (2690)	11'-1" (3380)
G	8" (200)	8" (200)	8" (200)	8" (200)	12" (300)
BATTER	NONE	NONE	NONE	100:1	100:2
Ⓐ BARS	#4 @ 18" (#13M @ 450)	#4 @ 12" (#13M @ 305)	#4 @ 10 1/2" (#13M @ 265)	#6 @ 12 1/2" (#19M @ 315)	#7 @ 13" (#22M @ 330)
Ⓑ BARS	—————	—————	#4 @ 10 1/2" (#13M @ 265)	#6 @ 12 1/2" (#19M @ 315)	#7 @ 13" (#22M @ 330)
Ⓒ BARS	#4 @ 18" (#13M @ 450)	#4 @ 12" (#13M @ 305)	#5 @ 10 1/2" (#16M @ 265)	#7 @ 12 1/2" (#22M @ 315)	#9 @ 13" (#29M @ 330)
TOE SOIL PRESSURE	1480 psf (70 kPa)	2220 (105)	3120 (150)	4120 (195)	5170 (250)


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**REINFORCED CONCRETE
RETAINING WALL TYPE 5**

614-3


SHEET 3 OF 3

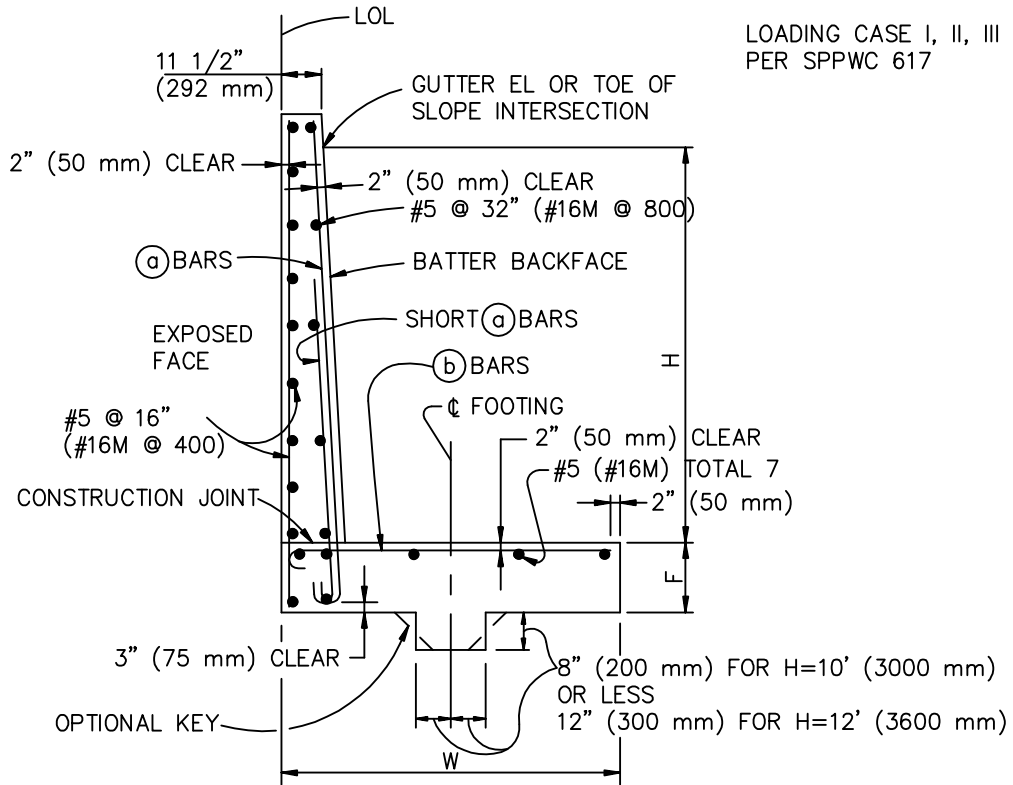

SECTION

NUMBER ABOVE SHORT ⓐ BARS IS DISTANCE, INCHES (mm), FROM TOP OF FOOTING TO END OF BARS

BARS ALONG EXPOSED FACE NOT SHOWN

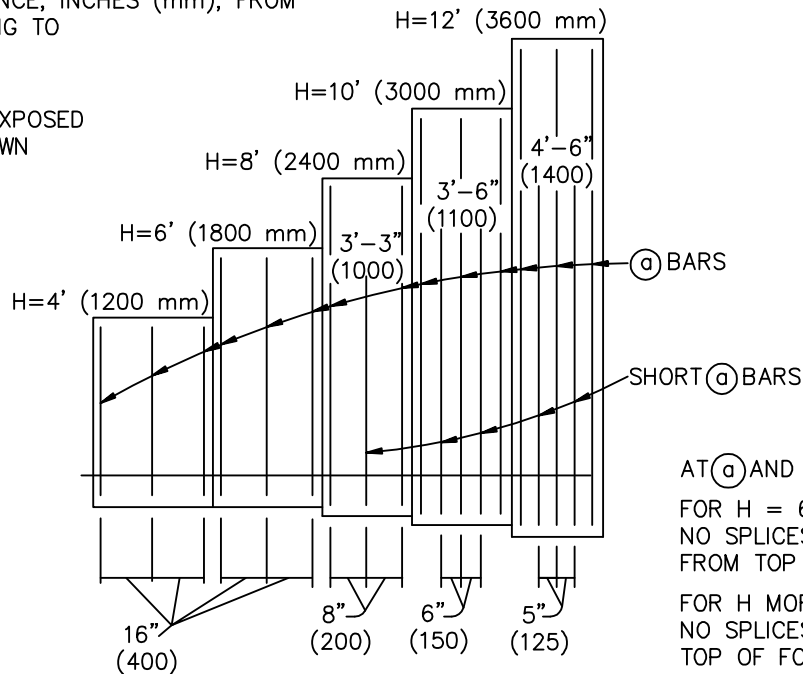

AT ⓐ AND SHORT ⓐ BARS:

FOR H = 6' (1800 mm) OR LESS, NO SPLICES WITHIN 20" (500 mm) FROM TOP OF FOOTING.

FOR H MORE THAN 6' (1800 mm), NO SPLICES WITHIN H/4 FROM TOP OF FOOTING.

ELEVATION

SIMILAR TO CALTRANS TYPE 5

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1991, 1996, 2005, 2009

**REINFORCED CONCRETE
RETAINING WALL TYPE 6**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

615-4

SHEET 1 OF 2


TABLE OF REINFORCING STEEL, DIMENSIONS AND DATA

DESIGN H		4' (1200 mm)	6' (1800)	8' (2400)	10' (3000)	12' (3600)	
W		4'-0" (1250)	5'-0" (1550)	6'-6" (2000)	8'-0" (2450)	9'-6" (2900)	
F		16" (400)	16" (400)	18" (450)	18" (450)	22" (550)	
BATTER		NONE	NONE	NONE	100:3	100:6	
(a) BARS		#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#5 @ 12" (#16M @ 300)	#5 @ 10" (#16M @ 250)	
SHORT (a) BARS		————	————	#5 @ 16" (#16M @ 400)	#5 @ 12" (#16M @ 300)	#5 @ 10" (#16M @ 250)	
(b) BARS		#5 @ 16" (#16M @ 400)	#5 @ 16" (#16M @ 400)	#5 @ 8" (#16M @ 200)	#5 @ 6" (#16M @ 150)	#5 @ 5" (#16M @ 125)	
TOE PRESSURE	CASE I	psf (kPa)	1600 (80)	2200 (105)	2500 (120)	3000 (145)	3500 (170)
	CASE II	psf (kPa)	1500 (75)	2100 (100)	2700 (130)	3400 (165)	4100 (195)
	CASE III	psf (kPa)	1600 (80)	2300 (110)	2900 (140)	3800 (185)	4400 (210)
	CASE IV	psf (kPa)	2000 (95)	3200 (155)	4200 (200)	5300 (255)	6500 (310)


NOTES:

1. SEE SPPWC 617 FOR STANDARD WALL DETAILS.
2. METRIC REINFORCING BAR SPACING IS IN MILLIMETERS.

DESIGN LOADING
CASE I OR II PER
SPPWC 617

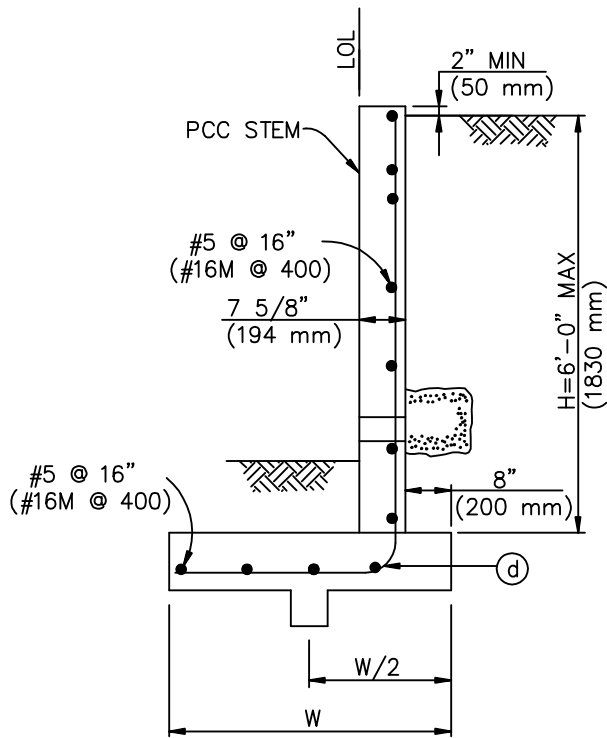

TYPE 7A

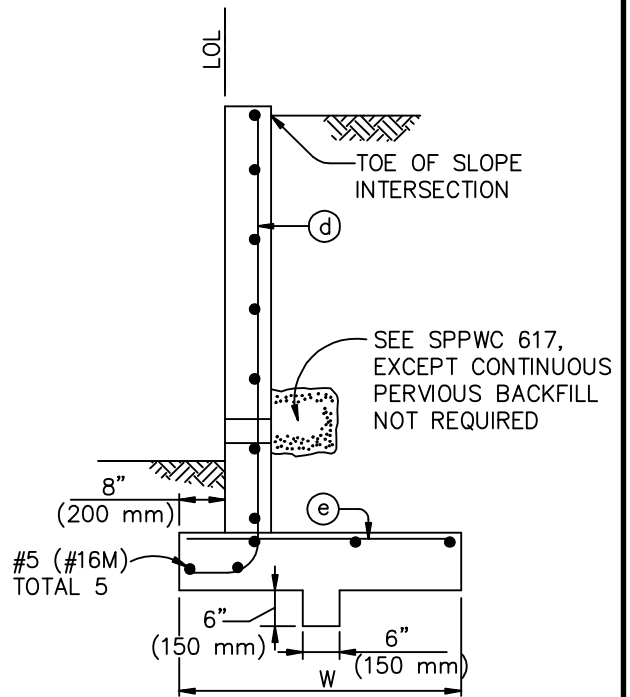

TYPE 7B

AT (d) BARS, NO SPLICES WITHIN
20" (500 mm) FROM TOP OF FOOTING

NOTES:

1. SEE SPPWC 617 FOR STANDARD WALL DETAILS.
2. METRIC REINFORCING BAR SPACING IS IN MILLIMETERS.

SIMILAR TO CALTRANS TYPE 6

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2005, 2009

**REINFORCED CONCRETE
RETAINING WALL TYPE 7**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

616-3


SHEET 1 OF 2

TYPE 7A WALL


DESIGN H	3'-4" (1020 mm)	4'-0" (1220)	4'-8" (1420)	5'-4" 1630	6'-0" (1830)
W	3'-2" (1000)	3'-6" (1100)	3'-10" (1200)	4'-2" (1300)	4'-6" (1400)
ⓓ BARS	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 12" (#16M @ 300)

TYPE 7B WALL

DESIGN H	3'-4" (1020 mm)	4'-0" (1220)	4'-8" (1420)	5'-4" (1630)	6'-0" (1830)
W	2'-8" (850)	3'-0" (950)	3'-4" (1050)	3'-8" (1150)	4'-0" (1250)
ⓓ BARS	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 12" (#16M @ 300)
ⓔ BARS	(#5 @ 15") (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 12" (#16M @ 300)


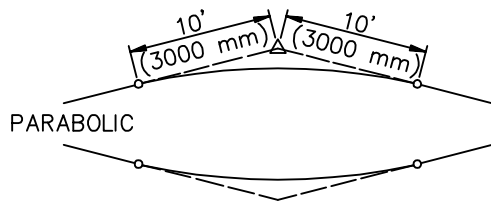


VERTICAL CURVE AT TOP OF WALL SLOPE CHANGE
USE WHERE SHOWN ON THE PLANS

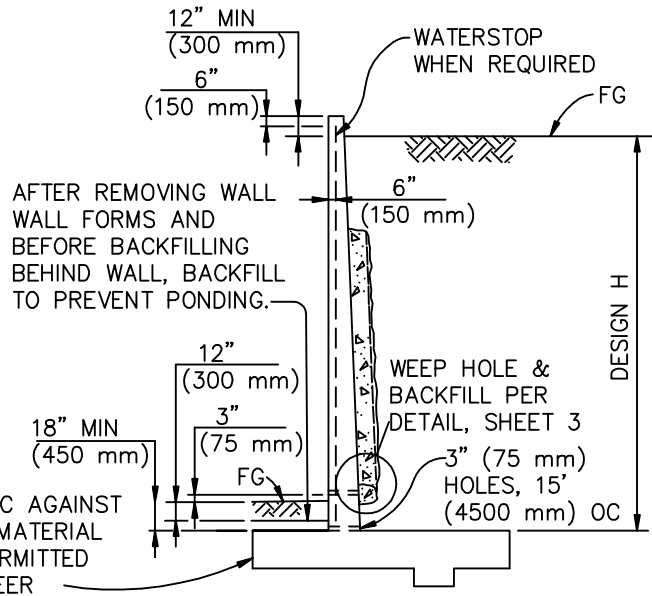


DESIGN AND DRAINAGE

EXPANSION JOINT IF REQUIRED

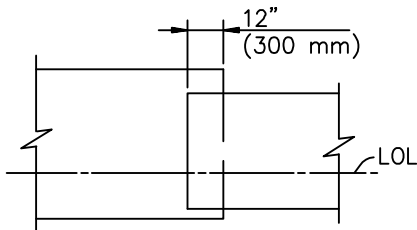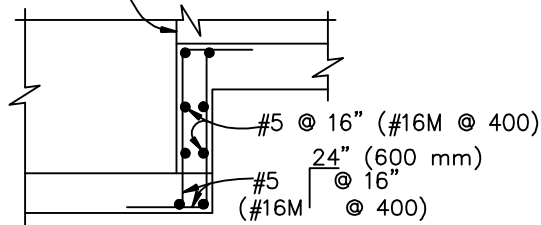


FOOTING STEP

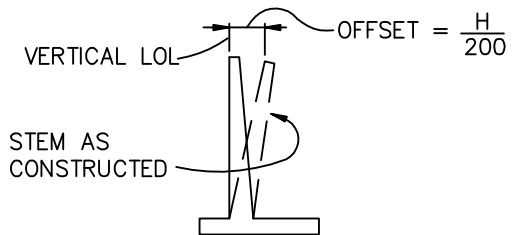

APPROXIMATE WALL OFFSET VALUES

VALUES FOR OFFSETTING FORMS WILL BE DETERMINED BY THE ENGINEER

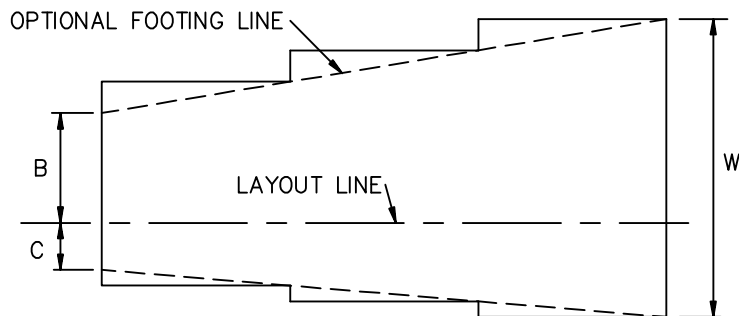

TYPICAL FOOTING LAYOUT

SIMILAR TO CALTRANS STD PLANS B0-3, B3-8 AND B3-9

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2005, 2009


**REINFORCED CONCRETE
RETAINING WALL DETAILS**

STANDARD PLAN

617-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 8

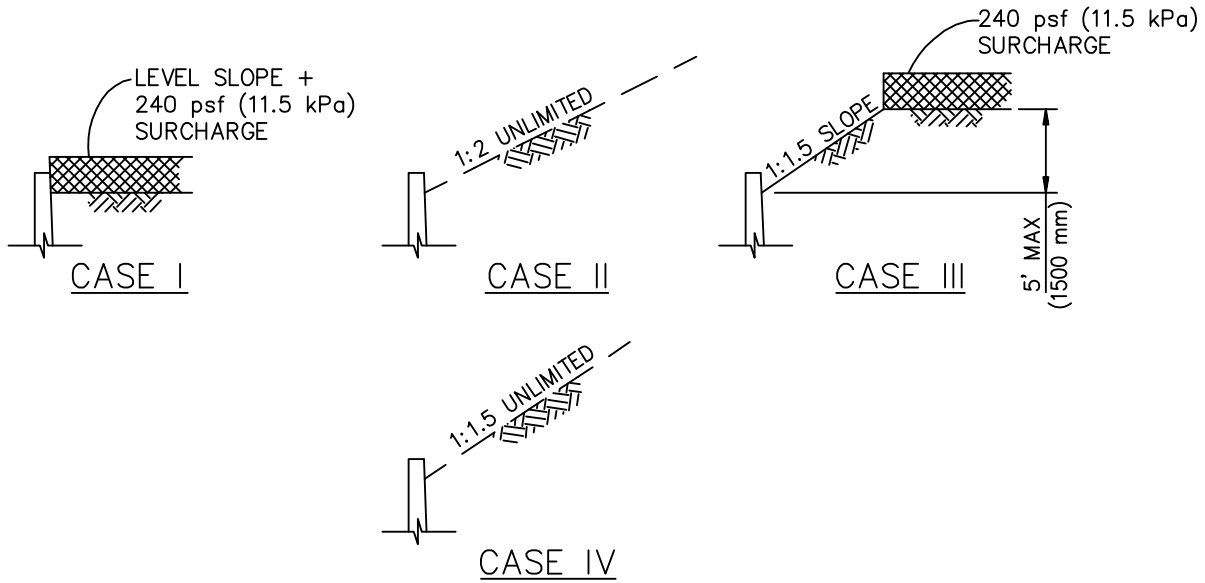

DESIGN LOADING CASES

DESIGN CONDITIONS:

DESIGN H MAY BE EXCEEDED BY 6" (150 mm) BEFORE USING VALUES SHOWN FOR NEXT GREATER H.

SPECIAL FOOTING DESIGN IS REQUIRED WHERE FOUNDATION MATERIAL IS INCAPABLE OF SUPPORTING TOE PRESSURES SHOWN ON WALL STANDARD PLANS.

RETURN WALL NOT REQUIRED IF NOT SHOWN ON PLANS.

DESIGN DATA:

$f_c = 1,300 \text{ psi (10 MPa)}$ $f'_c = 3,250 \text{ psi (25 MPa)}$ $f_s = 24 \text{ ksi (168 MPa)}$

$n = 10$ SOIL WEIGHT = $120 \text{ pcf (19 kN/m}^3\text{)}$

240 psf (11.5 kPa) SURCHARGE:


EQUIVALENT FLUID PRESSURE =

36 psf/ft (5.6 kPa/m) MAXIMUM FOR DETERMINATION OF TOE PRESSURE.

27 psf/ft (4.2 kPa/m) MINIMUM FOR DETERMINATION OF HEEL PRESSURE.

EARTH PRESSURES FOR 1:2 UNLIMITED SLOPE, 1:1.5 SLOPE, AND 1:1.5 UNLIMITED SLOPE DETERMINED FROM RANKINE'S FORMULA WITH $\phi = 33^\circ 42'$.


CUT OR BUTT EVERY OTHER FRONT FACE HORIZONTAL BAR AT WEAKENED PLANE JOINT



SEE DETAIL A

SECTION

JOINT MAY BE FORMED WITH 1/8" (3 mm) HARDBOARD AND CUT BACK TO THE ROOT OF THE CHAMFER ON THE EXPOSED FACE.

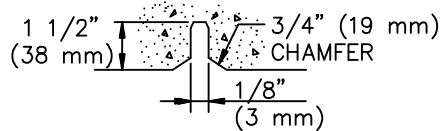

DETAIL A

WEAKENED PLANE JOINT


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN



**REINFORCED CONCRETE
RETAINING WALL DETAILS**

617-3

SHEET 2 OF 8

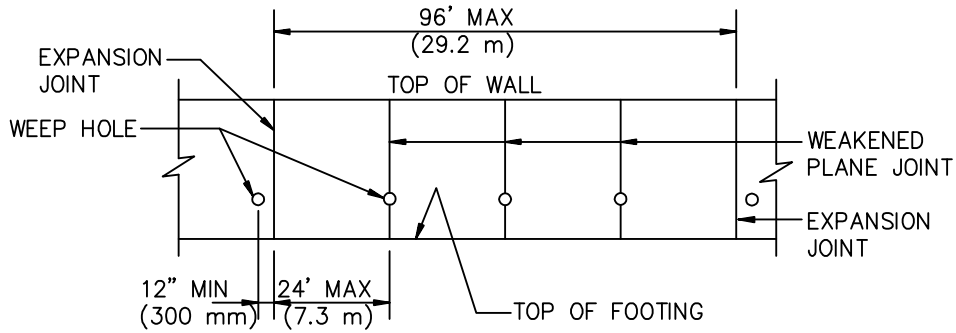

WALL EXPANSION JOINTS
AND WEAKENED PLANES

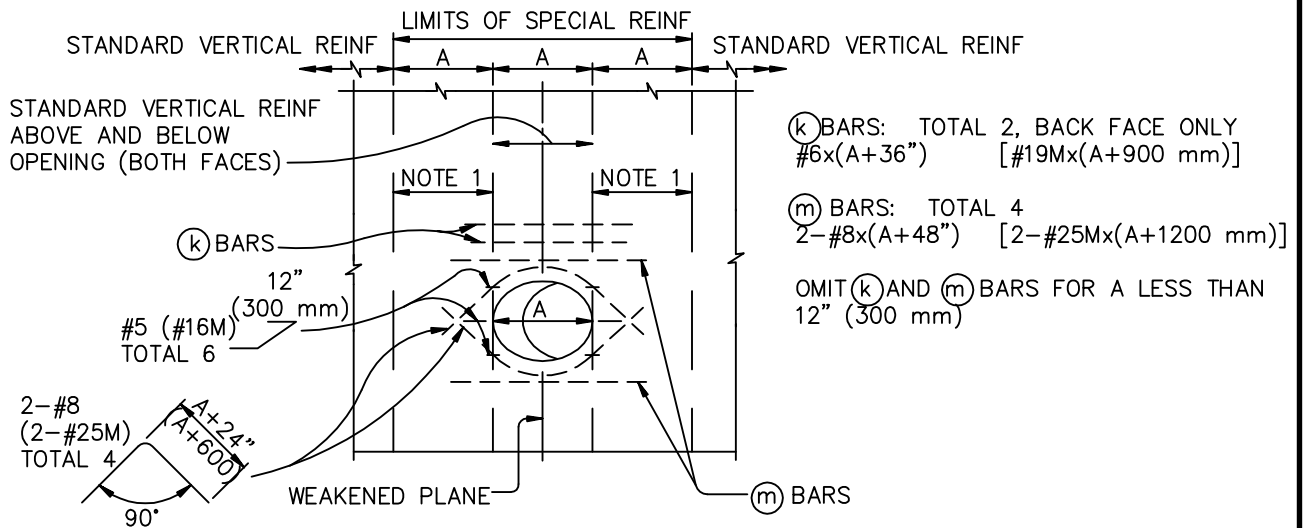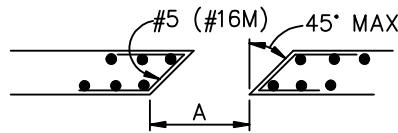


RETAINING WALL UTILITY OPENING

MAX SIZE OF OPENING $A=48"$ (1200 mm)



NOTES:

1. STANDARD VERTICAL REINFORCEMENT PLUS ADDITIONAL VERTICAL BARS MATCHING SIZE AND NUMBER OF BARS CUT BY THE OPENING. PLACE HALF ON EACH SIDE. EXTEND THE ADDITIONAL BARS INTO THE FOOTING THE SAME AS THE OTHER VERTICAL WALL REINFORCEMENT AND TO A MINIMUM OF 60 BAR DIAMETERS ABOVE THE TOP OF UTILITY OPENING IF WALL HEIGHT PERMITS. BUNDLE BARS AS REQUIRED.
2. HORIZONTAL REINFORCEMENT IS STANDARD EXCEPT AS SHOWN.
3. ALL REINFORCEMENT SHALL CLEAR OPENING BY 2" (50 mm) MIN.
4. ADJUST EXPANSION JOINT LOCATIONS TO FALL OUTSIDE THE LIMITS OF SPECIAL REINFORCING.

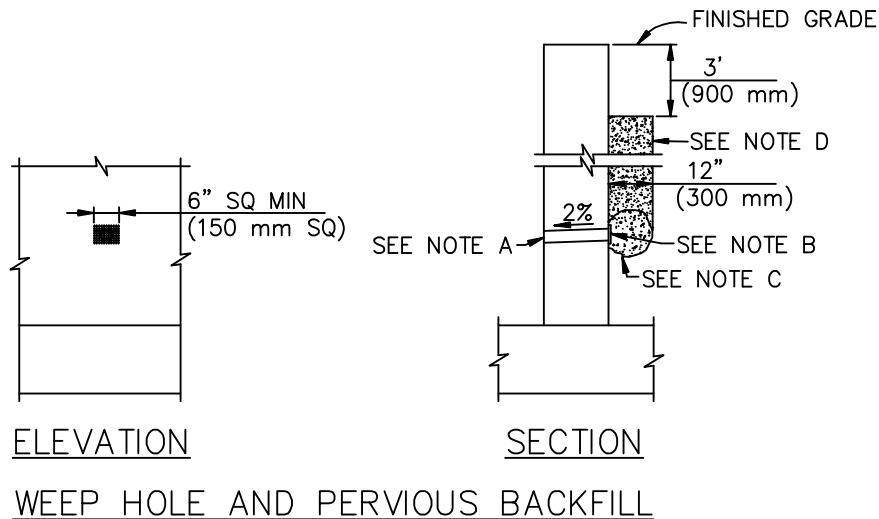


NOTES

- A. 4" (100 mm) DIA DRAINS EACH 25' (7.6 m) MAX. FOR WALLS ADJACENT TO SIDEWALKS OR CURBS, PROVIDE CURB DRAINS PER SPPWC 150 OR 151. PLACE EXPOSED WALL DRAINS AT LEAST 3" (75 mm) ABOVE FINISHED GRADE.
- B. ALUMINUM OR GALV STEEL WIRE MESH HARDWARE CLOTH, WIRES 0.03" (0.64 mm) DIA. EACH 1/4" (6 mm). ANCHOR FIRMLY TO BACKFACE.
- C. 1 CF (0.03 m³) PERVIOUS BACKFILL MATERIAL IN NONWOVEN FILTER FABRIC, SECURELY TIED.
- D. PERVIOUS BACKFILL MATERIAL CONTINUOUS BEHIND RETAINING WALL.

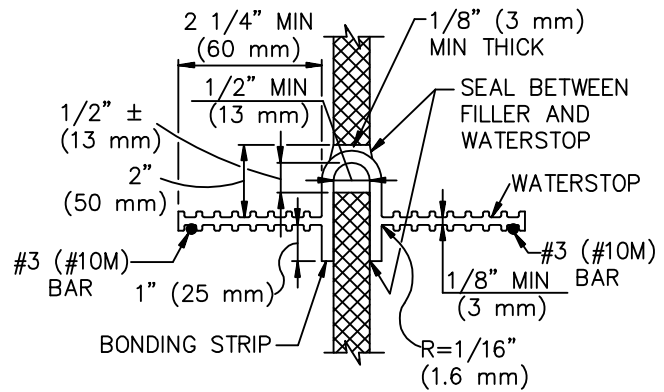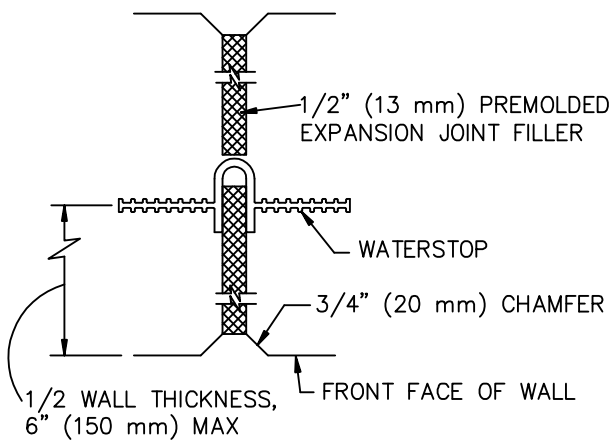


WATERSTOP NOTES:


- 1. HOLES PERMITTED IN THE OUTER 1/2" (13 mm) OF THE WEB FOR WIRE, RINGS, ETC. TIE WEB TO #3 (#10M) REBARS EACH 16" (400 mm) MAX TO SUPPORT THE WATERSTOP IN POSITION DURING PCC PLACEMENT OR SUBMIT ALTERNATIVE TO ENGINEER FOR APPROVAL.
- 2. WATERSTOP SHALL HAVE 5 OR MORE PAIRS OF RAISED RIBS TO PROVIDE 0.1 SQ IN (65 mm²) MINIMUM RIB CROSS-SECTION AREA ON EACH HALF OF THE WATERSTOP

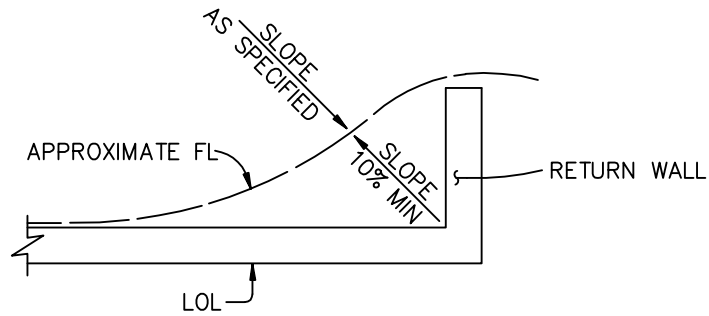

WALL DRAINAGE
WHERE GUTTER NOT REQUIRED

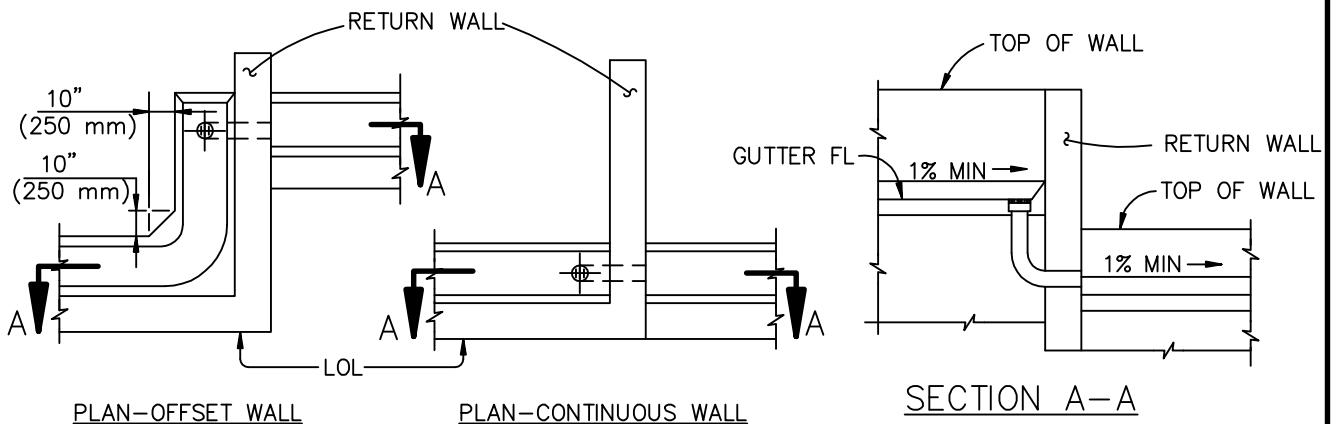


PLAN-OFFSET WALL PLAN-CONTINUOUS WALL
DRAIN THROUGH RETURN WALL


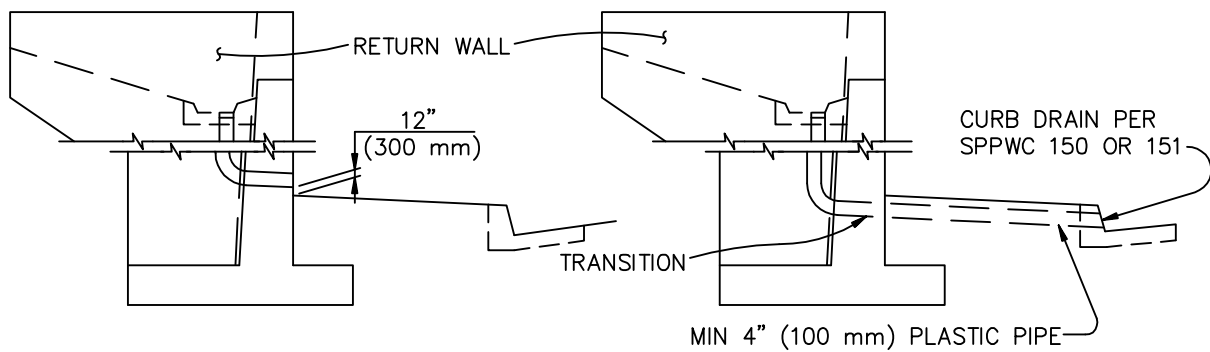


WALL GUTTER OUTLET
TO FACE OF WALL



WALL GUTTER OUTLET TO CURB
CURB DRAIN AREA SHALL BE AT LEAST THAT
OF PIPE FROM WALL GUTTER

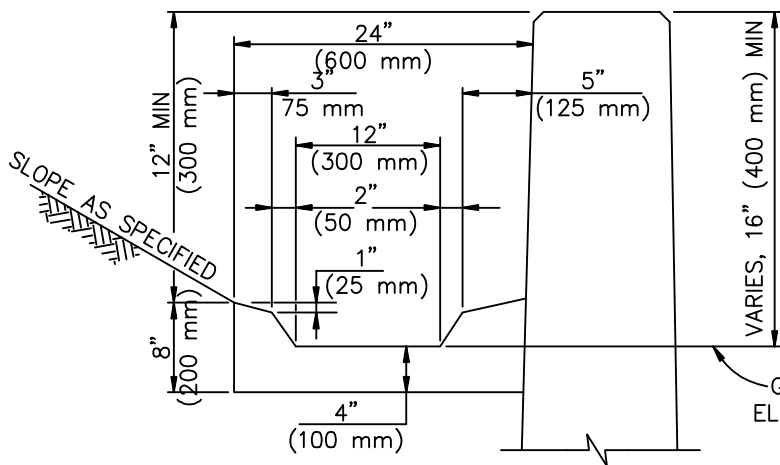


TYPICAL GUTTER DETAIL

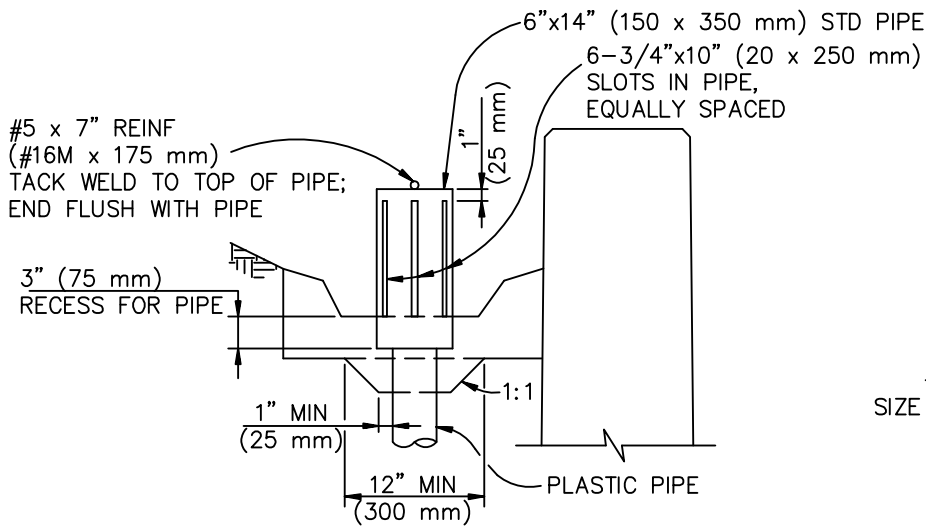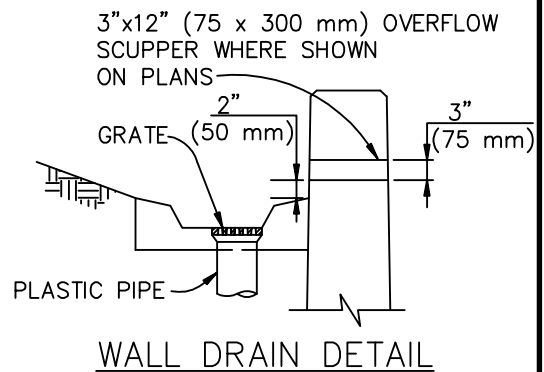


WALL DRAIN WITH PIPE DOME




GRATE DETAIL
SIZE TO FIT STANDARD HUBS

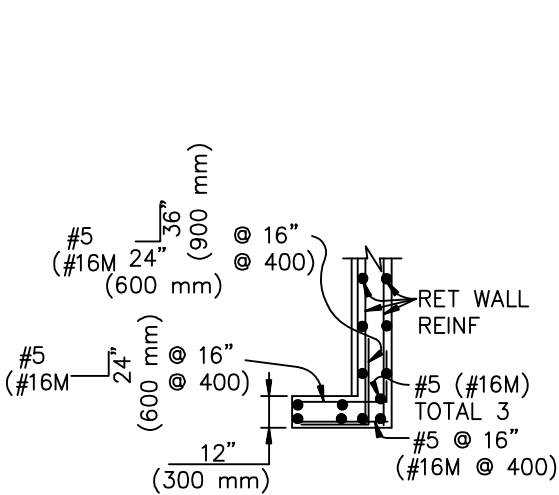


PLAN
RETURN WALL TYPE "D"

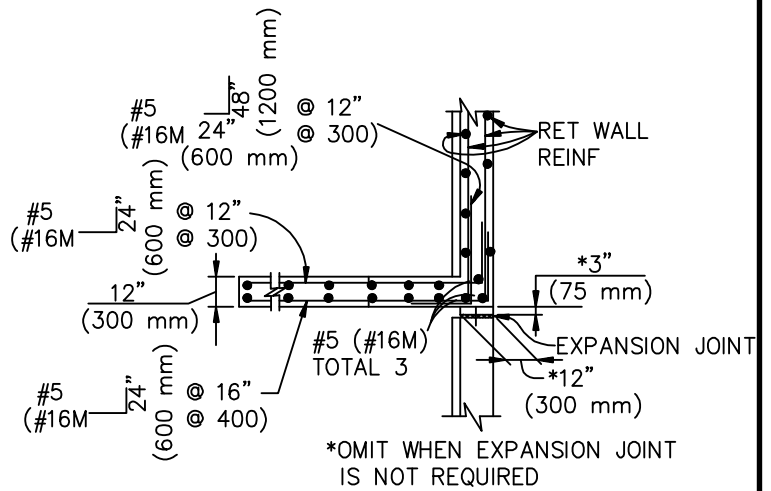

PLAN
RETURN WALL TYPE "A"

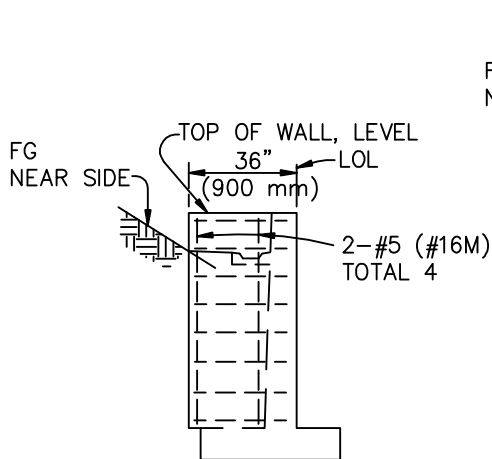


ELEVATION
RETURN WALL TYPE "D"
USE WHERE H=6' (1800 mm)
OR LESS

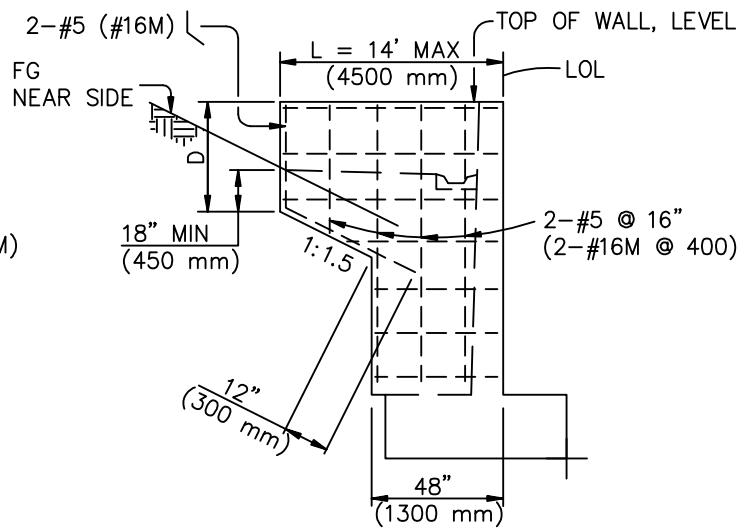


ELEVATION
RETURN WALL TYPE "A"
USE WHERE H=8' (2400 mm) OR LESS

METRIC REINFORCING BAR
SPACING IS IN MILLIMETERS

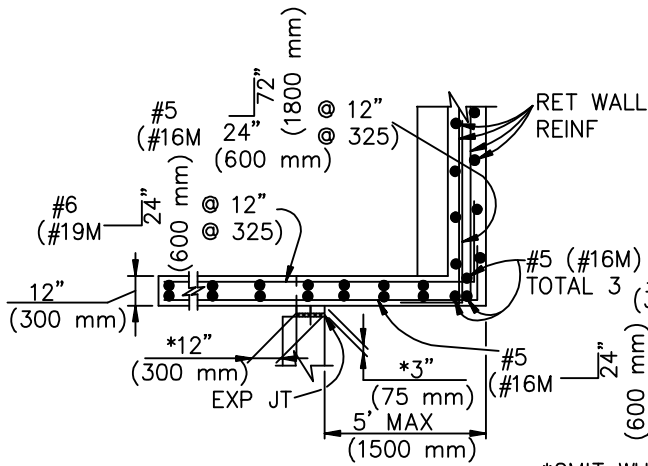


PLAN
RETURN WALL TYPE "B"

*OMIT WHEN EXPANSION JOINT IS NOT REQUIRED

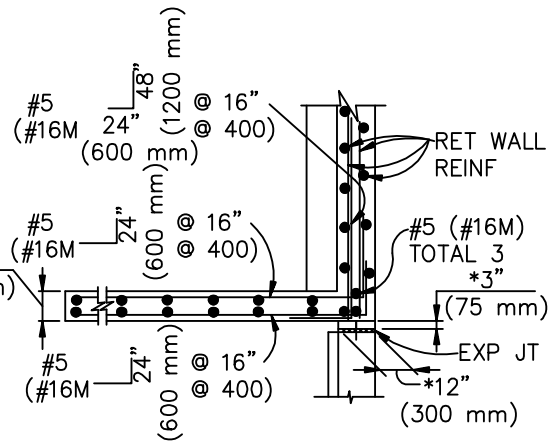


PLAN
RETURN WALL TYPE "C"

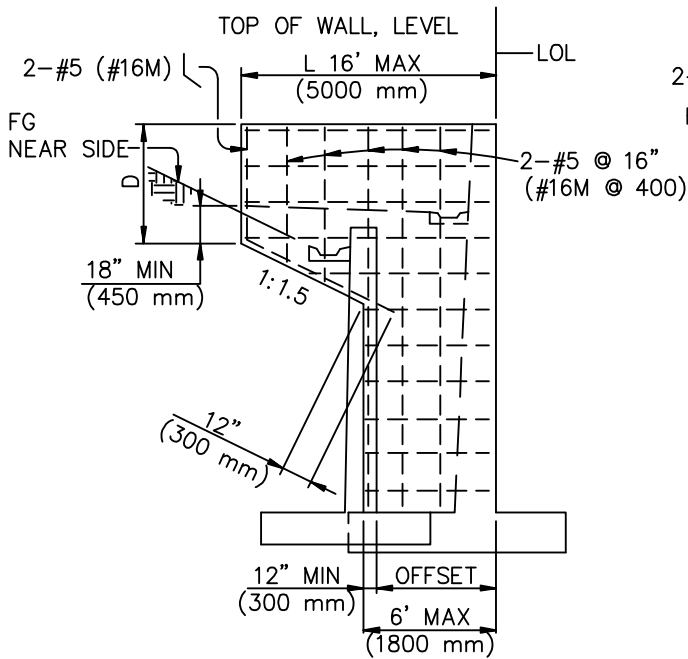

ELEVATION
RETURN WALL TYPE "B"



USE AT OFFSET WALLS WHERE
H=10' (3000 mm) OR MORE

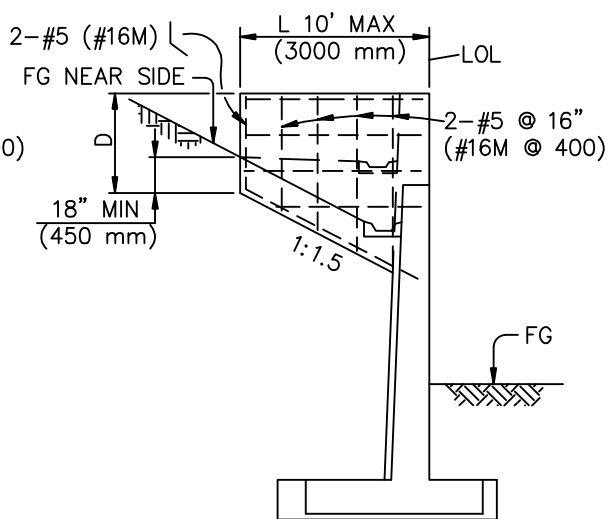

ELEVATION
RETURN WALL TYPE "C"

USE AT STRAIGHT WALLS WHERE
H=10' (3000 mm) OR MORE

METRIC REINFORCING BAR
SPACING IS IN MILLIMETERS

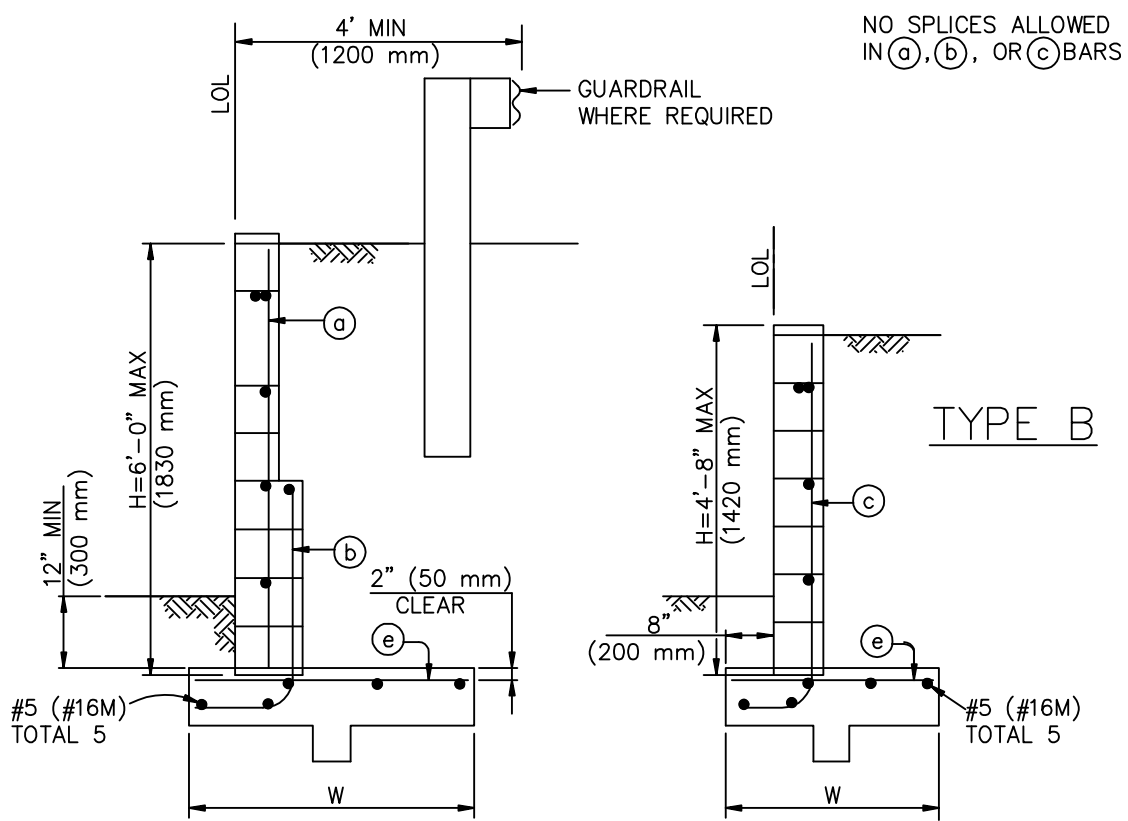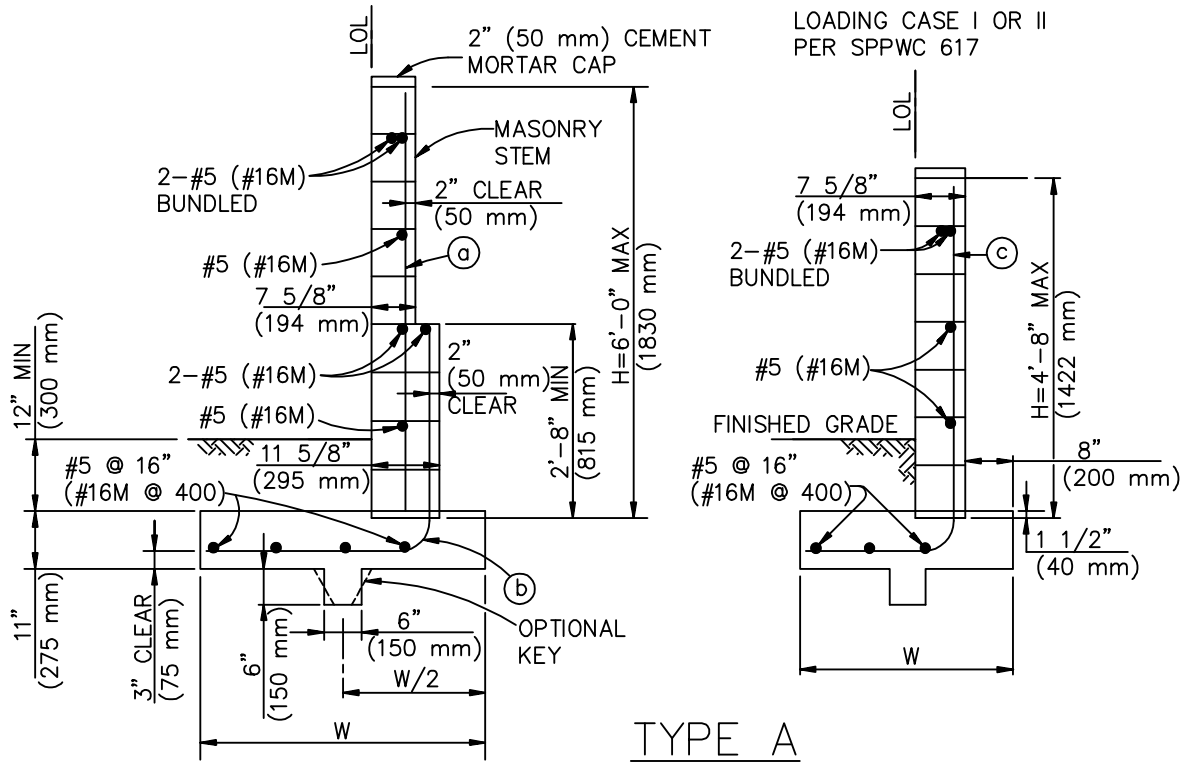

SIMILAR TO CALTRANS TYPE 6


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2005, 2009

MASONRY RETAINING WALL


USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
618-3
SHEET 1 OF 3

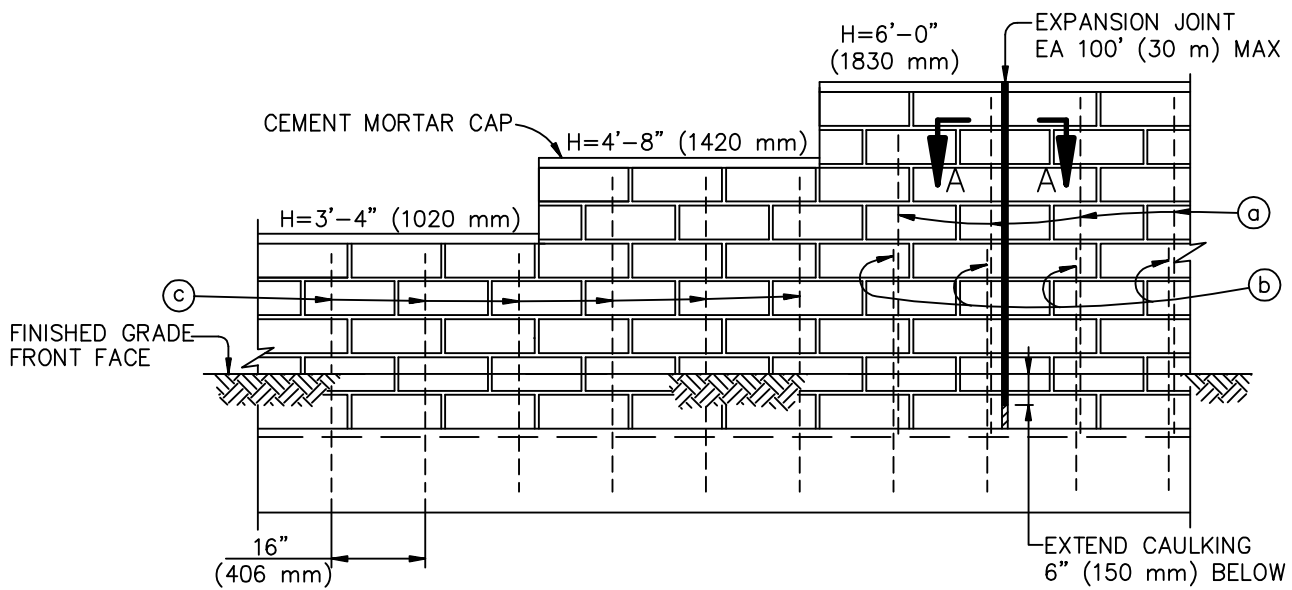

OMIT MORTAR FROM VERTICAL JOINT IN FIRST COURSE ABOVE FINISHED GRADE AT 2'-8" (813 mm) CENTERS FOR WEEP HOLES. FILL ALL CELLS WITH GROUT.

ELEVATION

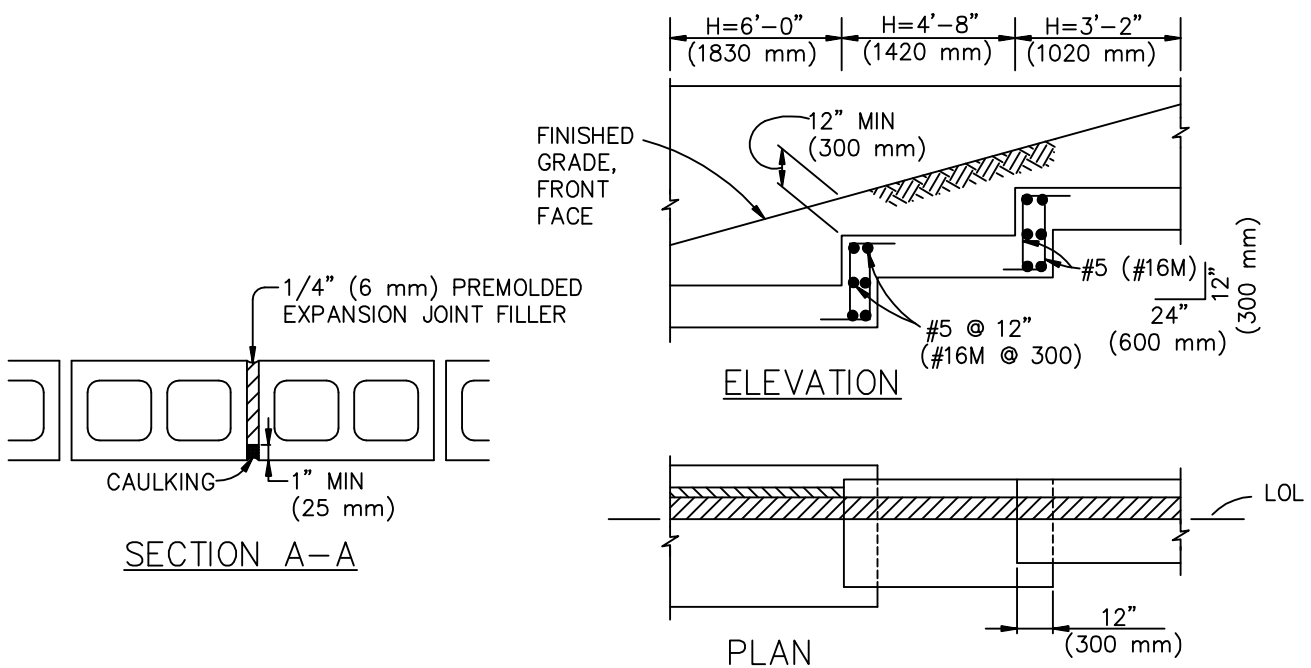

FOOTING STEP DETAILS

TYPE A WALL

DESIGN H	3'-4" (1020)	4'-0" (1220)	4'-8" (1420)	5'-4" (1630)	6'-0" (1830)
W	3'-2" (1000 mm)	3'-6" (1100)	3'-10" (1200)	4'-2" (1300)	4'-6" (1400)
Ⓐ BARS	————	————	————	#5 @ 16" (#16M @ 406)	#5 @ 16" (#16M @ 406)
Ⓑ BARS	————	————	————	#5 @ 16" (#16M @ 406)	#5 @ 16" (#16M @ 406)
Ⓒ BARS	#5 @ 16" (#16M @ 406)	#5 @ 16" (#16M @ 406)	#5 @ 16" (#16M @ 406)	————	————

TYPE B WALL

DESIGN H	3'-4" (1020 mm)	4'-0" (1220)	4'-8" (1420)	5'-4" (1630)	6'-0" (1830)
W	2'-8" (850)	3'-0" (950)	3'-4" (1050)	3'-8" (1150)	4'-0" (1250)
Ⓐ BARS	————	————	————	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)
Ⓑ BARS	————	————	————	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)
Ⓒ BARS	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	————	————
Ⓔ BARS	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 15" (#16M @ 375)	#5 @ 12" (#16M @ 300)

DESIGN DATA (SEE SPPWC 617 FOR PCC, STEEL, AND OTHER SOIL DATA)

$$f_m = 500 \text{ psi (3.5 MPa)} \quad f'_m = 1500 \text{ psi (10.5 MPa)}$$

REQUIRED SOIL BEARING CAPACITY 2000 psf (95 kPa)

NOTES:

1. SEE SPPWC 617 FOR STANDARD WALL DETAILS.
2. METRIC REINFORCING BAR SPACING IS IN MILLIMETERS.




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

MASONRY RETAINING WALL

STANDARD PLAN

618-3

SHEET 3 OF 3

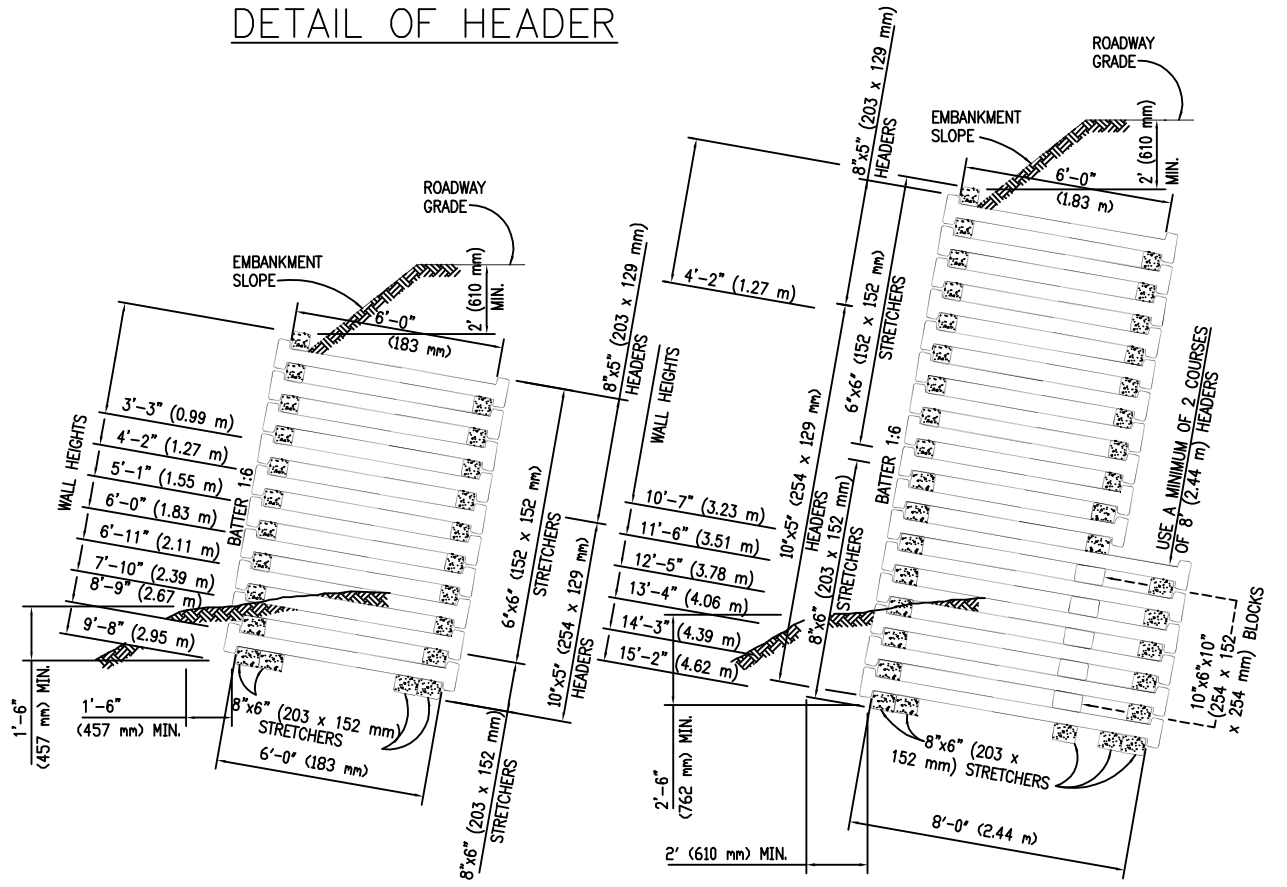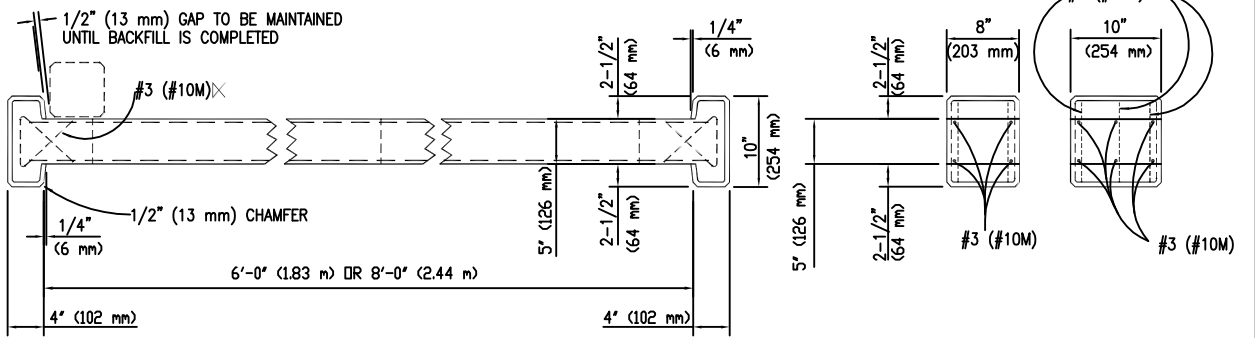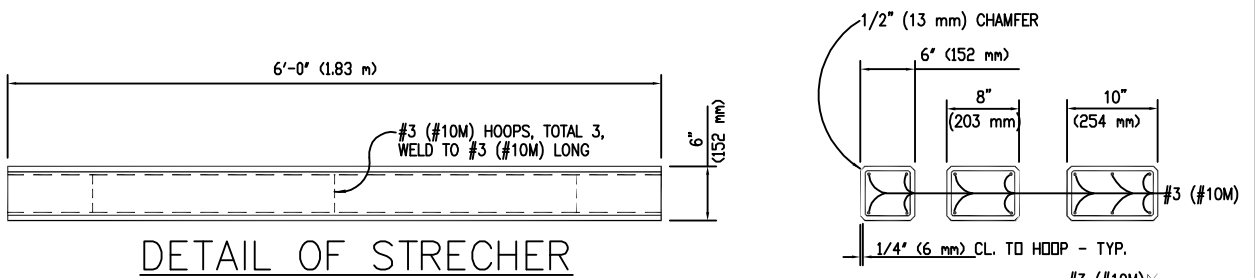

TYPE A

WALLS 9'-8" (2.95 m) OR LESS IN HEIGHT

TYPE B

WALLS BETWEEN 10'-7" (3.23 m) AND 15'-2" (4.62 m) IN HEIGHT

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1984 REV. 1996, 2009


REINFORCED CONCRETE CRIB WALL

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

619-2

SHEET 1 OF 6

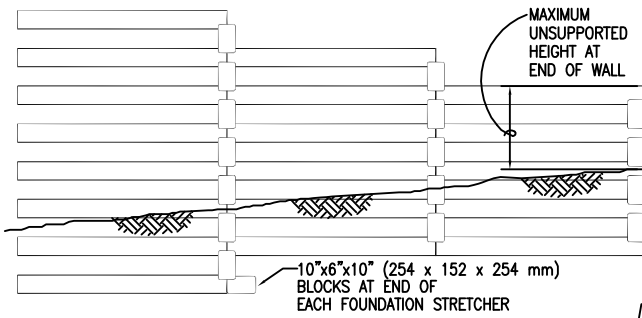

WALL LAYOUT DETAILS

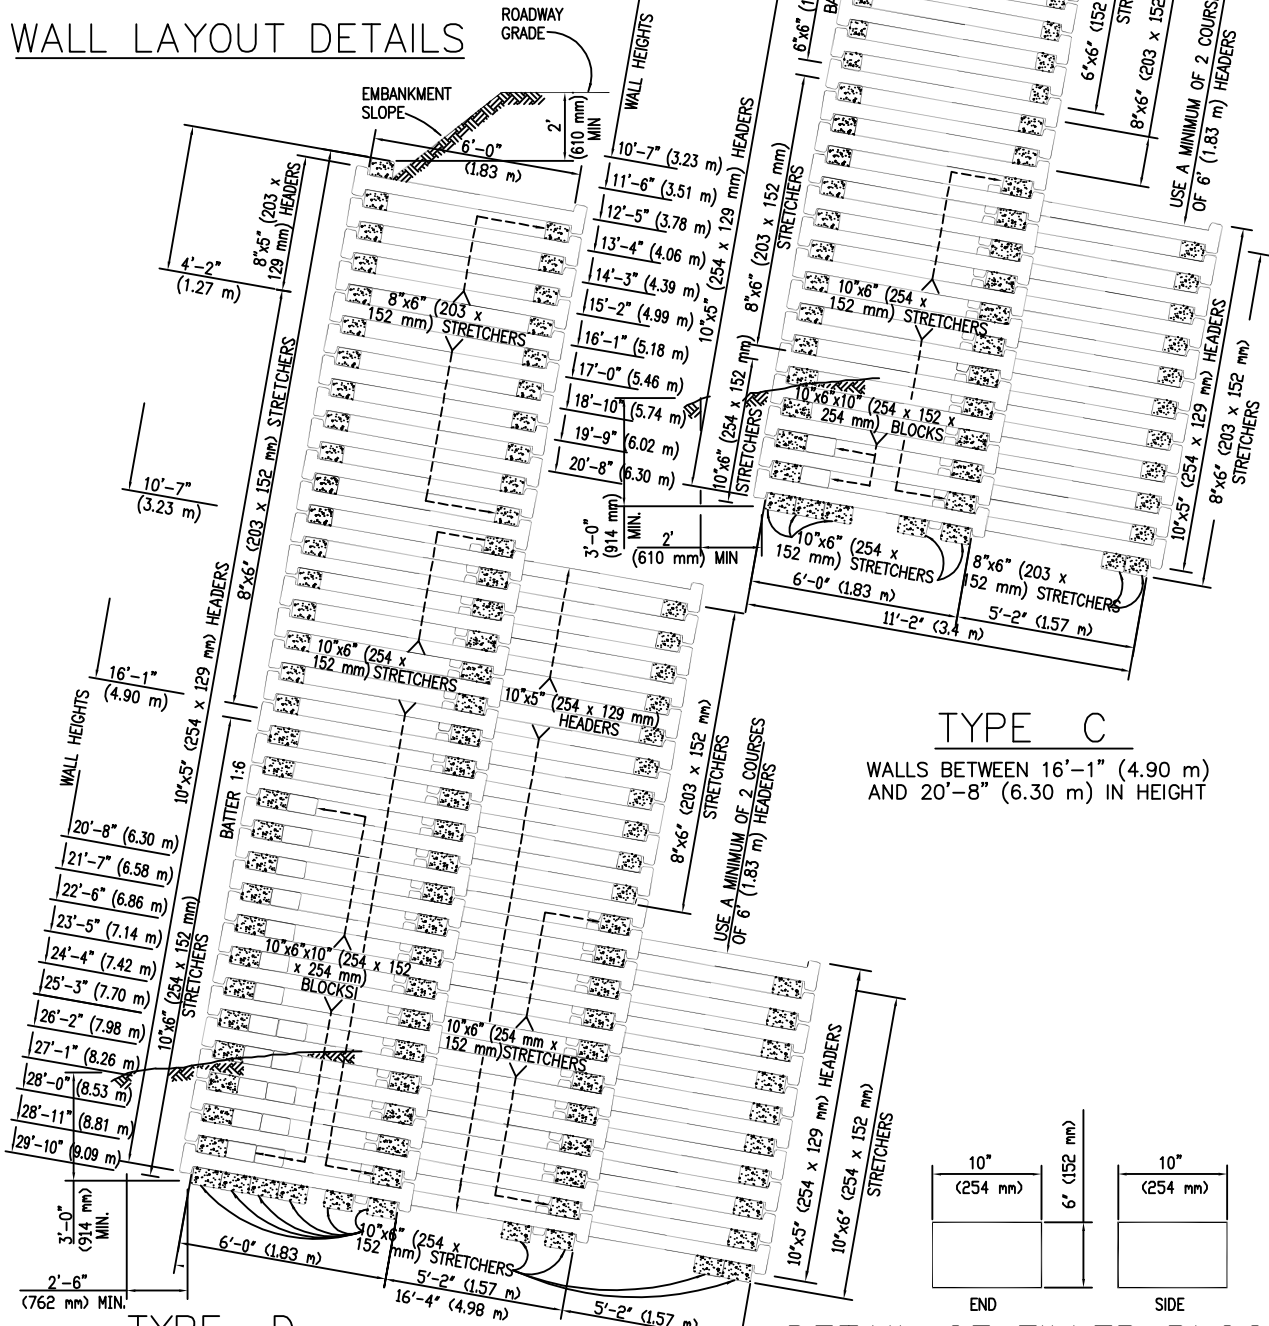

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

REINFORCED CONCRETE CRIB WALL

619-2

SHEET 2 OF 6

NUMBER OF UNITS REQUIRED FOR ONE INTERMEDIATE 6' (1.83 m) PANEL OF HEIGHTS AS SHOWN IN SHEETS 1 & 2

HEIGHT OF WALL	FRONT CRIB					1ST ANCHOR CRIB					2ND ANCHOR CRIB					ONE COMPLETE PANEL								
	HEADERS		STRETCHERS		BLOCKS	HDRS.		STRETCHERS		STRS.		HDRS.		STRETCHERS		STRS.		HEADERS		STRETCHERS		BLOCKS		
	8"x5" (203 x 129 mm)	10"x5" (254 x 129 mm)	6"x6" (152 x 152 mm)	8"x6" (203 x 152 mm)	10"x6" (254 x 152 mm)	10"x5" (254 x 129 mm)	10"x6" (254 x 152 mm)	8"x6" (203 x 152 mm)	10"x6" (254 x 152 mm)	10"x5" (254 x 129 mm)	10"x6" (254 x 152 mm)	10"x5" (254 x 129 mm)	10"x6" (254 x 152 mm)	8"x5" (203 x 129 mm)	8"x6" (203 x 152 mm)	6"x6" (152 x 152 mm)	8"x6" (203 x 152 mm)	10"x6" (254 x 152 mm)	8"x5" (203 x 129 mm)	8"x6" (203 x 152 mm)	6"x6" (152 x 152 mm)	8"x6" (203 x 152 mm)	10"x6" (254 x 152 mm)	10"x6"x10" (254 x 254 x 152 mm)
3'-3" (0.99 m)	3		9													9			3					
4'-2" (1.27 m)	4		11													11			4					
5'-1" (1.55 m)	4	1	13													13			4					
6'-0" (1.83 m)	4	2	15													15			4					
6'-11" (2.11 m)	4	3	17													17			4					
7'-10" (2.39 m)	4	4	19													19			4					
8'-9" (2.67 m)	4	5	17	4												17			4					
9'-8" (2.95 m)	4	6	17	6												17			4					
10'-7" (3.23 m)	4	7	17	9	1											17			4					1
11'-6" (3.51 m)	4	8	17	11	1											17			4					1
12'-5" (3.78 m)	4	9	17	13	2											17			4					2
13'-4" (4.06 m)	4	10	17	15	3											17			4					3
14'-3" (4.34 m)	4	11	17	17	4											17			4					4
15'-2" (4.62 m)	4	12	17	19	5											17			4					5
16'-1" (4.90 m)	4	13	17	11	10											17			4					10
17'-0" (5.18 m)	4	14	17	11	12											17			4					12
17'-11" (5.46 m)	4	15	17	11	14											17			4					14
18'-10" (5.74 m)	4	16	17	11	16											17			4					16
19'-9" (6.02 m)	4	17	17	11	18											17			4					18
20'-8" (6.30 m)	4	18	17	11	20											17			4					20
21'-7" (6.58 m)	4	19	17	11	23											17			4					23
22'-6" (6.86 m)	4	20	17	11	25											17			4					25
23'-5" (7.14 m)	4	21	17	11	27											17			4					27
24'-4" (7.42 m)	4	22	17	11	29											17			4					29
25'-3" (7.70 m)	4	23	17	11	31											17			4					31
26'-2" (7.98 m)	4	24	17	11	33											17			4					33
27'-1" (8.26 m)	4	25	17	11	35											17			4					35
28'-0" (8.53 m)	4	26	17	11	37											17			4					37
28'-11" (8.81 m)	4	27	17	11	39											17			4					39
29'-10" (9.09 m)	4	28	17	11	41											17			4					41


NOTE: USE 8"x6"
(203 x 152 mm)
STRETCHER WITH
VERTICAL WALLS

NOTE: USE 8"x6"
(203 x 152 mm)
STRETCHER WITH
VERTICAL WALLS

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
619-2
SHEET 3 OF 6

REINFORCED CONCRETE CRIB WALL

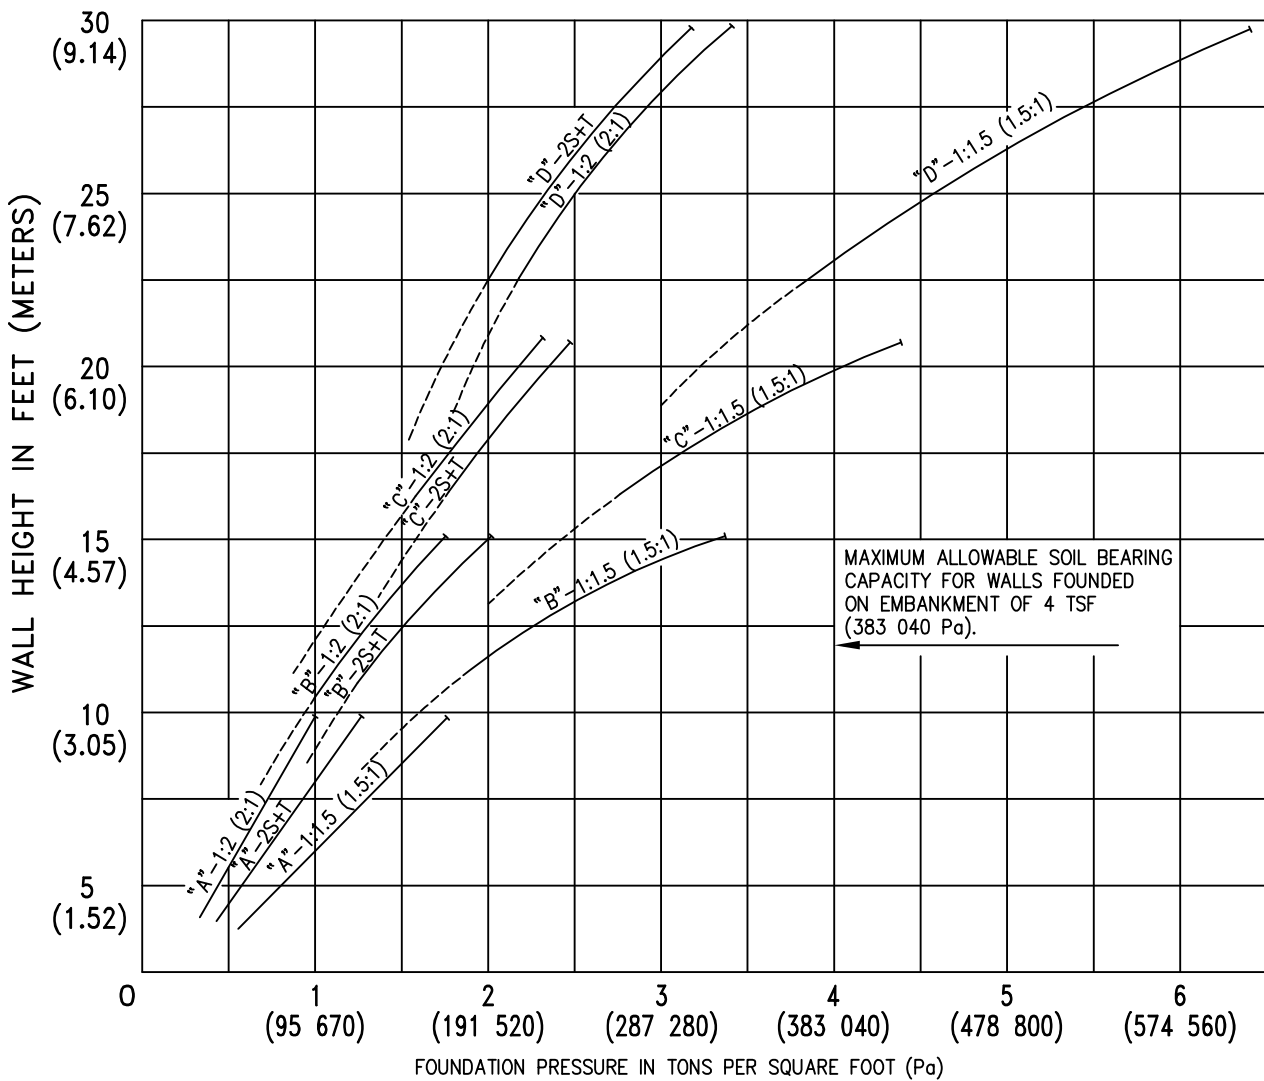

DESIGN CRITERIA:

1. **WALL BASE IN EMBANKMENT:** A MINIMUM DEPTH OF 5' (1.52 m) OF EMBANKMENT AT 95% RELATIVE SOIL COMPACTION IS REQUIRED BELOW THE BASE OF ALL WALLS IN ORDER TO CONSTITUTE AN EMBANKMENT CONDITION. WHEN THE FOUNDATION PRESSURE IS BETWEEN 2.5 TSF (239 400 Pa) AND 4.0 TSF (383 040 Pa) EMBANKMENT BELOW THE WALL SHALL CONSIST OF "STRUCTURAL BACKFILL" MATERIAL. RELATIVE COMPACTION SHALL BE 95%.
2. **WALL BASE IN ORIGINAL GROUND:** ALLOWABLE SOIL AT TOE OF WALL SHALL BE DETERMINED BY FOUNDATION SITE INVESTIGATION WALLS THAT ARE TO RETAIN CUT SLOPES SHALL BE DESIGNED FOR LATERAL AND TOE PRESSURES DETERMINED FROM SITE INVESTIGATION DATA. OVERALL STABILITY OF SLOPE WITH WALL IN PLACE MUST BE ANALYZED. IF ORIGINAL GROUND SLOPES AWAY FROM TOE OF WALL, REDUCTION IN ALLOWABLE BEARING CAPACITY DUE TO SLOPE MUST BE CONSIDERED. WALLS SHALL NOT BE FOUNDED IN ORIGINAL GROUND HAVING AN ALLOWABLE BEARING CAPACITY OF LESS THAN 1.5 TSF (143 640 Pa). CONSIDERATION SHOULD BE GIVEN TO REMOVAL AND REPLACEMENT OF UNSUITABLE MATERIAL WITH "STRUCTURAL BACKFILL" MATERIAL. RELATIVE COMPACTION SHALL BE 95%.
3. **DESIGN DATA:** WEIGHT OF SOIL = 120 PCF (1920 kg/m³). FOR 2' (610 mm) LEVEL SURCHARGE WITH TRAFFIC LOADING, AN EQUIVALENT FLUID PRESSURE OF 36 PCF (1724 Pa) WAS USED. EARTH PRESSURE FOR 1:2 (2:1) SLOPE AND 1:1 1/2 (1 1/2:1) UNLIMITED SLOPES DETERMINED FROM RANKINE'S FORMULA WITH $\phi = 33^{\circ}42'$.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

REINFORCED CONCRETE CRIB WALL

619-2

SHEET 4 OF 6

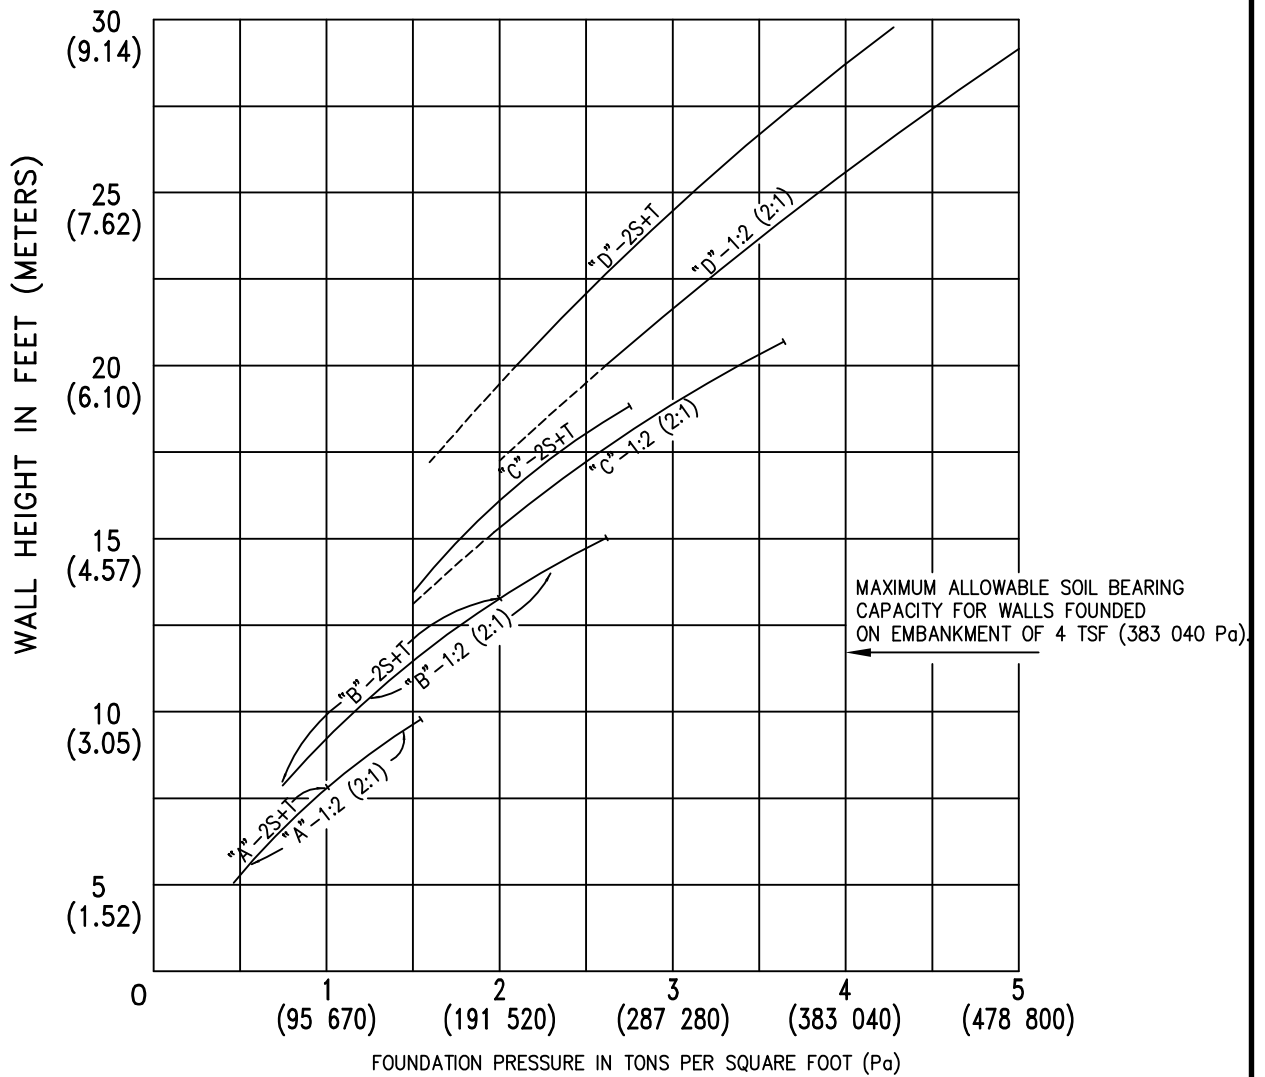


VERTICAL WALL

LEGEND FOR GRAPHS:

- A, B, C, D = WALL TYPE
 - 2S+T = 2' (610 mm) LEVEL SURCHARGE WITH TRAFFIC LOADING
 - 1:2 (2:1) = 1:2 (2:1) SLOPE ABOVE WALL
 - 1:2.5 (2.5:1) = 1:1.5 (1.5:1) SLOPE ABOVE WALL
- 115' (35.05 m) MAX. DIFFERENCE IN ELEVATION FROM TOE OF WALL TO TOP OF SLOPE.

SOLID LINES INDICATED NORMAL RANGE OF WALL USE. UPPER END AT LINE INDICATES MAXIMUM WALL HEIGHT FOR A GIVEN WALL TYPE AND LOADING.

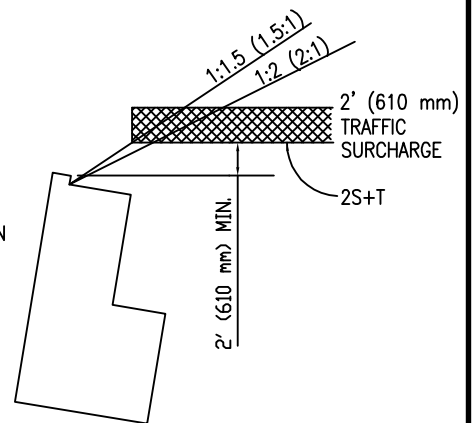

DESIGN SURCHARGES

DESIGN EXAMPLES:

EXAMPLE NO. 1

GIVEN: WALL HEIGHT 24' (7.32 m)
1:2 (2:1) EMBANKMENT SLOPE TO BE RETAINED. BASE FOUNDED IN EMBANKMENT.

SELECT: EITHER VERTICAL OR BATTERED "D" WALL. BOTH WALLS REQUIRE 5' (1.52 m) DEPTH EMBANKMENT OF 95% COMPACTION BELOW BASE. HOWEVER, FOR THE VERTICAL WALL WITH A FOUNDATION PRESSURE OF 3.0 TSF (287 280 Pa) EMBANKMENT MATERIAL MUST BE "STRUCTURAL BACKFILL" (SEE DESIGN NOTE 1)

EXAMPLE NO. 2

GIVEN: WALL HEIGHT 20' (6.10 m)
1:2 (2:1) CUT SLOPE TO BE RETAINED. FOUNDATION SITE INVESTIGATION INDICATES LATERAL PRESSURE FROM MATERIAL ABOVE WILL BE EQUIVALENT TO 1:2 (2:1) EMBANKMENT SLOPE, AND THE ALLOWABLE SOIL BEARING CAPACITY IS 2.5 TSF (239 400 Pa).

SELECT: BATTERED "C" WALL. ALSO A VERTICAL "D" WALL CAN BE USED. BY INCREASING THE ALLOWABLE BEARING CAPACITY OF THE ORIGINAL GROUND (SEE DESIGN NOTE 2), A VERTICAL "C" WALL CAN BE USED.

EXAMPLE NO. 3

GIVEN: WALL HEIGHT 9' (2.74 m)
2' (610 mm) LEVEL SURCHARGE WITH TRAFFIC LOADING TO BE RETAINED. BASE FOUNDED IN EMBANKMENT.

SELECT: BATTERED "A" WALL OR VERTICAL "B" WALL. IF VERTICAL "B" IS USED, THE ACTUAL HEIGHT OF THE WALL WILL BE 9'-8" (2.95 m). THE FIRST STEP IN THE WALL WILL BE 7'-10" (2.39 m), WHICH IS THE LIMITING HEIGHT OF THE "A" WALL FOR THE 2S+T SURCHARGE. A MINIMUM OF 2 COURSES OF 8' (2.44 m) HEADERS IS PROVIDED.

DESIGN CRITERIA:

1. WALLS 12'-5" (3.78 m) OR LESS IN HEIGHT MAY BE CONSTRUCTED WITH NO BATTER.
2. UNITS SHOWN IN TABLE ARE FOR INTERMEDIATE PANELS. IN COMPUTING A WALL OF SAY 7 PANELS, IT IS NECESSARY TO REMEMBER THAT 7+1 OR 8 VERTICAL ROWS OF HEADERS ARE REQUIRED. IN ADDITION, ANOTHER VERTICAL ROW OF HEADERS MUST BE ADDED WHENEVER, IN CASE OF LONG WALLS, THE WALL IS "BROKEN" AT PANEL POINTS OF APPROXIMATELY 96 FEET (29.26 m). TABLE OF NUMBER OF UNITS REQUIRED APPLY TO BATTERED WALLS.
3. FOR BATTERED WALLS, STEPS IN WIDTH ARE TO BE MADE AT THE WALL HEIGHTS SHOWN ON THIS SHEET WHEN THE NEXT LOWER LEVEL CONSISTS OF AT LEAST 2 COURSES OF HEADERS. FOR VERTICAL WALLS, STEPS IN WIDTH ARE TO BE MADE AT THE LIMITING TOTAL HEIGHT FOR EACH WALL SHOWN ON THE GRAPHS ON THE DESIGN DATA SHEET PROVIDING THE NEXT LOWER LEVEL CONSISTS OF AT LEAST 2 COURSES OF HEADERS.
4. $f'_c = 3250$ PSI (22 392 kPa), $f_y = 40,000$ PSI (275 600 kPa).

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

REINFORCED CONCRETE CRIB WALL

STANDARD PLAN


619-2

SHEET 6 OF 6

WALL WIDTH TYPE	h	L
"A"	3" (76 mm)	6'-7 5/8" (2.02 m)
"B"	1 3/8" (35 mm)	8'-9 5/8" (2.68 m)
"C"	5 13/16" (148 mm)	10'-11 13/16" (3.35 m)
"D"	10 3/16" (259 mm)	13'-2 1/16" (4.01 m)
"E"	14 5/8" (371 mm)	15'-4 5/16" (4.68 m)
"F"	18 3/8" (476 mm)	17'-8 1/2" (5.40 m)

NOTE: DISTANCE "H" FOR TYPE "A" IS A MINUS QUANTITY - THAT IS, FRONT COLUMN BASE IS LOWER THAN REAR COLUMN BASE.


ALL BOLTS TO BE 5/8" (16 mm) WITH A MINIMUM LENGTH OF 1 1/4" (32 mm) THICKNESS GIVEN IN MILLIMETERS (INCHES).

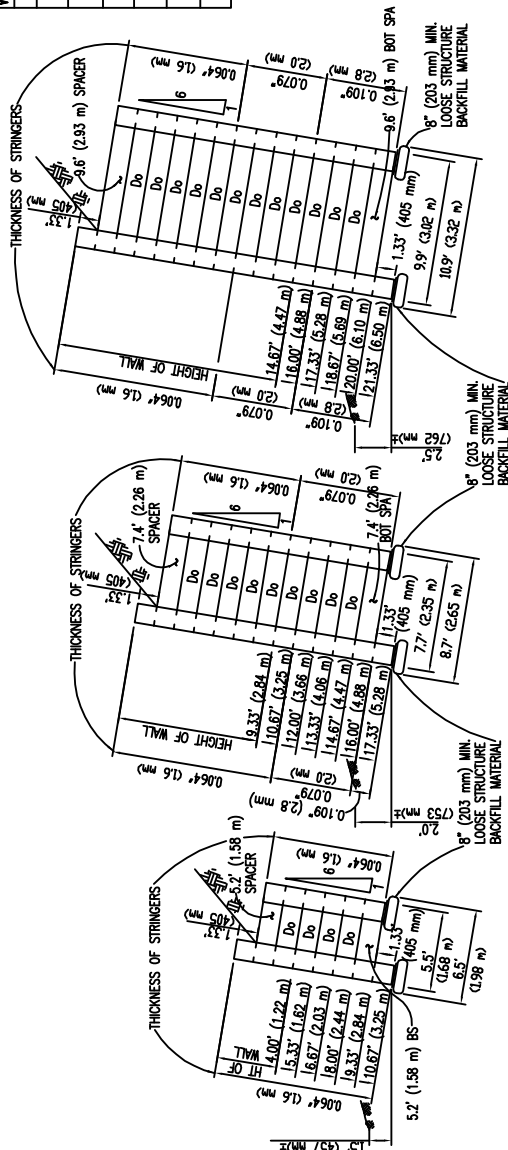


TYPE C

TYPE B


TYPE A

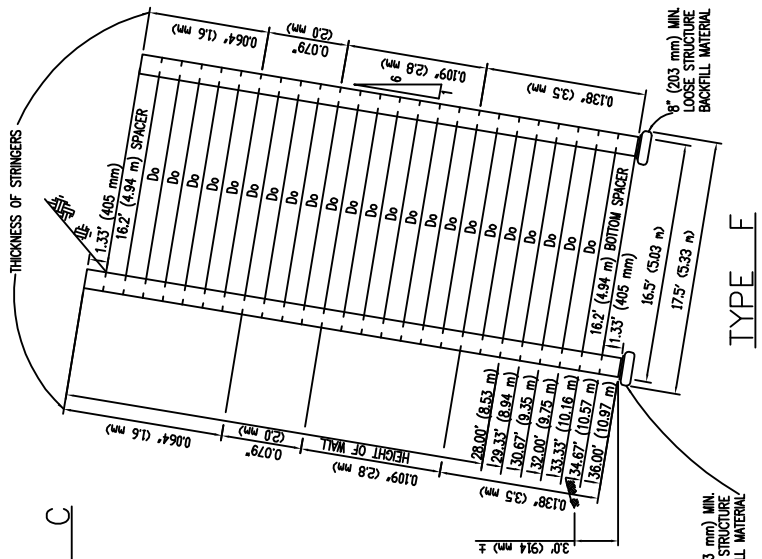

TYPE F

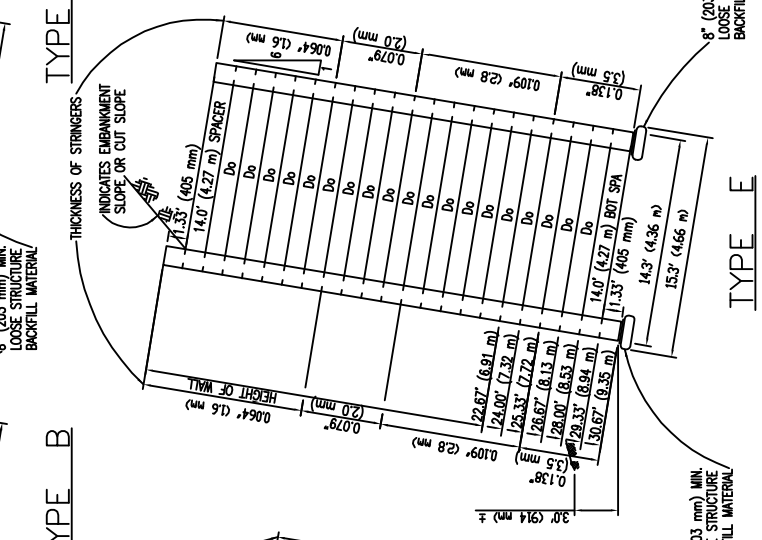

TYPE E

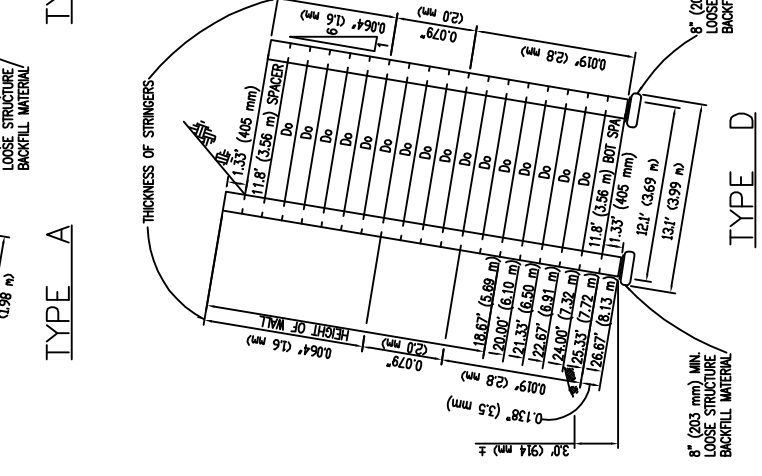

TYPE D

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE PUBLIC WORKS STANDARDS INC. GREENBOOK COMMITTEE 1993 REV. 1996, 2009


STEEL CRIB WALL

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

620-2


SHEET 1 OF 7

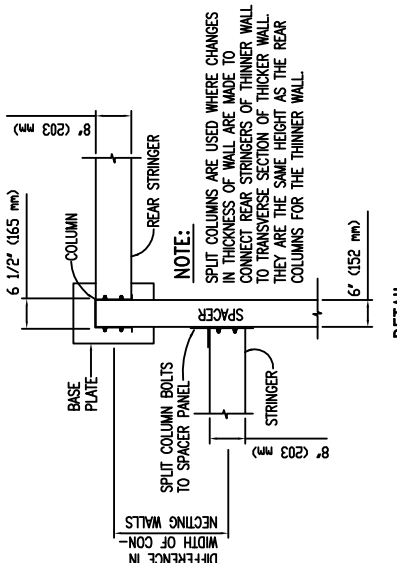


**DETAIL
SPLIT COLUMN ATTACHMENT**

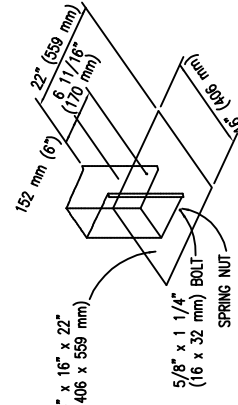


BASE PLATE ARRANGEMENT

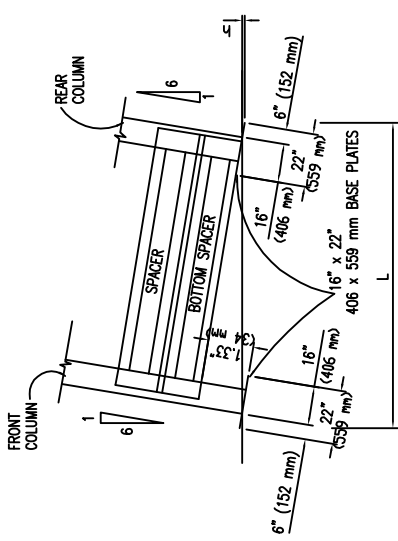


DETAIL BASE PLATE PLACEMENT

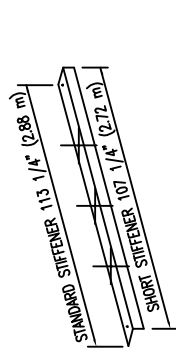


STRINGER STIFFENER - 0.168" (4.3 mm)

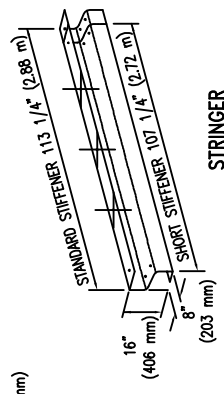

STRINGER

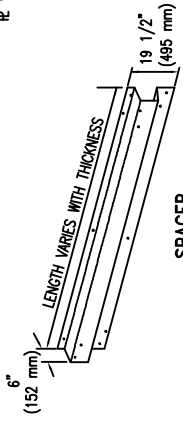

SPACER

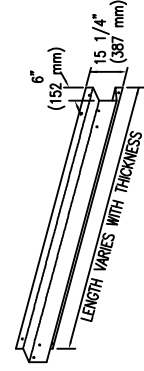


BOTTOM SPACER


NOTE: SEE TABLE ON SHEET NO. 6 FOR THICKNESS AND LENGTH.

GENERAL NOTES:


DESIGN "TYPE" TO BE SHOWN ON ALL CRIB LAYOUTS. FOR DESIGN DATA SEE SHEETS NO. 4 AND NO. 5.

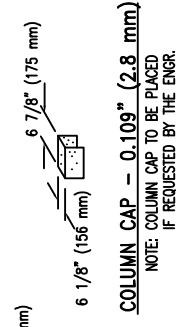


COLUMN CAP - 0.109" (2.8 mm)




**COLUMN
0.168" (4.3 mm)**

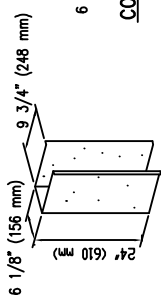

**COLUMN SPLICE PLATE
0.138" (3.5 mm)**

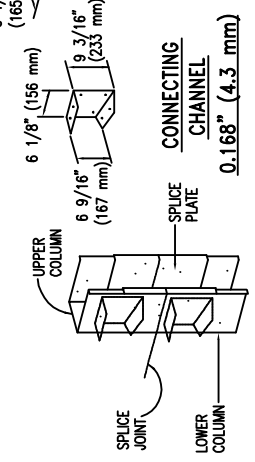


**ASSEMBLY AT
COLUMN SPLICE
0.168" (4.3 mm)**

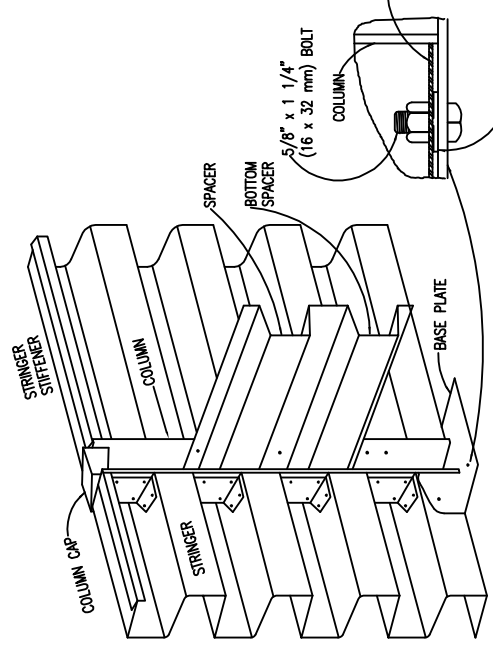

**CRIB ASSEMBLY
FRONT COLUMN
REAR COLUMN SIMILAR**

NOTE:
BEFORE SETTING BASE PLATE INSERT BOLT AND FASTEN WITH SPRING NUT.

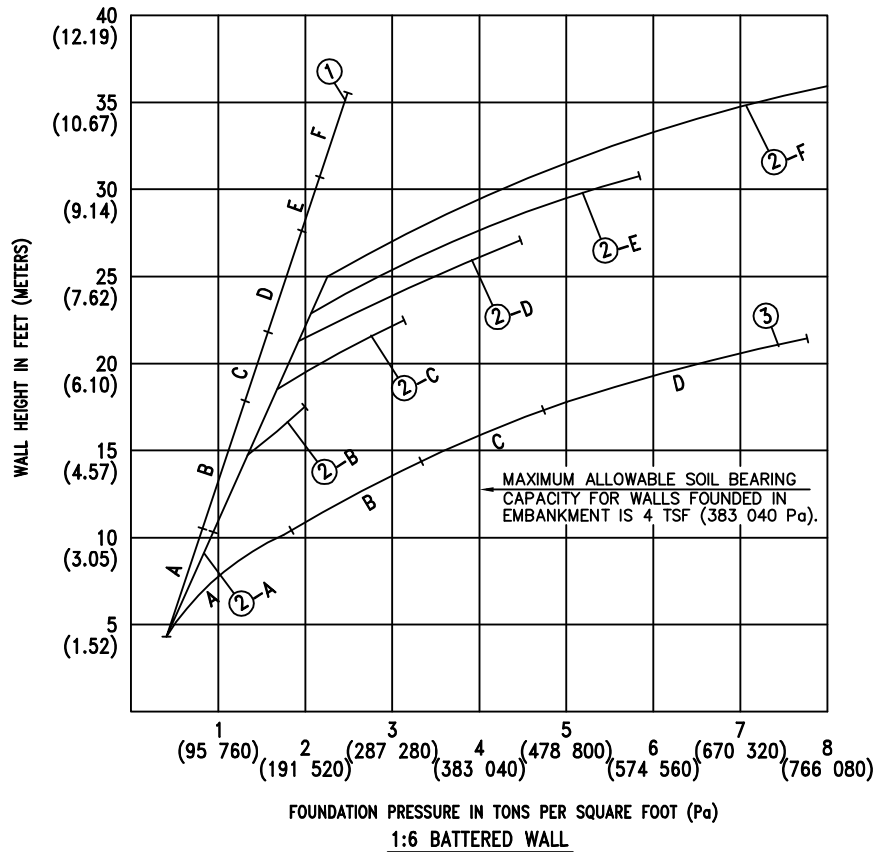

DESIGN EXAMPLES

EXAMPLE NO. 1

GIVEN: WALL HEIGHT 24' (7.32 m).
1:2 (2:1) EMBANKMENT SLOPE TO BE RETAINED.
115' (35.05 m) MAXIMUM FROM TOE OF WALL TO TOP OF SLOPE.
BASE IN EMBANKMENT (5' (1.52 m) DEPTH MIN.).

SELECT: 1:6 BATTERED WALL. VERTICAL WALL NOT PERMITTED. "D" WALL SELECTED.
MAXIMUM HEIGHT ON GRAPH IS 26.00' (7.92 m) AT 4 TSF (383 040 Pa). SINCE THE FOUNDATION PRESSURE IS 3.2 TSF (306 432 Pa) AT 24.00' (7.32 m), THE WALL MUST BE FOUNDED ON A 5 FOOT (1.52 m) THICKNESS OF "STRUCTURE BACKFILL" (SEE DESIGN NOTE 1). A DRAINAGE SYSTEM BEHIND THIS WALL WILL BE REQUIRED.

EXAMPLE NO. 2

GIVEN: WALL HEIGHT 29' (8.84 m).
1:2 (2:1) CUT SLOPE TO BE RETAINED. FOUNDATION SITE INVESTIGATION INDICATES LATERAL PRESSURE FROM MATERIAL ABOVE WILL BE EQUIVALENT TO 1:2 (2:1) EMBANKMENT SLOPE. BASE IN EXCAVATION LEVEL AT TOE OF WALL. FOUNDATION INVESTIGATION DETERMINES THE ALLOWABLE SOIL BEARING CAPACITY AT 3 TSF (287 280 Pa).

SELECT: BATTERED "F" WALL MAXIMUM HEIGHT AT 4 TSF (383 040 Pa) IS 29' (8.84 m), THEREFORE THE REPLACEMENT OF 5 FOOT (1.52 m) EXCAVATION WITH "STRUCTURE BACKFILL" TO INCREASE THE ALLOWABLE SOIL BEARING CAPACITY TO 4 TSF (383 040 Pa) IS REQUIRED (SEE DESIGN NOTE 1). A DRAINAGE SYSTEM FOR THIS WALL SHOULD BE INVESTIGATED.

EXAMPLE NO. 3

GIVEN: WALL HEIGHT 15' (4.57 m).
1:1.5 (1.5:1) EMBANKMENT SLOPE 18' (5.49 m) ABOVE TOP OF WALL TO BE RETAINED BASE ON ORIGINAL GROUND FOUNDATION INVESTIGATION DETERMINES ALLOWABLE SOIL BEARING CAPACITY AT 2 TSF (191 520 Pa).
BASE IN EMBANKMENT (6' (1.52 m) DEPTH MIN.).

SELECT: LOADING CONDITIONS INTERPOLATED AS BETWEEN 1:1.5 (1.5:1) AND 1:2 (2:1) EMBANKMENT SLOPE. USE A TYPE "B" BATTERED WALL OR A TYPE "C" VERTICAL WALL. HOWEVER, IF THE TYPE "C" WALL IS USED 5' (1.52 m) OF EXCAVATION MUST BE REPLACED TO INCREASE THE ALLOWABLE SOIL BEARING CAPACITY TO 4 TSF (383 040 Pa). (SEE DESIGN NOTE 1).

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STEEL CRIB WALL

STANDARD PLAN

620-2


SHEET 3 OF 7

DESIGN CRITERIA:

1. WALL BASE IN EMBANKMENT. A MINIMUM DEPTH OF 5' (1.52 m) OF EMBANKMENT AT 95% RELATIVE SOIL COMPACTION IS REQUIRED BELOW THE BASE OF ALL WALLS IN ORDER TO CONSTITUTE AN EMBANKMENT CONDITION. WHEN THE FOUNDATION PRESSURE IS BETWEEN 2.5 TONS/S.F. (239 400 Po) AND 4.0 TONS/S.F. (383 040 Po), EMBANKMENT BELOW THE WALL SHALL CONSIST OF "STRUCTURE BACKFILL" MATERIAL AS SET FORTH IN SECTION 300-3.5 OF THE STANDARD SPECIFICATIONS. THE LIMITS OF RELATIVE COMPACTION (95%) SHALL BE AS SET FORTH IN SECTION 300-3.5 OF THE STANDARD SPECIFICATIONS.
2. WALL BASE IN ORIGINAL GROUND. ALLOWABLE SOIL PRESSURE AT TOE OF WALL SHALL BE DETERMINED BY FOUNDATION SITE INVESTIGATION. WALLS THAT ARE TO RETAIN CUT SLOPES SHALL BE DESIGNED FOR LATERAL AND TOE PRESSURES DETERMINED FROM SITE INVESTIGATION DATA. OVERALL STABILITY OF SLOPE WITH WALL IN PLACE MUST BE ANALYZED. IF ORIGINAL GROUND SLOPES AWAY FROM TOE OF WALL, REDUCTION IN ALLOWABLE BEARING CAPACITY DUE TO SLOPE MUST BE CONSIDERED. WALLS SHALL NOT BE FOUND IN ORIGINAL GROUND HAVING AN ALLOWABLE BEARING CAPACITY OF LESS THAN 1.5 TONS/S.F. (143 640 Po). CONSIDERATION SHOULD BE GIVEN TO REMOVAL AND REPLACEMENT OF UNSUITABLE MATERIAL WITH "STRUCTURE BACKFILL" MATERIAL. RELATIVE COMPACTION SHALL BE 95%.
3. DRAINAGE.
 - A. INTERNAL: SECTION 300-3.5 OF THE STANDARD SPECIFICATIONS.
 - B. EXTERNAL: IF THE COMBINED HEIGHT OF WALL AND OVERFILL (MEASURED ALONG FACE OF WALL AND VERTICALLY FROM THE TOE OF FILL TO TOP OF FILL) EXCEEDS 25' (7.62 m), A SYSTEM TO DRAIN WATER AWAY FROM THE BACK FACE OF WALL SHALL BE PROVIDED. THE TYPE AND EXTENT OF THIS SYSTEM WILL DEPEND ON THE TYPE OF BACKFILL MATERIAL EXPECTED TO BE USED, THE COMBINED HEIGHT OF WALL AND BACKFILL, AND THE LOCATION OF THE WATER TABLE IN THE AREA.
4. SLOPING SURCHARGE LIMITATIONS: THE MAXIMUM HEIGHT OF FILL BEHIND ANY WALL OF FAMILY OF WALLS, SHALL NOT EXCEED 15' (35.02 m) (MEASURED VERTICALLY FROM THE TOE OF THE BOTTOM WALL TO THE TOP OF FILL BEHIND THE UPPERMOST WALL). FOR A FAMILY OF WALLS THE SLOPE OF A LINE DRAWN FROM THE TOP OF THE FRONT FACE OF BOTTOM WALL TO THE TOP OF THE FRONT FACE OF ANY INTERMEDIATE OR TOP WALL, IN NO CASE EXCEED 1:1.5 (1:1.5).

MATERIAL SPECIFICATIONS:

- STEEL SHEETS:
 AASHTO M218
 45,000 ULTIMATE
 33,000 YIELD
 20% ELONGATION
 BOLTS: ASTM A307 GRADE A.

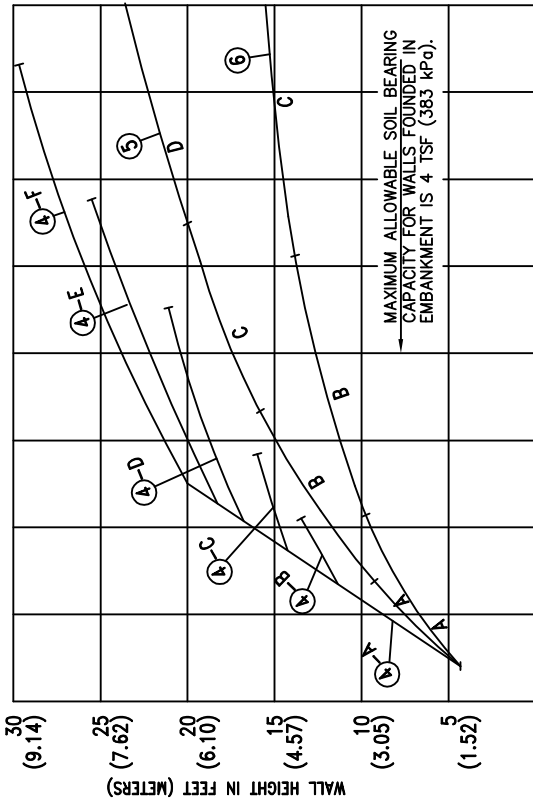

MAXIMUM ALLOWABLE SOIL BEARING CAPACITY FOR WALLS FOUNDED IN EMBANKMENT IS 4 TSF (383 KPa).

FOUNDATION PRESSURE IN TONS PER SQUARE FOOT (Po).

VERTICAL WALL

SURCHARGE	LEVEL 2' (610 mm) MIN. SURCHARGE	1:2 (2:1) WITH FINITE* SURCHARGE	1:1.5 (1.5:1) WITH FINITE* SURCHARGE
WALL ON 1:6 BATTER			
WALL VERTICAL			

*15' (35.05 m) MAXIMUM DIFFERENCE IN ELEVATION FROM TOE TO WALL TO TOP OF SLOPE
 A,B,C,D,E,F = WALL TYPE
 ZZZZZZZ INDICATES 2' (610 mm) MIN. SURCHARGE ABOVE "ROADWAY GRADE"

LEGEND FOR GRAPHS




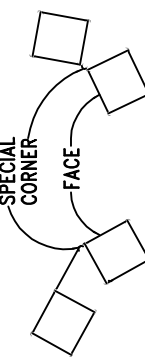
UPPER END OF LINE INDICATES MAXIMUM WALL HEIGHT FOR A GIVEN WALL TYPE

CURVATURE CHART - 1 TO 6 BATTER

THIS DATA, OMITTING HEIGHT RESTRICTIONS, CAN BE USED FOR VERTICAL WALLS

DESIGN	Type "A" BASE WIDTH 5.5' (1.7 m)	Type "B" BASE WIDTH 7.7' (2.4 m)	Type "C" BASE WIDTH 9.9' (3.0 m)	Type "D" BASE WIDTH 12.1' (3.7 m)	Type "E" BASE WIDTH 14.3' (4.4 m)	Type "F" BASE WIDTH 16.5' (5.0 m)	HEIGHT
METHOD 1	0' to 0'26'	0' to 0'20'	0' to 0'14'	0' to 0'12'	0' to 0'10'	0' to 0'8'	
METHOD 2	4'59" to 5'25"	3'34" to 3'54"	2'47" to 3'01"	2'16" to 2'28"	1'55" to 2'05"	1'18" to 1'26"	
36' (11.0)							36' (11.0 m)
32' (9.8)							32' (9.8 m)
28' (8.5)							28' (8.5 m)
24' (7.3)							24' (7.3 m)
20' (6.1)							20' (6.1 m)
16' (4.9)							16' (4.9 m)
12' (3.6)							12' (3.6 m)
8' (2.4)							8' (2.4 m)
4' (1.2)							4' (1.2 m)
RADIUS x 100' (30.5 m)	25 20 15 10 5 3	15 10 5 2 10 5 2	10 5 2 10 5 2	10 5 2 10 5 2	10 5 2 10 5 2	10 5 2 10 5 2	
DEGREE OF CURVE	25 20 15 10 5 3	15 10 5 2 10 5 2	10 5 2 10 5 2	10 5 2 10 5 2	10 5 2 10 5 2	10 5 2 10 5 2	

EXAMPLE - To build a Type "D" wall 20.00' (6.1 m) high on a 1400' (425 m) radius curve, use Method 2 with one set of short stringers in each group of five panel sections.

<p>METHOD 1</p>  <p>DEFLECTION ANGLE</p> <p>USE NORMAL PLAY IN BOLT HOLES OF STANDARD PARTS. MAXIMUM DEFLECTION SHOWN AT TOP OF TABLE CAN BE OBTAINED AT EACH COLUMN IN VERTICAL OR BATTERED WALLS. CHART SHOWS SMALLEST RADIUS WHICH CAN BE USED FOR EACH DESIGN OF WALL</p>	<p>METHOD 2</p>  <p>SHORT STRINGER</p> <p>USE SHORT PANEL SECTIONS 9'-6" (2.9 m) FACE OR REAR) IN ADDITION TO PLAY IN BOLT HOLES CURVATURE CHART INDICATES NUMBER # OF BINS IN EACH GROUP, INCLUDING A MODIFIED BIN, NECESSARY TO BUILD A CURVED WALL AT A REQUIRED HEIGHT AND RADIUS.</p>	<p>METHOD 3</p>  <p>USE STRINGERS FIELD CUT (WITH SABER SAW) AND DRILLED TO FIT WALL DIMENSIONS AS IT IS ASSEMBLED. ANY RADIUS CAN BE FITTED ON ANY HEIGHT OF WALL, BATTERED OR VERTICAL, GENERALLY STANDARD PANELS ARE USED. BETWEEN FIELD CUT PANELS, WITH VERY SHORT RADI THE SPACING OF THE TRANSVERSE SECTIONS CAN BE SHORTENED SO THAT TWO PLACES CAN BE CUT FROM EACH STRINGER. THIS METHOD IS APPLICABLE TO LARGE SINGLE DEFLECTIONS.</p>	<p>METHOD 4</p>  <p>SPECIAL CORNER FACE</p> <p>USE SPECIAL SHOP FABRICATED CORNER CONNECTION PIECES. BATTER, HEIGHT, ANGLE TURN, AND BASE WIDTH DETERMINE THE DIRECTION OF DIMENSION LIMITATIONS APPLICABLE ON THIS METHOD. MANUFACTURER SHOULD BE CONTACTED BEFORE DETAILING DESIGN FOR A SPECIFIC TURN. REAR STRINGERS ARE OMITTED AND IT MAY BE NECESSARY TO INCREASE THE BASE WIDTH OF ADJACENT BINS TO PROVIDE NEEDED STABILITY. THIS METHOD IS AN ALTERNATIVE FOR METHOD 3.</p>
<p>NOTE - USE GRAPHS SHOWN ON STEEL CRIB WALL SHEET NO. 3 TO DETERMINE BASE WIDTH TO HEIGHT RATIO FOR THE VARIOUS SURCHARGES ON BOTH VERTICAL AND BATTER WALLS.</p> <p>RIGHT ANGLE TURNS IN BATTERED WALLS CAN BE MADE BY ERECTING ONE COMPLETE BIN VERTICALLY IN THE CORNER.</p>			

NOTE: THIS TABLE APPLIES ONLY TO STANDARD PANEL SECTIONS AND INCLUDES UNITS FOR BOTH FRONT AND REAR OF A 10 ELEMENT OF WALL.



UNITS REQUIRED PER TRANSVERSE SECTION

WALL HEIGHT FEET (m)	BEARING PLATE 16"x22" (406 x 559 mm)	FRONT COLUMN HEIGHT IN FEET (METERS)			REAR COLUMN HEIGHT IN FEET (METERS)			TOTAL HEIGHT (METERS)	TOTAL HEIGHT (FEET)	COLUMN SPACING (METERS)	SPACERS THICKNESS & LENGTH			BOTTOM SPACERS THICKNESS & LENGTH			UNITS REQUIRED PER PANEL SECTION						
		1ST LIFT	2ND LIFT	3RD LIFT	TOTAL HEIGHT	1ST LIFT	2ND LIFT				3RD LIFT	TOTAL HEIGHT	0.064" (1.6 mm)	0.079" (2.0 mm)	0.109" (2.8 mm)	0.064" (1.6 mm)	0.079" (2.0 mm)	0.109" (2.8 mm)	STR	STR	WALL HEIGHT FEET (METERS)		
4.00 (1.22)	2	4.00 (1.22)			4.00 (1.22)			4.00 (1.22)	1.33 (0.41)	5.33 (1.63)	1								4			1	4.00 (1.22)
5.33 (1.62)	2	5.33 (1.62)			5.33 (1.62)			5.33 (1.62)	2.67 (0.81)	8.00 (2.43)	1	1							6			1	5.33 (1.62)
6.67 (2.03)	2	6.67 (2.03)			6.67 (2.03)			6.67 (2.03)	4.00 (1.22)	10.67 (3.25)	1	2							8			1	6.67 (2.03)
8.00 (2.44)	2	8.00 (2.44)			8.00 (2.44)			8.00 (2.44)	5.33 (1.62)	13.33 (4.06)	1	3							10			1	8.00 (2.44)
9.33 (2.84)	2	9.33 (2.84)			9.33 (2.84)			9.33 (2.84)	6.67 (2.03)	16.00 (4.87)	1	4							12			1	9.33 (2.84)
10.67 (3.25)	2	10.67 (3.25)			10.67 (3.25)			10.67 (3.25)	8.00 (2.44)	18.67 (5.69)	1	5	5						14			1	10.67 (3.25)
12.00 (3.66)	2	12.00 (3.66)			12.00 (3.66)			12.00 (3.66)	9.33 (2.84)	21.33 (6.50)	1	6	6						14	2		1	12.00 (3.66)
13.33 (4.06)	2	13.33 (4.06)			13.33 (4.06)			13.33 (4.06)	10.67 (3.25)	24.00 (7.31)	1	7	7						14	4		1	13.33 (4.06)
14.67 (4.47)	2	14.67 (4.47)			14.67 (4.47)			14.67 (4.47)	12.00 (3.66)	26.67 (8.13)	1	8	8						14	6		1	14.67 (4.47)
16.00 (4.88)	2	16.00 (4.88)			16.00 (4.88)			16.00 (4.88)	13.33 (4.06)	29.33 (8.94)	2	9	9						14	8		1	16.00 (4.88)
17.33 (5.28)	2	17.33 (5.28)			17.33 (5.28)			17.33 (5.28)	14.67 (4.47)	32.00 (9.75)	2	10	10						14	8	2	1	17.33 (5.28)
18.67 (5.69)	2	18.67 (5.69)			18.67 (5.69)			18.67 (5.69)	16.00 (4.88)	34.67 (10.51)	2	11	11						14	8	4	1	18.67 (5.69)
20.00 (6.10)	2	20.00 (6.10)			20.00 (6.10)			20.00 (6.10)	17.33 (5.28)	37.33 (11.36)	2	12	12						14	8	6	1	20.00 (6.10)
21.33 (6.50)	2	21.33 (6.50)			21.33 (6.50)			21.33 (6.50)	18.67 (5.69)	40.00 (12.19)	2	13	13						14	8	8	1	21.33 (6.50)
22.67 (6.91)	2	22.67 (6.91)			22.67 (6.91)			22.67 (6.91)	20.00 (6.10)	42.67 (13.01)	2	14	14						14	8	10	1	22.67 (6.91)
24.00 (7.32)	2	24.00 (7.32)			24.00 (7.32)			24.00 (7.32)	21.33 (6.50)	45.33 (13.82)	2	15	15						14	8	12	1	24.00 (7.32)
25.33 (7.72)	2	25.33 (7.72)			25.33 (7.72)			25.33 (7.72)	22.67 (6.91)	48.00 (14.63)	3	16	16						14	8	14	1	25.33 (7.72)
26.67 (8.13)	2	26.67 (8.13)			26.67 (8.13)			26.67 (8.13)	24.00 (7.32)	50.67 (15.44)	3	17	17						14	8	14	2	26.67 (8.13)
28.00 (8.53)	2	28.00 (8.53)			28.00 (8.53)			28.00 (8.53)	25.33 (7.72)	53.33 (16.25)	4	18	18						14	8	14	4	28.00 (8.53)
29.33 (8.94)	2	29.33 (8.94)			29.33 (8.94)			29.33 (8.94)	26.67 (8.13)	56.00 (17.07)	4	19	19						14	8	14	6	29.33 (8.94)
30.67 (9.35)	2	30.67 (9.35)			30.67 (9.35)			30.67 (9.35)	28.00 (8.53)	58.67 (17.88)	4	20	20						14	8	14	8	30.67 (9.35)
32.00 (9.75)	2	32.00 (9.75)			32.00 (9.75)			32.00 (9.75)	29.33 (8.94)	61.34 (18.70)	4	21	21						14	8	14	10	32.00 (9.75)
33.33 (10.16)	2	33.33 (10.16)			33.33 (10.16)			33.33 (10.16)	30.67 (9.35)	64.01 (19.51)	4	22	22						14	8	14	12	33.33 (10.16)
34.67 (10.57)	2	34.67 (10.57)			34.67 (10.57)			34.67 (10.57)	32.00 (9.75)	66.68 (20.32)	4	23	23						14	8	14	14	34.67 (10.57)
36.00 (10.97)	2	36.00 (10.97)			36.00 (10.97)			36.00 (10.97)	33.33 (10.16)	69.35 (21.14)	4	24	24						14	8	14	16	36.00 (10.97)

UNITS REQUIRED PER SHORT PANEL SECTION

WALL HEIGHT	SHORT STRINGERS IN FRONT OF WALL								SHORT STD STD'F	SHORT STRINGERS IN REAR OF WALL								STD. STD STD'F
	0.064" (1.6 mm)		0.079" (2.0 mm)		0.109" (2.8 mm)		0.138" (3.5 mm)			0.064" (1.6 mm)		0.079" (2.0 mm)		0.109" (2.8 mm)		0.138" (3.5 mm)		
	STD	SHORT	STD	SHORT	STD	SHORT	STD	SHORT		STD	SHORT	STD	SHORT	STD	SHORT	STD	SHORT	
FEET (METERS)	9.5' (2.90 m)	9.0' (2.74 m)	9.5' (2.90 m)	9.0' (2.74 m)	9.5' (2.90 m)	9.0' (2.74 m)	9.5' (2.90 m)	9.0' (2.74 m)	STD'F	9.5' (2.90 m)	9.0' (2.74 m)	9.5' (2.90 m)	9.0' (2.74 m)	9.5' (2.90 m)	9.0' (2.74 m)	9.5' (2.90 m)	9.0' (2.74 m)	
4.00 (1.22)	1	3							1	3	1							1
5.33 (1.62)	2	4							1	4	2							1
6.67 (2.03)	3	5							1	5	3							1
8.00 (2.44)	4	6							1	6	4							1
9.33 (2.84)	5	7							1	7	5							1
10.67 (3.25)	6	8							1	8	6							1
12.00 (3.66)	6	8							1	8	6							1
13.33 (4.06)	6	8	2	2					1	8	6	2	2					1
14.67 (4.47)	6	8	3	3					1	8	6	3	3					1
16.00 (4.88)	6	8	4	4					1	8	6	4	4					1
17.33 (5.28)	6	8	4	4	1	1			1	8	6	4	4	1	1			1
18.67 (5.69)	6	8	4	4	2	2			1	8	6	4	4	2	2			1
20.00 (6.10)	6	8	4	4	3	3			1	8	6	4	4	3	3			1
21.33 (6.50)	6	8	4	4	4	4			1	8	6	4	4	4	4			1
22.67 (6.91)	6	8	4	4	5	5			1	8	6	4	4	5	5			1
24.00 (7.32)	6	8	4	4	6	6			1	8	6	4	4	6	6			1
25.33 (7.72)	6	8	4	4	7	7			1	8	6	4	4	7	7			1
26.67 (8.13)	6	8	4	4	7	7	1	1	1	8	6	4	4	7	7	1	1	1
28.00 (8.53)	6	8	4	4	7	7	2	2	1	8	6	4	4	7	7	2	2	1
29.33 (8.94)	6	8	4	4	7	7	3	3	1	8	6	4	4	7	7	3	3	1
30.67 (9.35)	6	8	4	4	7	7	4	4	1	8	6	4	4	7	7	4	4	1
32.00 (9.75)	6	8	4	4	7	7	5	5	1	8	6	4	4	7	7	5	5	1
33.33 (10.16)	6	8	4	4	7	7	6	6	1	8	6	4	4	7	7	6	6	1
34.67 (10.57)	6	8	4	4	7	7	7	7	1	8	6	4	4	7	7	7	7	1
36.00 (10.97)	6	8	4	4	7	7	8	8	1	8	6	4	4	7	7	8	8	1


NOTE: THIS TABLE APPLIES ONLY TO SHORT PANEL SECTIONS FOR CURVED WALLS AND INCLUDES UNITS FOR BOTH FRONT AND REAR OF A 9.5 ELEMENT OF WALL.

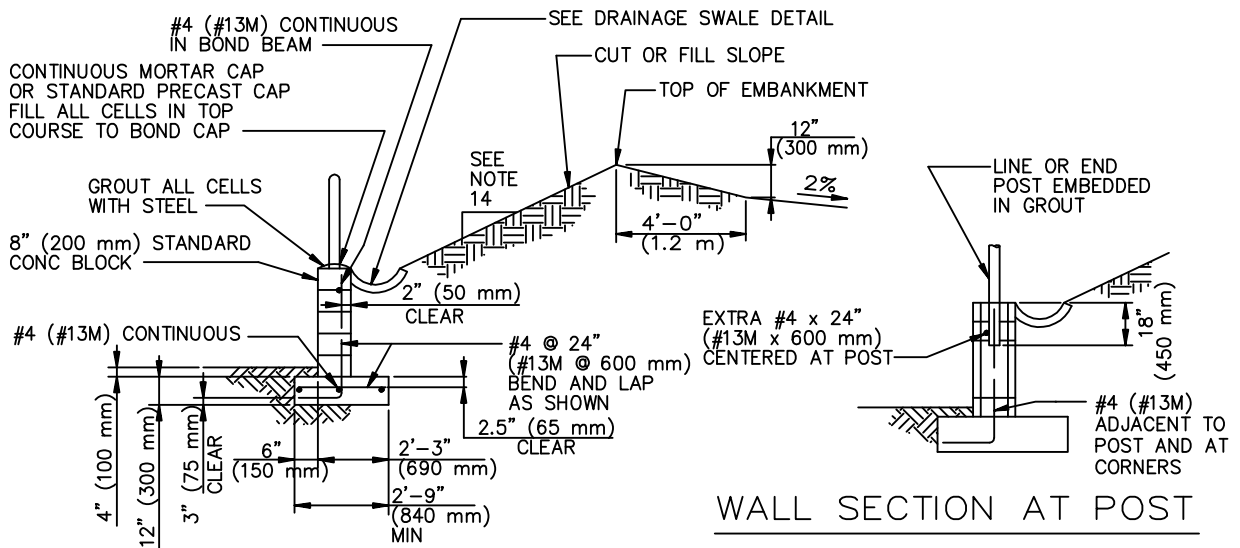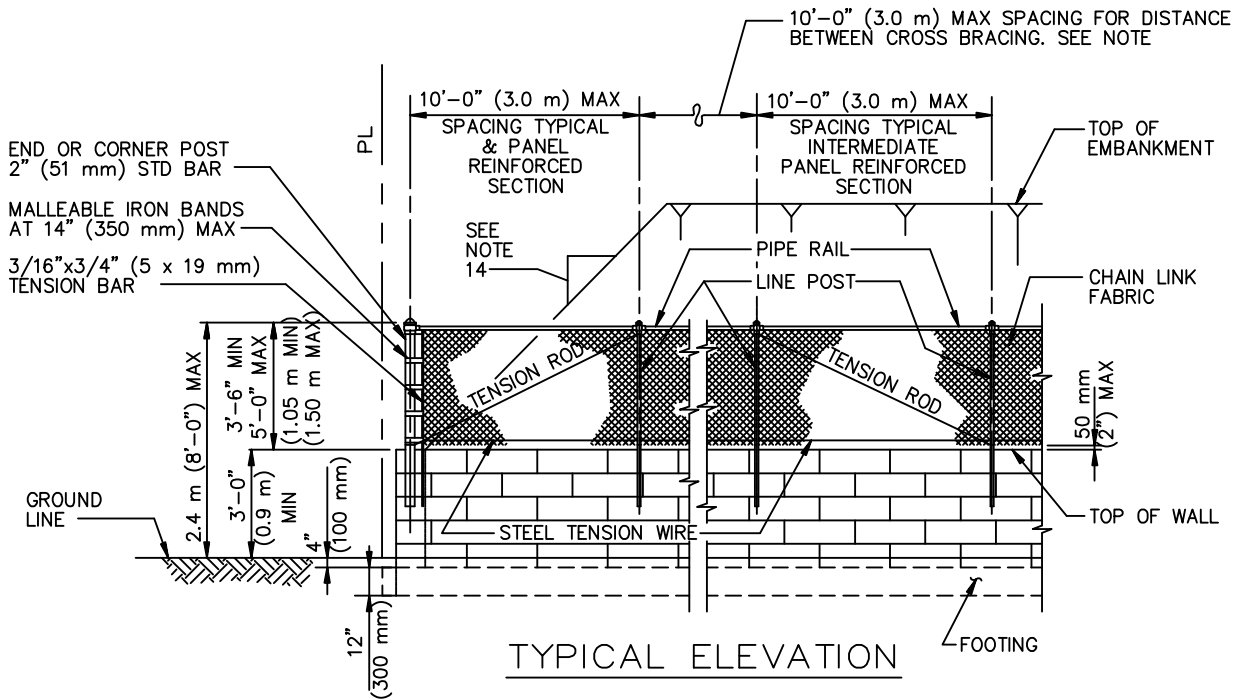

TYPICAL WALL SECTION

WALL SECTION AT POST

WELDED WIRE MESH
6x6-W4.0xW4.0
(152x152 MW25.8xMW25.8)

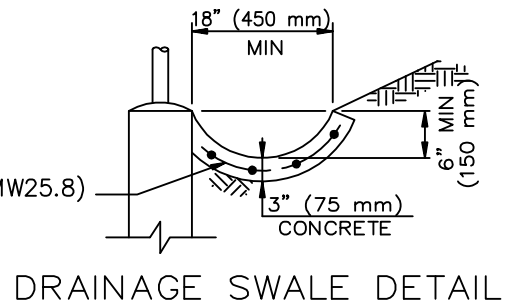

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2009

**REINFORCED CONCRETE BLOCK WALL
AND CHAIN LINK FENCE COMBINATION**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

621-2

SHEET 1 OF 2

NOTES:

1. THE BLOCK WALL SHALL BE CONSTRUCTED IN ACCORDANCE WITH SSPWC 303-4.1.
2. USE STANDARD 8" (200 mm) WIDE NORMAL WEIGHT CONCRETE BLOCK PER SSPWC 202-2.
3. USE CONCRETE BOND BEAM BLOCK WHERE HORIZONTAL STEEL IS CALLED FOR.
4. MORTAR, GROUT AND WATER SHALL BE IN ACCORDANCE WITH SSPWC 202-2.
5. REINFORCING STEEL SHALL BE GRADE 40 (GRADE 300) PER SSPWC 201-2.
6. ALL BLOCKS SHALL BE LAID UP IN MORTAR HEAD AND BED JOINTS FOR FULL THICKNESS OF FACE SHELLS. WEBS OF EACH COURSE SHALL CENTER ON WEBS OF COURSES BELOW. OMIT HEAD JOINT IN GRADE COURSE.
7. PLACE A MINIMUM 4" (100 mm) LAYER OF NO. 4 CONCRETE AGGREGATE BETWEEN THE SOIL BACKFILL AND THE OPEN HEAD JOINT.
8. ALL CELLS IN WHICH STEEL IS PLACED SHALL BE FILLED WITH GROUT.
9. CONCRETE SHALL BE 500-A-2500 (310-A-17) PER SSPWC 201-2.
10. POUR FOOTING AGAINST UNDISTURBED NATURAL SOIL OR SOIL THAT HAS BEEN COMPACTED TO 90% OPTIMUM DENSITY PER ASTM D1557-78.
11. CHAIN LINK FENCING SHALL BE CONSTRUCTED IN ACCORDANCE WITH SSPWC 304-3. MATERIAL SHALL BE IN ACCORDANCE WITH SSPWC 206-6.
12. PROVIDE OPEN HEAD JOINTS AT INTERVALS NO GREATER THAN 48" (1.2 m). WHERE WALL IS LOCATED ADJACENT TO A SIDEWALK, PROVIDE 2" ϕ (50 mm ϕ) WEEP HOLES UNDER SIDEWALK.
13. FOR PRIVATE PROPERTY, USE 1V:2H SLOPE. FOR PUBLIC PROPERTY, USE ENGINEER'S DESIGNATION.
14. WELDED WIRE MESH SHALL BE PER SSPWC 201-2.4.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

**REINFORCED CONCRETE BLOCK WALL
AND CHAIN LINK FENCE COMBINATION**

621-2

SHEET 2 OF 2

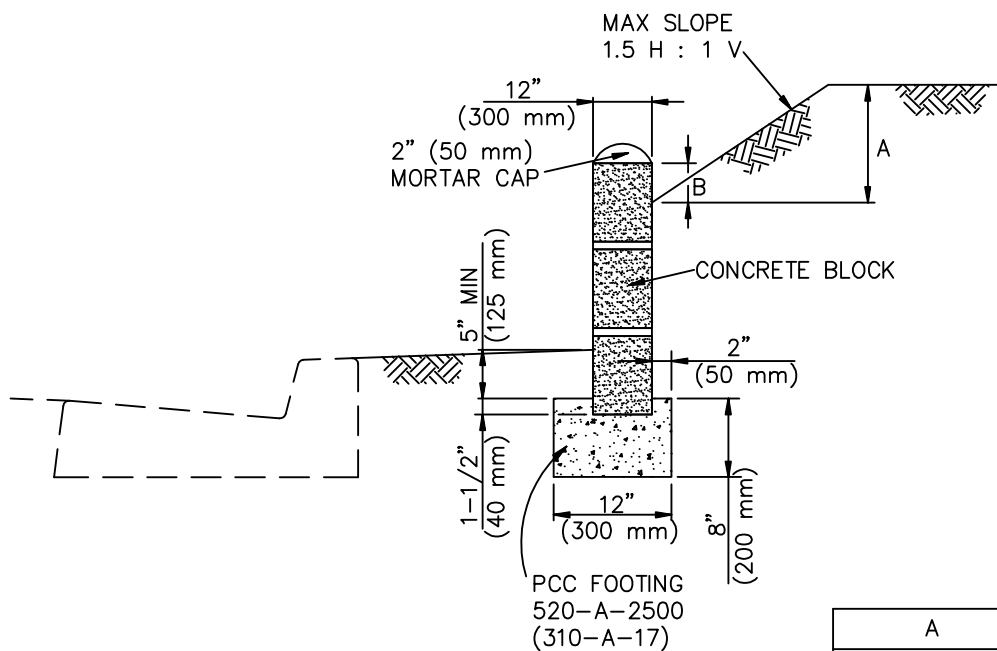

A	B
0 TO 6" (0 TO 150 mm)	2" (50 mm)
6" TO 16" (151 TO 400 mm)	4" (100 mm)
17" TO 48" (410 TO 1200 mm)	6" (150 mm)

NOTES:

1. MAX HEIGHT OF WALL IS 3 COURSES OF 8" (200 mm) HIGH BLOCK.
2. NO LIVE-LOAD SURCHARGE SHALL BE ALLOWED ON RETAINED SOIL.
3. POUR FOOTING AGAINST UNDISTURBED EARTH.
4. TOP OF FOOTING MAY BE PLACED AT SAME GRADE AS STREET IF STREET GRADE IS UNIFORM AND 5% MAX.
5. PLACE CONCRETE BLOCKS IMMEDIATELY AFTER POURING THE FOOTING. FILL ALL CELLS SOLID WITH GROUT AND ROD SO THAT GROUT IS MONOLITHIC WITH FOOTING.
6. IN FIRST COURSE ABOVE FINISHED GRADE, OMIT MORTAR FROM VERTICAL JOINTS EACH 32" (800 mm) TO SERVE AS WEEP HOLES.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2005, 2009


CONCRETE BLOCK SLOUGH WALL

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION


STANDARD PLAN

622-3


SHEET 1 OF 1

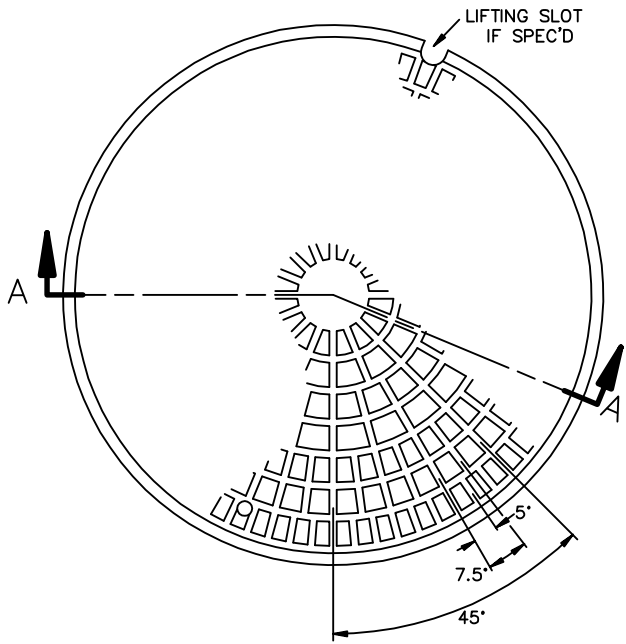


TOP OF COVER

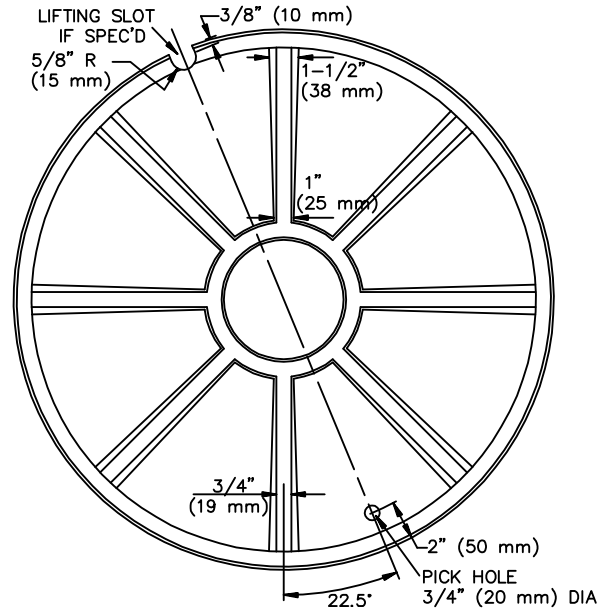


BOTTOM OF COVER

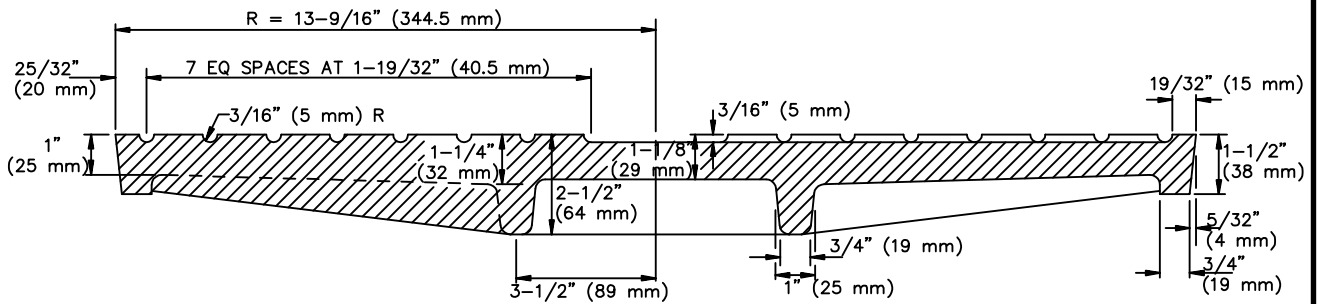

SECTION A-A

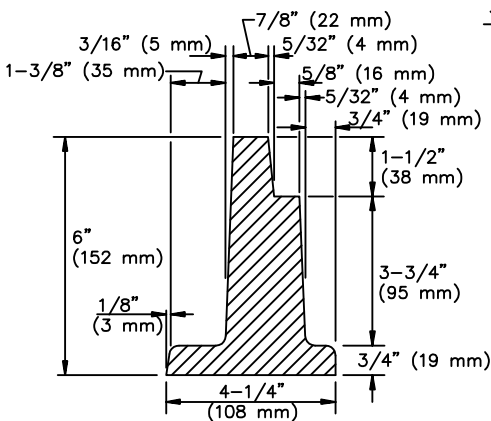

FRAME DETAIL

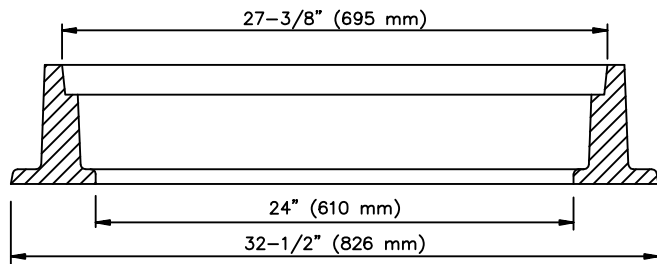

SECTION THRU FRAME

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

**24" (610 mm) MANHOLE FRAME
AND COVER**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

630-3

SHEET 1 OF 2

NOTES:

1. THE CAST IRON USED SHALL CONFORM TO ASTM A-48 CLASS 35B.
2. COVERS SHALL BE CAST WITH THE LETTER "D" FOR STORM DRAINS AND "S" FOR SEWERS, AND THE AGENCY'S IDENTIFICATION IN ACCORDANCE WITH INSTRUCTIONS FURNISHED BY THE AGENCY. THE LETTER "D" OR "S" SHALL BE APPROXIMATELY 2-1/2" (65 mm) HIGH WITH 1/2" (15 mm) LINE WIDTH, AND PLACED IN THE CENTER OF THE COVER. ALL LETTERS SHALL BE FLUSH WITH THE FINISHED SURFACE OF THE COVER.
3. FOUNDRY IDENTIFYING MARK, HEAT AND DATE SHALL BE CAST ON THE BOTTOM OF THE COVER AND ON THE INSIDE OF THE FRAME.
4. IMPORTED COVERS AND FRAMES SHALL HAVE THE COUNTRY OF ORIGIN MARKING IN COMPLIANCE WITH FEDERAL REGULATIONS.
5. WEIGHT OF FRAME SHALL BE 260 LBS (118 kg). WEIGHT OF COVER SHALL BE 175 LBS (79 kg). ACTUAL WEIGHTS SHALL BE WITHIN A RANGE OF 95% TO 110%.
6. THE MANHOLE FRAME AND COVER SHALL BE INSPECTED BY THE ENGINEER PRIOR TO SHIPMENT TO THE JOBSITE. ACCEPTANCE WILL BE INDICATED BY THE AGENCY'S MARK.
7. THE PROOF-LOAD FOR TEST METHOD B OF SSPWC 206-3.2 IS 40,700 LBS (180 kN).
8. COVERS FOR MANHOLES LOCATED IN EASEMENTS, ALLEYS, PARKWAYS AND ALL PLACES OTHER THAN PAVED STREETS SHALL BE PROVIDED WITH SOCKET-SET SCREW LOCKING DEVICES. DRILL AND TAP TWO HOLES TO A DEPTH OF 1" (25 mm) AT 90 DEGREES TO PICK HOLE AND INSTALL 3/4" x 3/4" (20 x 20 mm) STAINLESS STEEL SOCKET-SET SCREWS WITH 3/8" (10 mm) RECESSED HEX HEAD. ALL THREADS SHALL BE N.C.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


24" (610 mm) MANHOLE FRAME AND COVER

630-3


SHEET 2 OF 2

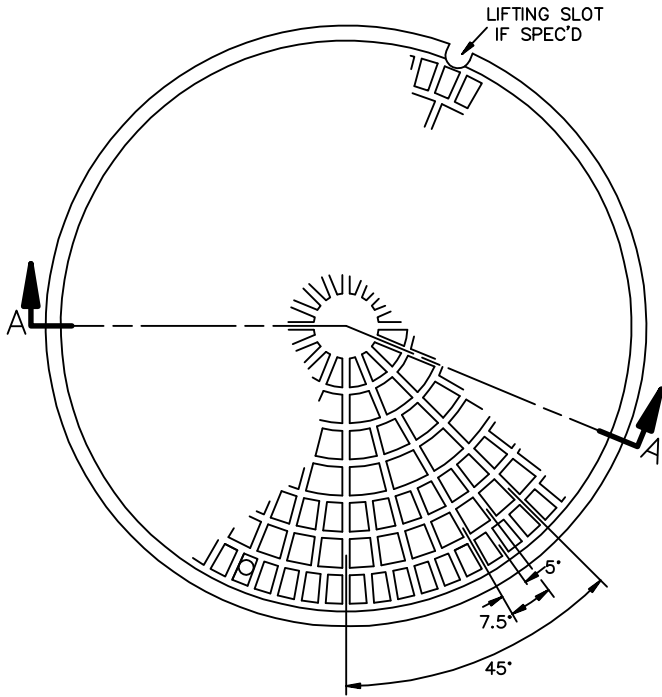


TOP OF COVER

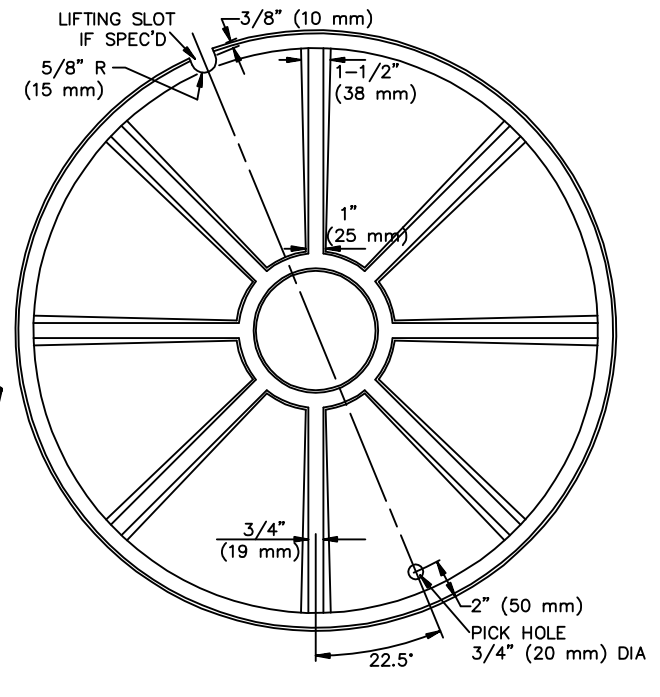


BOTTOM OF COVER

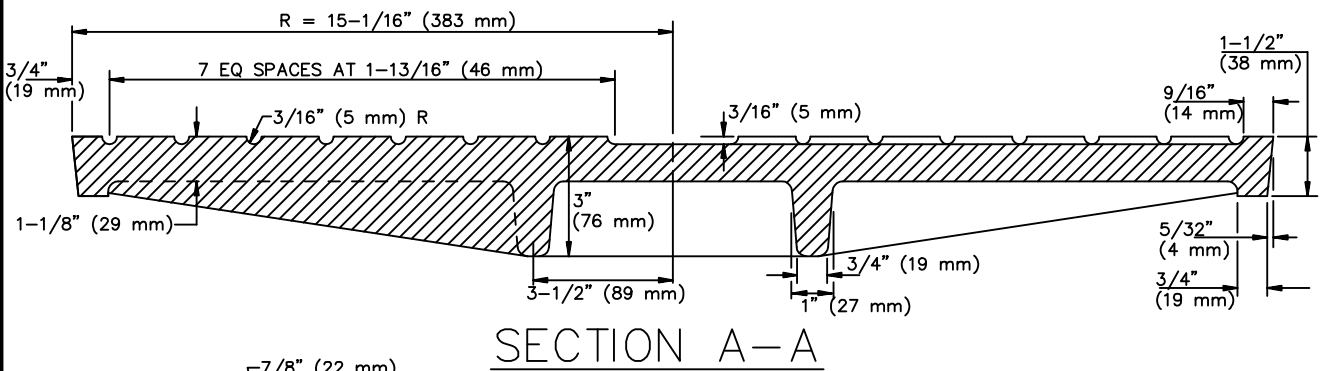

SECTION A-A

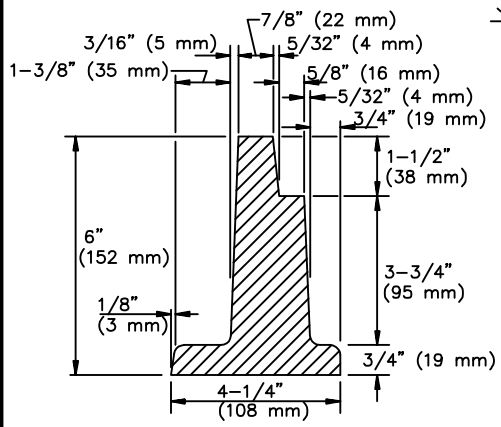

FRAME DETAIL

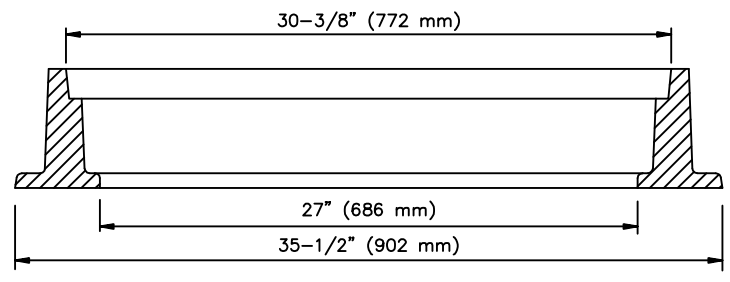

SECTION THRU FRAME

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

**27" (686 mm) MANHOLE FRAME
AND COVER**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN
631-3
SHEET 1 OF 2

NOTES:

1. THE CAST IRON USED SHALL CONFORM TO ASTM A-48 CLASS 35B.
2. COVERS SHALL BE CAST WITH THE LETTER "D" FOR STORM DRAINS AND "S" FOR SEWERS, AND THE AGENCY'S IDENTIFICATION IN ACCORDANCE WITH INSTRUCTIONS FURNISHED BY THE AGENCY. THE LETTER "D" OR "S" SHALL BE APPROXIMATELY 2-1/2" (65 mm) HIGH WITH 1/2" (15 mm) LINE WIDTH, AND PLACED IN THE CENTER OF THE COVER. ALL LETTERS SHALL BE FLUSH WITH THE FINISHED SURFACE OF THE COVER.
3. FOUNDRY IDENTIFYING MARK, HEAT AND DATE SHALL BE CAST ON THE BOTTOM OF THE COVER AND ON THE INSIDE OF THE FRAME.
4. IMPORTED COVERS AND FRAMES SHALL HAVE THE COUNTRY OF ORIGIN MARKING IN COMPLIANCE WITH FEDERAL REGULATIONS.
5. WEIGHT OF FRAME SHALL BE 280 LBS (127 kg). WEIGHT OF COVER SHALL BE 230 LBS (104 kg). ACTUAL WEIGHTS SHALL BE WITHIN A RANGE OF 95% TO 110%.
6. THE MANHOLE FRAME AND COVER SHALL BE INSPECTED BY THE ENGINEER PRIOR TO SHIPMENT TO THE JOBSITE. ACCEPTANCE WILL BE INDICATED BY THE AGENCY'S MARK.
7. THE PROOF-LOAD FOR TEST METHOD B OF SSPWC 206-3.2 IS 48,300 LBS (215 kN).
8. COVERS FOR MANHOLES LOCATED IN EASEMENTS, ALLEYS, PARKWAYS AND ALL PLACES OTHER THAN PAVED STREETS SHALL BE PROVIDED WITH SOCKET-SET SCREW LOCKING DEVICES. DRILL AND TAP TWO HOLES TO A DEPTH OF 1" (25 mm) AT 90 DEGREES TO PICK HOLE AND INSTALL 3/4" x 3/4" (20 x 20 mm) STAINLESS STEEL SOCKET-SET SCREWS WITH 3/8" (10 mm) RECESSED HEX HEAD. ALL THREADS SHALL BE N.C.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


27" (686 mm) MANHOLE FRAME AND COVER

631-3


SHEET 2 OF 2

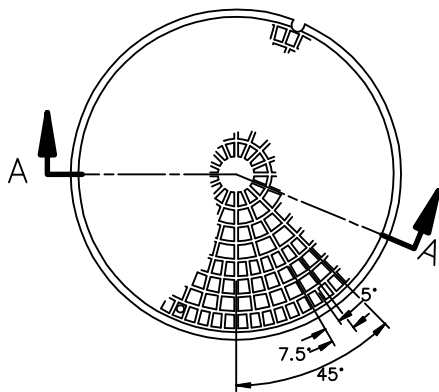


TOP OF COVER

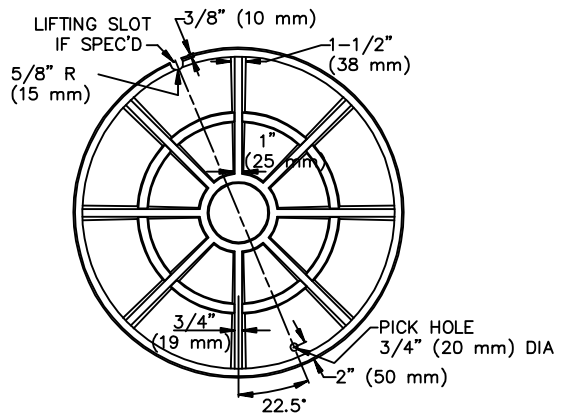


BOTTOM OF COVER

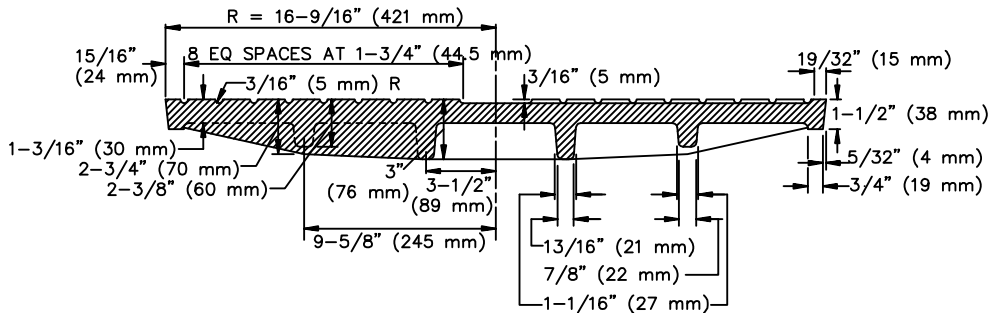

SECTION A-A

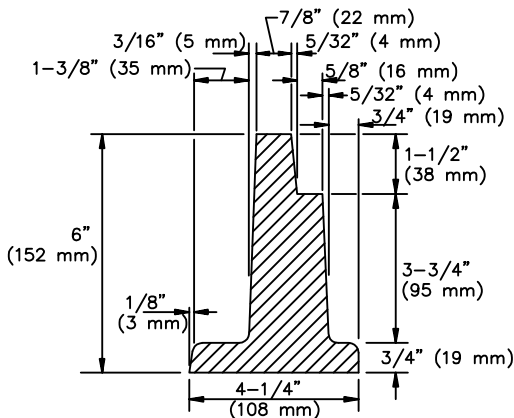

FRAME DETAIL

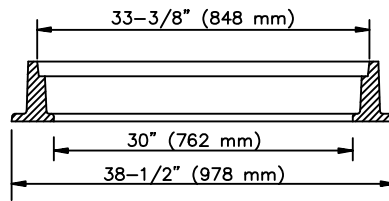

SECTION THRU FRAME

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1996, 2009

**30" (762 mm) MANHOLE FRAME
AND COVER**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

632-3

SHEET 1 OF 2

NOTES:

1. THE CAST IRON USED SHALL CONFORM TO ASTM A-48 CLASS 35B.
2. COVERS SHALL BE CAST WITH THE LETTER "D" FOR STORM DRAINS AND "S" FOR SEWERS, AND THE AGENCY'S IDENTIFICATION IN ACCORDANCE WITH INSTRUCTIONS FURNISHED BY THE AGENCY. THE LETTER "D" OR "S" SHALL BE APPROXIMATELY 2-1/2" (65 mm) HIGH WITH 1/2" (15 mm) LINE WIDTH, AND PLACED IN THE CENTER OF THE COVER. ALL LETTERS SHALL BE FLUSH WITH THE FINISHED SURFACE OF THE COVER.
3. FOUNDRY IDENTIFYING MARK, HEAT AND DATE SHALL BE CAST ON THE BOTTOM OF THE COVER AND ON THE INSIDE OF THE FRAME.
4. IMPORTED COVERS AND FRAMES SHALL HAVE THE COUNTRY OF ORIGIN MARKING IN COMPLIANCE WITH FEDERAL REGULATIONS.
5. WEIGHT OF FRAME SHALL BE 320 LBS (145 kg). WEIGHT OF COVER SHALL BE 305 LBS (138 kg). ACTUAL WEIGHTS SHALL BE WITHIN A RANGE OF 95% TO 110%.
6. THE MANHOLE FRAME AND COVER SHALL BE INSPECTED BY THE ENGINEER PRIOR TO SHIPMENT TO THE JOBSITE. ACCEPTANCE WILL BE INDICATED BY THE AGENCY'S MARK.
7. THE PROOF-LOAD FOR TEST METHOD B OF SSPWC 206-3.2 IS 51,100 LBS (227 kN).
8. COVERS FOR MANHOLES LOCATED IN EASEMENTS, ALLEYS, PARKWAYS AND ALL PLACES OTHER THAN PAVED STREETS SHALL BE PROVIDED WITH SOCKET-SET SCREW LOCKING DEVICES. DRILL AND TAP TWO HOLES TO A DEPTH OF 1" (25 mm) AT 90 DEGREES TO PICK HOLE AND INSTALL 3/4" x 3/4" (20 x 20 mm) STAINLESS STEEL SOCKET-SET SCREWS WITH 3/8" (10 mm) RECESSED HEX HEAD. ALL THREADS SHALL BE N.C.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN


30" (762 mm) MANHOLE FRAME AND COVER

632-3


SHEET 2 OF 2

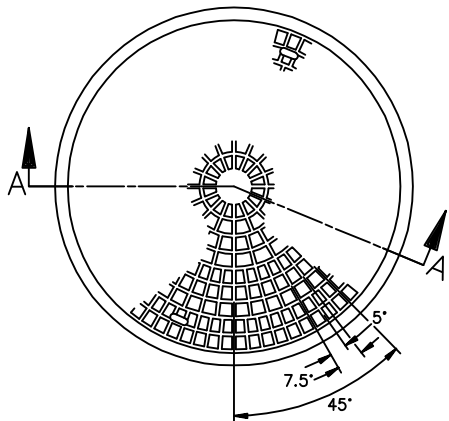


TOP OF COVER

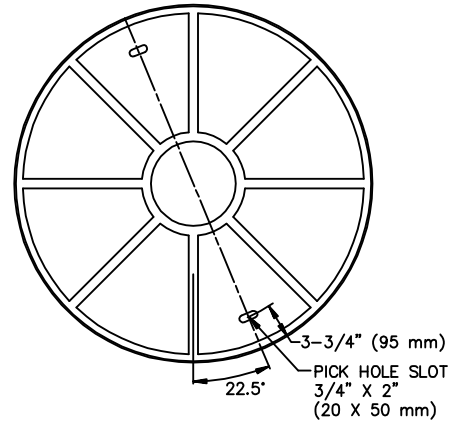


BOTTOM OF COVER

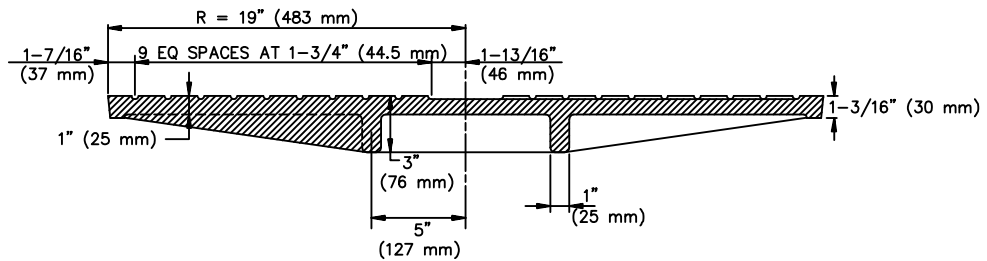

SECTION A-A

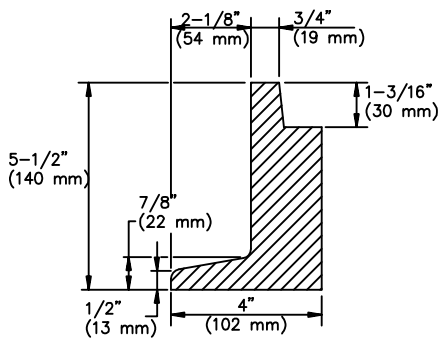

FRAME DETAIL

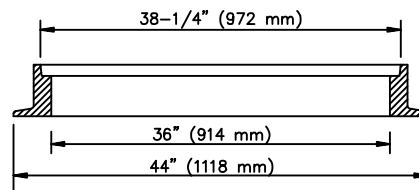

SECTION THRU FRAME

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1984
REV. 1992, 1996, 2009

**36" (914 mm) MANHOLE FRAME
AND COVER**

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

633-3

SHEET 1 OF 2

NOTES:

1. THE CAST IRON USED SHALL CONFORM TO ASTM A-48 CLASS 35B.
2. COVERS SHALL BE CAST WITH THE LETTER "D" FOR STORM DRAINS AND "S" FOR SEWERS, AND THE AGENCY'S IDENTIFICATION IN ACCORDANCE WITH INSTRUCTIONS FURNISHED BY THE AGENCY. THE LETTER "D" OR "S" SHALL BE APPROXIMATELY 2-1/2" (65 mm) HIGH WITH 1/2" (15 mm) LINE WIDTH, AND PLACED IN THE CENTER OF THE COVER. ALL LETTERS SHALL BE FLUSH WITH THE FINISHED SURFACE OF THE COVER.
3. FOUNDRY IDENTIFYING MARK, HEAT AND DATE SHALL BE CAST ON THE BOTTOM OF THE COVER AND ON THE INSIDE OF THE FRAME.
4. IMPORTED COVERS AND FRAMES SHALL HAVE THE COUNTRY OF ORIGIN MARKING IN COMPLIANCE WITH FEDERAL REGULATIONS.
5. WEIGHT OF FRAME SHALL BE 335 LBS (152 kg). WEIGHT OF COVER SHALL BE 340 LBS (154 kg). ACTUAL WEIGHTS SHALL BE WITHIN A RANGE OF 95% TO 110%.
6. THE MANHOLE FRAME AND COVER SHALL BE INSPECTED BY THE ENGINEER PRIOR TO SHIPMENT TO THE JOBSITE. ACCEPTANCE WILL BE INDICATED BY THE AGENCY'S MARK.
7. THE PROOF-LOAD FOR TEST METHOD B OF SSPWC 206-3.2 IS 41,300 LBS (183 kN).
8. COVERS FOR MANHOLES LOCATED IN EASEMENTS, ALLEYS, PARKWAYS AND ALL PLACES OTHER THAN PAVED STREETS SHALL BE PROVIDED WITH SOCKET-SET SCREW LOCKING DEVICES. DRILL AND TAP TWO HOLES TO A DEPTH OF 1" (25 mm) AT 90 DEGREES TO PICK HOLE AND INSTALL 3/4" x 3/4" (20 x 20 mm) STAINLESS STEEL SOCKET-SET SCREWS WITH 3/8" (10 mm) RECESSED HEX HEAD. ALL THREADS SHALL BE N.C.




STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

**36" (914 mm) MANHOLE FRAME
AND COVER**


STANDARD PLAN

633-3

SHEET 2 OF 2

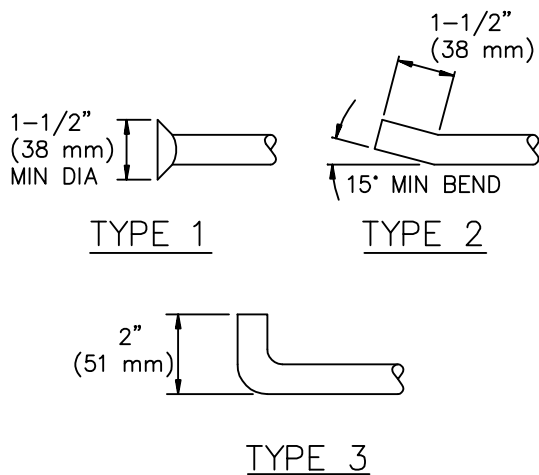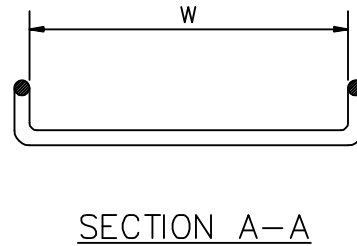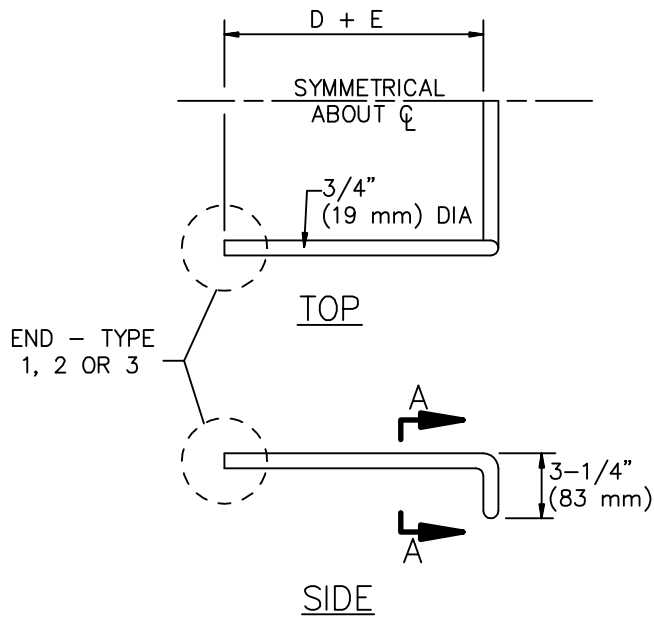

END DETAILS - SIDE VIEW

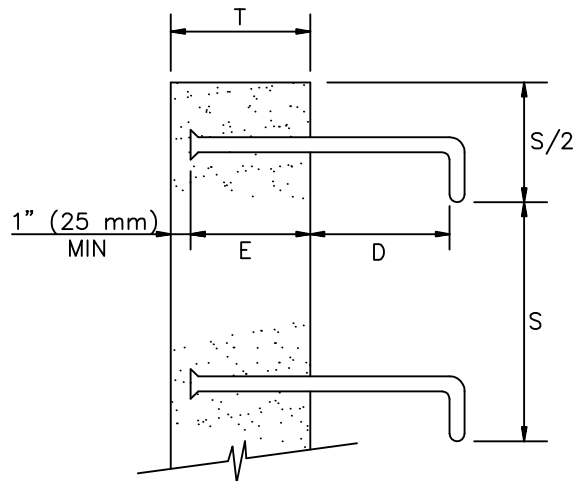

INSTALLATION DETAIL

UNLESS OTHERWISE NOTED:

D = 7" (175 mm)
 E = 6" (150 mm) OR T - 1" (25 mm), WHICHEVER IS LESS
 MINIMUM E IS 3" (75 mm)
 S = 12" (300 mm) MAX, EVENLY SPACED
 W = 16" (400 mm) MIN

FOR MANHOLES AND UNDERGROUND VAULTS:
 S = 16" (400 mm) MAX, EVENLY SPACED
 W = 14" (350 mm) MIN

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
 PUBLIC WORKS STANDARDS INC.
 GREENBOOK COMMITTEE
 1984
 REV. 1992, 1996, 2009

STEEL STEP

STANDARD PLAN

635-3

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

SHEET 1 OF 2

NOTES:

1. STEPS SHALL BE STEEL CONFORMING TO ASTM A307 AND SHALL BE GALVANIZED AFTER FABRICATION. UNLESS OTHERWISE NOTED, STEPS MAY ALSO BE POLYPROPYLENE STEPS, STEEL REINFORCED, CONFORMING TO SPPWC 636.
2. IF STAINLESS STEEL STEPS ARE REQUIRED, THE MATERIAL SHALL CONFORM TO ASTM A276, 300 SERIES.
3. STEP ENDS MAY BE TYPE 1, 2 OR 3, AS SHOWN.
4. BOTTOM STEP SHALL BE A MAXIMUM OF 2' (600 mm) ABOVE FLOOR OR SHELF.
5. STEPS WITH TYPE 1 OR 2 ENDS MAY BE CAST IN PLACE, OR PLACED IN THE CENTER OF 1-1/2" (40 mm) MIN DIA DRILLED OR FORMED HOLES AND SET WITH HIGH STRENGTH NON-SHRINK GROUT, 6000 PSI (40 MPa) MIN. STEPS WITH TYPE 3 ENDS SHALL BE CAST-IN-PLACE.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

STEEL STEP


STANDARD PLAN

635-3


SHEET 2 OF 2

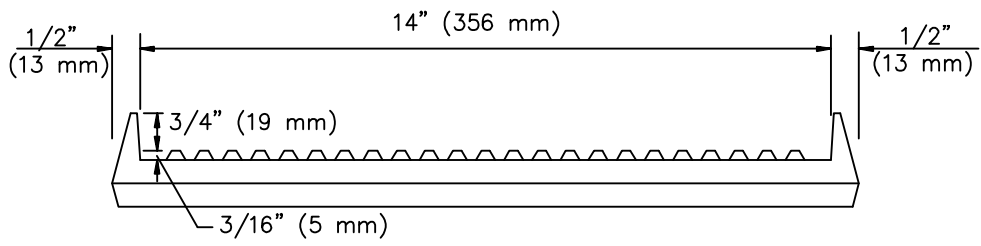


FRONT

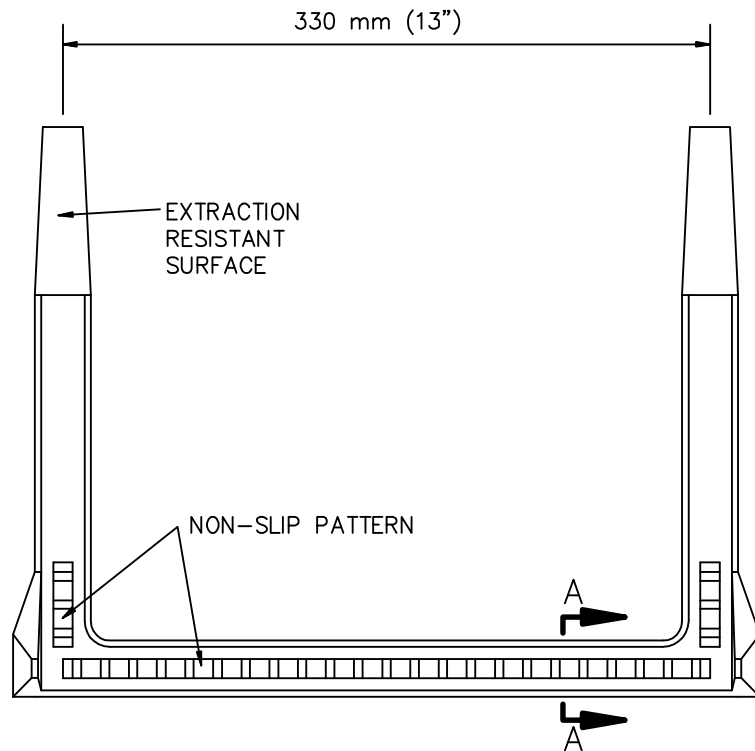

TOP

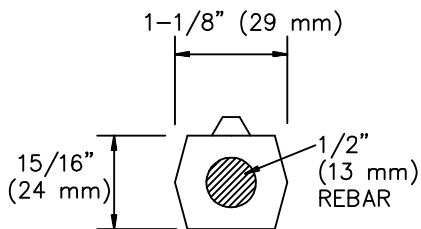

SECTION A-A

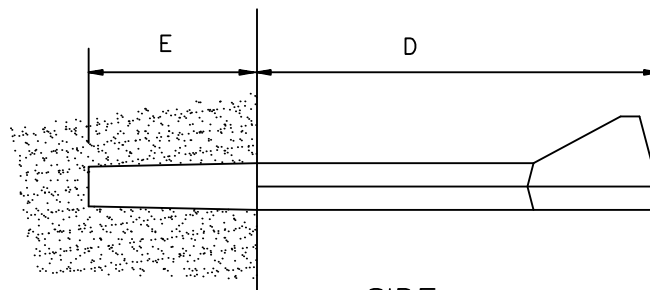

SIDE

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1991
REV. 1996, 2009

POLYPROPYLENE-PLASTIC STEP

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

636-2

SHEET 1 OF 2

NOTES:

1. STEPS SHALL BE STEEL-REINFORCED COPOLYMER POLYPROPYLENE PLASTIC CONFORMING TO:
 - (A) ASTM D478 AND C497, EXCEPT THAT THE MINIMUM HORIZONTAL PULLOUT LOAD SHALL BE 1,500 LBS (6.7 kN).
 - (B) ASTM A615 GRADE 60 DEFORMED REINFORCING STEEL BAR.
 - (C) CALIFORNIA CODE OF REGULATIONS TITLE 8, GENERAL INDUSTRY SAFETY ORDERS.
2. STEPS SHALL BE CAPABLE OF WITHSTANDING AN IMPACT LOAD OF 70 FT-LBS (95 N.m) AT 20°F (-7°C) WITHOUT CRACKING OR FRACTURING.
3. THE MINIMUM TOTAL CROSS-SECTIONAL AREA OF THE EXPOSED PORTION OF THE STEP, INCLUDING THE DEFORMED STEEL BAR AND EXCLUDING THE NON-SLIP TREAD SURFACE, SHALL BE 1.0 SQ IN (645 mm²).
4. THE ENTIRE POLYPROPYLENE PLASTIC MATERIAL SURROUNDING THE REINFORCING STEEL BAR SHALL BE CAST MONOLITHICALLY. MINIMUM COVER SHALL BE 3/16" (5 mm).
5. A CERTIFICATION OF COMPLIANCE WITH THE REQUIREMENTS OF NOTES 1 THROUGH 4 PREPARED BY AN INDEPENDENT CERTIFIED LABORATORY SHALL BE SUBMITTED TO THE ENGINEER CONCURRENTLY WITH A REQUEST FOR APPROVAL.
6. E = 3-3/8" (86 mm). FOR VAULTS AND MANHOLES, D = 5-1/2" (140 mm). FOR OTHER INSTALLATIONS, D = 7-1/2" (190 mm). THESE DIMENSIONS MAY BE PLUS OR MINUS 1/4" (6 mm).
7. STEPS SHALL BE EVENLY SPACED. MAXIMUM VERTICAL SPACING OF STEPS SHALL BE 16" (400 mm), WITH THE BOTTOM STEP A MAXIMUM OF 2' (600 mm) ABOVE FLOOR OR SHELF.
8. IF TAPERED STEPS ARE INSTALLED INTO STRAIGHT DRILLED OR FORMED HOLES, APPROVED NON-SHRINK GROUT SHALL BE INJECTED INTO THE HOLE PRIOR TO INSTALLATION. HOLES SHALL BE STRAIGHT AND PARALLEL. EXCEPT AS OTHERWISE NOTED, STEPS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDED PROCEDURES.
9. A DROP STEP WITH A MINIMUM DROP OF 3/4" (19 mm) MAY BE USED. THE DROP STEP SHALL MEET ALL OTHER CRITERIA OF THIS PLAN.


STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

POLYPROPYLENE-PLASTIC STEP



STANDARD PLAN

636-2

SHEET 2 OF 2

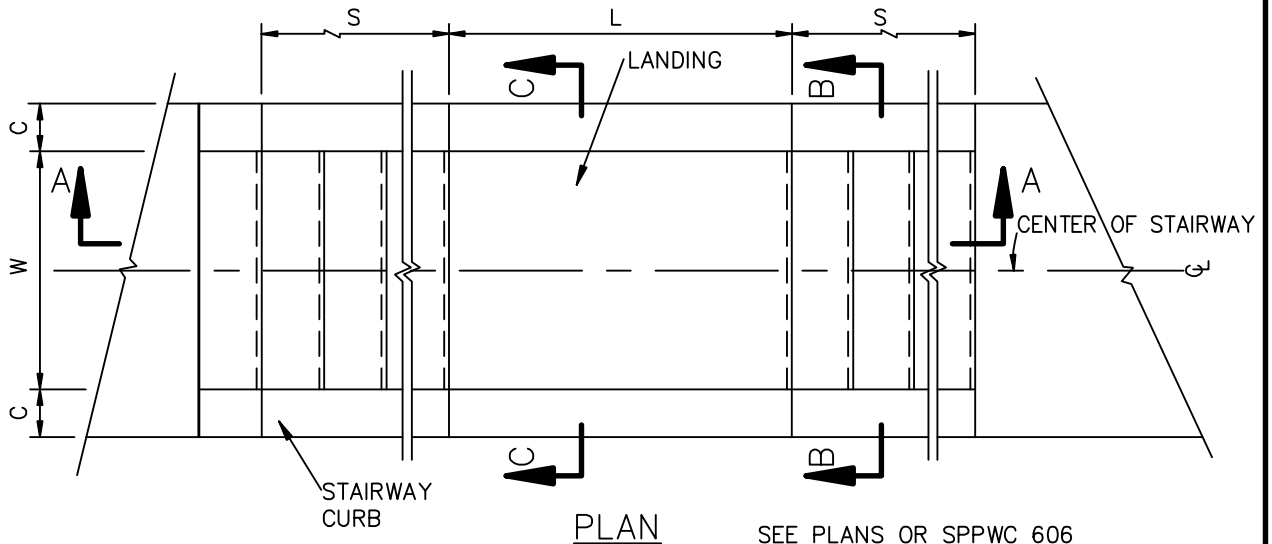

SEE PLANS OR SPPWC 606 FOR HANDRAIL DETAILS.

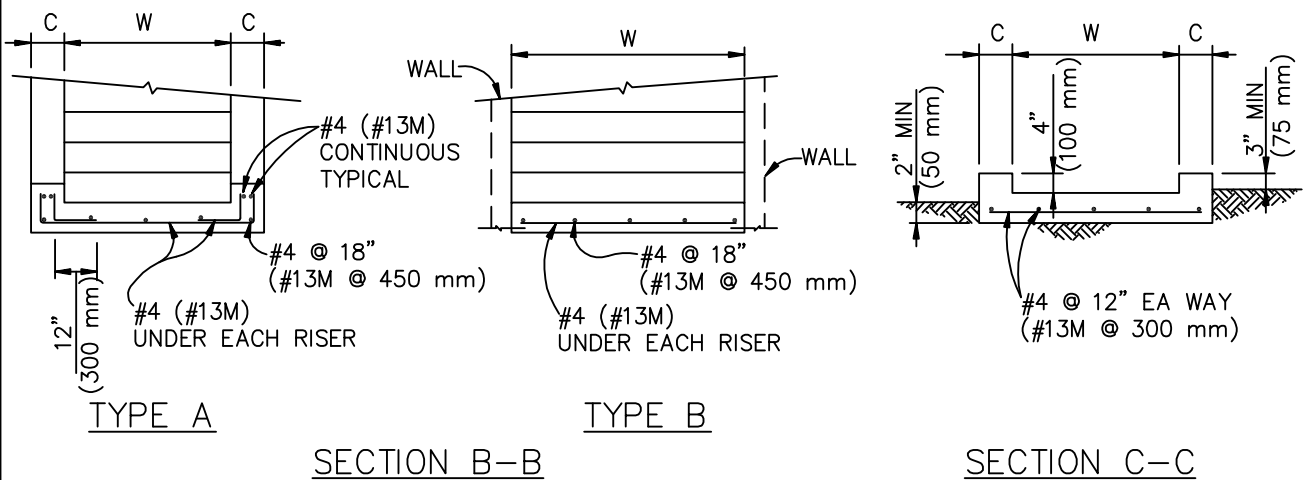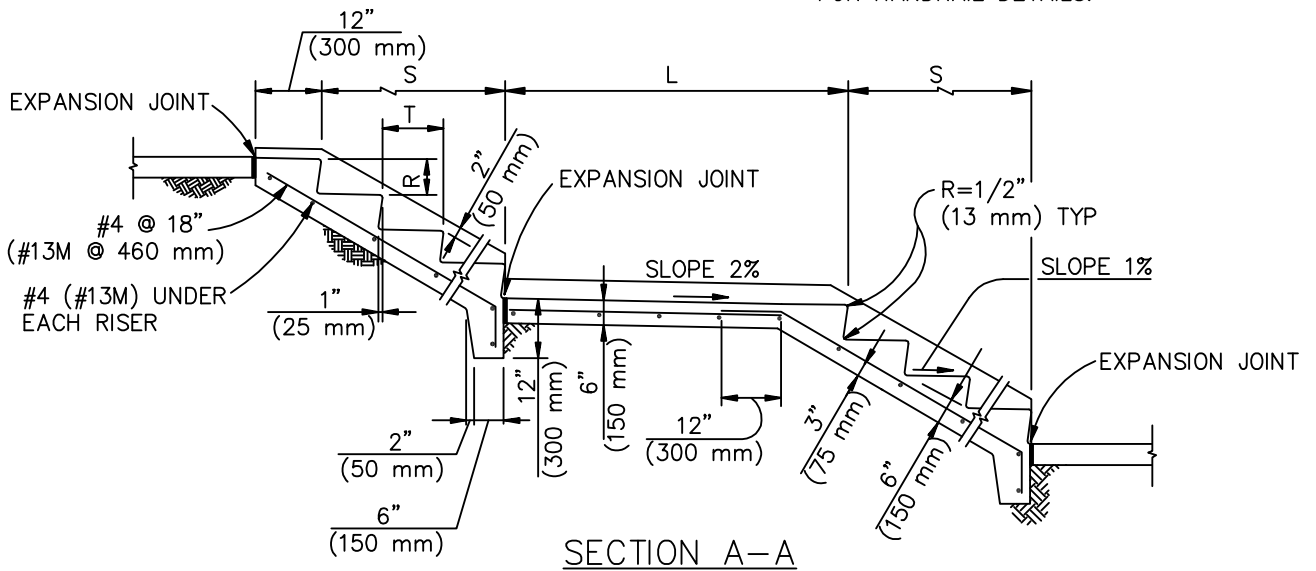

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

PROMULGATED BY THE
PUBLIC WORKS STANDARDS INC.
GREENBOOK COMMITTEE
1993
REV. 1996, 2005, 2009

REINFORCED CONCRETE STAIRWAY

USE WITH STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION

STANDARD PLAN

640-3

SHEET 1 OF 2

NOTES:

1. SEE THE PLANS FOR THE FOLLOWING INFORMATION:
TYPE OF STAIRWAY AND LOCATION
W = WIDTH OF STAIRWAY
L = LENGTH OF LANDINGS
T = LENGTH OF TREAD
R = HEIGHT OF RISER
C = WIDTH OF CURB
S = LENGTH OF STAIRWAY FLIGHT
2. CONCRETE FINISH FOR EXPOSED SURFACES SHALL BE CLASS I, EXCEPT THAT TREADS AND LANDINGS SHALL BE TROWELLED SMOOTH AND GIVEN A FINE BROOM FINISH IN A DIRECTION PERPENDICULAR TO THE CENTERLINE OF THE STAIRWAY. THE BROOM FINISH SHALL BE BROUGHT TO THE NOSE OF THE TREADS AND LANDINGS.
3. ONE HANDRAIL IS REQUIRED FOR STAIRWAYS 4' (1.22 m) WIDE OR LESS. TWO HANDRAILS ARE REQUIRED FOR WIDER STAIRWAYS.

STANDARD PLANS FOR PUBLIC WORKS CONSTRUCTION

REINFORCED CONCRETE STAIRWAY

STANDARD PLAN

640-3

SHEET 2 OF 2