



NOTES:

1. Gutter depression, curb transition and structure's top slab shall be poured monolithic.
2. Surface finish of the gutter depression shall be light broom finish.
3. Concrete strength and curing compound per Detail 2-002.1.
4. Gutter depression shall be 3 inches.
5. Deep joint shall be 2" deep.

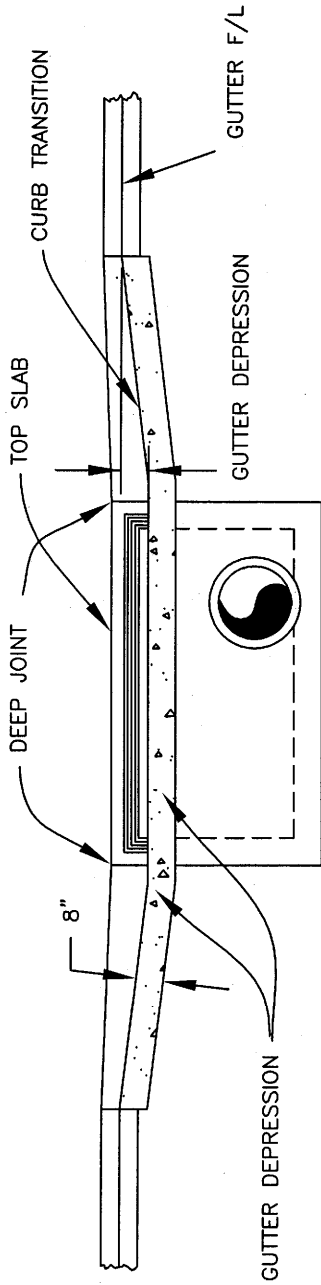

SECTION AT GUTTER F/L

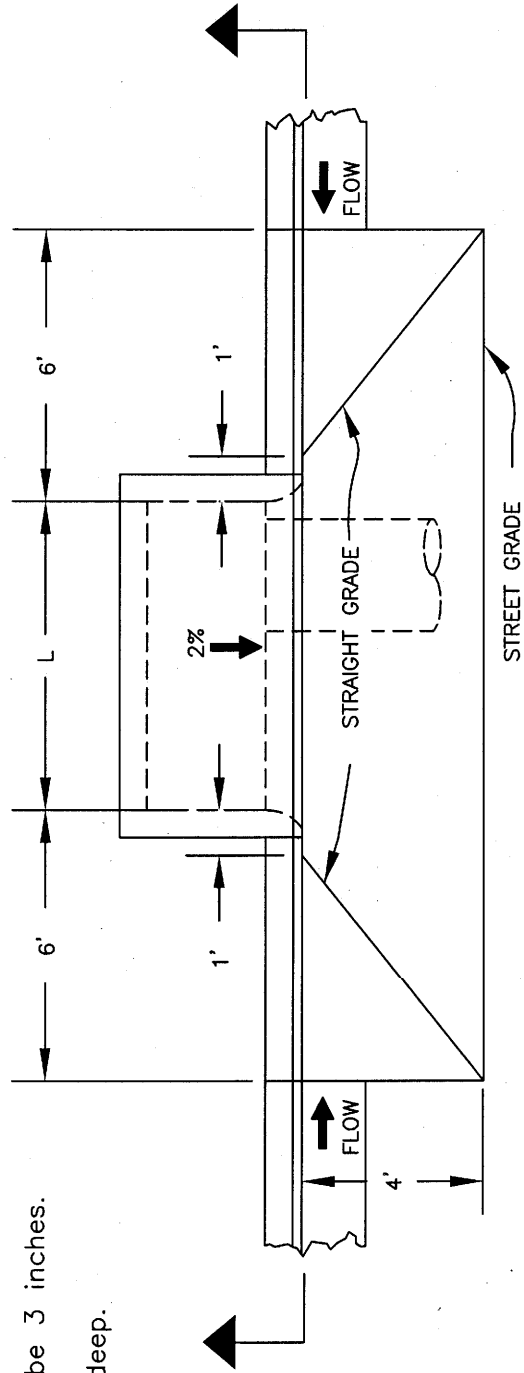

PLAN - INLET IN SAG

REVISED	DATE	APPROVED	STANDARD DETAIL
		<i>Anthony J. D'Amico</i>	CITY OF SANTA BARBARA - PUBLIC WORKS DEPARTMENT
			GUTTER DEPRESSION - TYPE A1
			2-004.1-06

APPROVED: *Anthony J. D'Amico* 1/31/07
 PUBLIC WORKS DIRECTOR DATE