


PLAN


The upper portions of incoming and outgoing sewers shall be removed and the broken edges shall be plastered smooth with cement mortar.

Transition between inverts shall be a smooth warped surface.

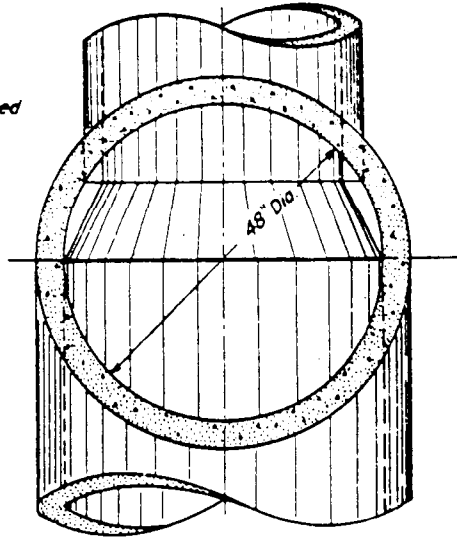

SECTION

NOTE: P.C.C. slab not to be poured until paving is in place.

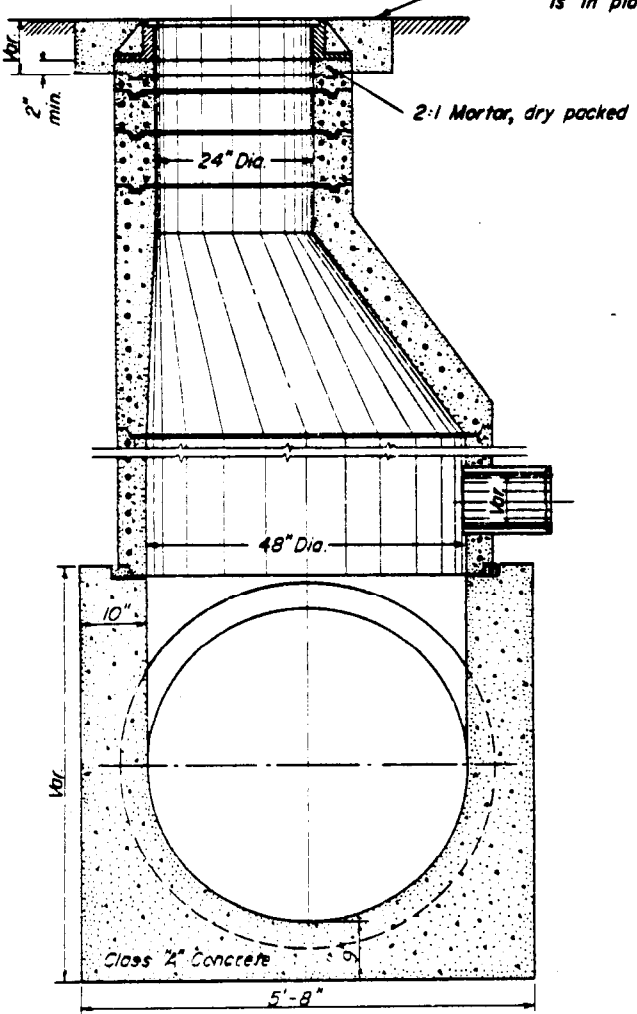

SECTION

GENERAL NOTES:

All work shall conform to the applicable sections of the specifications entitled "Standard Specifications, State of California, Department of Transportation", current edition.

Mortar shall consist of one part portland cement to two parts of clean, well graded sand.

Joints shall be filled with mortar and neatly raked or wiped on inside of pipe.

Precast reinforced manhole sections shall be constructed in accordance with the provisions of ASTM C-478, current edition.

REVISED JUL '89

| | | |
|--|---|-------------------|
| APPROVED BY THE CITY COUNCIL <i>[Signature]</i> 11-65 | STANDARD MANHOLE TYPE "B" | DATE 11-12-54 |
| <i>[Signature]</i> CITY CLERK | | DRAWN T.J.M. |
| APPROVED <i>H.E. Bergeron</i> CITY ENGINEER | CITY OF BAKERSFIELD CALIFORNIA ENGINEERING DEPARTMENT | CHECKED J.D.H. |
| | | SCALER None |
| | | S-21 |