


NOTES:

1. Class 560-C-3250 Concrete to be used.
2. Pipe size and inlet and outlet flow line elevations to be shown on improvement plans.
3. When pipe sizes greater than 18" are used a larger frame and cover may be required by the City Engineer
4. V is a maximum of 4' For depths greater than 4' or for a vehicular traffic situation use Std. Dwg. 430 or 431.
5. Bike proof grating shall be used instead of solid cover when shown on plans.

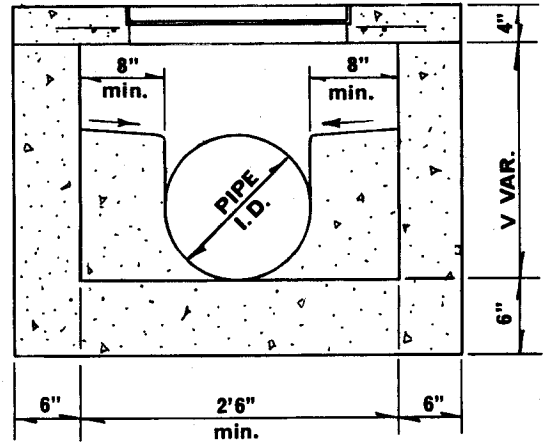

SECTION A - A

APPROVED <i>[Signature]</i> DATE <i>2-8-74</i>	
CITY PUBLIC WORKS DIRECTOR - R.C.E. 8134	
<i>[Symbol]</i> Changed 6" clearance to 3"	<i>[Signature]</i> 4/23/84
<i>[Symbol]</i> REMOVED LOCKING REQ.	<i>[Signature]</i> 4/29/84

CITY OF RIVERSIDE
PUBLIC WORKS DEPT. - ENGINEERING DIV.

CLEANOUT BOX

STANDARD DRAWING NO. **425**