



ADJUSTING SCREW DETAIL

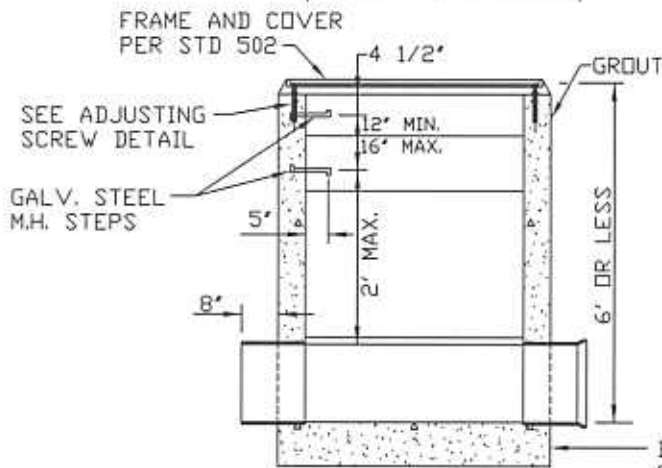


SECTION A-A

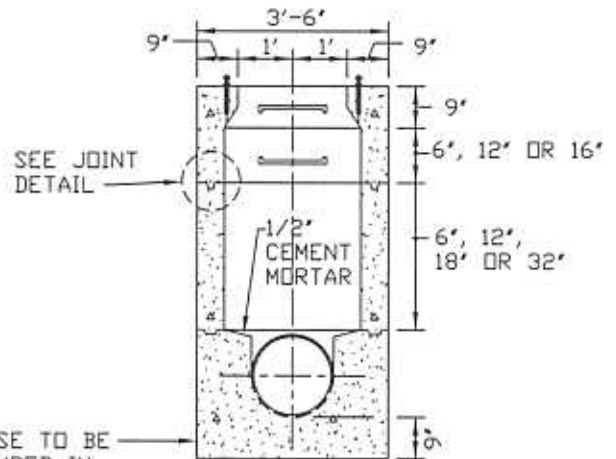

SECTION B-B


TYPE B

BASE AND CHANNELS POURED MONOLITHICAL

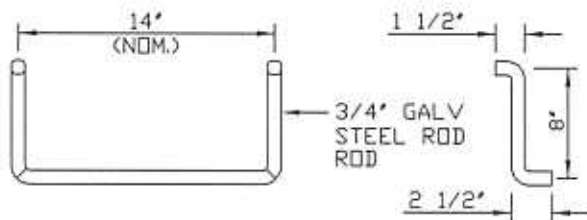

PRECAST OR GROUT STEPS INTO PLACE AT 16" D.C. AS SHOWN IN SECTIONAL ELEVATION.


DROP STEP DETAIL

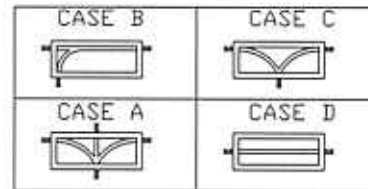

ALTERNATE PLACEMENT OF CHANNELS

NOTES:

1. CONCRETE FOR ALL PRECAST UNITS SHALL BE THOROUGHLY VIBRATED IN FORMS. IT SHALL BE CURED ACCORDING TO APPROVED PRACTICE EITHER BY STEAM, SPRINKLING, MEMBRANE SOLUTION, OR A COMBINATION OF THESE. IT SHALL DEVELOP 3000 PSI OR GREATER IN 28 DAYS.
2. ALL FIELD POURED CONCRETE TO BE CLASS 560-C-3250 AND ALLOWED TO SET 24 HOURS BEFORE PLACING PRECAST UNITS.
3. ALL PRECAST UNITS SHALL BE REINFORCED FOR H-20 BRIDGE LOADING.
4. TO BE USED FOR DEPTHS LESS THAN 5' FROM MANHOLE TOP TO SEWER PIPE SHELF.

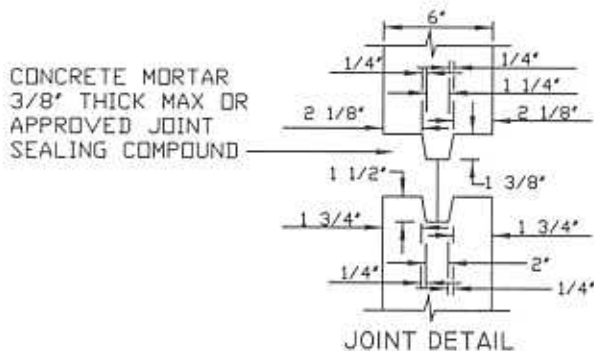

JOINT DETAIL

REVISIONS		APPROVED		CITY OF TEMECULA
DATE	INIT.	DATE		
12/1/06	R.M.	12/1/06	<i>Ronald J. Parks</i>	
			RONALD J. PARKS DEPUTY DIRECTOR, PUBLIC WORKS R.C.E. NO. 19744 EXP. 9-30-07	STANDARD NO. 501