
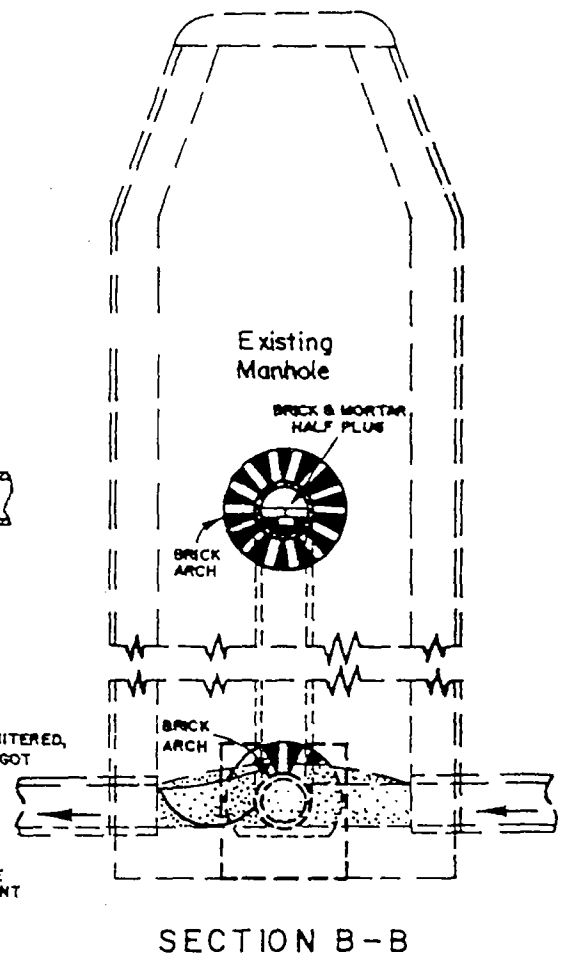


NOES:

- 1 - CLASS "B" CONCRETE TO BE USED (5.0 SACK)
- 2 - PIPE AND FITTINGS TO BE 8" MIN. INSIDE DIAMETER.
- 3 - IF NO STUBS EXIST, THE MANHOLE IS TO BE BROKEN THROUGH AND STUBS ARE TO BE SET TO GRADE IN CONCRETE OR MASONRY.
- 4 - TURN A BRICK ARCH AROUND EVERY PIPE OPENING INTO MANHOLE.
- 5 - CROWN OF INLET TO BE 0.10 FT. HIGHER THAN CROWN OF STRAIGHT-THRU SEWER UNLESS OTHERWISE NOTED. CONCRETE FORMED INVERT TO BE SHAPED THRU EXISTING SHELF IN A SMOOTH CURVE TO MEET EXISTING STRAIGHT-THRU INVERT.
- 6 - ALL BRICK IS TO BE WHOLE, SOUND, AND HARD BURNED AND MUST OTHERWISE CONFORM TO SUCH SPECIFICATIONS AS INDICATED BY THE CITY ENGINEER.
- 7 - 3.0' DESIRABLE MINIMUM VERTICAL DROP (NO VERTICAL JOINT ENCASMENT).  
1.82' ABSOLUTE MINIMUM VERTICAL JOINTS TO BE ENCASED BETWEEN 1.82' & 3.0'.

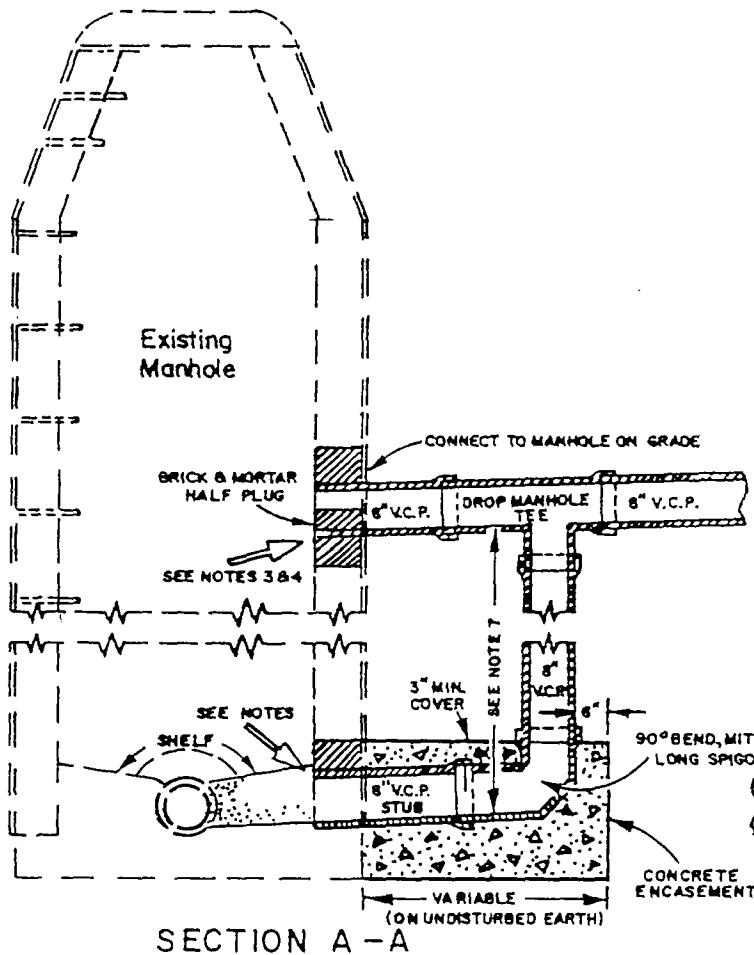

CITY OF COLTON PUBLIC WORKS DEPT.		
DROP ONLY TO EXISTING MANHOLE		
DRAWN BY: TIBOR F.	SCALE: 1" = 3' - 0"	DRAWING NO.
CHK'D: <i>DAS</i>	DATE: OCTOBER 1963	304
APP'D: <i>L. Glenn Wilson</i>		