


SECTION A-A

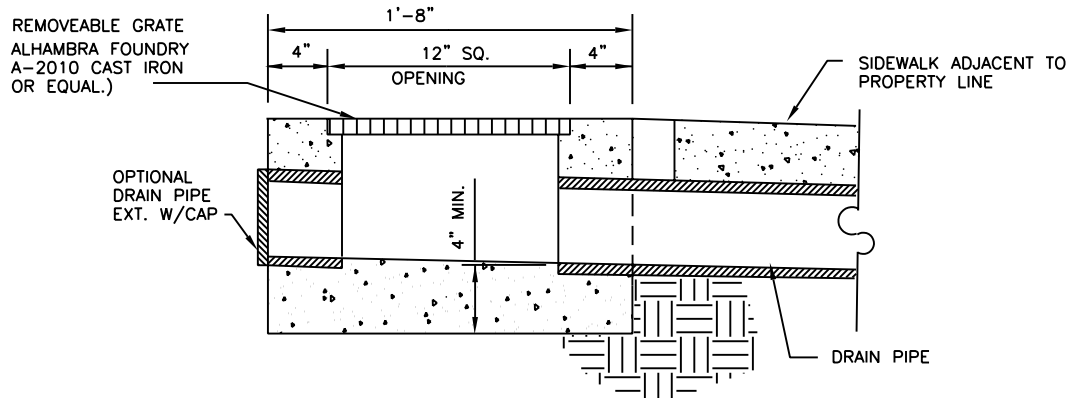

DROP INLET DETAIL

NOTES:

1. THIS STANDARD SHALL BE USED WHERE CURB & SIDEWALK ARE EXISTING.
2. CURB DRAIN SHALL BE CONSTRUCTED BY BORING THRU CURB FACE.
3. DRAIN PIPE SHALL BE CIRCULAR ASBESTOS CEMENT OR RIGID PLASTIC, WITH AN INSIDE DIAMETER OF 3 INCHES FOR 6 INCH CURB FACE & 4 INCHES FOR 8 INCH CURB FACE.
4. DROP INLET MAY BE AN APPROVED PREFABRICATED DESIGN OR CONSTRUCTED ON-SITE. A TEE OR ELBOW, WITH A REMOVEABLE GRATE-TYPE CAP, ENCASED IN CONCRETE, IS AN ACCEPTABLE ALTERNATE.

REVISIONS	CITY OF IRVINE	STANDARD PLAN No.
	UNDER SIDEWALK DRAIN - EXIST.'G CONST.	305A
	Approved by: Mark L. Carroll R.C.E. 31515 City Engineer	Date: 11-12-98
		Sheet 1 of 1