



PLAN

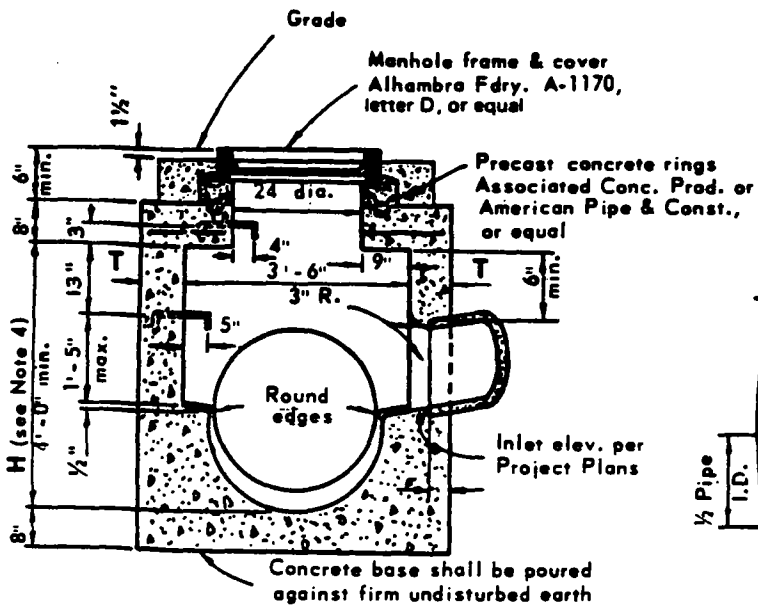

SECTION A-A

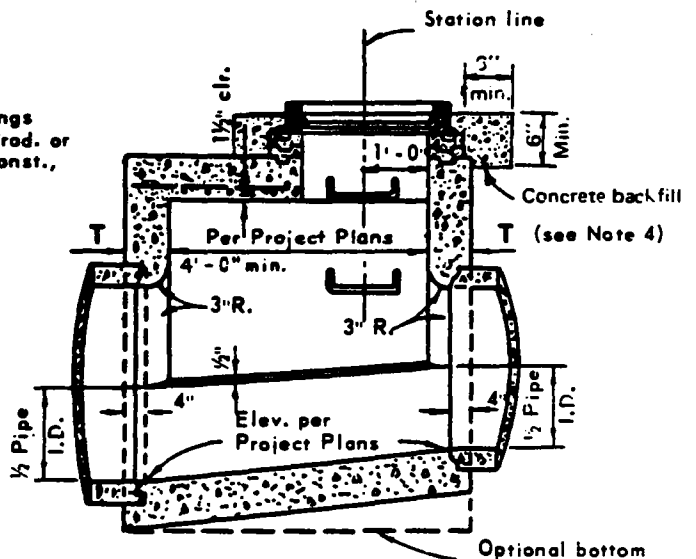

SECTION B-B

NOTES

1. Concrete shall be Class 560-C-3250 with a maximum slump of 5".
2. Floor of manhole shall be steel-trowelled.
3. Precast concrete rings shall be seated in mortar with inside joints neatly struck and pointed and not exceeding 3/8" in thickness.
4. Thickness T shall be 8" for H up to and including 8 ft. and shall be 10" for values of H over 8 ft.
5. Steps shall be 3/4" Ø galv. steel as Alhambra Fdry. A-3320, or equal.

C	3-11-83	Rev.
B	6-16-78	Rev.
A	8-26-76	Rev.
Revised		By

**CITY OF ANAHEIM**  
 DEPARTMENT OF PUBLIC WORKS  
 ENGINEERING DIVISION

MANHOLE NO. 1A  
 33" or smaller pipe

APP *Shanton Pierce* 2/16/67  
 Director of Public Works Date

APP *James P. Maddal* 2-16-67  
 City Engineer Date

STANDARD  
 DETAIL NO. 310-C