


NOTES:

- FLOOR OF BOX TO BE TROWELED SMOOTH.
- WHEN TOE OF SLOPE IS WITHIN THE R/W, INLET TYPE I BEGINS AT THE TOE, RATHER THAN AT THE R/W LINE.
- FOR OPEN DITCH APPROACH (TYPE II) THE 2' OR MORE IS FROM THE R/W LINE.
- TOP OF INLET STRUCTURE (TYPE I OR II) TO BE FLUSH WITH ADJACENT SIDEWALK WHERE PRACTICAL.
- A HEADED STEEL STUD 5/8" X 6 3/8" WITH HEAD 0.1" ATTACHED BY A FULL PENETRATION BUTT WELD MAY BE USED AS AN ALTERNATE ANCHOR.
- NORMAL CURB AT POINTS M AND O. B + 5" AT POINTS N AND P.
- THE 3" LEG OF THE INTERIOR ANCHORS SHALL BE PARALLEL TO THE TOP OF SIDEWALK.
- ALL METAL FORM STAKES MUST HAVE PROTECTIVE DEVICES SUCH AS "MUSHROOMS" INSTALLED AT ALL TIMES DURING USE, TO ADEQUATELY INSURE THE PUBLIC SAFETY.
- CONCRETE (SEE COB STD DWG. S-218 KEYNOTE 1).

S	B	GALVANIZED STEEL ANGLE	ANCHOR	J BARS		
				SIZE	SPACING	LENGTH
1'-0"	3"	2 1/2" X 2" X 3/8"	2	#3	7"	1'-9"
1'-6"	-	-	-	-	-	2'-3"
2'-0"	-	-	-	-	-	2'-9"
2'-6"	-	-	-	-	-	3'-3"
3'-0"	-	-	3	-	-	3'-9"
3'-6"	-	-	-	-	6"	4'-3"
4'-0"	-	-	-	-	5"	4'-9"
4'-6"	4"	3 1/2" X 3" X 1/2"	-	-	6 1/2"	5'-3"
5'-0"	-	-	-	-	5"	5'-9"
5'-6"	-	-	-	-	4"	6'-3"
6'-0"	-	-	-	-	3 1/2"	6'-9"

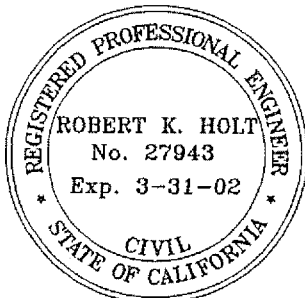

APPROVED: PUBLIC WORKS DIRECTOR

James W. Rodkey Jr. DATE 7/7/00
 JAMES W. RODKEY, JR.

APPROVED: CITY ENGINEER
Robert K. Holt DATE 8/31/00
 ROBERT K. HOLT, P.E.

CITY OF
BLYTHE

CURB OUTLET
 STRUCTURE