



2 1/2 X 1 1/2 X 1/4 GALVANIZED STEEL ANGLE




ANCHOR
DETAIL


NO. 5 DEFORMED BAR
3" LEG AT 90°

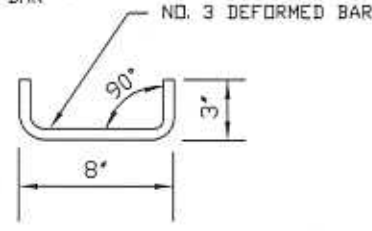


DOWEL
DETAIL

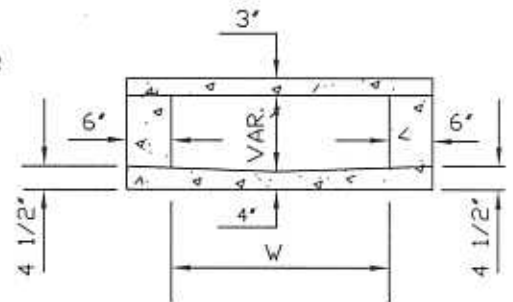

SECTION X-X

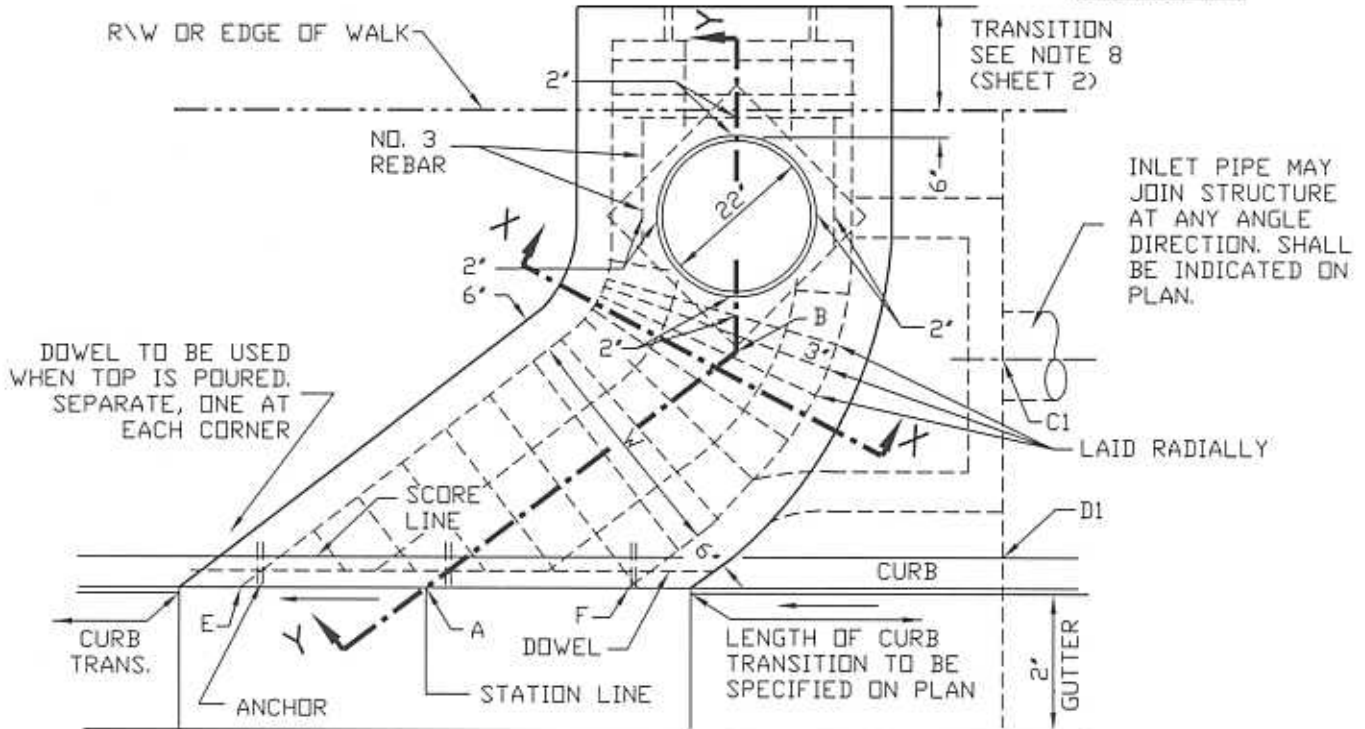

TOP VIEW

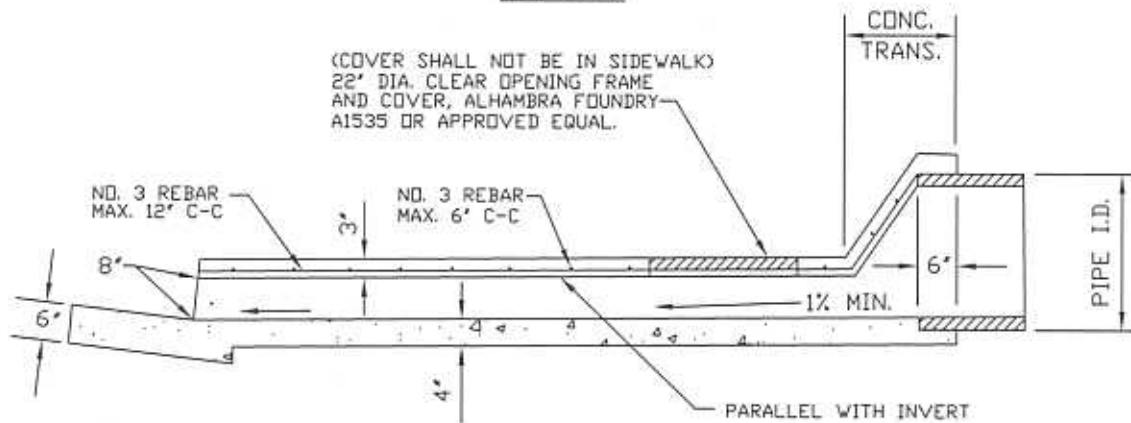

SECTION Y-Y

REVISIONS		APPROVED		CITY OF TEMECULA
DATE	INIT.	DATE		
12/1/06	R.M.	12/1/06	<i>Ronald J. Parks</i>	CURB OUTLET
			RONALD J. PARKS DEPUTY DIRECTOR, PUBLIC WORKS R.C.E. NO. 19744 EXP. 9-30-07	
				STANDARD NO. 301 (1 of 2)

CURB OUTLET NOTES:

1. CONCRETE SHALL BE CLASS 520-C-2500 WHEN STRUCTURE IS TO BE CONSTRUCTED WITHIN THE LIMITS OF A PROPOSED SIDEWALK OR IS CONTIGUOUS TO SUCH SIDEWALK. THE TOP OF THE STRUCTURE MAY BE POURED MONOLITHIC WITH THE SIDEWALK, USING THE SAME CLASS OF CONCRETE AS IN THE SIDEWALK.

2. DIMENSIONS SHALL BE AS FOLLOWS UNLESS OTHERWISE SPECIFIED ON THE PLAN:
 - A-B = 5'
 - C1-D1 = 3'
 - E-F = 5'
 - W = 3'

3. FLOOR OF STRUCTURE SHALL BE GIVEN A STEEL-TROWELED FINISH AND CONSTRUCTED ON A STRAIGHT GRADE FROM BACK OF STRUCTURE TO GUTTER FLOW-LINE AT POINT A. THE OUTLET TO A POINT 3' FROM THE GUTTER, FROM WHICH V-SECTION SPECIFIED FOR INVERT SHALL EXTEND FROM PIPE POINT THE INVERT SHALL BE WARPED TO JOIN THE GUTTER FLOW-LINE AT THE STRUCTURE.

4. REINFORCING STEEL BARS SHALL BE 1" FROM BOTTOM.

5. SURFACE OF ALL EXPOSED CONCRETE SHALL CONFORM TO EXISTING OR PROPOSED CURB AND WALK ADJACENT TO THE STRUCTURE.

6. CORRUGATED METAL FORMS SHALL NOT BE USED FOR SUPPORTING THE TOP SLAB.

7. TOP OF STRUCTURE SHALL SLOPE 2% TOWARD CURB EXCEPT WHEN OTHERWISE SHOWN ON PLAN OR TO FIT EXISTING SIDEWALK.

8. TRANSITION FROM PIPE TO STRUCTURE, IF REQUIRED, TO BE IN BACK OF SIDEWALK. DIMENSIONS OF TRANSITION SHALL BE SPECIFIED ON THE PLAN.

REVISIONS		APPROVED		CITY OF TEMECULA
DATE	INIT.	DATE	<i>12/1/06</i>	CURB OUTLET
12/1/06	R.M.		<i>Ronald J. Parks</i>	
		RONALD J. PARKS DEPUTY DIRECTOR, PUBLIC WORKS R.C.E. NO. 19744 EXP. 9-30-07		STANDARD NO. 301 (2 of 2)