


CAST IRON FRAME AND COVER:  
ALHAMBRA FOUNDRY NO. A-1240  
(O.A.E.), LETTERED "SEWER".

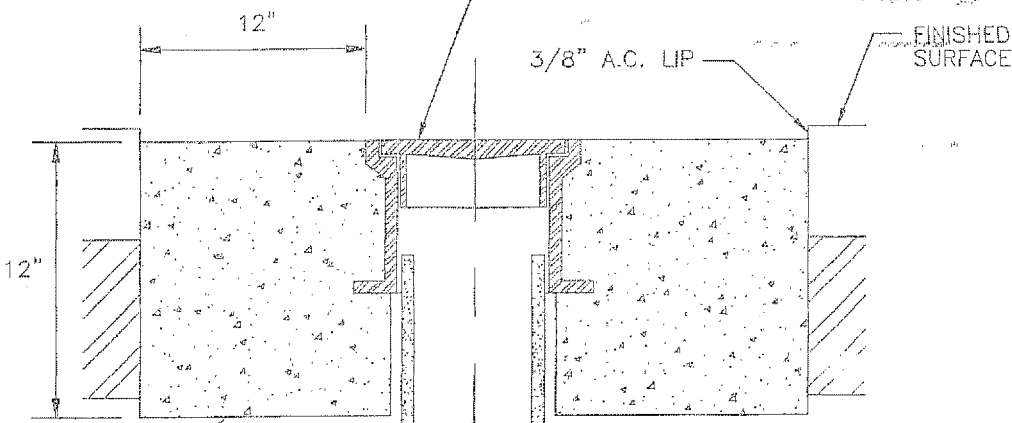

CONCRETE SHALL BE CLASS "3"  
CONCRETE WHICH SHALL ATTAIN  
A 28-DAY COMPRESSIVE  
STRENGTH OF 4000 PSI IN  
ACCORDANCE WITH ASTM  
C39/C39M-99 AND SHALL  
CONTAIN 1-1/2 LBS.  
POLYPROPYLENE FIBER PER  
CUBIC YARD. FIBER BY  
FIBERMESH CO., FORTA MONO,  
O.A.E.


6" DIA. PIPE

GASKETED STOPPED

D X 6" WYE FITTING

NOTES:

1. CLEANOUT RING AND COVER SHALL BE RAISED TO FINISHED GRADE AND SUPPORT COLLAR INSTALLED AFTER PAVING OR FINE GRADING.
2. D= DIAMETER OF MAIN LINE PIPE.



APPROVED: PUBLIC WORKS DIRECTOR  
*James W. Rodkey Jr.* DATE *7/7/00*  
JAMES W. RODKEY, JR.  
APPROVED: CITY ENGINEER  
*Robert K. Holt* DATE *8/1/00*  
ROBERT K. HOLT, P.E.

CITY OF  
**BLYTHE**

STANDARD CLEANOUT

STANDARD DRAWING NO. SS-406

REVISION	BY	DATE