


PROFILE

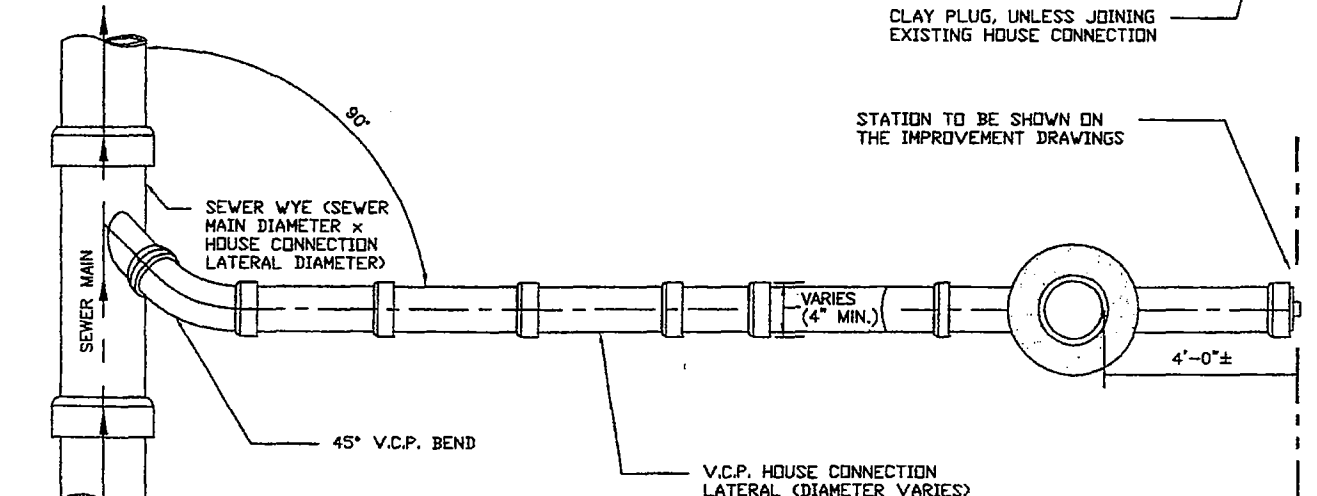

PLAN

- NOTES:
1. SEWER LATERALS FOR RESIDENTIAL USE SHALL BE 4" DIAMETER, MINIMUM.
  2. SEWER LATERALS FOR ALL OTHER USES SHALL BE 6" DIAMETER, MINIMUM.
  3. SEWER LATERAL CLEANDOUT DIAMETER SHALL MATCH LATERAL SIZE.

ITEM	No. REQ'D.	DESCRIPTION	APPROVED MATERIAL LIST NO.
1	1	CAST IRON CLEAN-OUT FRAME AND COVER. COVER SHALL BE MARKED "SEWER".	SD-06

APPROVED  
  
 OPERATIONS ENGINEER

DATE 11-15-07  
 RCE NO. 58514

DESERT WATER AGENCY  
 PALM SPRINGS, CALIFORNIA

SEWER LATERAL  
 (NEW MAIN)

REVISION	BY	DATE
SIDEWALK ADDED AND LATERAL SLOPE MADE CONSTANT	JDT	6/1/05
C.O. 0/S 4' FROM P.L.; LAT. EXTENDING TO P.L.	JDT	6/1/05

STANDARD DRAWING S107A